NOTES:

Figured dimensions only to be taken from this drawing. All dimensions to be checked on site. Department to be informed immediately of any discrepancies before work proceeds.

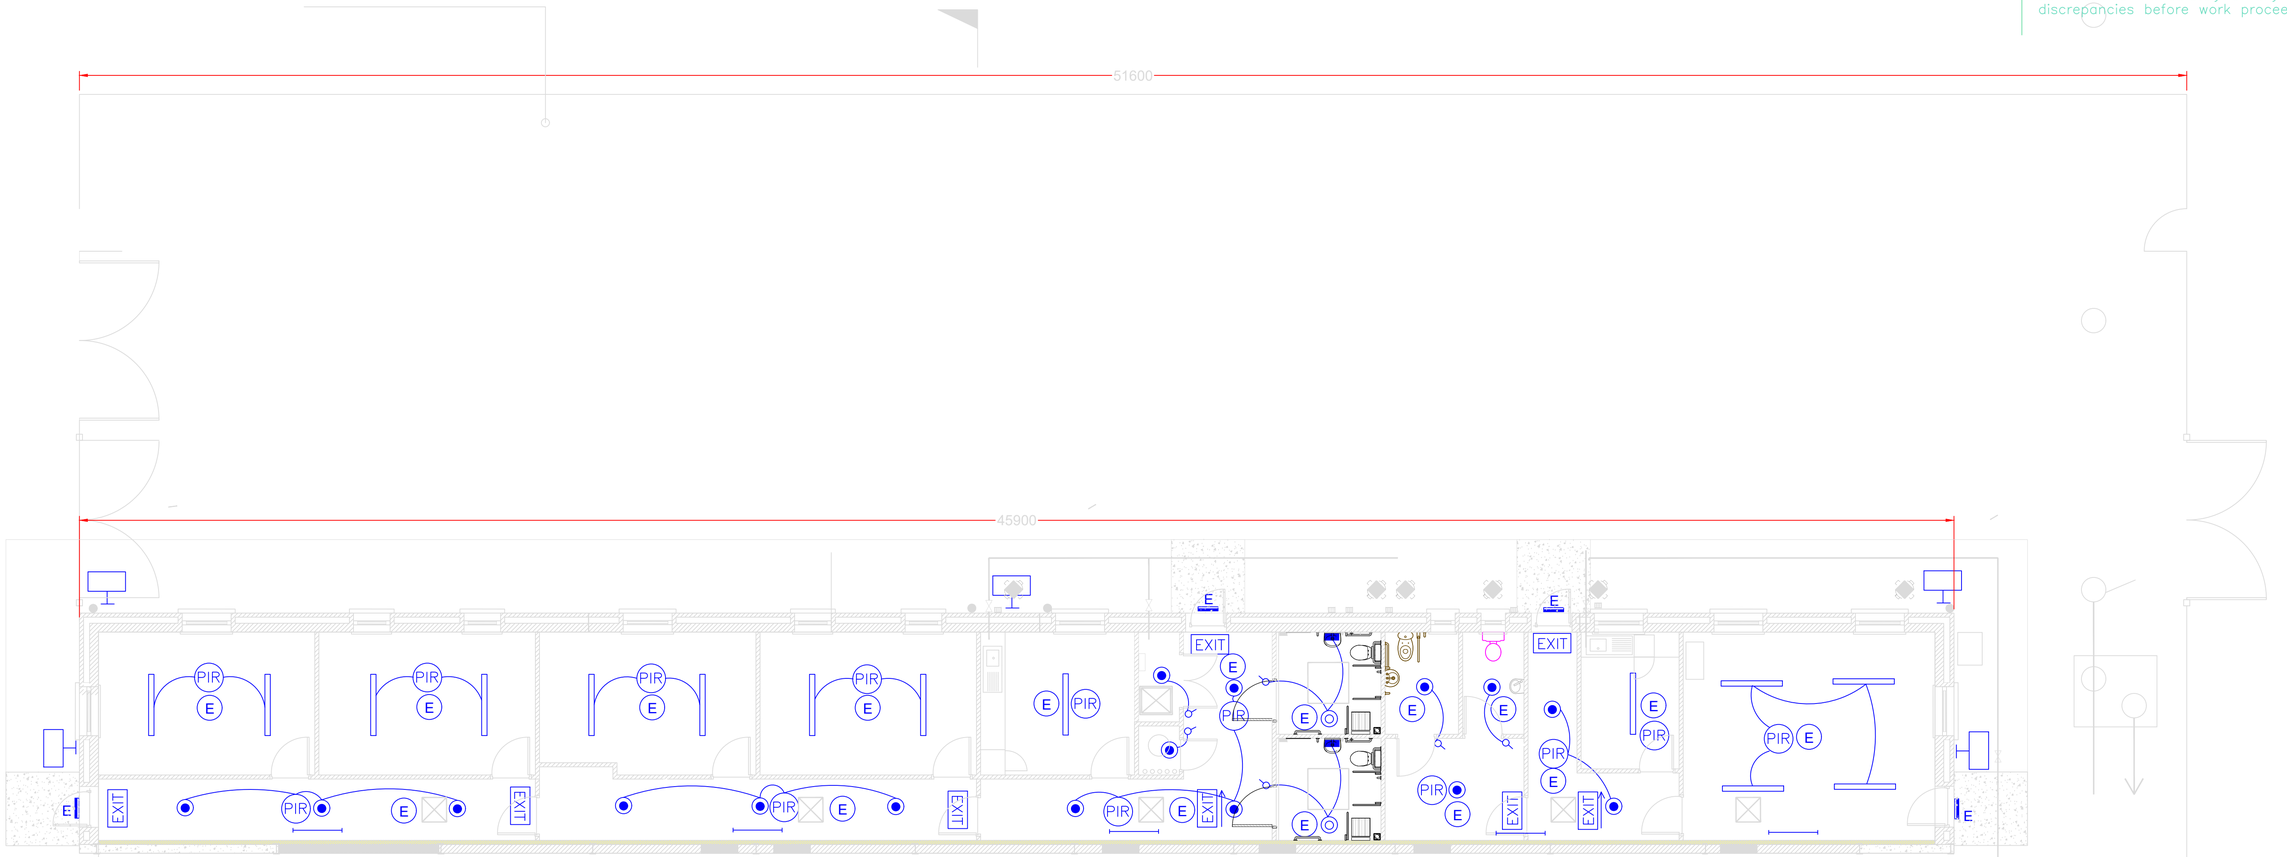

LEGEND

- Luminaire Type 1 as Prelux Campus 58W LED
- Luminaire Type 2 as Rexel 15W LED 2DW LED
- Luminaire Type 3 (Over-Mirror Type- Switched) DIVA 8W LED DUAL VOLTAGE SHAVER LIGHT
- Luminaire Type 4 Disano 1844 Globo 2.0 14w LED IP65
- EXIT Luminaire Type 5 Emergency Exit Sign as Ansell Watchman 3W NM LED
- E Luminaire type 6 Emergency Luminaire as Ansell Falcon 3W surface LED 3NM
- E Luminaire type 7 IP65 Emergency Luminaire as NVC Nebraska Lithium 2W 3NM
- Luminaire Type 8 (Flood Type) Photo-cell and Timeclock controlled 100W LED Floodlight Pole/Bracket Mounted 5m Mounting Height
- Luminaire Type 9 Corrosionproof NVC Cleveland Single LED 35W IP65 Located in Attic. Switched at Hatch.
- PIR PIR Lighting Presence Detector
- Switch mounted at 1350mm above FFL

Emergency Luminaires denoted by subscript 'E' to be fitted with inverter pack

Notes;
A sample of each type of light fitting to be provided to site for Architect/Engineer approval prior to placing of order.

Final locations of light fittings to be confirmed with Engineer/Architect

Emergency Lighting to be supplied , installed and commissioned to Irish Standard IS:3217

Emergency Lighting shall comprise self contained stand alone fittings with 3hr Battery and inverter.

PIR Motion Sensors to be adjustable for time duration and outside ambient lighting level

REV	DESCRIPTION	BY	DATE

job title

NEW BFW OFFICES
AT GORMANSTON CAMP
Co. MEATH

drg.title

PROPOSED SERVICES

ELECTRICAL LIGHTING LAYOUT

scale

1:75

drawn	checked	date
DDD	C.Carey	May.2026

PLANNING & DESIGN OFFICE
Infrastructure & Utilities,2 Engr. Group, Cathal Brugha Bks., Dublin 6.

drg.no.	rev
PDE-B14-85-402	