


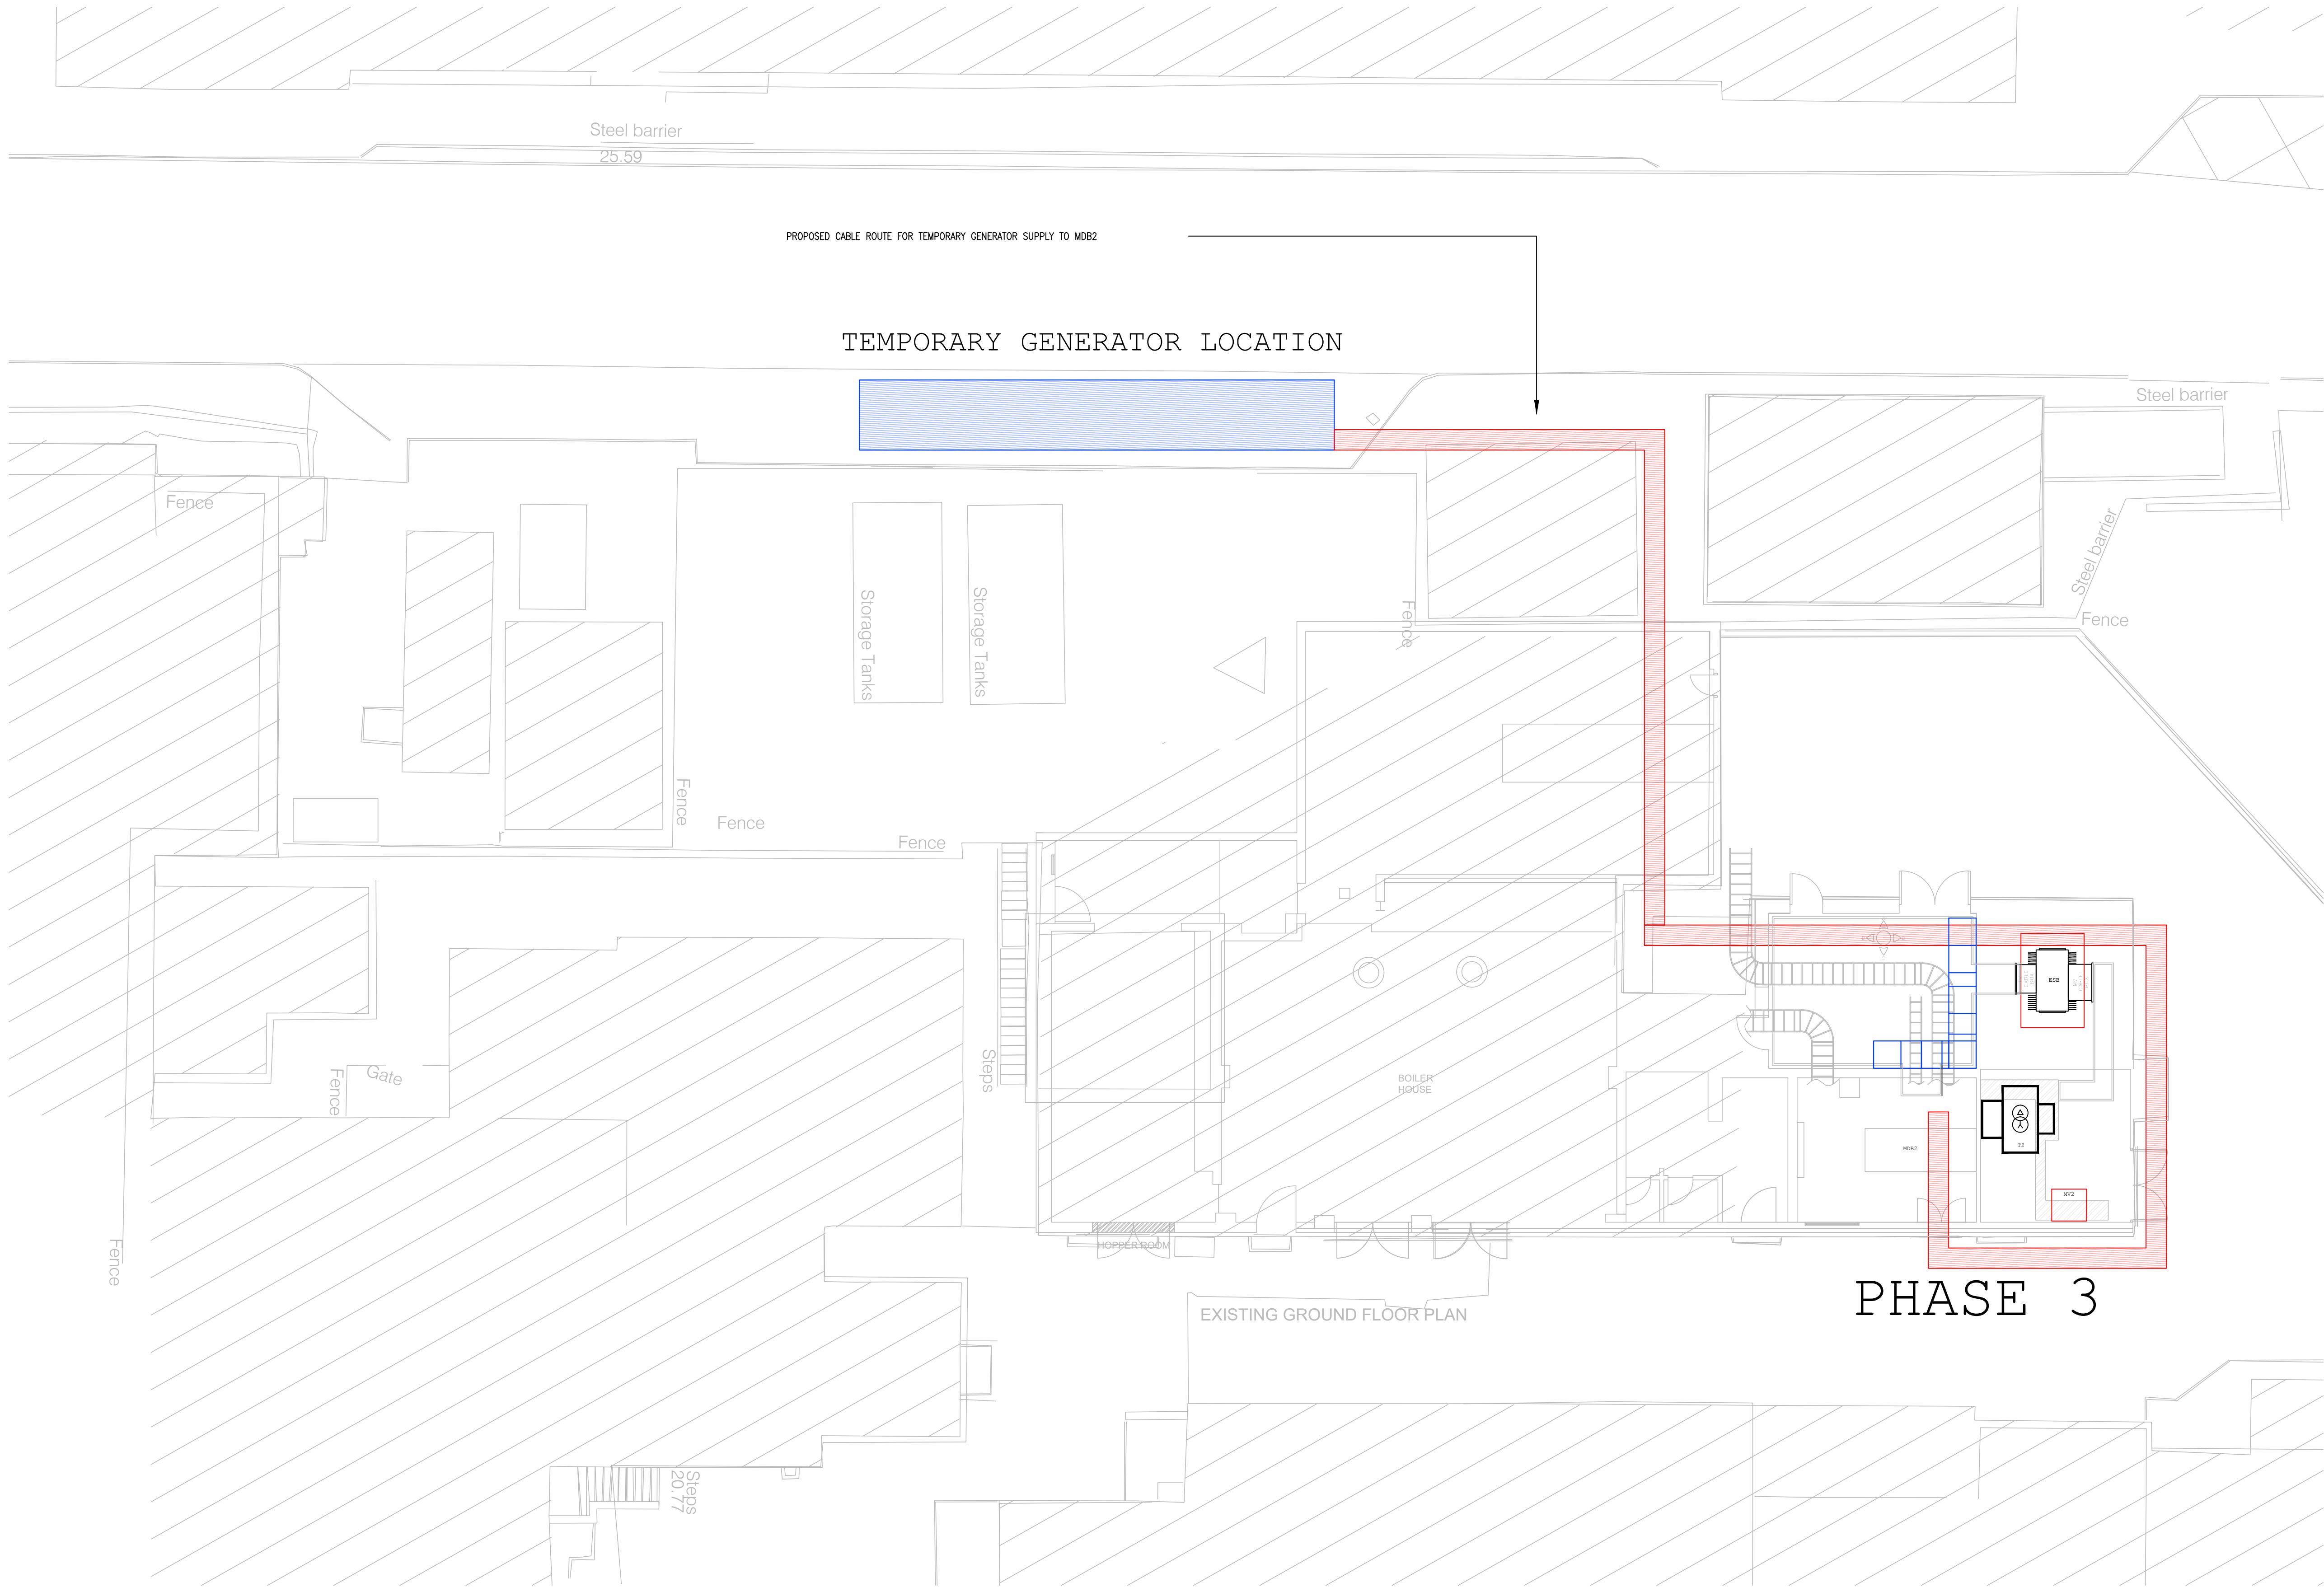

- General Notes
- DO NOT SCALE FROM THIS DRAWING-
WORK ONLY FROM FIGURED DIMENSIONS.
 - ALL ERRORS & OMISSIONS TO BE REPORTED TO THE
CONSULTING ENGINEER
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARCHITECTS
AND STRUCTURAL ENGINEER'S DRAWINGS.
 - REFER TO DOCUMENT REGISTER FOR DESCRIPTION
OF STATUS CODES.

- NOTES PHASE 3:
- INSTALL NEW 2 NO TRAILER MOUNTED, CONTAINERISED, DIESEL
GENERATOR SETS, WITHIN WEATHERPROOF, ACOUSTIC
ENCLOSURES OF A MINIMUM RATING OF 1,250KVA/1,000KW
EACH.
 - SWITCHGEAR AND CONTROLS FOR EACH GENERATOR CAPABLE
OF SYNCHRONISING ONE WITH THE OTHER AND SHARING LOAD
OR OPERATING ON A DUTY/STANDBY BASIS WITH AUTOMATIC
STARTING OF THE STANDBY SET IN THE EVENT OF A FAILURE
OF THE DUTY SET.
 - FLEXIBLE, TEMPORARY CABLES OF SUFFICIENT SIZE TO CARRY
1,200A ON A CONTINUOUS BASIS.
 - SEPARATE FUEL STORAGE FOR EACH SET OF SUFFICIENT
CAPACITY TO RUN ITS ASSOCIATED GENERATOR FOR 12 HOURS
ON FULL RATED LOAD.
 - CONTINUOUS 24/7 ATTENDANCE ON SITE BY A TECHNICAL
REPRESENTATIVE OF THE RENTAL GENERATOR PROVIDER.
 - ARRANGEMENTS FOR REGULAR FUEL OIL DELIVERIES
THROUGHOUT THE DURATION OF THE SHUTDOWN.
 - THE CONTRACTOR SHALL BE REQUIRED TO ARRANGE FOR A
LOAD TEST OF EACH GENERATOR SET TO BE CARRIED OUT AND
CERTIFIED PRIOR TO THE DELIVERY OF THE SETS TO SITE.

02	P08	May '26	Issued for Tender	K.M.
01	P08	Mar '26	Issued for Tender	K.M.
Rev	Status	Date	Description	D.E.

Revision	Project Drawing Reference			
02	25672-ZZ-Z-ZZZ-DR-VCE-EE-0007			

Status	Varming Project Number			
P08	25672			

Date	Checked By	Drawn By	Scale
December 2025	J.G.	K.M.	As Noted

Client	HSE
--------	-----

Project Title	T2 Upgrade Sligo University Hospital
---------------	---

Drawing Title	Electrical Services Phase 3 Temporary Generators Installation
---------------	---



Dublin	01 4872300	01 4872300	01 4872300	01 4872300
Cork	021 2375080	021 2375080	021 2375080	021 2375080
Roscommon	090 6602380	090 6602380	090 6602380	090 6602380
Website	www.varming.ie	www.varming.ie	www.varming.ie	www.varming.ie

