




- Disconnect existing pipe
- Locate exesting valves
- Proposed new pipes
- Proposed new valves
- GWS_Bulk_Meters_point
- GWS_Water_Pipes_polyline

Supply and fit 80M of 2" pipe with new SV and ScV. Tie existing 1" pipes back into new pipe, 2 No.

Supply and fit new pump house with all associated works, to be designed by competent company. Include supply and fit of ESB kiosk and 65M of ducting to nearest pole. Decommission old pump house

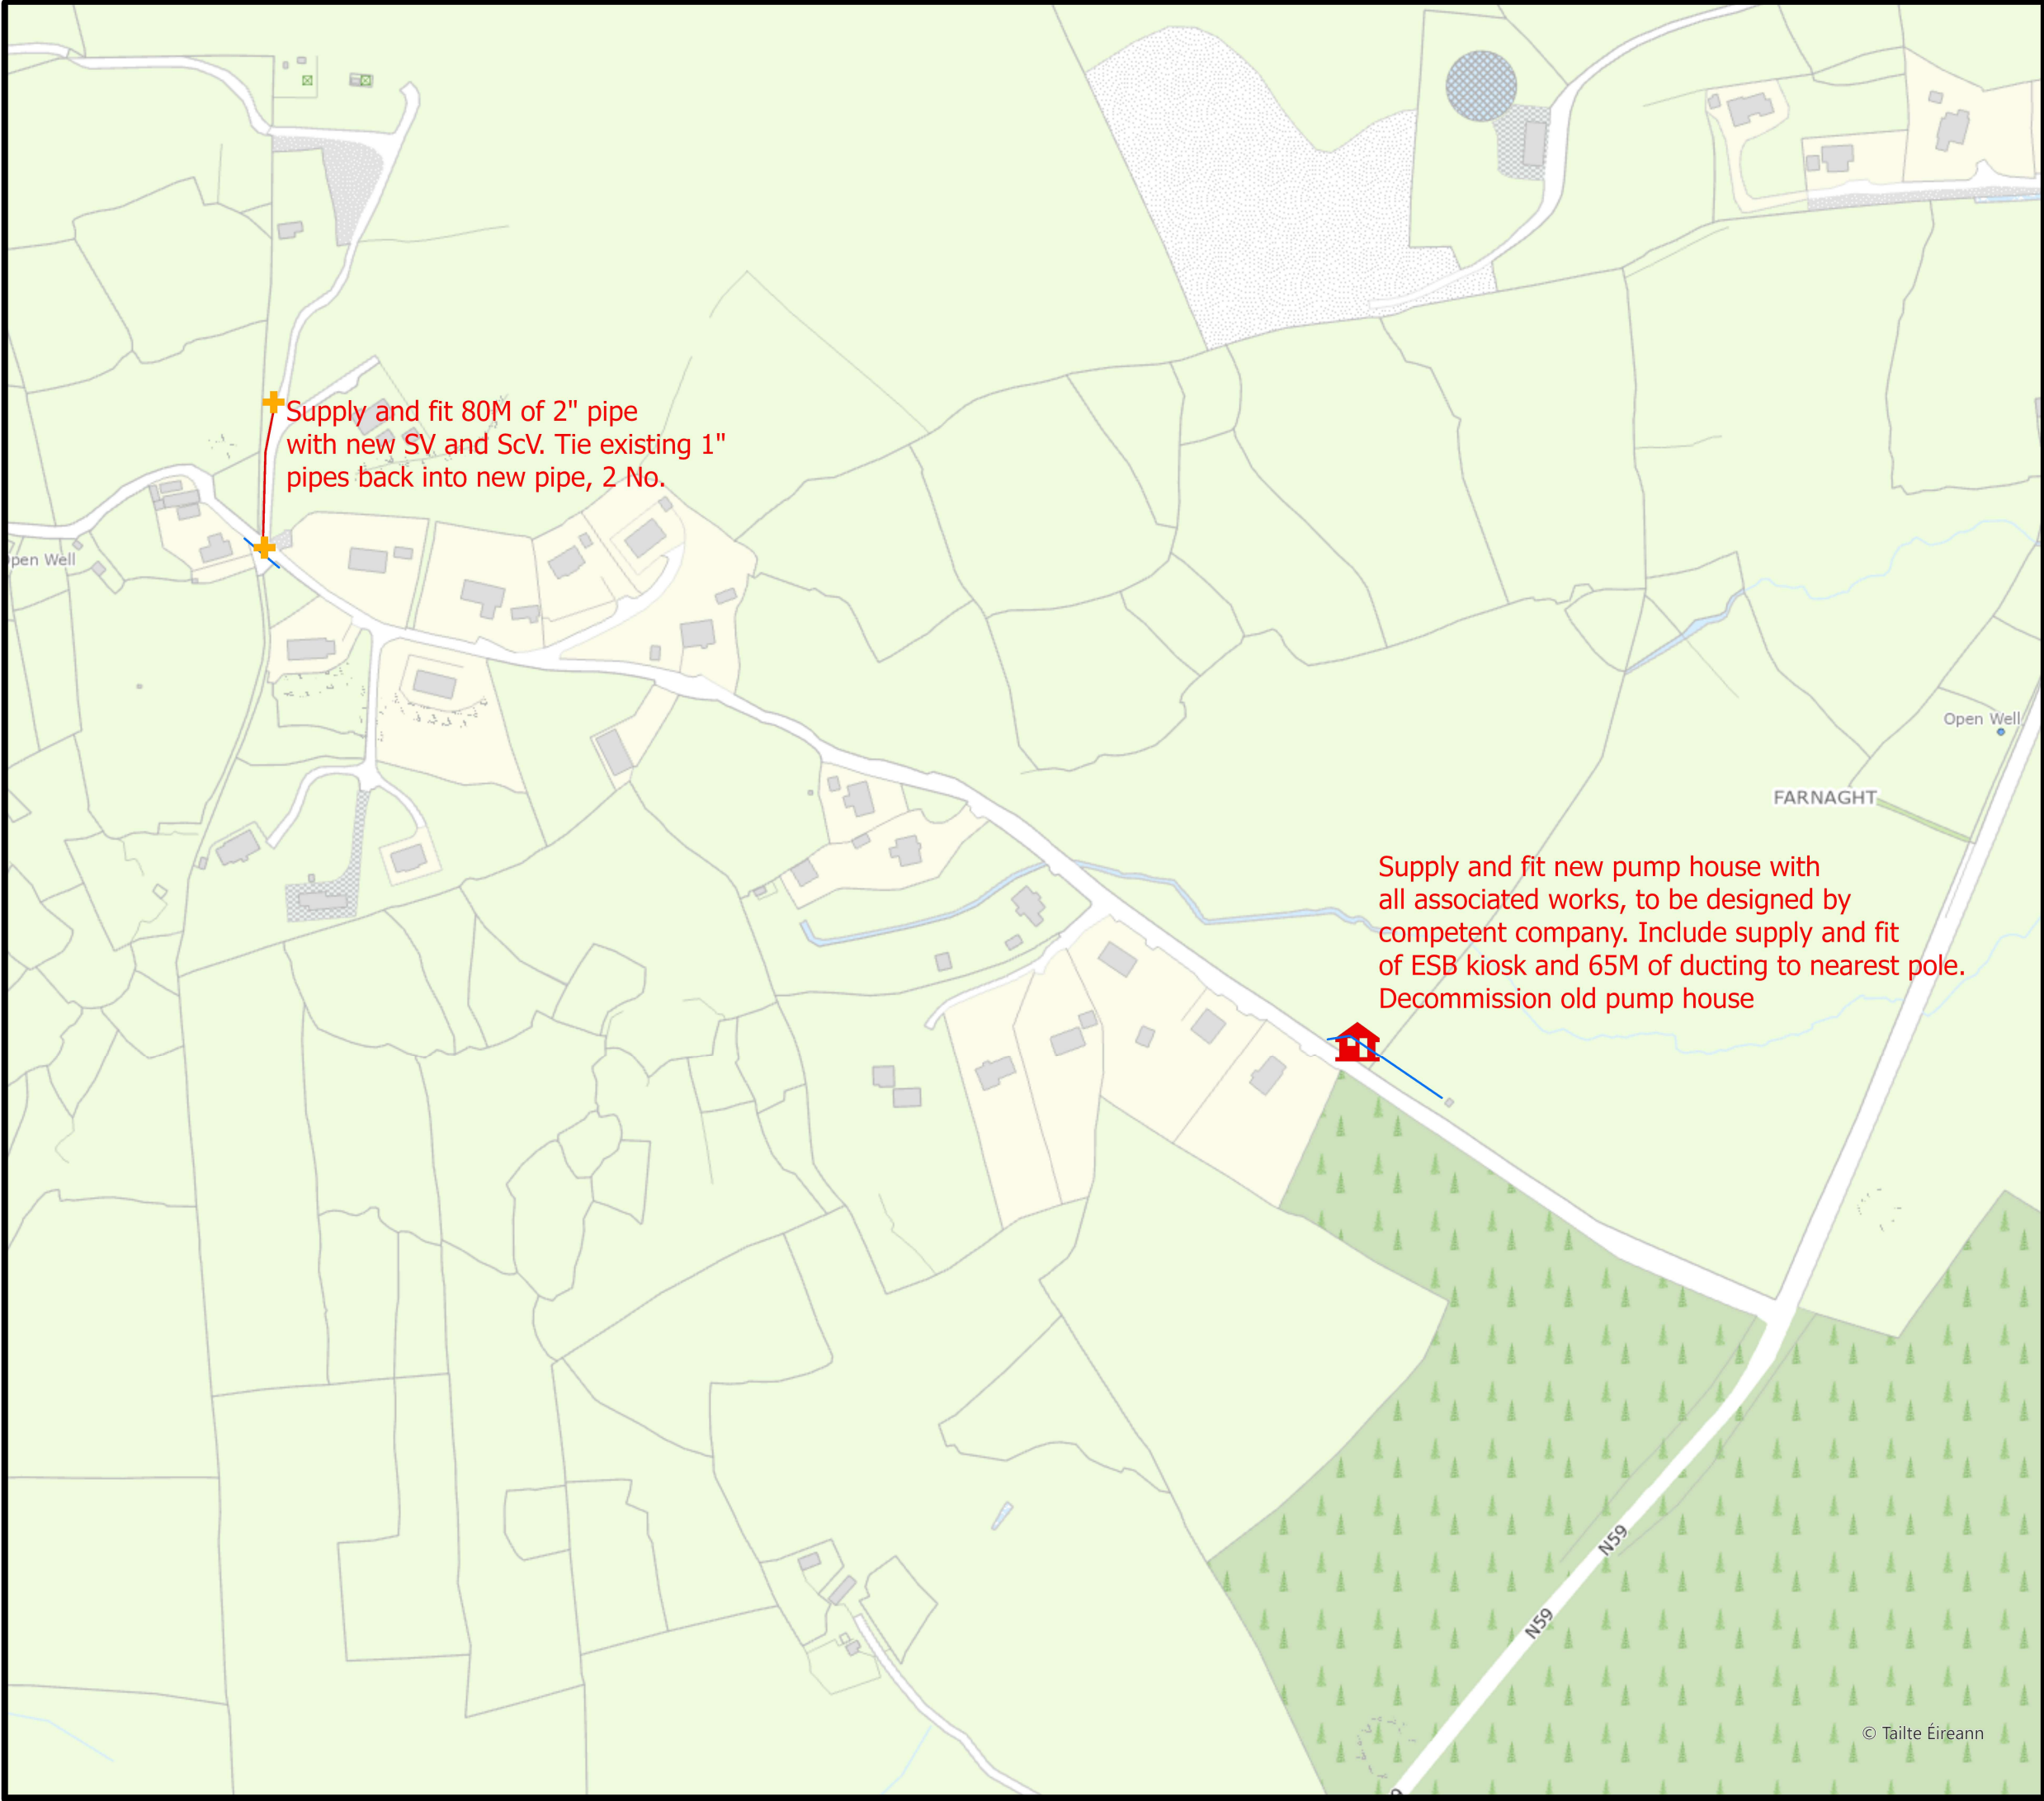

CYAL50441423
© Tailte Éireann – Surveying.

PROJET: Farnaught GWS
proposed works

TITLE: Farnaught GWS Westport

Drawn By: J Jennings

Date: 23/02/2026

