



GENERAL NOTES

1. THIS DRAWING IS TO BE USED IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL, AND STRUCTURAL DRAWINGS & SPECIFICATIONS.
 2. THE ELECTRICAL CONTRACTOR SHALL CO-ORDINATE WITH ALL OTHER TRADES BEFORE CONSTRUCTION WORK. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MAIN CONTRACTOR CO-ORDINATE ALL SERVICES.
 3. THE ELECTRICAL CONTRACTOR SHALL ALLOW FOR CO-ORDINATING THE ELECTRICAL INSTALLATION WITH THE MECHANICAL CONTRACTOR EXHAUSTER. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MECHANICAL CONTRACTOR CO-ORDINATE ALL SERVICES.
 4. NO AND SOLID THIS DRAWING, ALL DIMENSIONS TO BE, MARK ON SITE.
 5. THE ELECTRICAL CONTRACTOR SHALL ALLOW FOR THE SUPPLY AND INSTALLATION OF ALL ELECTRICAL SERVICES INDICATED ON THIS DRAWING.
 6. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE TO IDENTIFY SUITABLE FINAL ROUTES FOR CABLE CONDUITANT, ELECTRICAL SERVICES, ETC. AS INDICATED ON THE DRAWINGS.
 7. ALL MAINS AND ALL ELECTRICAL CONDUITANT SHALL BE INSTALLED IN THE MANNER AS INDICATED. THIS IS, RESERVE, DUCT, AND IF NOT SPECIFIED OTHERWISE, SHALL BE INSTALLED IN THE MANNER AS INDICATED.
 8. DUAL CABLES OF ALL TYPES OF SIZES/OF POINTS/DEFINITE, ETC. SHALL BE MARKED ON SITE WITH THE EMPLOYERS REPRESENTATIVE AND THE CLIENT.
 9. ALL SERVICES HAVING FIRE DANGER SHALL BE INSTALLED EACH SIDE OF THE BARRIER. THE MAIN CONTRACTOR SHALL ALLOW FOR FIRE RISKING THE SPOTS AFTER SERVICES SHALL BE COMPLETED.
 10. THE ELECTRICAL CONTRACTOR SHALL ALLOW FOR ALL ACCESSIBLE LABORER, WINDING, AND ATTENDANCES IN COMPLIANCE WITH THE ELECTRICAL SERVICES AS INDICATED ON THE DRAWING.
 11. THE MAIN CONTRACTOR SHALL REFER TO THE KEY PLAN ON THE DRAWING WHICH INDICATES WHERE WORKS WILL BE REQUIRED TO BE COMPLETED.
- ELECTRICAL SCHEMATIC NOTES FOR MAIN BOARD.**
12. THE CONTRACTOR SHALL ALLOW FOR THE DECOMMISSIONING AND REMOVAL OF THE EXISTING MAIN DISTRIBUTION ELECTRICAL BOARD IN THE BUILDING.
 13. THE CONTRACTOR SPECIFIC FOR SPECIAL DETAILS ON THE NEW MAIN DISTRIBUTION ELECTRICAL BOARD TO BE INSTALLED IN THE BUILDING.
 14. THE CONTRACTOR SHALL ALLOW FOR GROUNDING OF A SEPARATE SHEATH OF THE EXISTING MAIN DISTRIBUTION ELECTRICAL BOARD AND ALL EXISTING ELECTRICAL BOARDS IN THE BUILDING.

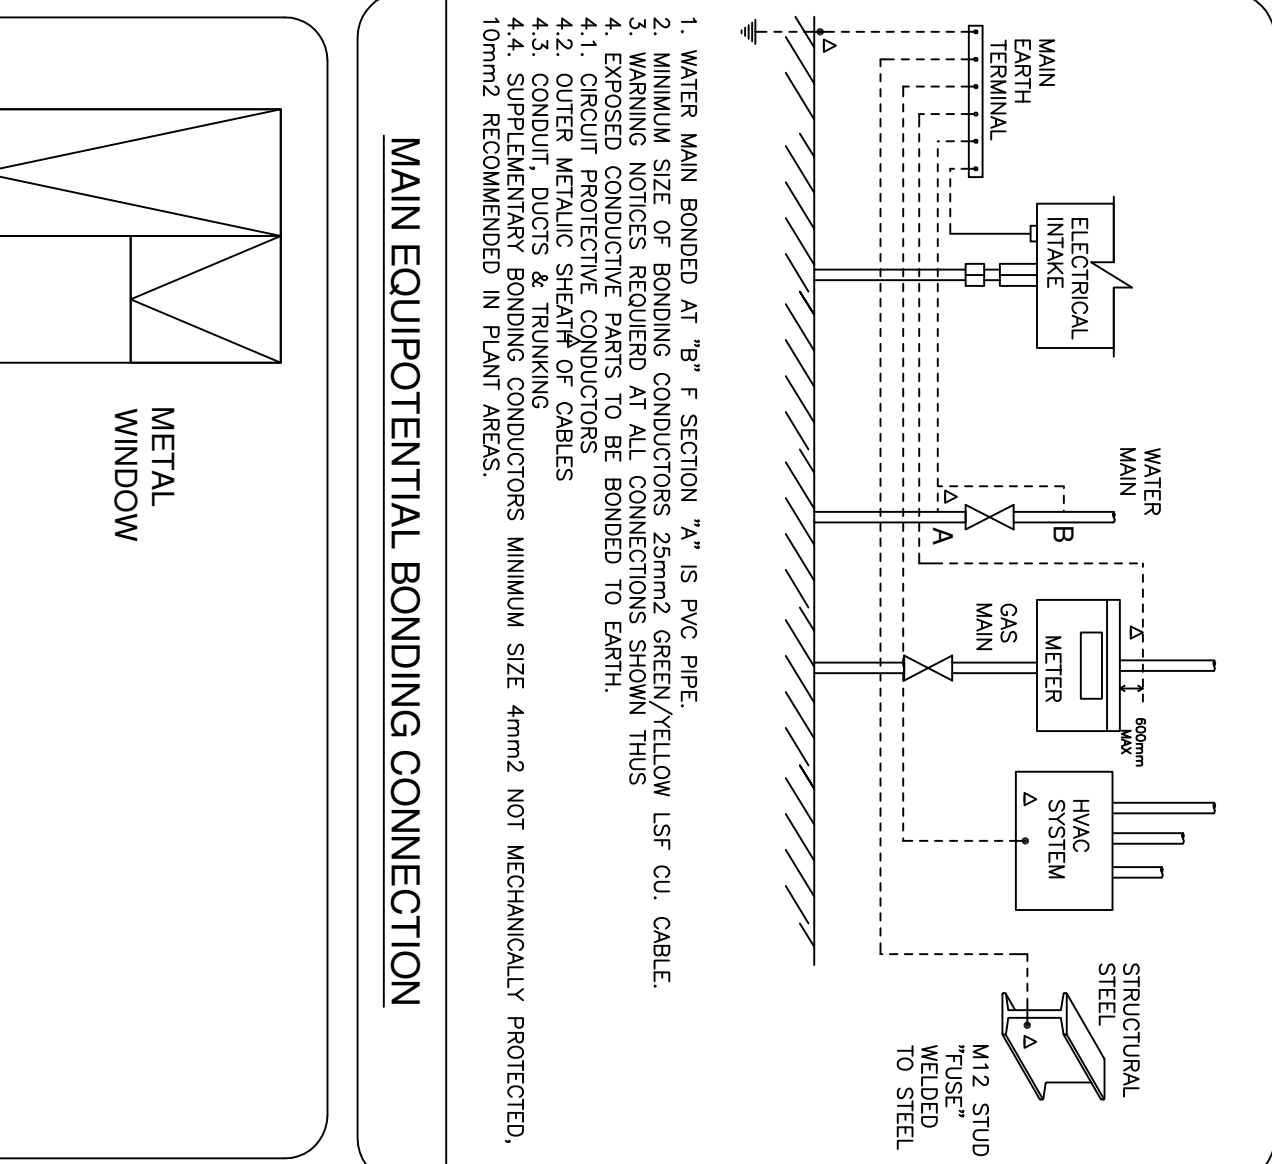


29. REFER TO TABLE 51C COLOUR CODE FOR CABLE CORES AND INSULATED CONDUCTORS OF AMENDMENT No. 2 ET101:2004/42:2005 OF THE NATIONAL RULES FOR ELECTRICAL INSTALLATIONS.

25. THE CONTRACTOR SHALL ALLOW FOR THE SUPPLY AND INSTALLATION OF THE NEW MAIN DISTRIBUTION ELECTRICAL BOARD AND FOR THE FULL REMOVAL AND RECOMMISSIONING OF THE EXISTING MAIN DISTRIBUTION ELECTRICAL BOARD IN THE BUILDING.
26. SOME OF THE EXISTING ELECTRICAL PIPES IN THE BUILDING SHALL BE RETAINED AND CONNECTED TO THE NEW MAIN DISTRIBUTION ELECTRICAL BOARD AS INDICATED ON THE SCHEMATIC.
- ELECTRICAL SCHEMATIC NOTES FOR SUB BOARD IN THE EXTENSION:**
27. SEE ELECTRICAL SPECIFICATIONS FOR SPECIFIC DETAILS ON ALL THE ELECTRICAL BOARD IN THE NEW EXTENSION OF THE BUILDING.
28. ALL ELECTRICAL CABLES SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE ELECTRICAL REGULATIONS.

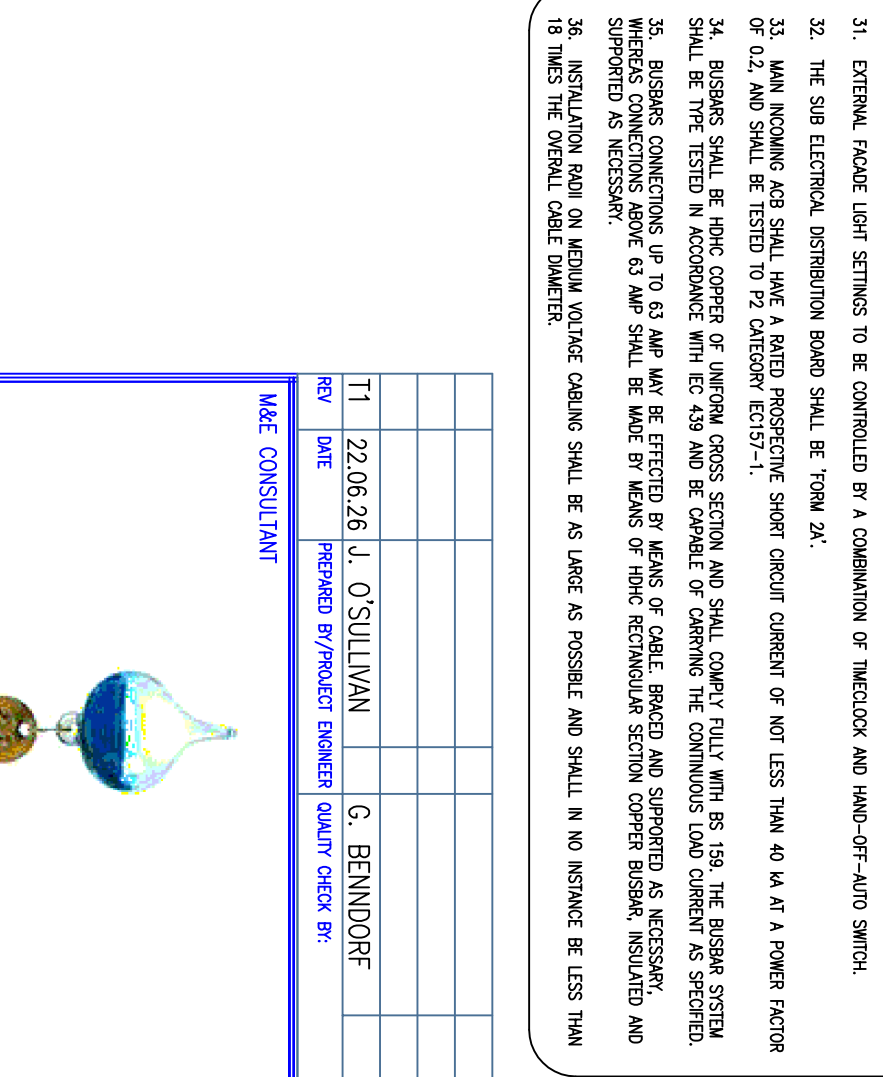

PER	DATE	PREPARED BY/PROJECT ENGINEER	QUALITY CHECK BY:
W&E CONSULTANT			



GALILEO ENERGY SERVICES
 UNIT A6, M4 BUSINESS PARK,
 CELBRIDGE, CO. KILDARE.
 Tel: 01-6274103
www.galileoenergy.ie

Copyright ©

BRAY,
CO. WICKLOW.


Drawing Title

ELECTRICAL SCHEMATICS
TO BE INSTALLED IN THE
MAN BUILDING AND EXTENSION

Architect MCLOUGHLIN ARCHITECTURE
100 GLENVIEW AVE.
MILLERSMUM PARK, NIOS
CORKIDARE, IRELAND

Tel. 045 854 300

--	--	--	--	--	--

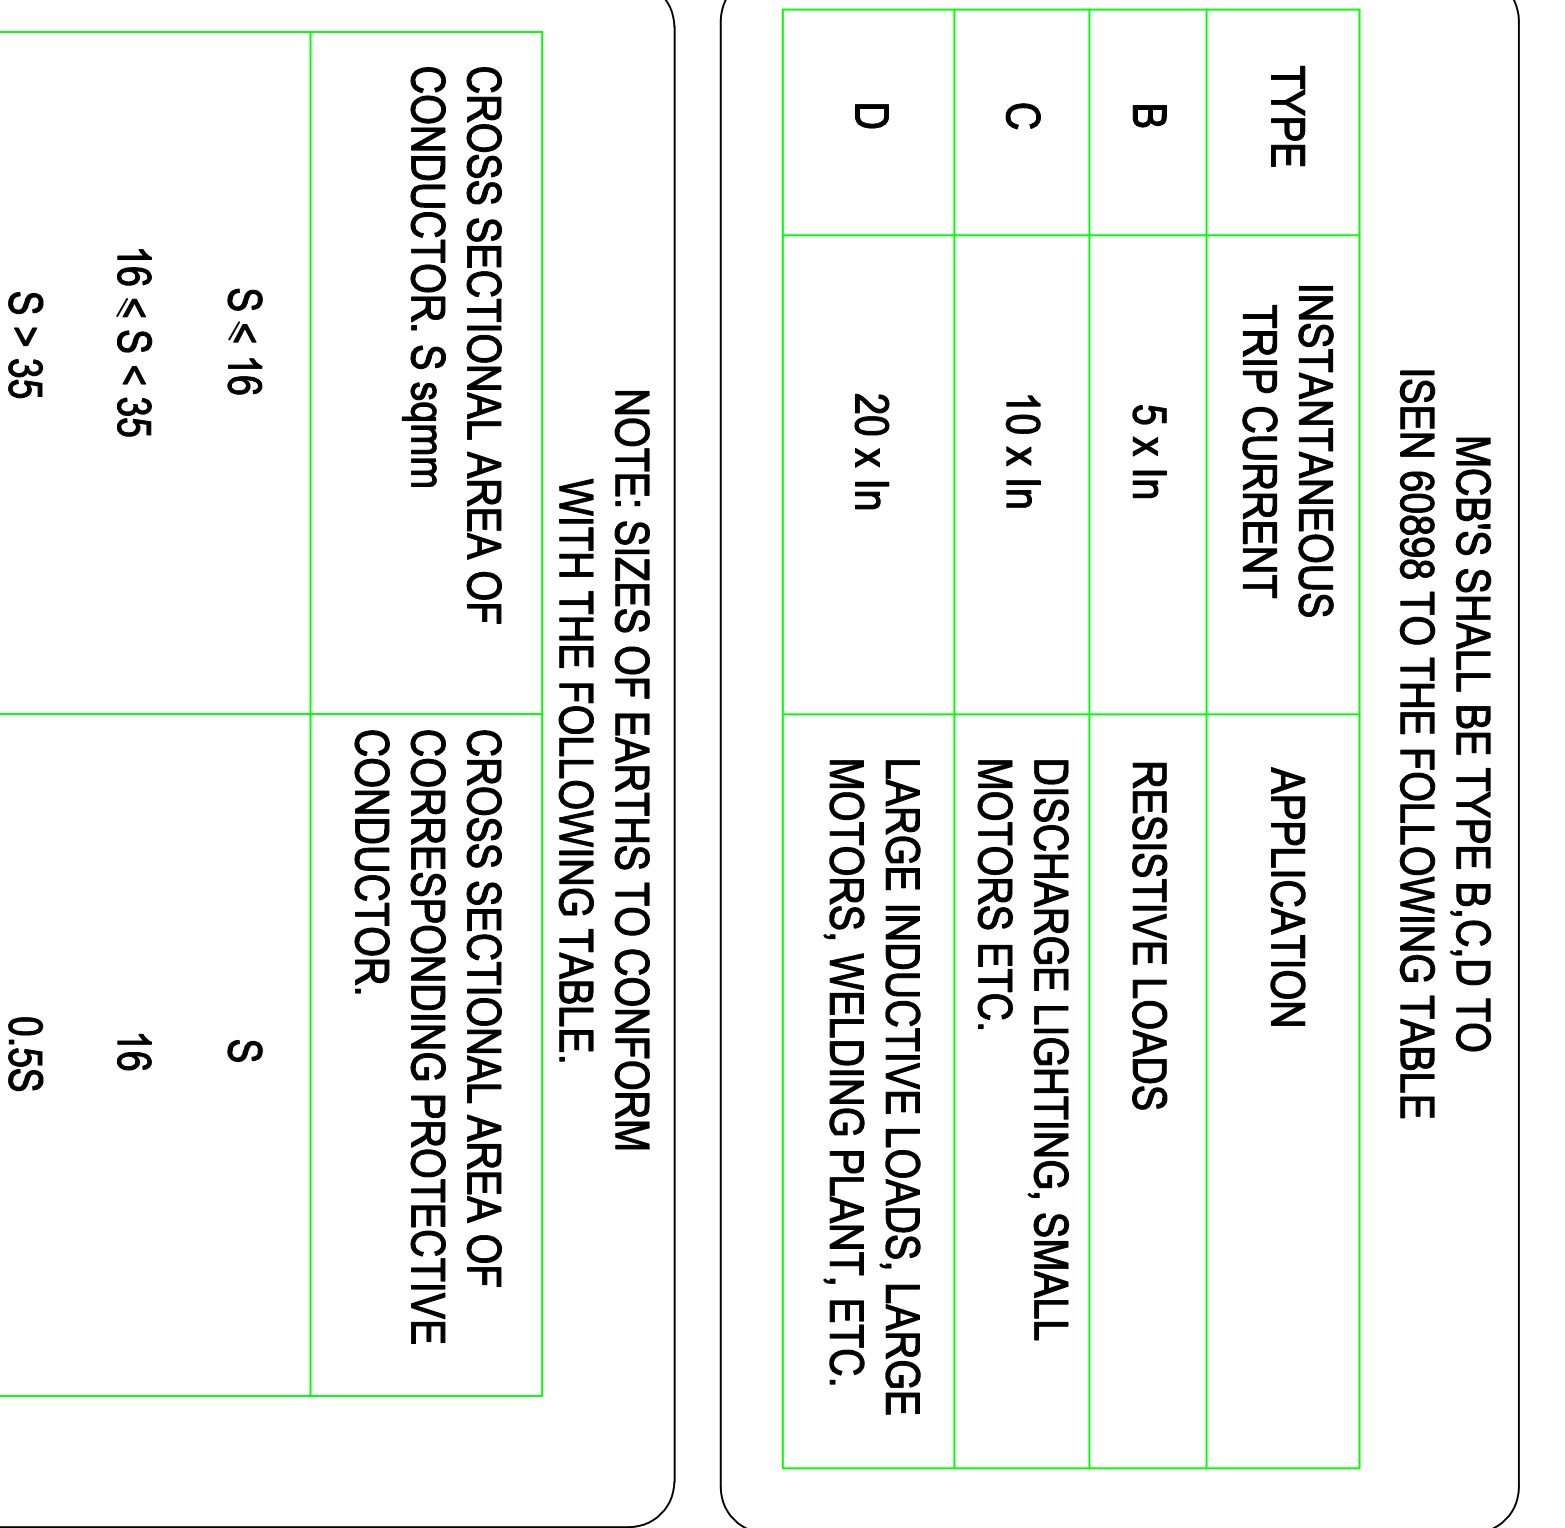

61(E001)	
Job No.	21-008
Drawn by:	J.O'S
Scale:	AS INDICATED
Rev.	T1