


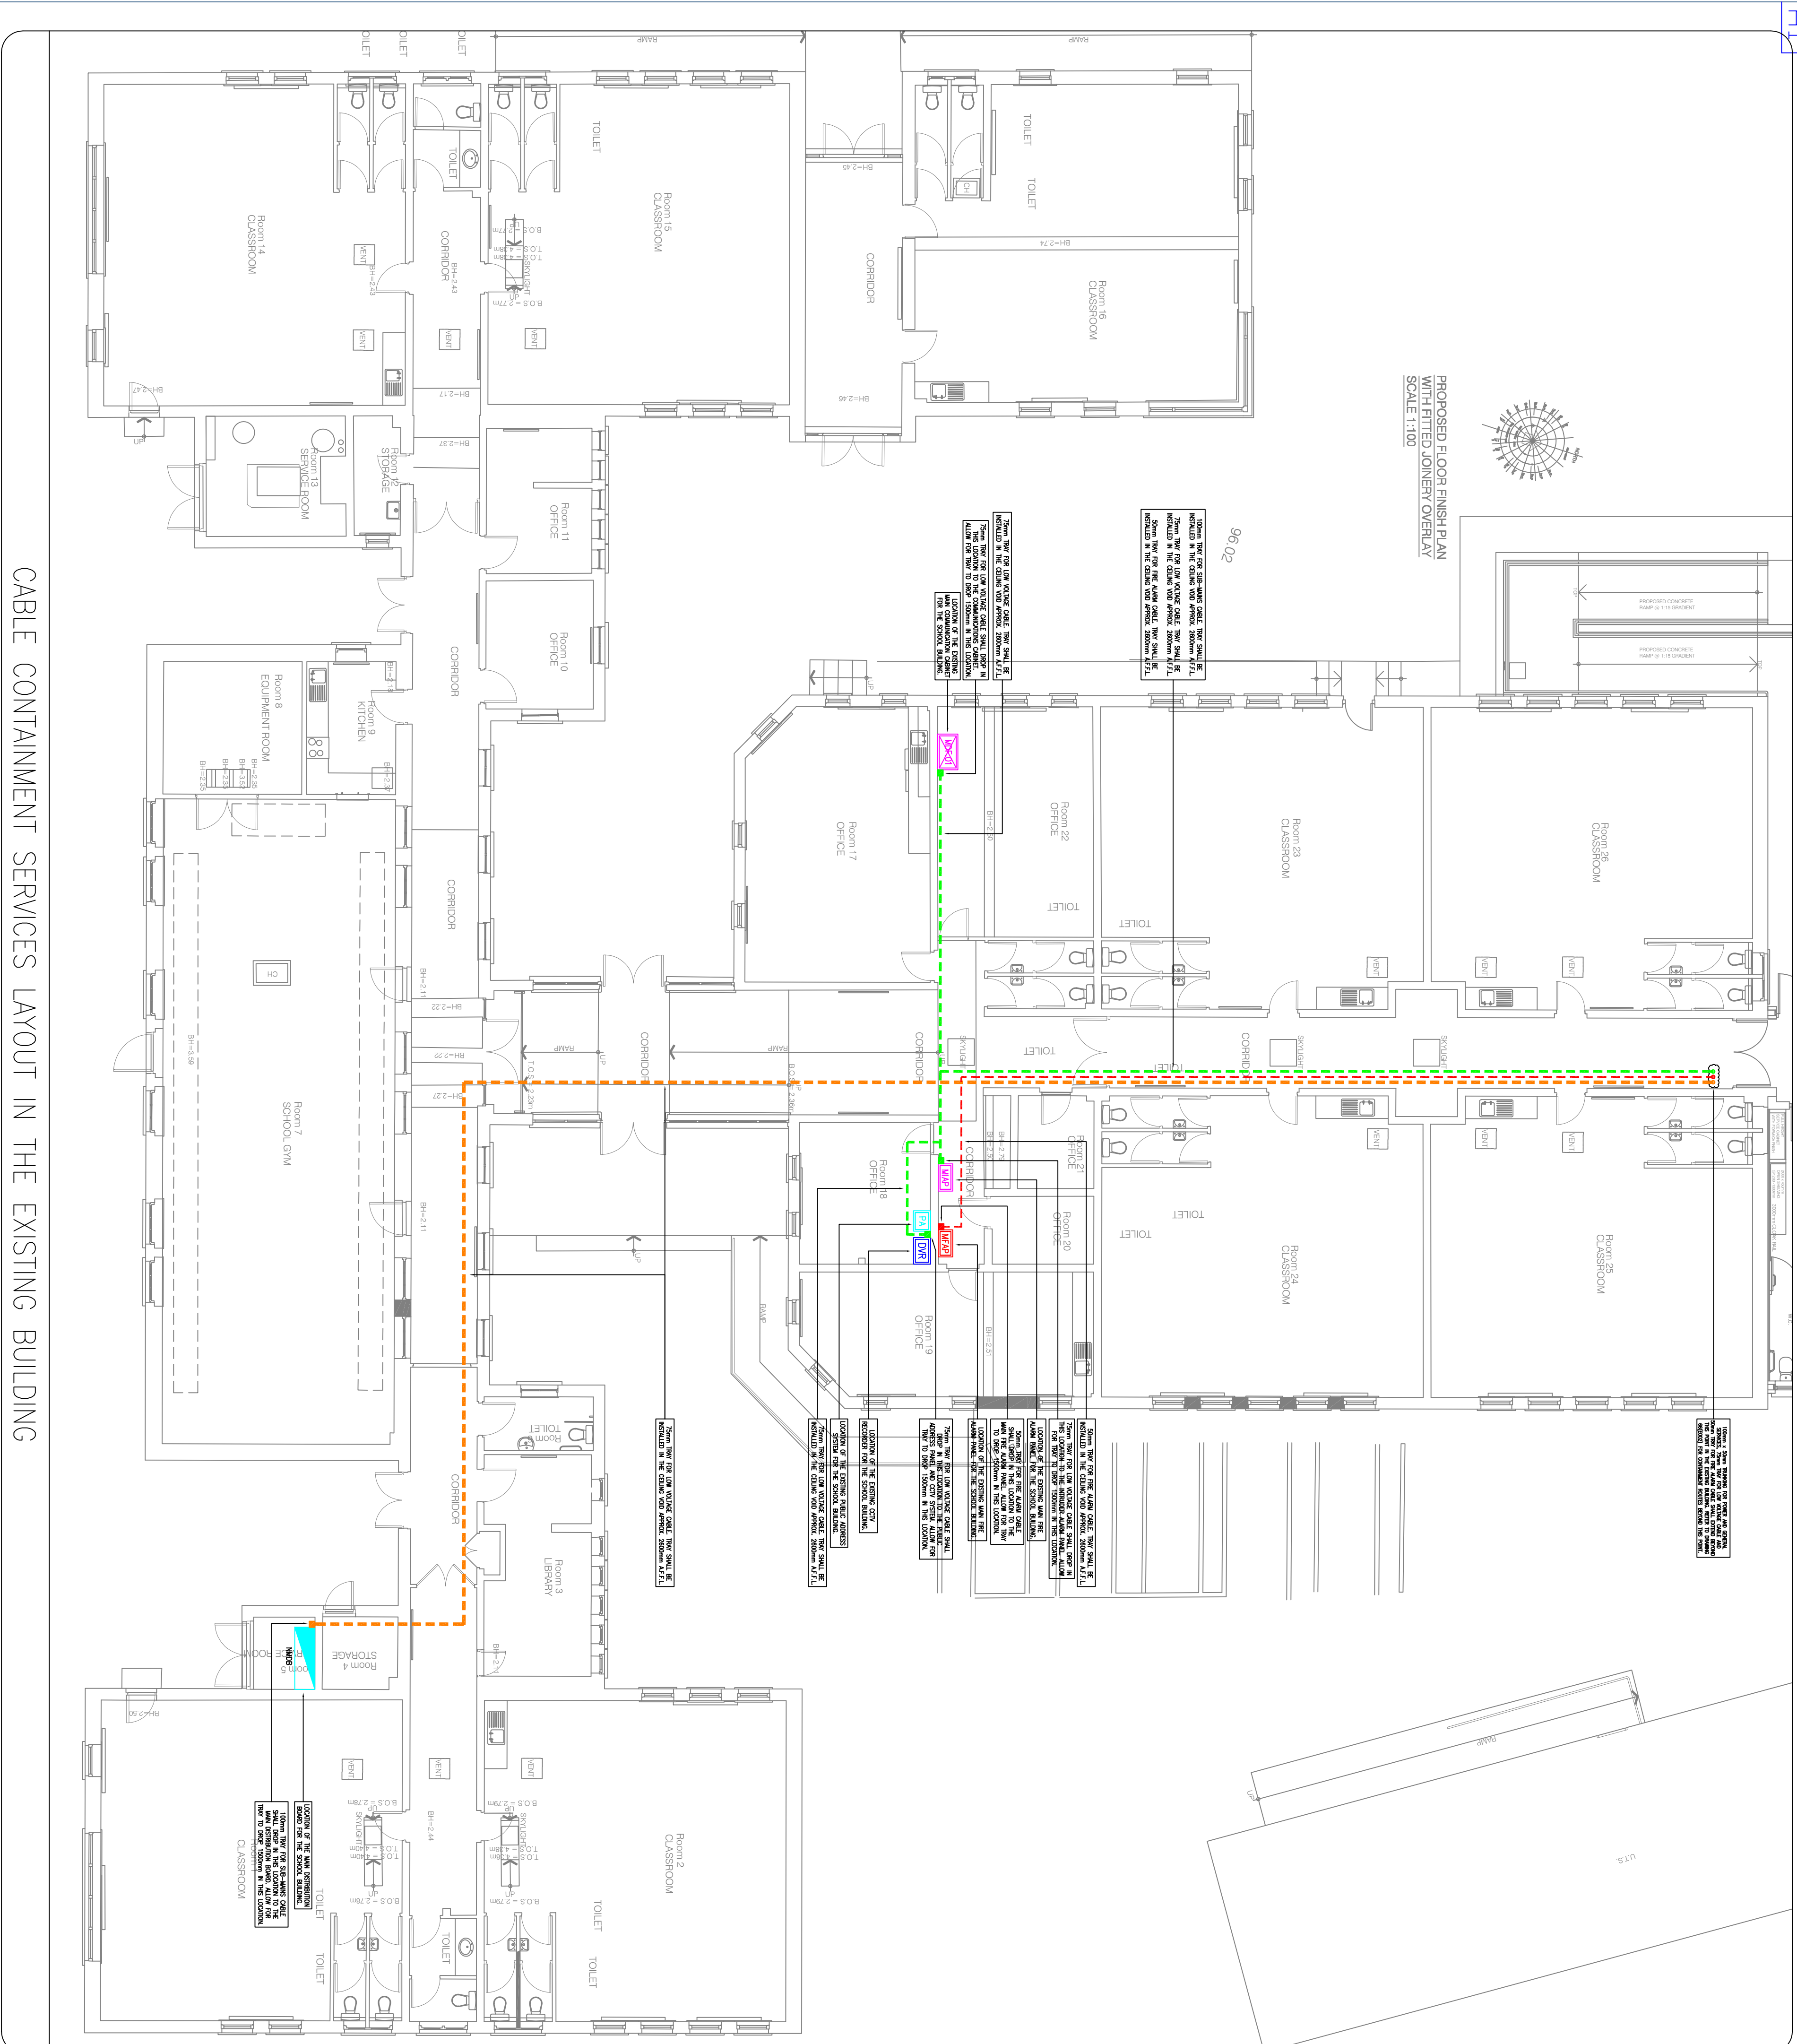

GENERAL NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS & SPECIFICATIONS.
 2. THE CONTRACTOR SHALL CO-ORDINATE FULLY WITH ALL OTHER TRADES RELEVANT TO MECHANICAL WORK. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MAIN CONTRACTOR CO-ORDINATE ALL SERVICES.
 3. THE MECHANICAL CONTRACTOR SHALL ALLOW FOR CO-ORDINATING THE MECHANICAL INSTALLATION WITH THE ELECTRICAL CONTRACTOR ON SITE EXTRA COSTS INCURRED DUE TO THE CO-ORDINATION EXERCISE NOT BEING COMPLETED WILL NOT BE ACCEPTED BY THE ENGINEER.
 4. DO NOT SCALE THIS DRAWING. ALL DIMENSIONS TO BE TAKEN ON SITE.
 5. THE CONTRACTOR SHALL ALLOW FOR THE SUPPLY AND INSTALLATION OF ALL ELECTRICAL SERVICES INDICATED ON THE DRAWING.
 6. THE CONTRACTOR SHALL BE RESPONSIBLE TO IDENTIFY SUITABLE FINAL ROUTES FOR CABLE CONTAINMENT ELECTRICAL SERVICES, ETC. AS INDICATED ON THE DRAWINGS.
 7. NEW MAIN RUN OF ELECTRICAL CONTINUITY SHALL BE INSTALLED IN THE MANSO AS INDICATED THIS IS EMPLOYED ONLY AND IF THE CONTRACTOR FINDS A MORE CONVENIENT ROUTE FOR THE ELECTRICAL SERVICES ON SITE THAT WILL BE ACCEPTABLE.
 8. FINAL LOCATION OF ALL RIGS OF SPOOTS/FANS/LIGHTING, ETC. SHALL BE AGreed ON SITE WITH THE EMPLOYERS REPRESENTATIVE AND THE CLIENT.
 9. ALL SERVICES THROUGH THE BARBERS SHALL BE LAYED ABOVE SIDE OF THE BARBER. THE MAIN CONTRACTOR SHALL ALLOW FOR FINE PROTECTING THE DRESSES AFTER SERVICES IS INSTALLED.
 10. THE CONTRACTOR SHALL ALLOW FOR ALL NECESSARY LABOUR, MENDING AND ATTENDANCES IN COMPLETING ALL THE ELECTRICAL WORKS AS INDICATED ON THE DRAWINGS AND SPECIFICATIONS.
- THE CONTRACTOR SHALL REFER TO THE KEY PLAN ON THE DRAWING WHICH INDICATES WHERE WORKS WILL BE REQUIRED TO BE CARRIED OUT IN THE BUILDING.

CABLE CONTAINMENT NOTES:

- [illegible]

CABLE CONTAINMENT SYMBOLS

	NEW SUS DISTRIBUTION BOARD FOR THE EXTENSION OF THE BUILDING
	NEW GALVANISED STEEL TRAY TO BE INSTALLED AT H/L FOR LOW VOLTAGE ELECTRICAL SERVICES (SEE DRAWING FOR PROPOSED SIZE)
	NEW GALVANISED STEEL TRAY TO BE INSTALLED AT H/L FOR GENERAL ELECTRICAL SERVICES (SEE DRAWING FOR PROPOSED SIZE)
	NEW GALVANISED STEEL TRAY TO BE INSTALLED AT H/L FOR FIRE ALARM CABLE (SEE DRAWING FOR PROPOSED SIZE)
	NEW GALVANISED STEEL TRAY TO BE INSTALLED AT H/L FOR SUB-MAINS (SEE DRAWING FOR PROPOSED SIZE)

	LOCATION OF THE EXISTING OR THE MAIN BUILDING.
	LOCATION OF THE EXISTING PUMP SYSTEM IN THE MAIN BUILDING.
	LOCATION OF THE EXISTING MAIN FIRE ALARM PANEL FOR THE MAIN BUILDING.
	LOCATION OF THE EXISTING MAIN FIRE ALARM PANEL FOR THE MAIN BUILDING.
	EXISTING INTERMEDIATE CABLE (C DENOTES CABINET NUMBER)

T1	22.06.26	J. O'SULLIVAN	G. BENNDORF
REV	DATE	PREPARED BY/PROJECT ENGINEER	QUALITY CHECK BY:

GALILEO ENERGY SERVICES
UNIT A6, M4 BUSINESS PARK,
CELBURIDGE, CO. KILDARE.
Tel: 01-6274103
www.galileoenergy.ie

Drawing Status TENDER			
Job Title KILMACANOGUE N.S. KILMACANOGUE, BRAY, CO. WICKLOW.		Drawing Title PROTECTIVE SERVICES AND CABLE CONTAINMENT SERVICES LAYOUT IN THE EXISTING BUILDING.	
Architect MCLOUGHLIN ARCHITECTURE Millennium Park, Noos Co. Kildare, Ireland Tel. 045 854 800			
Drawing No. 66(E002)			
Job No. 21-008	Drawing Size J.O'S 1:100 on A1	Rev. T1	