


ALL SANITARY WARE SET-OUT IN
STRICT ACCORDANCE WITH
BUILDING REGULATIONS TDG
PART M


REFER TO FITOUT SCHEDULES FOR FURTHER INFORMATION ON FINISHES AND FITOUT ELEMENTS

DESIGN AND INSTALLATION OF HOIST AND TRACK SYSTEM IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THEIR SPECIALIST SUPPLIERS. HOIST TO BE FULLY SOFFIT MOUNTED / HUNG AND IS TO MEET A MINIMUM CARRYING WEIGHT OF 200kg


SELECTED 100X10X10mm **PORCELAIN TILE**, TILE FINISH ON 12.5mm
TILE BACKER BOARD WITH SELECTED APPROVED ALUMINUM BOX
TILE TRIM TO THE PERIMETER OF ALL TILED SURFACES. 2-4mm JOINT
SIZE TO BE DETERMINED ON SITE TO ELIMINATE / MINIMIZE CUT
TILES IN HORIZONTAL DIMENSION. SETTING OUT TO PROVIDE FOR
NO CUT TILES IN VERTICAL DIMENSION. SELECTED APPROVED HIGH
QUALITY COLORED EPOXY GROUT FOR WALL TILES TO EN 13888.
DETAILED SUBMITTAL FOR ALL COMPONENT PARTS AND 1mx1m
SAMPLE PANEL REQUIRED WITH SELECTED GROUT AND TRIM.

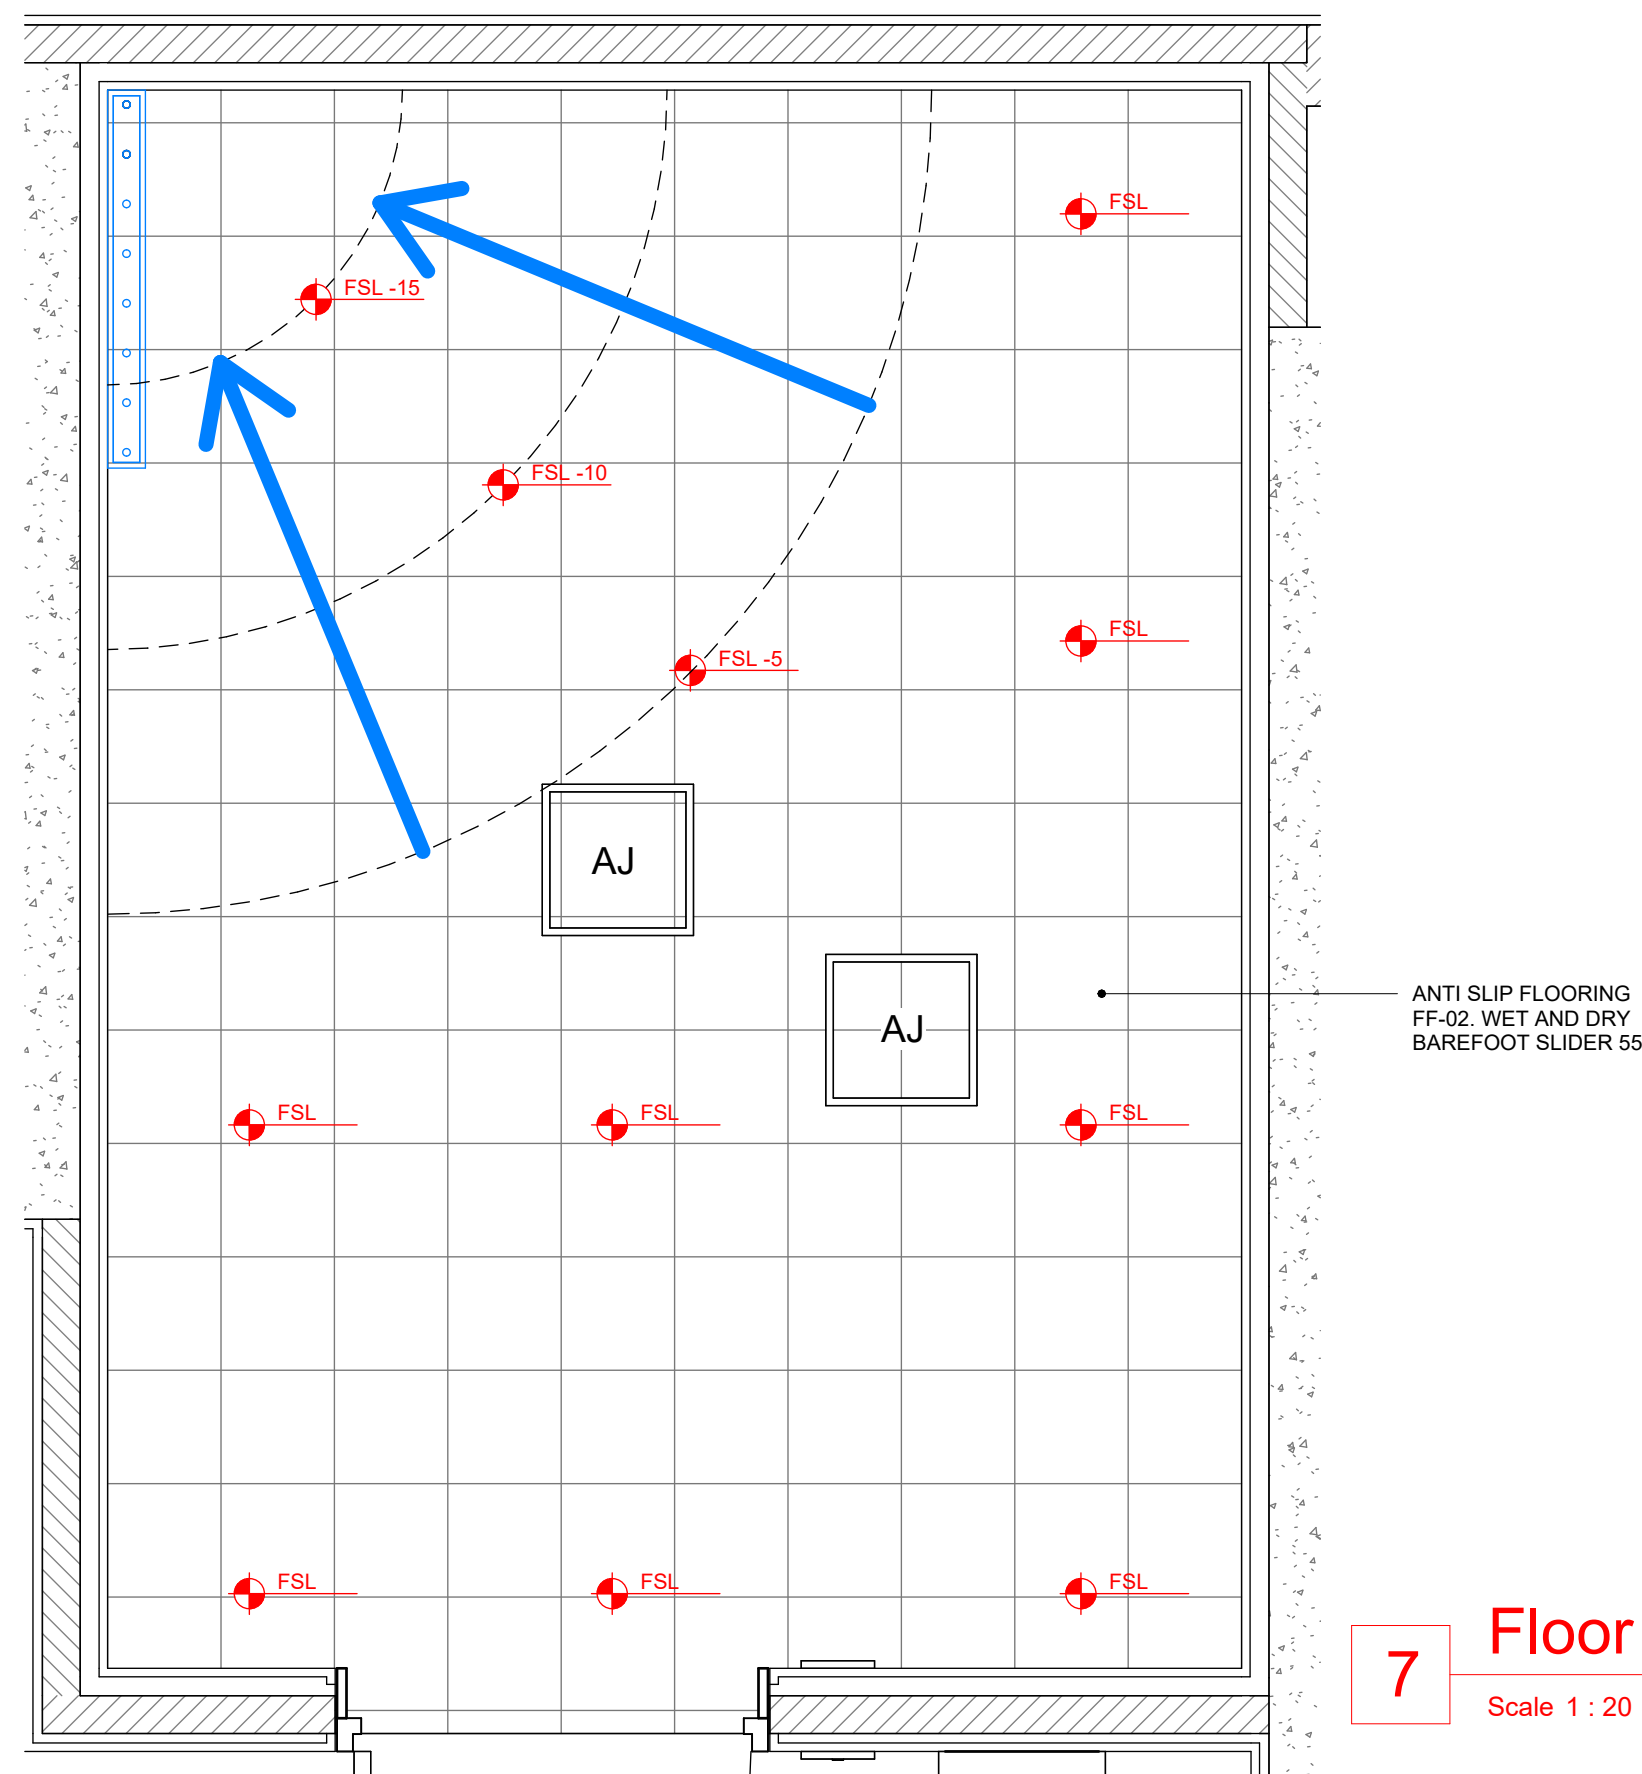

Scale 1 : 20 @A1

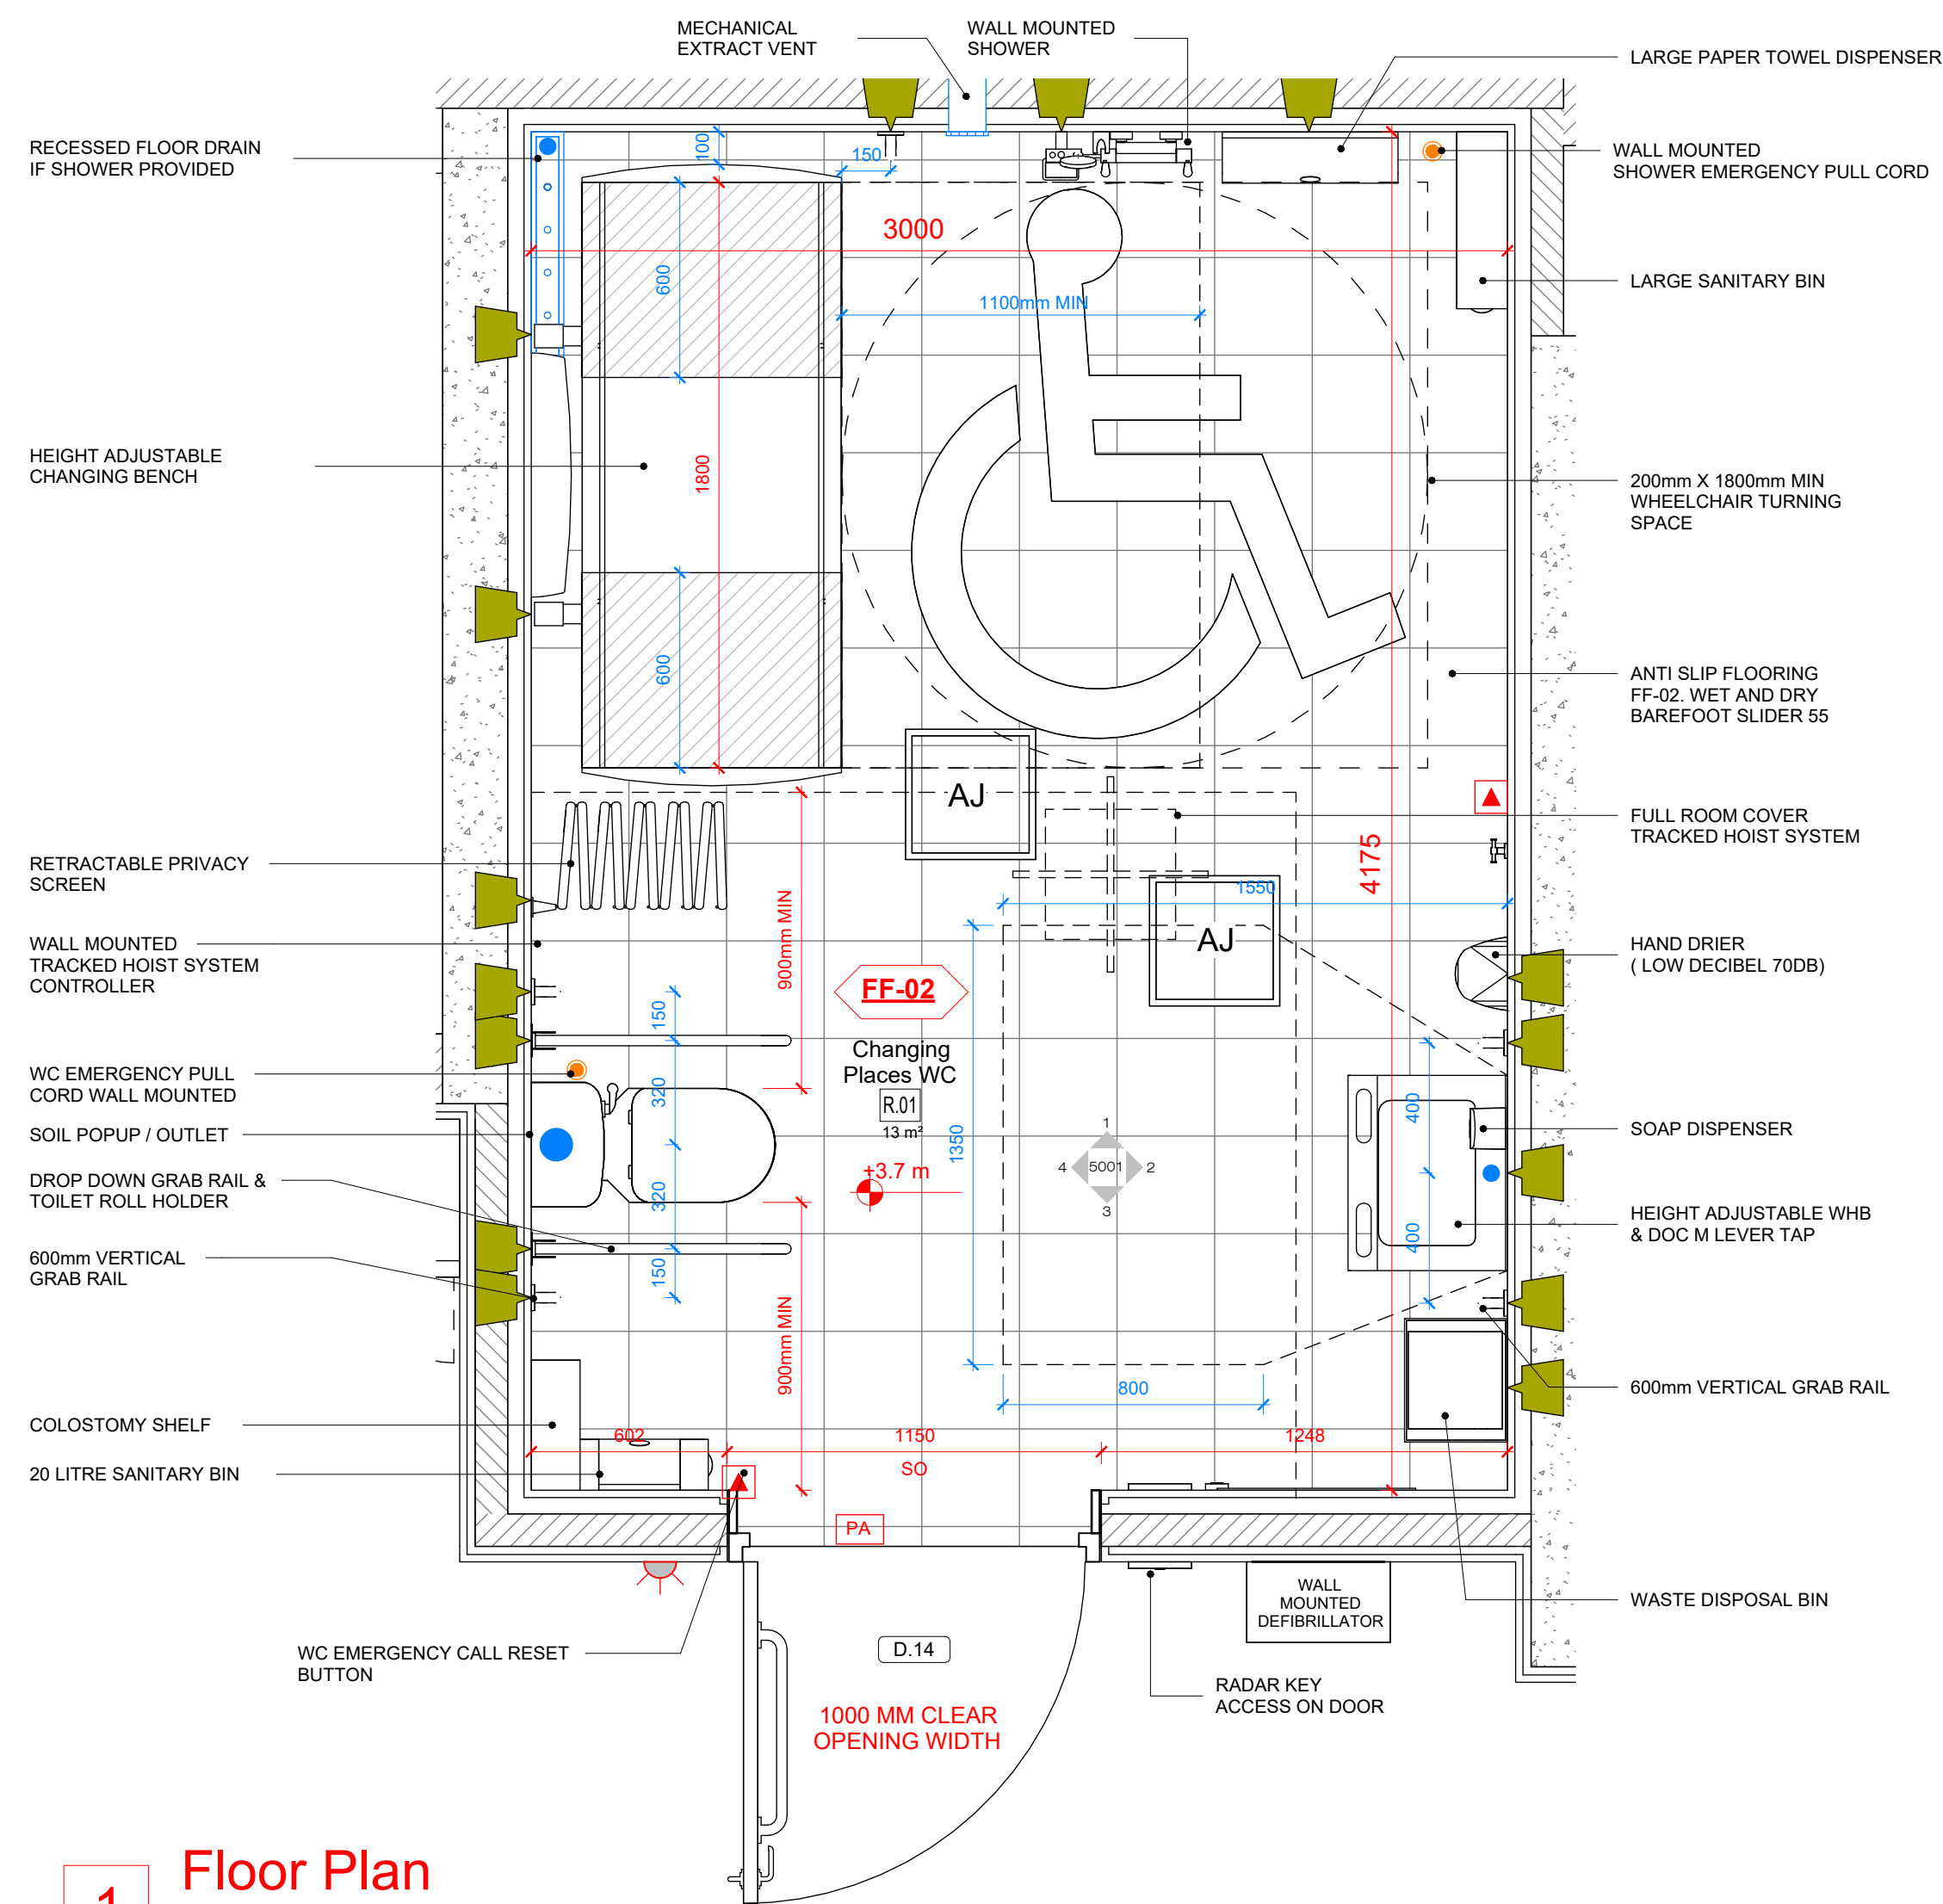

Scale 1 : 20 @A1

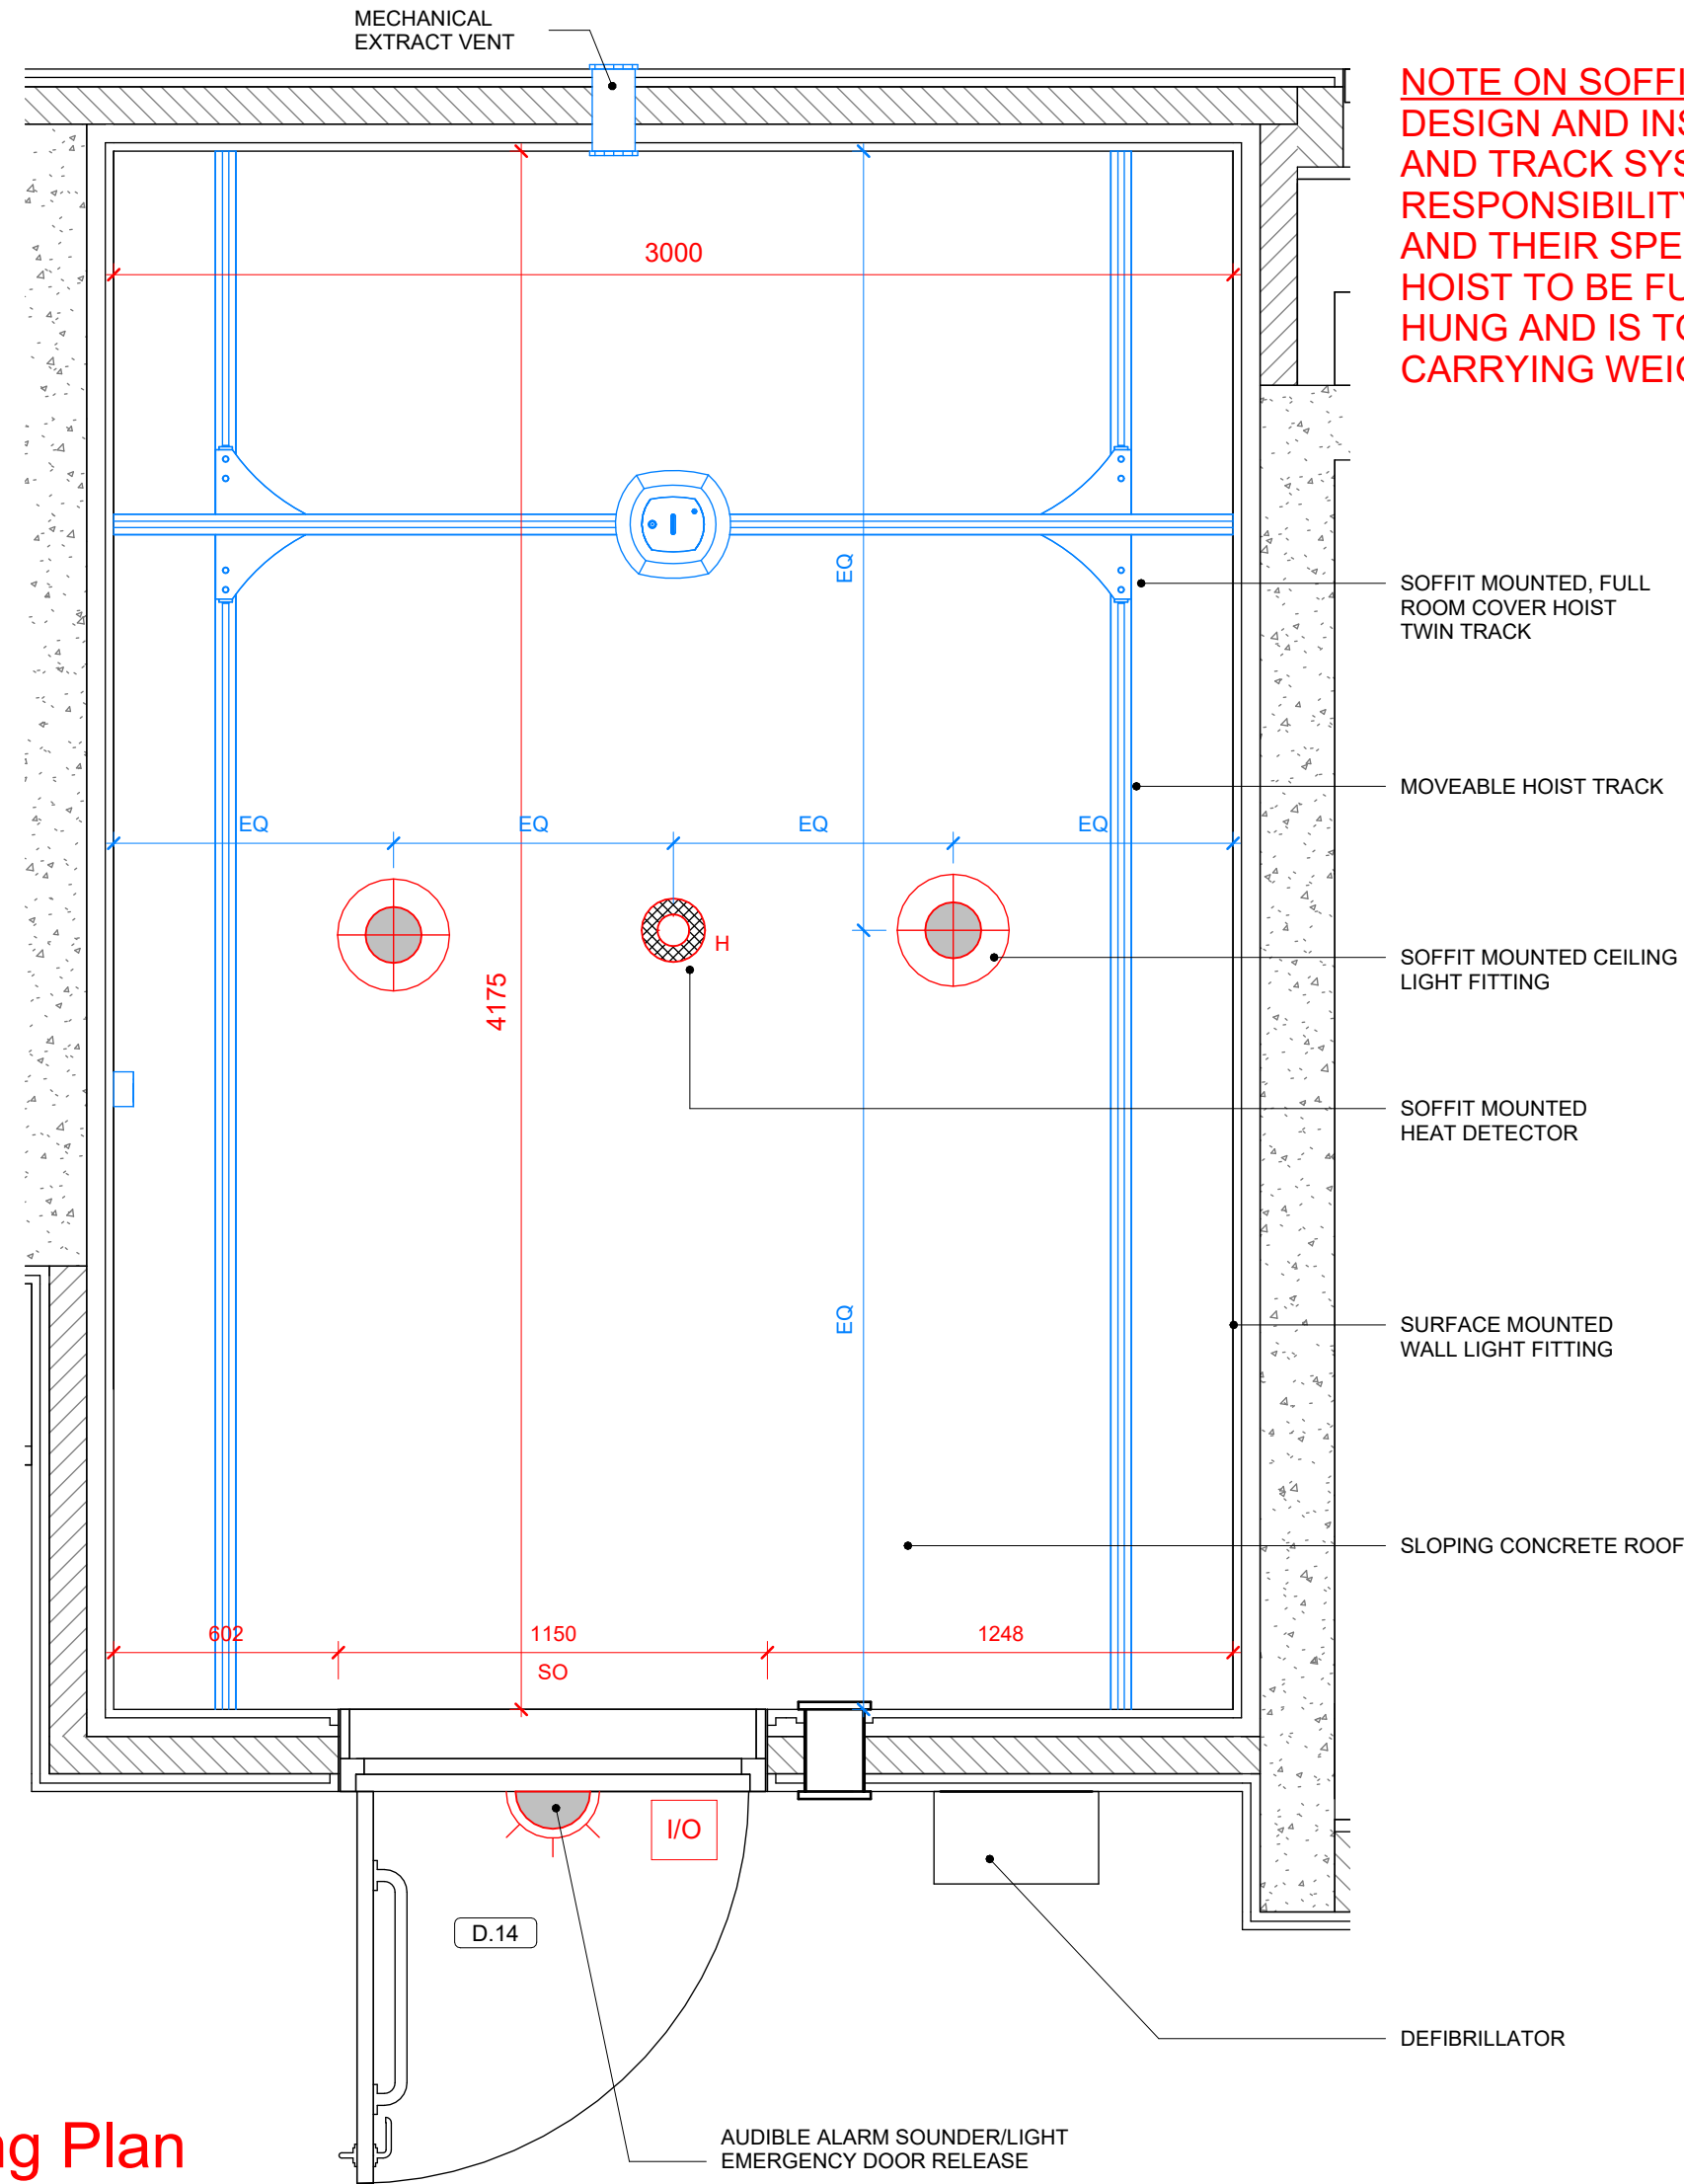

NOTE ON SOFFIT HOIST:
DESIGN AND INSTALLATION OF HOIST
AND TRACK SYSTEM IS THE SOLE
RESPONSIBILITY OF THE CONTRACTOR
AND THEIR SPECIALIST SUPPLIERS.
HOIST TO BE FULLY SOFFIT MOUNTED /
HUNG AND IS TO MEET A MINIMUM
CARRYING WEIGHT OF 200kg

-  GROUNDS REQUIRED 171KG LOADING to drop down rails & shower seat & 131KG for grab rails

NOTE:
Dimensions not to be scaled from drawing.
For any discrepancies found consult with design office.
Copyright © - Cork County Council Architect's Dept.
This drawing to be read in conjunction with all the
Specification Documents.

TO BE CONSTRUCTED IN ACCORDANCE WITH DOC M 1.4.10
SPECIFICALLY 1.4.10 CHANGING PLACES TOILET
SHOWER RAILS NEED TO BE ADJUSTABLE FROM
1050 HIGH TO 1800 HIGH
A COMPLIANT LONGER RAIL MAY NEED TO BE
SOURCED AND SWAPPED OUT
A CONTINUOUS CHARGING FULL ROOM COVER
OVERHEAD TRACKED HOIST SYSTEM SHOULD
BE PROVIDED THAT CONFORMS TO I.S. EN ISO
10535 'HOISTS FOR THE TRANSFER OF
DISABLED PERSONS – REQUIREMENTS AND TEST
METHODS'. SEE DOC M 1.4.10 K.

M&E INDICATIVE ONLY TO BE FULLY
COORDINATED WITH M&E CONSULTANT

All lighting to be energy efficient
LUX LEVEL 200-300 AT FLOOR LEVEL

- | | |
|---|---|
|  | SURFACE MOUNTED CEILING LIGHT WITH EMERGENCY SPOTLIGHT IP65 3200K |
|  | EPOS TERMINAL RECESSED INTO WALL SIZE & FACEPLATE TO BE AGREED |
|  | INTERNAL DOOR LOCK INDICATOR SENSOR SIZE & FACEPLATE TO BE AGREED |
|  | POWER ASSISTED DOOR CLOSER |
|  | PROPOSED POSITION ACCESSIBLE ALARM PANEL & LIGHT |
|  | AUDIBLE ALARM SOUNDER/LIGHT EMERGENCY DOOR RELEASE |
|  | PROPOSED POSITION FUSED SOCKET |
|  | EMERGENCY ALARM RESET BUTTON |
|  | EM EMERGENCY LIGHT 3HR WALL MOUNTED |
|  | EM EMERGENCY LIGHT 3HR SOFFIT MOUNTED |
|  | EM EMERGENCY FLOOD LIGHT 3HR WALL MOUNTED |
|  | SURFACE MOUNTED SMOKE DETECTOR IP 67 |
|  | DISABLED (DAC) ALARM PULL CORD |
|  | INPUT/OUTPUT DEVICE FIRE ALARM |
|  | MECHANICAL EXTRACT VENT (ELEVATION) |
|  | MECHANICAL EXTRACT VENT (PLAN) |
|  | VENT THROUGH TO DUCT |
|  | H HEAT DETECTOR IP 67 |
|  | SURFACE WALL MOUNTED UPLIGHTER ON COLUMN TO LIGHT SOFFIT, IP 67 WITH EMERGENCY LIGHT MOTION DETECTION |
|  | SURFACE WALL MOUNTED EXTERNAL LIGHT IP 67 WITH EMERGENCY LIGHT AND MOTION DETECTION |
|  | SURFACE MOUNTED WALL LIGHT FITTING IP67 3200K |
|  | FIRE EXIT SIGNANCE LIGHT IP 67 |

T.	TENDER ISSUE	13.07.2026
Rev	Description	Date
Revision		

Project Stage: **TENDER**

Roinn na nAiltirí
Seachadadh Caipitil
Halla an Chontae | Corcaigh | T12 R2NC | É
An tAiltire Contae | Marcus O'Colleáin

Architect Department
Capital Delivery Directorate
County Hall | Cork | T12 R2NC | Ireland
County Architect | Mark Collins
T +353-021 428 5430 | architects@cor

Protect Title: **Claycastle Watersports Facility**
Youghal Co. Cork

Drawing Title:

CHANGING PLACES TOILET

Design Team: Cork County Council Architects Department Capital Delivery	Date:	Jan 2023	Dwg No: 50
	Scale:	1:20	
	Sheet:	A1	
	Stage ID:	T	

File. No: **CCWF-CCC- ZZ- 00-DR-A- 5000**

Job No: **ATS1 S 2021 025**