
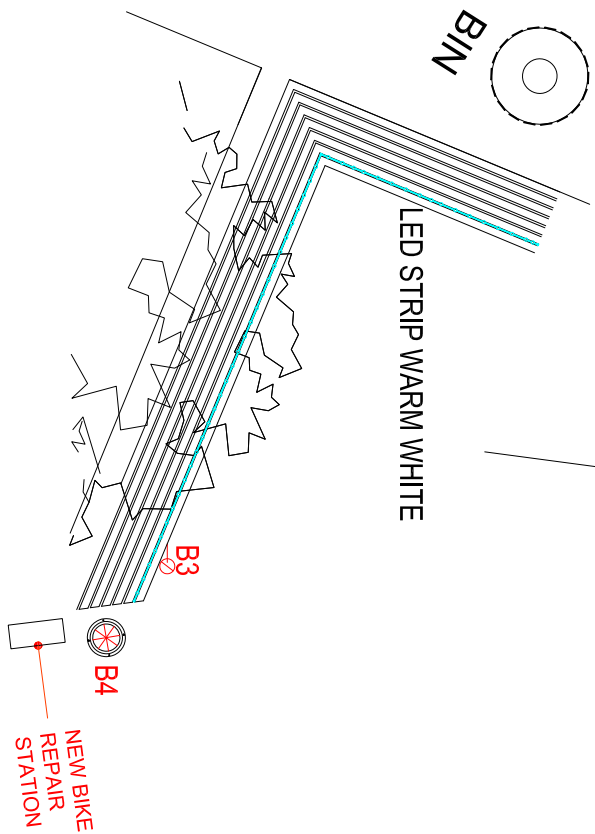
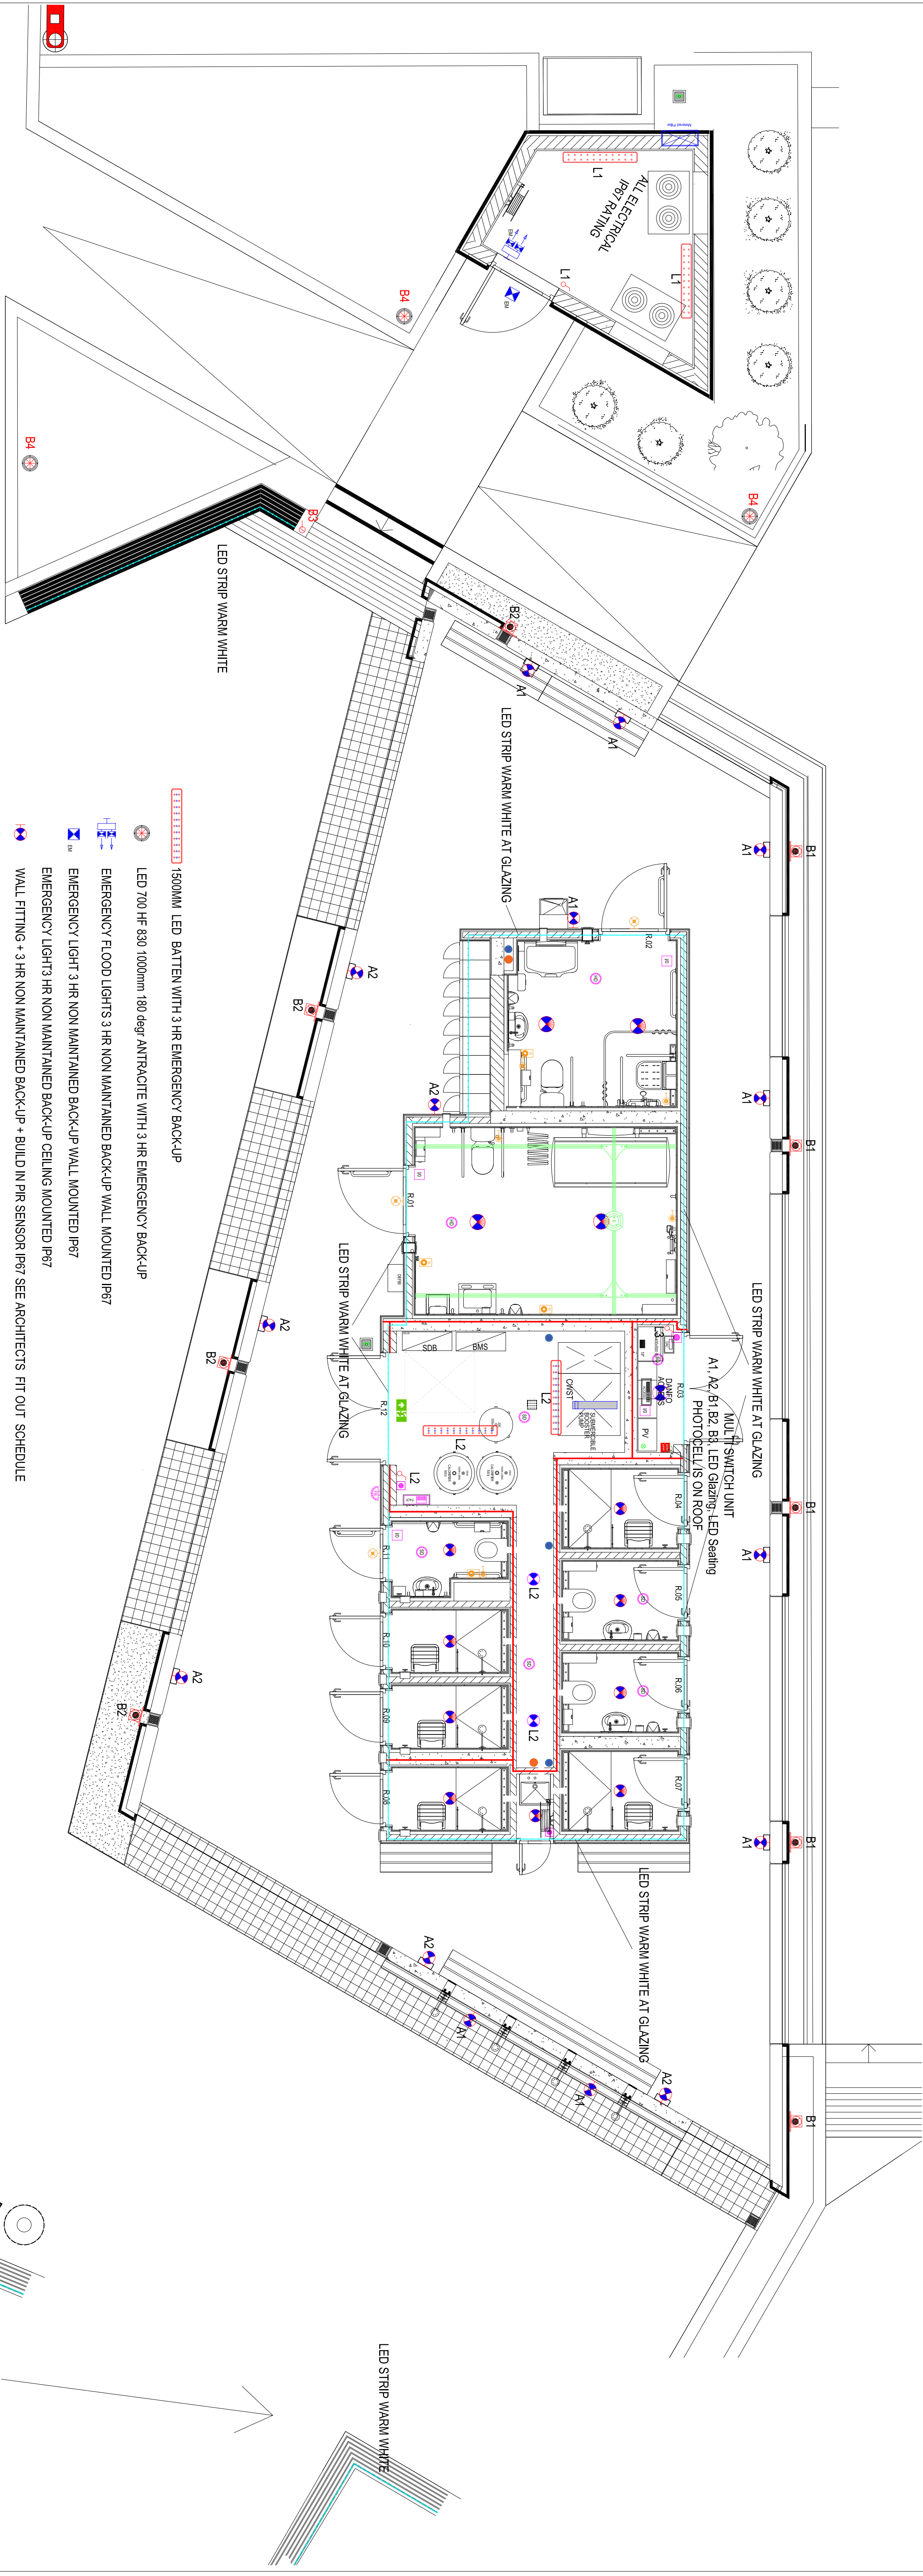


NB : DRAWING SYMBOLS NOT TO SCALE - MAINTAIN MINIMAL 300mm CLEARANCE AROUND SMOKE DETECTORS, AS PER IS 3218:2024 FIRE DETECTION & ALARM SYSTEMS


ALL CONDUITS ETC TO BE ENCASED IN THE CONCRETE BEFORE POURING. NO CHASING ALLOWED. SEE SPECIFICATIONS FOR FURTHER INFORMATION. END OF CONDUITS TO BE CAPPED AS TO PREVENT CONCRETE BLOCKAGES.

ALL ELECTRICAL EQUIPMENT AND WIRING ACCESSORIES TO BE MOUNTED A MINIMUM OF 1000MM ABOVE FFL WHERE POSSIBLE FOR FLOOD RISK MANAGEMENT.

ALL SYSTEMS ARE TO BE CAPABLE OF BEING FULLY DRAINED WHERE FREEZING TEMPERATURES COULD CAUSE DAMAGE TO PIPES AND EQUIPMENT.



- 1500MM LED BATTEN WITH 3 HR EMERGENCY BACK-UP
- LED 700 HF 830 1000mm 180 deg ANTRACITE WITH 3 HR EMERGENCY BACK-UP
- EMERGENCY FLOOD LIGHTS 3 HR NON MAINTAINED BACK-UP WALL MOUNTED IP67
- EMERGENCY LIGHT 3 HR NON MAINTAINED BACK-UP WALL MOUNTED IP67
- EMERGENCY LIGHT 3 HR NON MAINTAINED BACK-UP CEILING MOUNTED IP67
- WALL FITTING + 3 HR NON MAINTAINED BACK-UP + BUILD IN PIR SENSOR IP67 SEE ARCHITECTS FIT OUT SCHEDULE
- CEILING FITTING + 3 HR NON MAINTAINED BACK-UP + BUILD IN PIR SENSOR IP67
- GOLF SLIMLINE MODULAR MULTIWATTAGE 15,18,22 CCT3
- DIRECTIONAL MAINTAINED EXIT LIGHT IP67
- SOUNDER / STROBE, ADDRESSABLE IP67
- SMOKE DETECTOR / SOUNDER / STROBE, ADDRESSABLE
- HEAT DETECTOR / SOUNDER / STROBE, ADDRESSABLE
- BGU / MANUAL CALL POINT, ADDRESSABLE
- DISABLED (DAQ) ALARM PULL CORD
- LOCAL, DISABLED (DAQ) RESET
- LOCAL, DISABLED (DAQ) SOUNDER, INDICATOR LIGHT
- INPUT/OUTPUT DEVICE FIRE ALARM
- UP/LIGHTER RECESSED IP67 LED WARM WHITE 10W
- FIRE COLLAR 1 HOUR
- LED STRIP WARM WHITE IP67 RATED
- SPUR OUTLET SWITCHED FROM MDB ROOM
- ADDRESSABLE FIRE ALARM PANEL WITH DIALING OUT FACILITY
- PUBLIC LIGHT ON 6MTR COLUMN
- SEE DRAWING 2009 FOR SPECIFICATIONS ON LIGHT



COMMENTS	DATE	BY	APPD	CHK	ISSUED DATE	REVISION
	201	214	2026-07-06	1T		

LIGHTING [EM], FIRE/DAC/REFUGE ALARM

FLOOR PLANS

SCALE REF	1:50 A1
DOCUMENT NO	DKP-WA7-1001
CLIENT	Dark County Council
PROJECT NAME	Dark County Council

1001

