



Standard Specification for ESB MV/LV Networks Ducting (Minimum Standards)

Page 1 of 6

Note 1: ESB Networks reserves the right not to accept ducting which does not conform to these standards and dimensions
 Note 2: Refer to ESB Networks for Specific job Specification. These instructions do not apply to 38kV/110kV/220kV cable
 Note 3: All materials (ducts, marker tapes/strips, duct surrounds, mandrels and brushes) must be ESB approved materials




1 MINIMUM depths below finished ground level

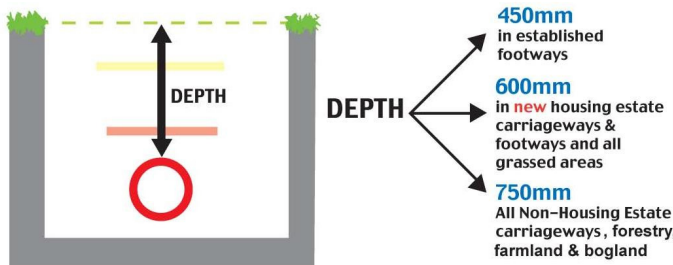

Depth is measured to top of duct
 Max depth is 1m except at:


- service crossings where 1.5m is allowed
- short rail and road crossings where up to 2.5m is allowed

2A Minimum Standard Clearances to Other Services

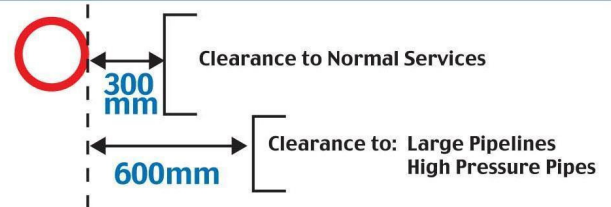


- To achieve these clearances see sections 3D and 3E below
- Clearances less than the above at pinch points and crossings requires placement of additional mechanical protection (concrete slab/brick) and agreement of ESB
- ESB ducts must never be laid over other services on parallel runs, except with the written prior agreement of the other utilities and ESB
- Other Services must never be laid directly over ESB ducts on parallel runs

2B Trench Installation Sequence

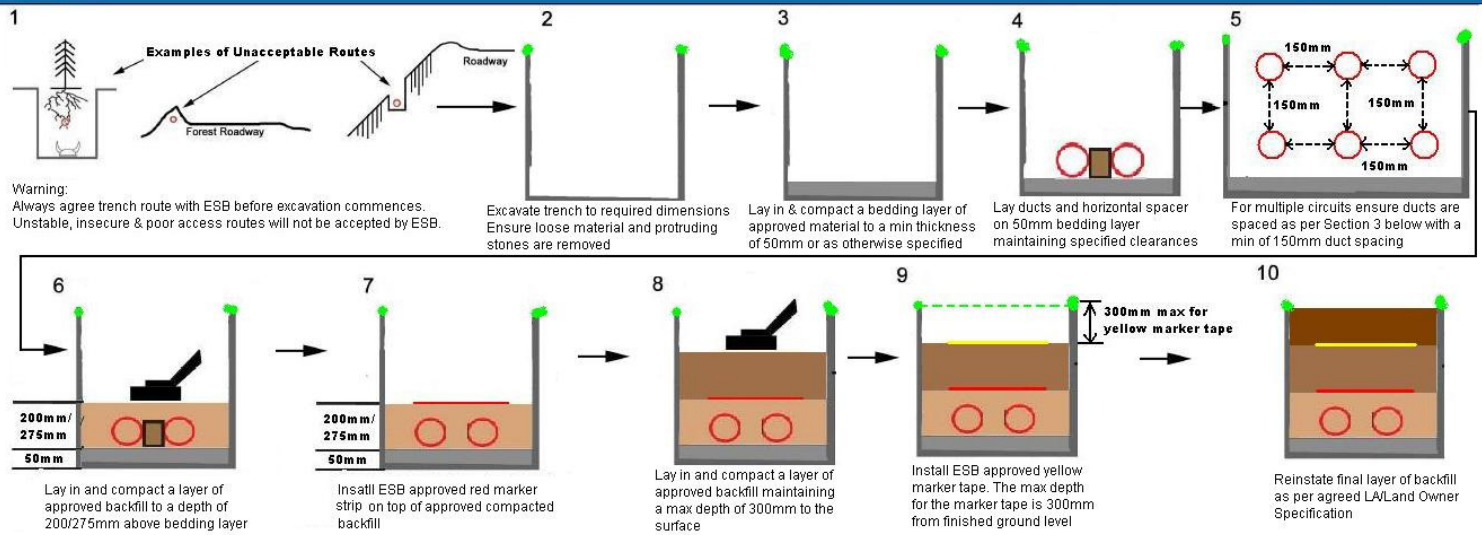

3A Minimum Duct Spacings for ESB Ducts


75mm minimum duct spacing for up to two ducts in any layer

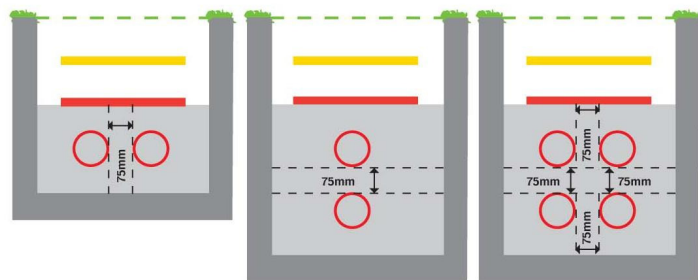

Duct crossovers not allowed at any point along route.

3B Minimum Duct Spacings for ESB Ducts

150mm duct spacing required for more than 2 ducts in any layer

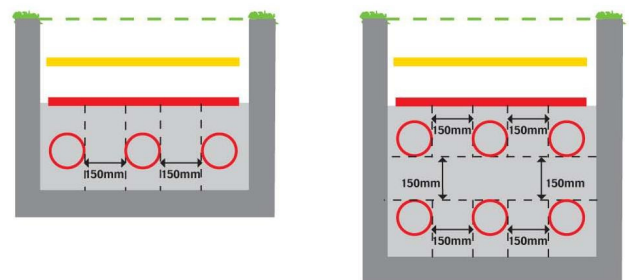

Duct crossovers not allowed at any point along route.

3C Minimum Duct Spacings for ESB Ducts

Minimum duct to trench wall clearances and minimum bedding depths

Minimum duct to trench edge clearance is 100mm and minimum bedding depth is 50mm

NB: 50mm minimum depth of compacted approved backfill above duct top

3D Minimum Duct Spacings for ESB Ducts

Achievement of Horizontal Duct Spacing

Use 75mm or 150mm temporary timber/brick or plastic spacers as appropriate to establish horizontal duct spacing during construction

NB Use 300mm or 600mm horizontal spacers to achieve horizontal spacing from other utilities as appropriate

Always keep a stock of 300mm, 150mm & 75mm spacers for ESB Trenching

Timber/Brick Spacer Or Customised 75mm or 150mm Plastic Horizontal Spacer

3E Minimum Duct Spacings for ESB Ducts

Achievement of Vertical Duct Spacing

STEP 1 Lay in Ducts and horizontal spacer Lay in 50mm bedding Layer

Step 2 Lay in and compact approved backfill to 200/275mm depth depending on spacing in 3A/3B above

Step 3 Check depth of approved backfill above 1st duct layer and lay in 2nd layer of ducts and spacers on top of sand layer

NB. Vertical Duct Spacers are not allowed anywhere as they create point loading of ducts. Refer to 3A/3B for spacings in specific situations

4A Installation of: Special ESB marked Yellow Marker Tape and Special ESB marked Red Marker Strip in Carriageways

ESB yellow marker tape and red marker strip is to be used on all carriageways and on grassed areas for both LV & MV cables

300mm Maximum for ESB yellow marker tape

75mm minimum above duct for ESB red marker strip.

ESB yellow marker tape and red marker strip widths must always be wider than ducts beneath

ESB yellow marker tape and ESB red marker strip must never be laid directly on top of ducts

Never lay other utility marker tape or strip over ESB ducts

Never lay ESB marker tape or strip over other utility pipes

4B Installation of Special ESB marked Yellow Marker Tape in all Footways

ESB approved yellow marker tape to be used on all Footways

300mm Maximum for ESB yellow marker tape

ESB yellow marker tape width must always be wider than width of ducts beneath

ESB Yellow marker tape must never be laid directly on top of ducts

Never lay other utility marker tape or strip over ESB ducts

Never lay ESB marker tape or strip over other utility pipes

CAUTION
ELECTRIC CABLE

5 Specification for duct surround material

The thermal resistivity of the duct surround material must be maximum 1.0km/watt @0% moisture content. Only ESB approved unwashed sand graded to BS882 standard or equivalent ESB approved material is acceptable.

Duct surround material must be well compacted around ducts without damaging the ducts

NB: Pea gravel and foam concrete are unacceptable ESB duct surround materials

Grading Curve for Good Sand Surround for MV and LV Cable

Particle Size (mm)	Cumulative % Passing
0.075	10
0.15	25
0.3	50
0.6	75
1.2	90
2.5	95
5.0	98
10.0	100

6A Specification for Installation of Ducts at sharp route bends

ESB Approved Long Radius Bend (minimum Duct Bend Radius 1.2 Metres) Bends less than 1.2 m radius are unacceptable

400mm 10N Minimum strength concrete on inside of bend to withstand cable pulling forces

Cross Section at bend Showing concrete support all around the duct and increased trench width

Wider trench to accommodate 400mm of concrete on inside of bend

Normal Trench Width

6B Specification for Installation of Ducts at Gentle sweep bend positions

6m length straight pipe

Sharp Inner end of duct protrudes at joint due to bending stiffness. Never bend ducts as sharp ends will protrude at joints as illustrated; result serious ripping/damage to cable

Always use a series of 11, 22 or 45° bends to provide a smooth joint interface where the trench route curves around in a large sweep. Never bend ducts around a large sweep trench

Concrete support as for item 6A

7 Obligation of Duct Installer to minimise the number and severity of duct bends

The duct installer must minimise the number and severity of preformed bends in ground with obstructions and other utility service crossings by opening ground 12m ahead of backfilled duct, wherever practical to do so. This safety obligation, which may require use of steel plating, allows the duct installer to pick the least bendy duct route through utility crossings and obstructions. Otherwise, numerous sharp unrecorded duct route deviations will be present making cable installation considerably more difficult and less safe for the cable installer.

Obstructions

Backfilled Duct

Digger

Dig 12m Ahead of duct to uncover obstructions

8 Standard for Brushing, Mandrelling Roping and End-capping of MV/LV Ducts

All Ducts must be:


- Thoroughly brushed and mandrelled to prove ducts against debris/excessive deflection
- Roped using 12mm polypropylene rope with certified safe breaking load of 1.5 tons – all rope joints to be properly spliced and PVC taped over. Approved Supplier Silver Strand Bunclana Donegal, ph (074) 9382503 - 500m drum lengths available to minimise splicing/coil handling
- Sealed using endcaps against grit and water getting into them
- NB: Replace mandrels once mandrel wear indicators or grooves are worn down
- Replace brushes once brush diameter falls 5mm below dimensions in table below
- Approved endcaps, both disposable and reusable types, are available from suppliers of approved ESB ducting
- Approved ESB Mandrel and brush suppliers:

Brandon Agencies, Rathnew, Co Wicklow: Phone 0404 20500 (Brushes & Mandrels)
 IS Varian, Greenhills Industrial Estate, Walkinstown, Dublin 12: Phone: 01-4501150 (Brushes Only)
 Clydesdale UK Phone 086 172 6665 (Brushes & Mandrels)
 Tynagh Network Systems, Loughrea, Co Galway: Phone: 091 842206 (Brushes & Mandrels)


125mm uPVC Duct Size	160mm uPVC Duct Size
125mm Mandrel Code: 9317547	160mm Mandrel Code: 9317548
125mm Brush Code: 8783254	160mm Brush Code: 8783251

9 Guidance on Correct Direction to Lay Spigot and Socket Ducting


Case 1 Duct run with all bends at one end

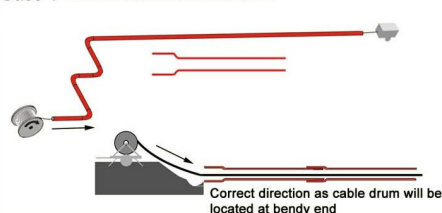


Case 2 (a)



Case 2(b)

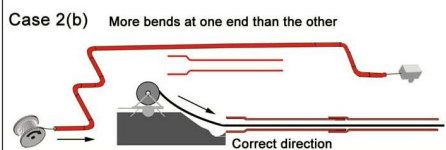


Case 3 Trenching routes longer than 500m

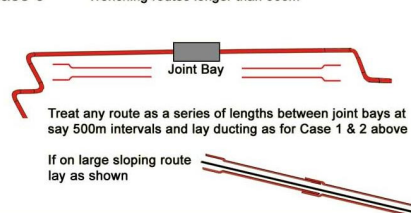

10 Approved ESB Ducting for MV/LV Cables

- Use only solid wall high impact resistance ESB approved PVC red ducting to IS 370 colour standard and ESB specification 16113 (3.8mm minimum wall thickness) Discoloured or unidentified ducting not acceptable. All duct material must be approved by ESB Networks.
- Lightweight flexible corrugated twinwall ducting is not acceptable to ESB irrespective of manufacturer
- Current approved Duct and duct bend manufacturers are: Lynplast (bend fittings only) Radius Systems, Wavin, Quality Plastics, MFP Plastics, Cork Plastics, Emtelle


11 Specification for Duct Jointing for MV/LV Cables

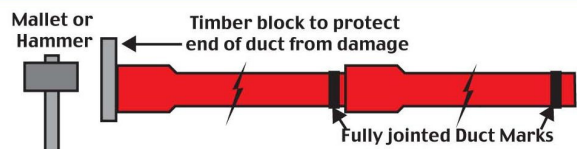

All ducts to be securely jointed by tapping against timber board on each duct until the black depth insertion mark is reached

12 Repair of Existing Ducts

Use only approved slip couplers from approved manufacturers in section 9

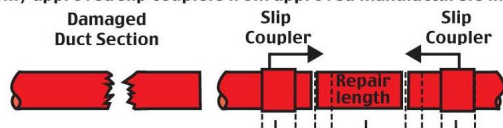

- Cut out damaged section of duct and ensure all cut surfaces are square and free from sharp edges
- Slide, position and centre the repair couplers on the centering marks

13 Sealing of Ducts

All ducts to be permanently sealed at both ends of duct run
Ducts to be temporarily sealed during installation using endcaps provided with each bale




ESB Code 125mm: 9317583 ESB Code 160mm: 9317566

14A Cross-Sectional Drawing of Backfilling in Front of MV Sub




See pg. 213 of MV/LV Manual

14B Plan View of Ducting in Front of Substation

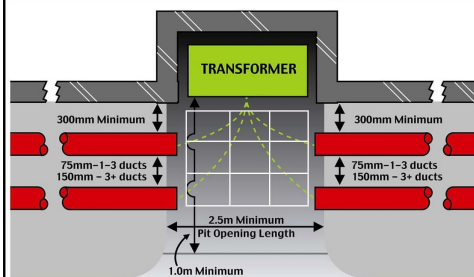


See pg. 212 of MV/LV Manual

17A Supporting ESB Cables/Ducts During Trenching Works

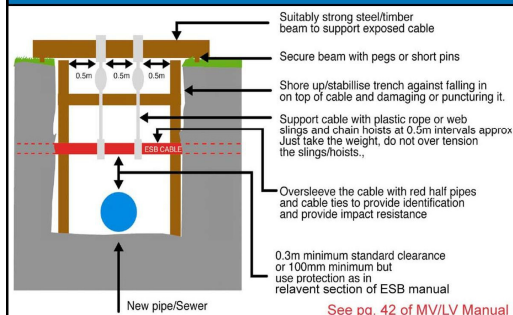


See pg. 42 of MV/LV Manual

17B Supporting ESB Cables/Ducts During Trenching Works

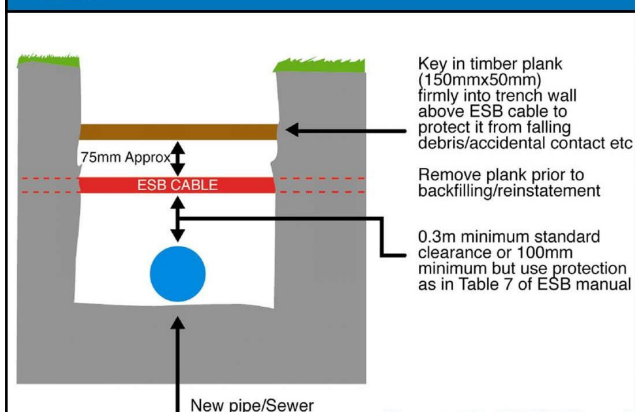


See pg. 42 of MV/LV Manual

18 Avoidance of Cable Damage Due to Improper Backfilling at Cable Crossings

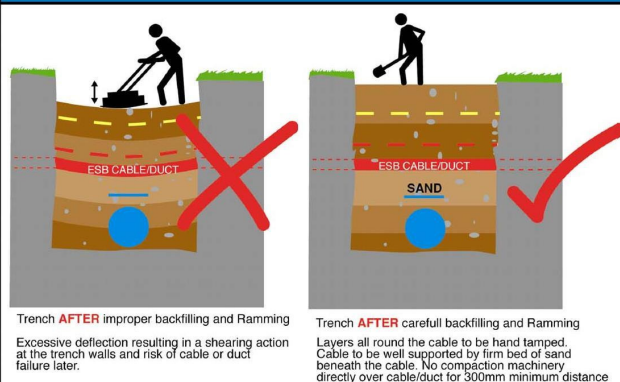

See pg. 44 of LV/MV Manual

19 MV/LV Trench Dimensions & Duct Clearances for 125mm Ducting Layouts

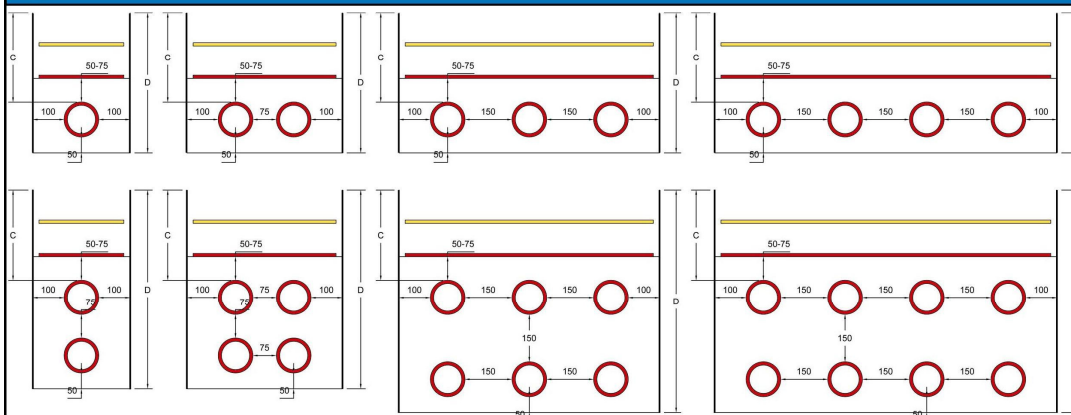

Minimum Trench Widths for 1 & 2 Rows of Ducts

No. Of Ducts in Row	1	2	3	4	5	6
Minimum Trench Width	325	525	875	1150	1425	1700


Minimum Trench & Duct Depths for 1 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	775	625	925	925
Minimum Depth to top of Duct (G)	600	450	750	750

Minimum Trench & Duct Depths for 2 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	975	825	1125	1125
Minimum Depth to top of Duct (G)	1050	900	1200	1200
Minimum Depth to top of Duct (G)	600	450	750	750

20A Bridge Crossings: Restricted Footpath Designs

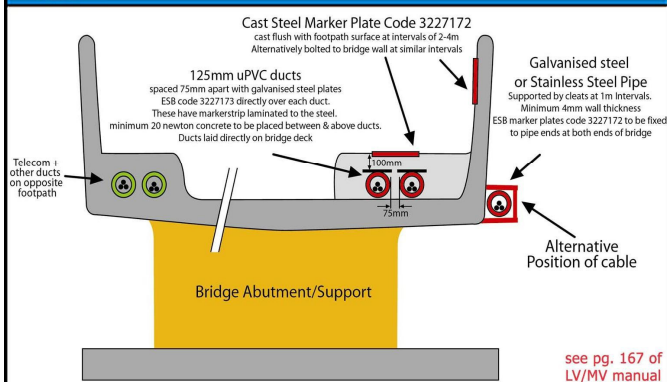


see pg. 167 of LV/MV manual

20B Bridge Crossings: Restricted Footpath Designs

1. The design must be agreed with the bridge authority. Position in footpath is preferred.
2. Minimum cover over ducts on footpath 100mm.
3. Where duct cover is > 300mm, marker strip & surface marker plates can be used.
4. Red uPVC ducting is not suitable for cable run external to bridges.
5. Where possible galvanised steel/stainless steel piping should be used, all joints must be free of weld burrs on inside. Alternatively heavy duty 10mm wall thickness black HDPE material with cast steel marker plates attached must be used to permanently warn of presence of electric cable.


see pg. 167 of LV/MV manual

21A River/Stream Crossings: Standard Where Burial/Drilling is possible

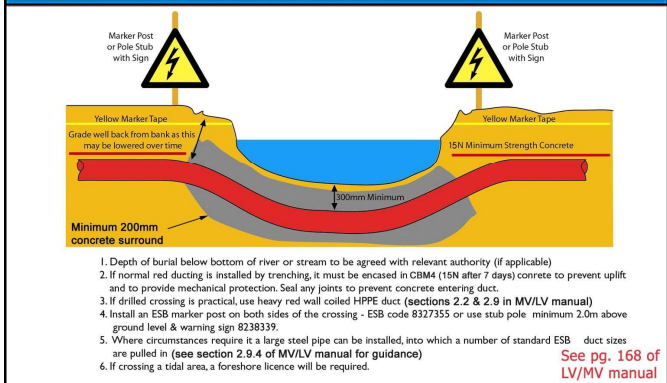


See pg. 168 of LV/MV manual

21B River/Stream Crossings: Standard Where Burial/Drilling is not possible

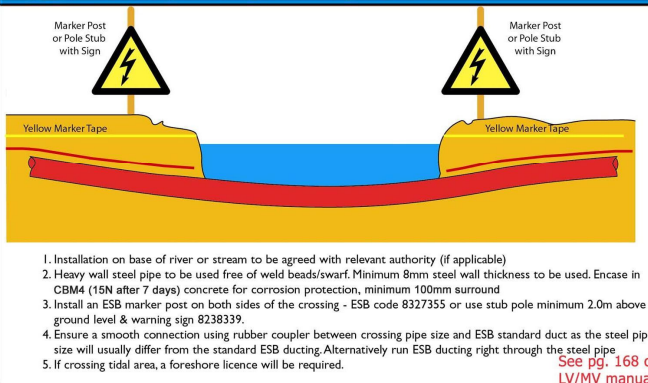

See pg. 168 of LV/MV manual

22A Minimum Standard Over Basements/Carparks

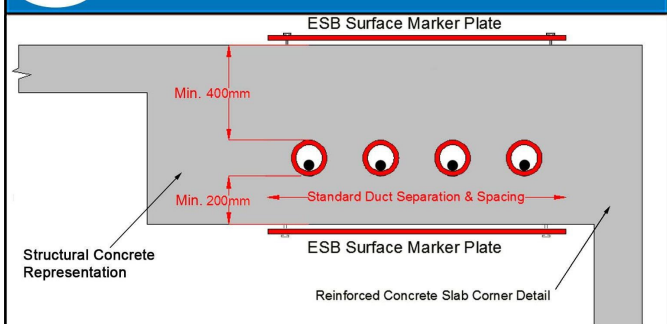

22B Minimum Standard Over Basements/Carparks

Minimum depth of duct is 400mm.


Minimum thickness from bottom of duct to underside of slab is 200mm.

ESB surface marker plates are to be placed at approximate intervals of 3 metres on the top and bottom surfaces of the slab.

Marker plates are to be cast level with the surface and screwed down to avoid lift off (ESB code: 3227172)

For ESB Ducts concrete surround - same strength for entire slab

23 MV/LV Trench Dimensions & Duct Clearances for 160mm Ducting

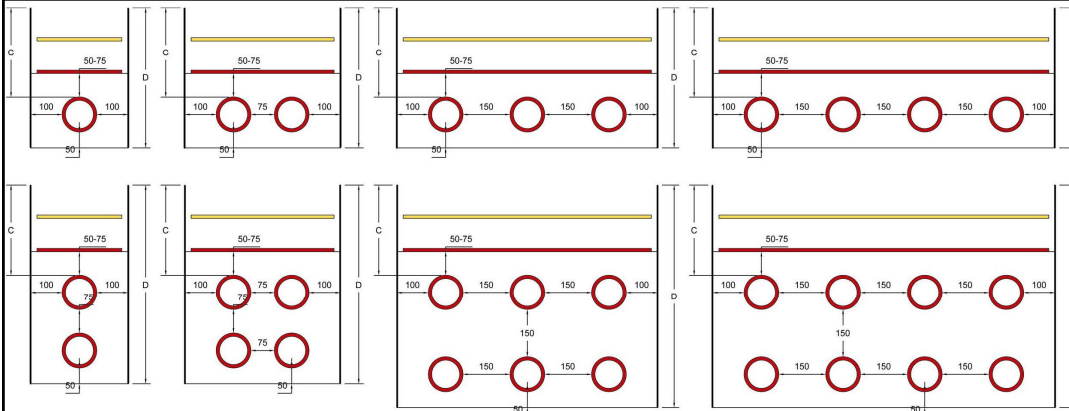

Minimum Trench Widths for 1 & 2 Rows of Ducts

No. Of Ducts in Row	1	2	3	4	5	6
Minimum Trench Width	360	595	980	1290	1600	1910


Minimum Trench & Duct Depths for 1 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	810	660	960	960
Minimum Depth to top of Duct (C)	600	450	750	750


Minimum Trench & Duct Depths for 2 Horizontal Row of Ducts

Location of Trench	New Housing Scheme Footpath, road & Grass Areas in Vicinity	Existing Footpaths	Existing or New Roads Other Than New Housing Scheme	Farmland, Forestry tracks & Bogland
Minimum Trench Depth (D)	1045	895	1195	1195
Minimum Depth to top of Duct (C)	1120	970	1270	1270
Minimum Depth to top of Duct (C)	600	450	750	750


24A MV Cable End Pole Position - Elevation

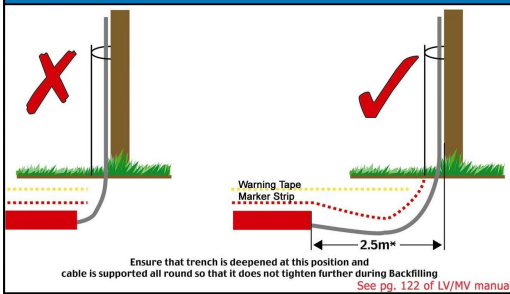

24B MV Cable End Pole Position - Plan View

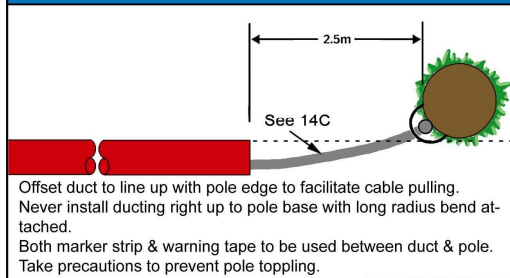


24C MV Cable End Pole - Marker Strip/Tape

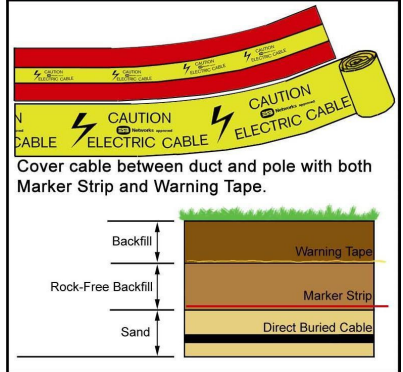


24D LV Cable End Pole Position - Elevation

Ducting For LV Mains and LV Service Cable

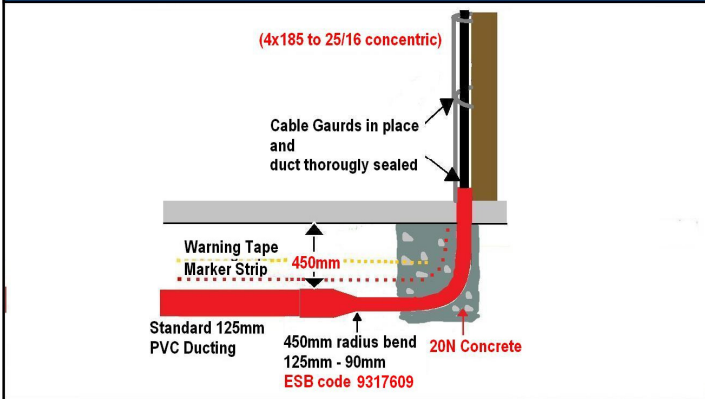


24E LV Cable End Pole Position - Plan View

Ducting for LV Mains and LV Service Cable

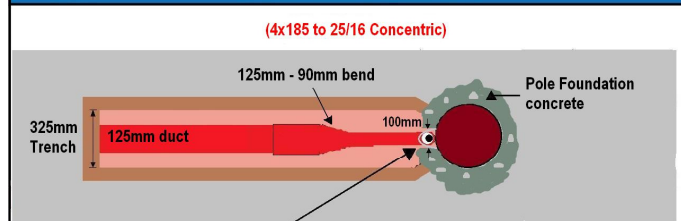


1. Cut channel into pole concrete foundation to allow for the vertical section of the duct bend to lie against the pole
2. Place duct bend into position
3. Backfill and support bend with 20N concrete mix as per elevation view

25 A LV Ducting for Non Domestic Connections Duct laid to Mains Cable

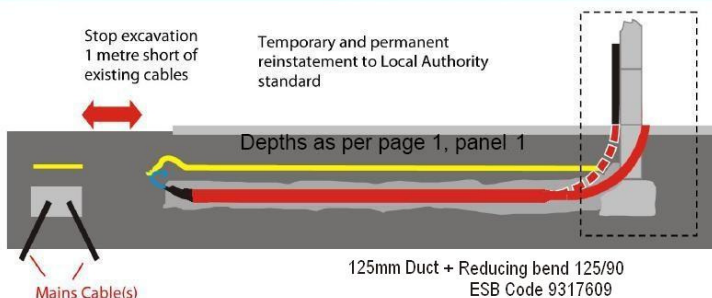

- General Note for all Cases:**
- 1: Excavation within 1 metre of existing cables must only be carried out by hand and with agreement of the local ESB Networks office. This is to prevent damage to existing cables and consequent safety risk for workers.
 - 2: Liaise with ESB Networks to confirm location of all cables.
- All Excavation work to be in accordance with HSA Code of Practice

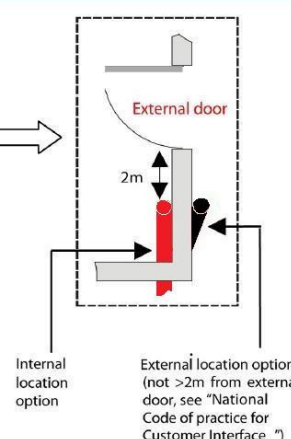


25B

LV Ducting for Non Domestic Connections Duct laid to Mini Pillar Location

The new duct must only be put into the vault with an ESB Networks person present

If no vault in front of minipillar, the limit of excavation must be agreed with ESB Networks personnel locally.
Temporary and permanent reinstatement to Local Authority Standard.

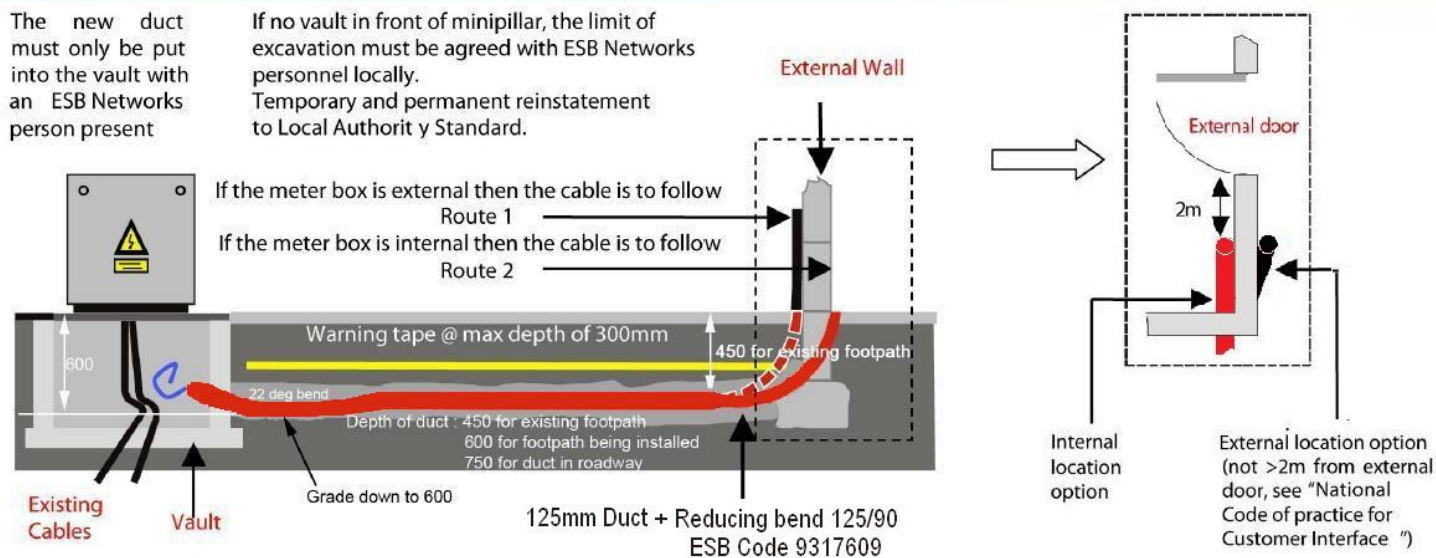

26

Specification for Standard Non-Scheme Domestic Underground Service to an Outdoor Meter Cabinet (low-voltage service not exceeding 50m) from an Overhead Network



The Customer must ensure that:

- The service pole and the complete run of the duct are both within the site boundary. ESB's Engineering Officer will confirm the service pole position and the ducting route on-site.
- An outdoor meter cabinet, to ESI Standard 12-3 (1986), is installed in a suitable location, see overleaf.
- An ESB approved "hockey stick" is installed at the meter cabinet position.
- Red ESB approved 50mm service ducting is installed at a minimum depth of 600mm between the hockey stick position and the service pole. Yellow ESB cable warning tape must be installed at a maximum depth of 300mm below ground level along the full length of the duct.
- Corrugated Ducting of any colour is not permitted.
- The duct shall be as straight as possible and free of sharp bends.
- A continuous and strong 10mm polypropylene draw rope is installed in the duct. It must be free of knots and secured at both ends of the duct.

Notes:

- It is essential that the ESB cable does not come into contact with the cavity insulation. Allow a projection of 25mm of the hockey stick into the base of the cabinet.
- There must be a minimum clearance of 100mm between the service duct and other services on the house-holder's property.
- ESB will provide black UV light-resistant ducting from below the finished ground level to the top of the service pole.
- For poles more than 50m away from the cabinet, 125mm red ESB approved ducting shall be used with an ESB approved service vault at the junction of the duct and the hockey stick.

Connection will only be made after all above requirements are met.

