
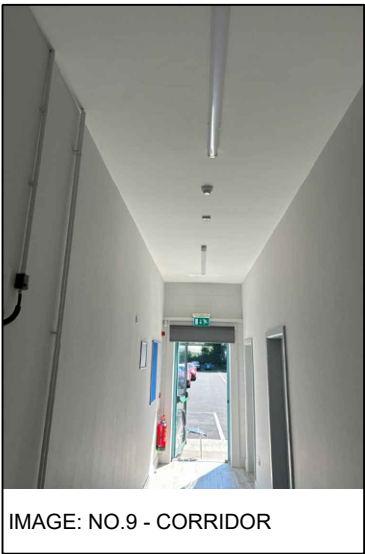
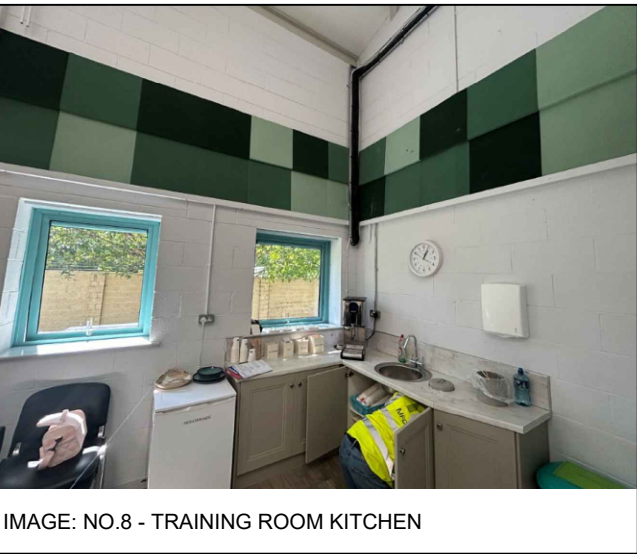
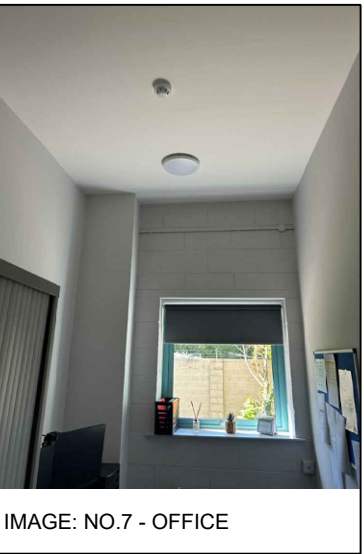
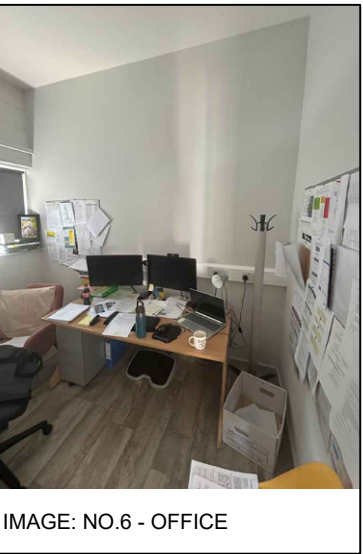
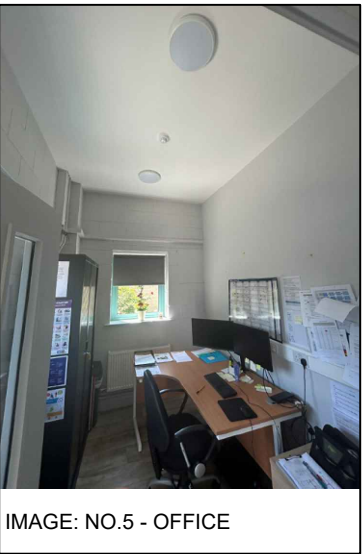
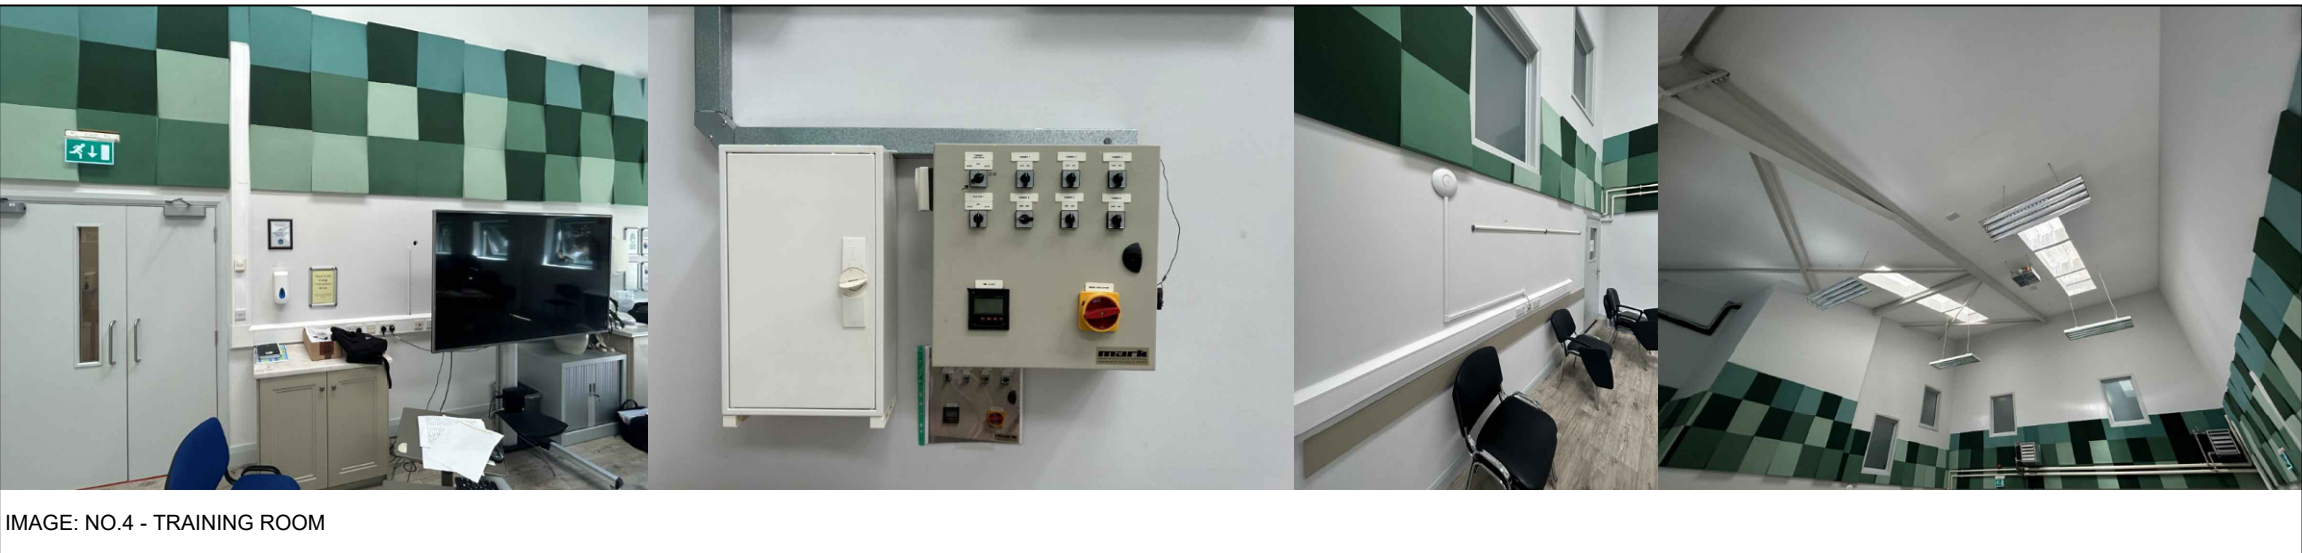
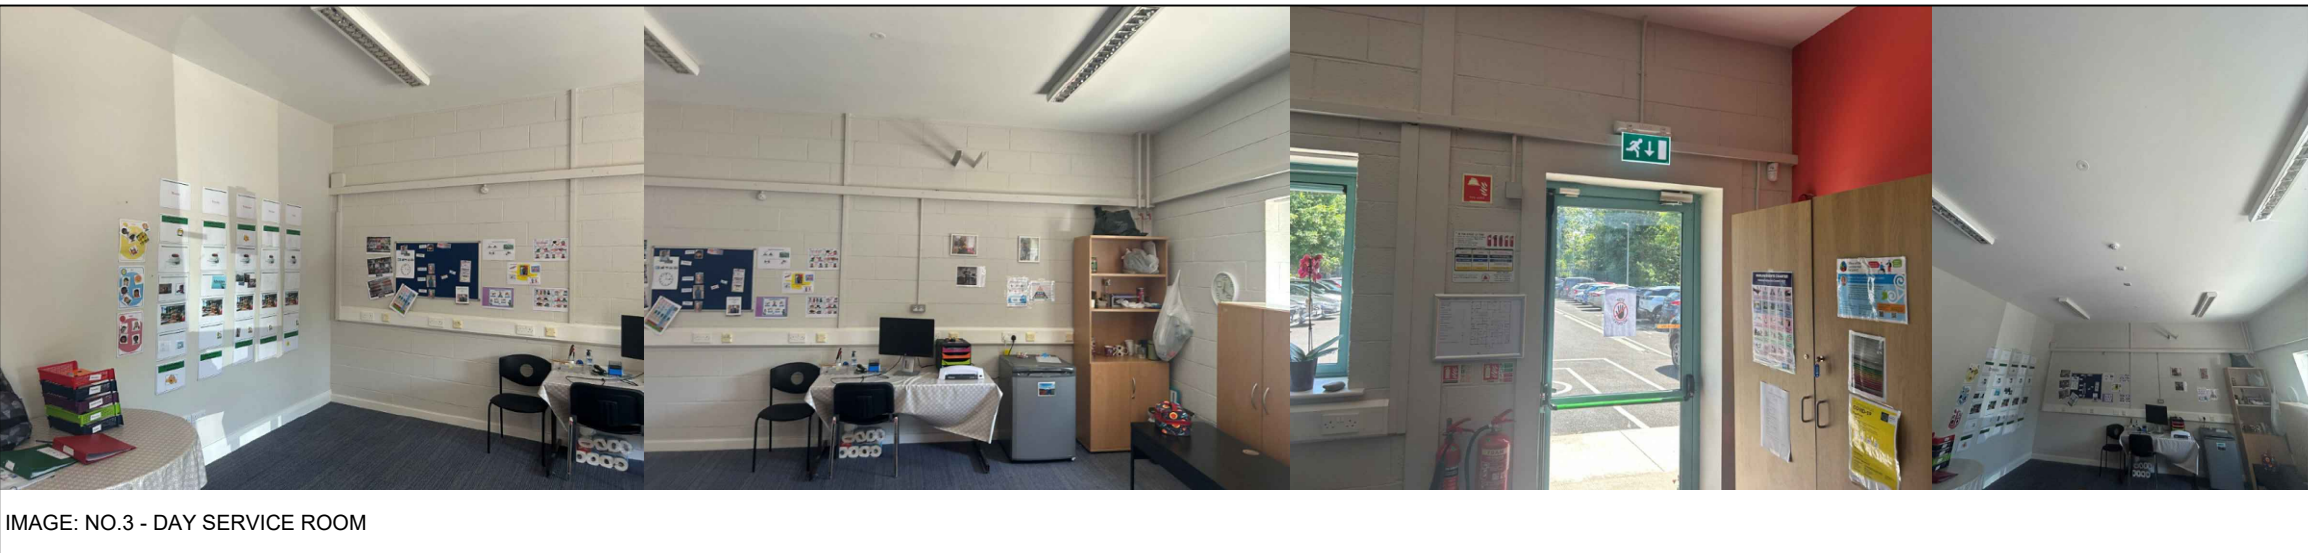
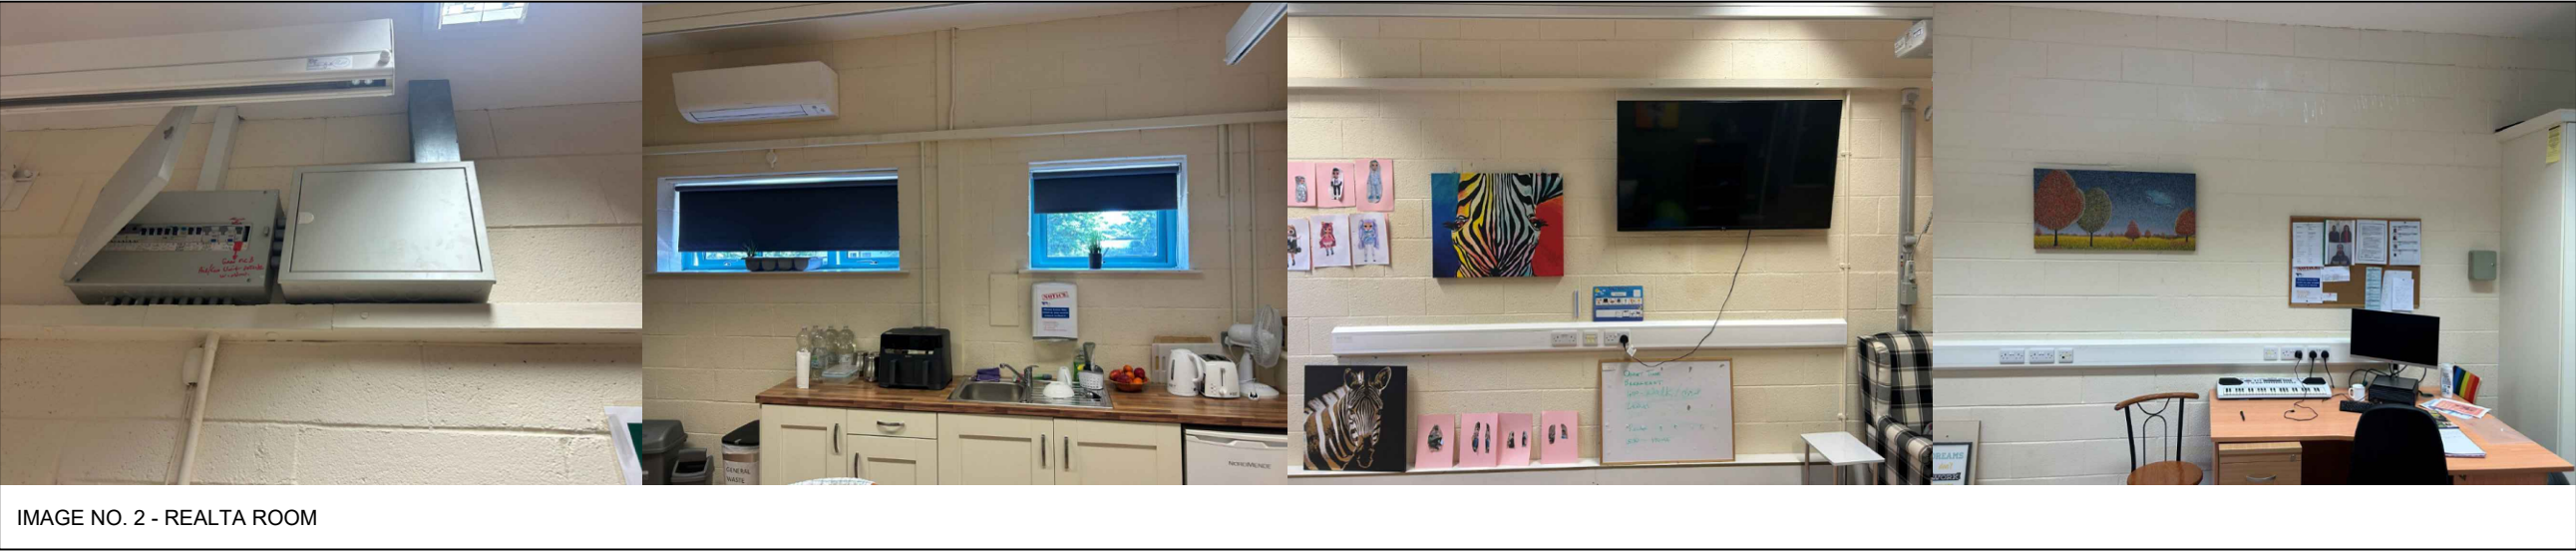


NOTES:

1. ALL CEILING MOUNTED SERVICES TO BE STRIPPED OUT AND REMOVED FROM SITE.
2. ALL WALL MOUNTED SERVICES TO BE RETAINED, IE DADO SOCKETS AND H/L TRUNKINGS FINAL SUB-CIRCUITS TO BE RE-WIRED TO MAIN DB.
3. ALL LIGHTING TO BE RE-WIRED COMPLETELY TO NEW MAIN DB.
4. ALL DATA POINTS TO BE RE-WIRED IN CAT6A TO EXISTING COMMS ROOM.
5. FIRE ALARM LOOPS ON BOTH FLOORS TO BE TEMPORARILY CLOSED OUTSIDE CONSTRUCTION ZONE TO ALLOW STRIPOUT OF EXISTING SYSTEM.
6. LOCAL DB'S IN REALTA SPACE AND TRAINING ROOMS TO BE STRIPPED OUT AND REMOVED FROM SITE.
7. EXISTING MAIN DB TO BE STRIPPED OUT AND REPLACED.

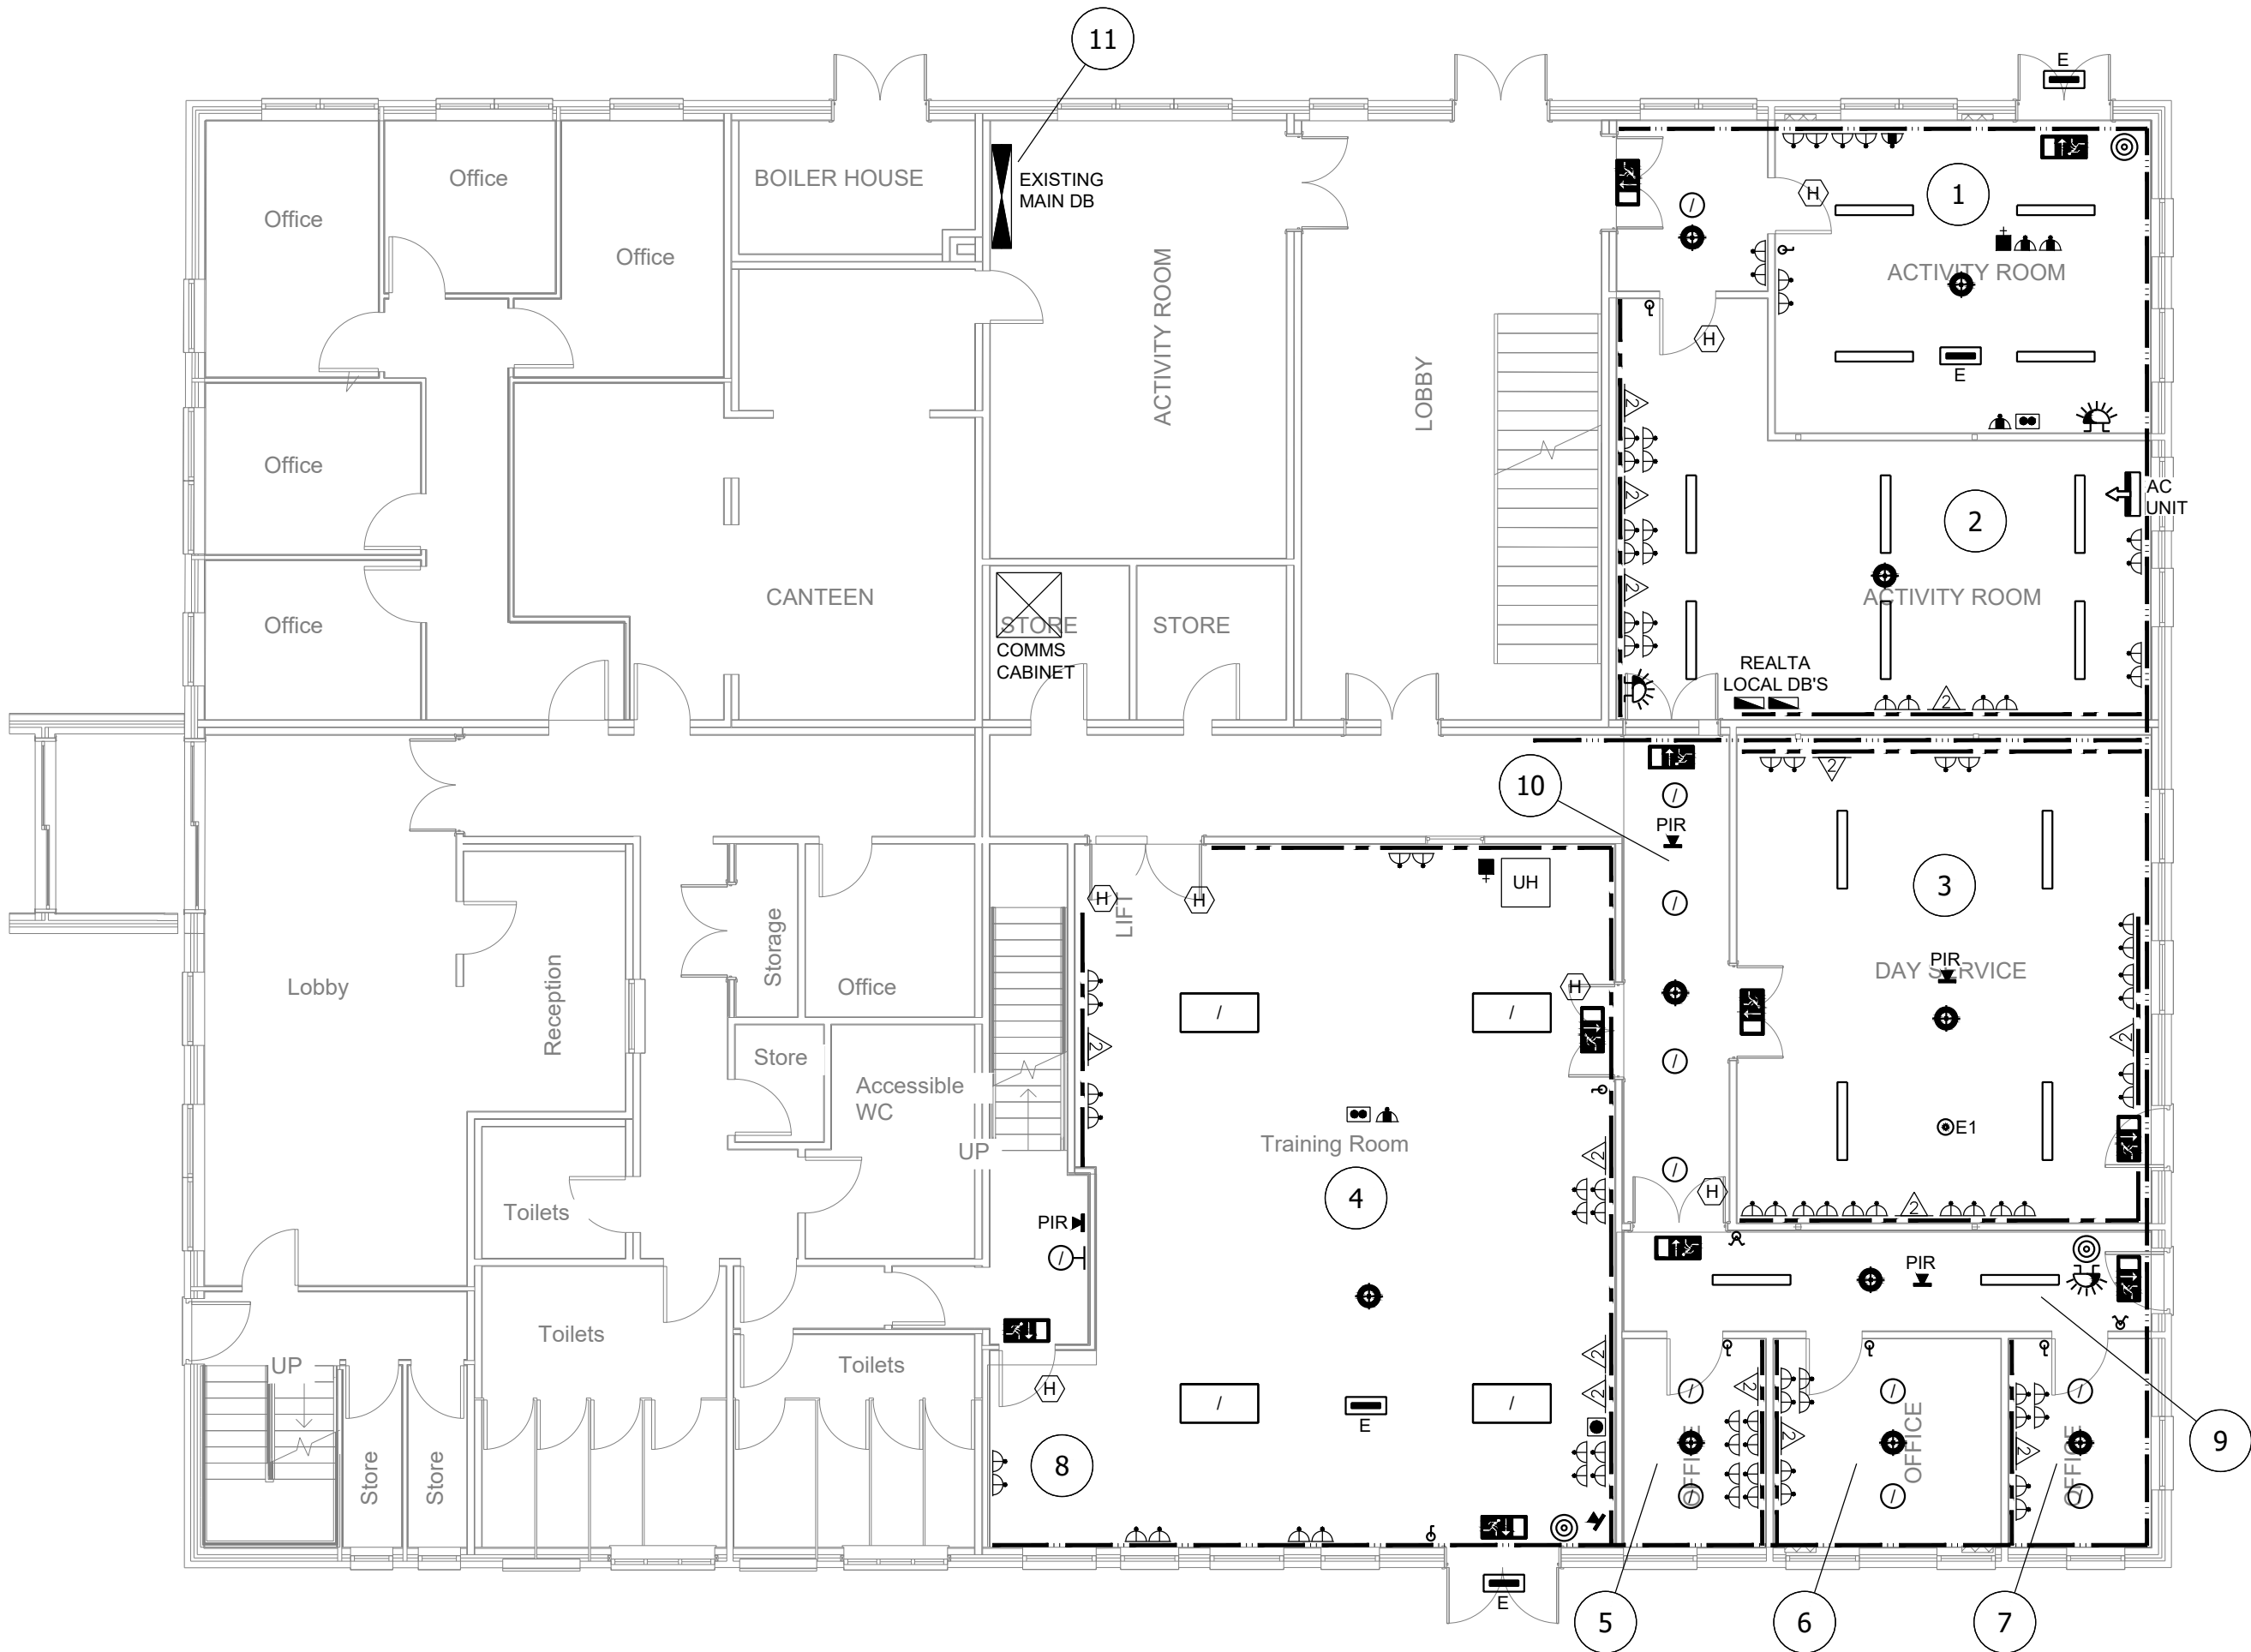

Copyright: ©

No part of this document may be re-produced or transmitted in any form or stored in any retrieval system of any nature without the written permission of the consultant as copyright holder excepts as agreed for use on the project for which the document was originally written.

General notes:

This drawing to be read in conjunction with all relevant architectural drawings and specifications.

This drawing to be read in conjunction with all relevant structural drawings and specifications.

This drawing to be read in conjunction with all relevant mechanical and electrical drawings and specifications.

All dimensions in millimeters, do not scale from this drawing, only use figured dimensions only.

Contractor must verify all dimensions on site prior to installation of services and production of working drawings.

Legend:

SYMBOL	DESCRIPTION
	OPTICAL SMOKE DETECTOR
	MANUAL CALL POINT C/W LID
	FIRE ALARM SOUNDER C/W FLASHING BEACON
	DOOR HOLD DEVICE
	MAINTAINED EXIT
	RECESSED LED EMERGENCY SPOT
	RECESSED EMERGENCY BULKHEAD
	13A SWITCH TWIN SOCKET LOW LEVEL - 450MM AFFL
	13A SWITCHED FUSED CONNECTION UNIT
	ISOLATOR
	2 GANG CAT 6A DATA POINT
	1 GANG RG59 TV POINT
	EV CHARGING POINT
	INLINE EXTRACT FAN
	FAN INFRA RED DETECTOR
	DOOR HOLD DEVICE
	UNIT HEATER CONTROLLER
	FIREFIGHTER ISOLATION SWITCH
	DADO TRUNKING TO BE RETAINED
	50X50 GALVANISED LV TRUNKING AT HIGH LEVEL TO BE RETAINED
	75X75 GALVANISED LV TRUNKING AT HIGH LEVEL TO BE RETAINED
	H/L HIGH LEVEL - 2200MM AFFL
	L/L LOW LEVEL - 450MM AFFL
	B/L BENCH LEVEL - 1100MM AFFL
	BOILERHOUSE CONTROL PANEL
	SUB-DISTRIBUTION BOARD
	SINGLE POLE ONE WAY SWITCH
	SINGLE POLE TWO WAY SWITCH
	1200 X 600 RECESSED/SURFACE FLUORESCENT
	600 X 600 RECESSED/SURFACE FLUORESCENT
	1500MM RECESSED/SURFACE FLUORESCENT
	RECESSED DOWNLIGHT
	WALL LIGHT

C02	For Tender	13/07/2026
C01	For Tender	30/06/2026
Rev	Description	Date



Client: Corlann Ireland
Kilcoman House, Galway

Architect: Ian Sheehy
Askeaton Limerick

Project: Proposed Extension to Offices
Gort Road

Drawing: Electrical Installation
Existing General Services
Ground & First Floor

MFC Project Reference | 26.3142 Scale | 1:100 A1

Drawn | GJA Checked | TK Approved | JM

Drawing Reference: Status: Rev:
26.3142-MFC-ZZ-00-DR-E-6200 (A4) (C02)