


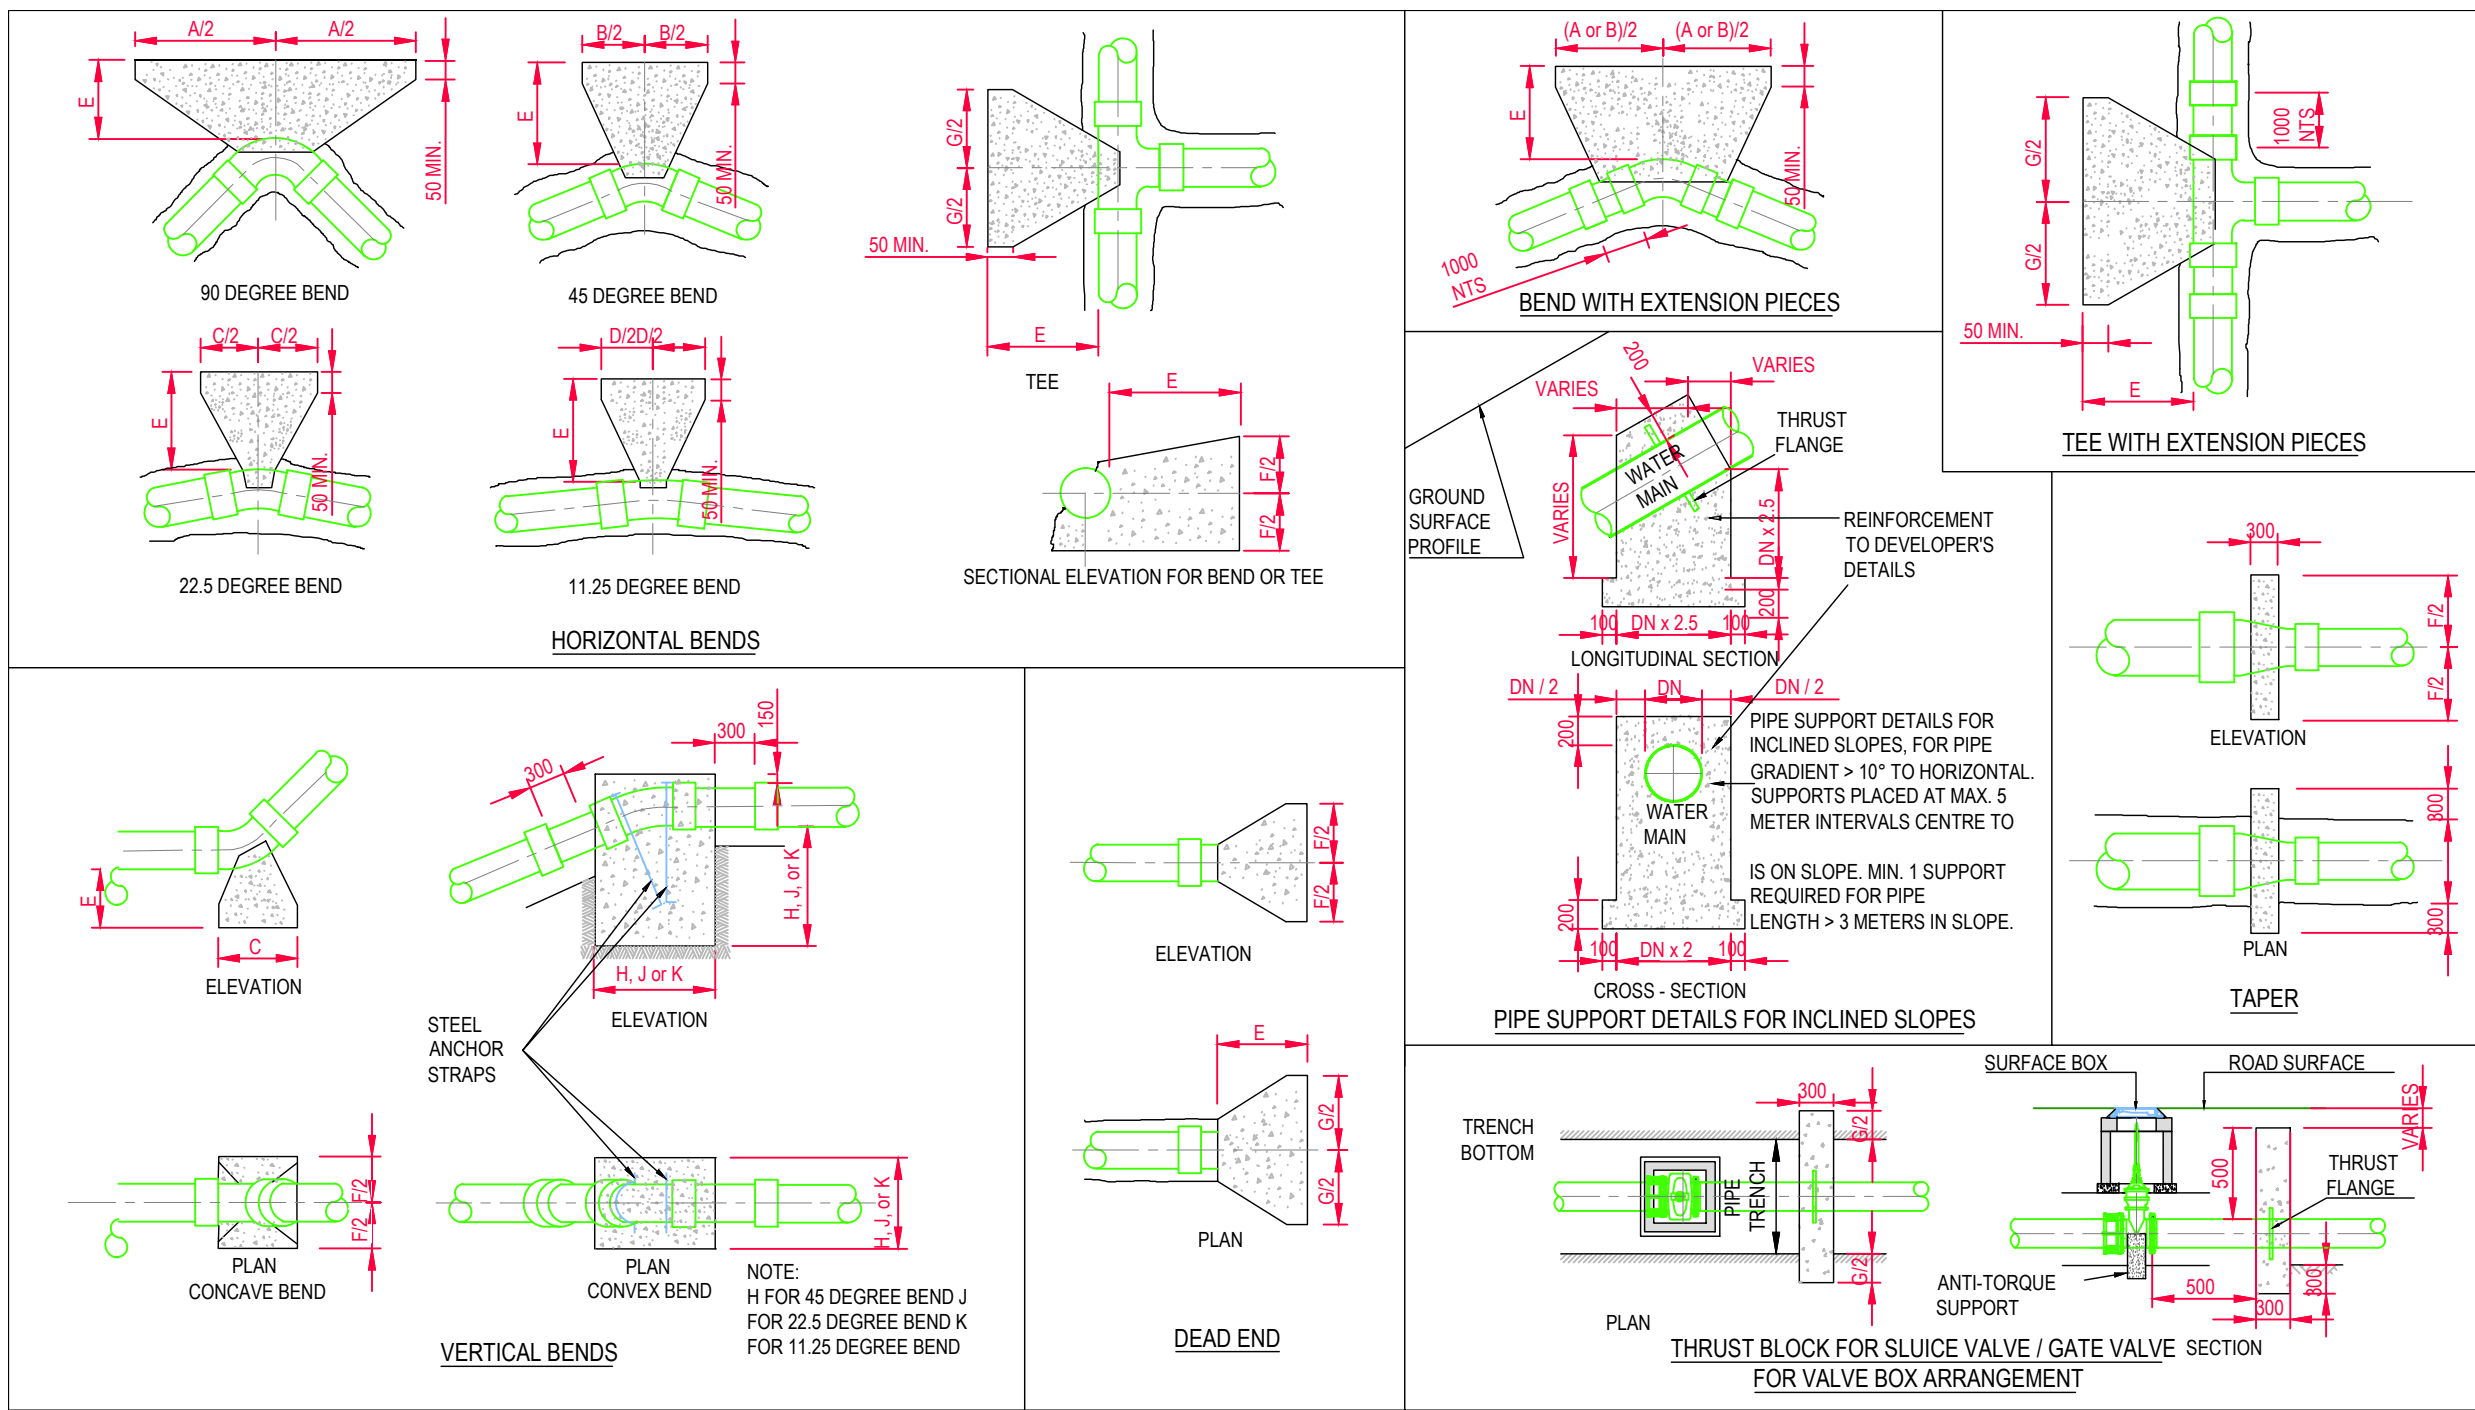

< 12 BAR TEST PRESSURE

NOM. DIA. (mm)	A	B	C	D	E	F	G	H	J	K
100	600	330	160	80	200	350	390	700	600	400
150	950	510	260	130	225	450	660	900	750	600
200	1150	600	310	160	300	650	790	1050	900	700
250	1350	750	380	200	300	800	970	1200	1000	750
300	1580	850	450	220	320	950	1110	1300	1100	850
350	2100	1150	570	290	450	1000	1450	1550	1200	900
400	2550	1400	700	350	500	1050	1800	1700	1250	1000
450	3000	1630	830	420	680	1100	2130	1800	1450	1150
500	3590	1950	990	500	800	1200	2540	1950	1600	1250
600	4100	2200	1120	570	850	1400	2880	2100	1700	1300

12 BAR TO 15 BAR TEST PRESSURE

NOM. DIA. (mm)	A	B	C	D	E	F	G	H	J	K
100	700	380	190	100	200	350	510	750	600	400
150	1135	620	320	160	225	450	760	950	750	600
200	1400	750	380	190	300	650	980	1150	950	700
250	1730	940	480	240	320	800	1210	1350	1050	850
300	2090	1130	580	300	380	950	1480	1500	1200	950
350	2600	1410	720	360	500	1050	1840	1700	1350	1050
400	2980	1610	820	420	750	1200	2110	1850	1500	1150
450	3400	1840	940	470	900	1300	2330	2000	1600	1250
500	4090	2210	1130	570	1000	1400	2890	2200	1750	1350
600	5010*	2710*	1380	700	1000	1500	3550*	2350	1900	1500



15 BAR TO 18 BAR TEST PRESSURE

NOM. DIA. (mm)	A	B	C	D	E	F	G	H	J	K
100	750	400	205	100	220	400	530	800	650	400
150	1250	700	350	180	250	500	890	1000	850	650
200	1650	890	450	320	320	700	1170	1250	1000	800
250	1960	1060	540	270	350	900	1370	1450	1150	900
300	2300	1200	640	320	500	1100	1630	1650	1300	1050
350	2930	1580	830	410	750	1200	2070	1850	1500	1150
400	3510	1900	970	190*	1000	1300	2490	2000	1600	1250
450	3810	2270	1160	580	1000	1350	2970	2150	1700	1350
500	4340*	2380	1210	610	1000	1400	3700	2250	1750	1400
600	6370*	3450*	1760	890	1000	1500	4500*	2400	2050	1650


1. ALL DIMENSIONS IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. CONCRETE THRUST BLOCKS (ANCHORAGE) SHALL BE POSITIONED SYMMETRICALLY WITH RESPECT TO THE CONNECTING PIPE & BENDS.
3. TRENCH DIMENSIONS - REFER TO DRAWING No. STD-W-13.
4. THRUST BLOCKS SHALL BEAR ON UNDISTURBED SOIL. IF FOR ANY REASON THEY CANNOT THEN THE DEVELOPER SHALL NOTIFY USICE EIREANN IMMEDIATELY WITH A PROPOSED SOLUTION.
5. THRUST BLOCK REINFORCEMENT REQUIRES SPECIFIC DESIGN.
6. FOR TEST PRESSURES GREATER THAN 18 BAR, THRUST BLOCK DESIGN IS TO BE SUBMITTED TO USICE EIREANN FOR REVIEW.
7. THRUST BLOCKS ARE DESIGNED FOR AN AVERAGE BEARING PRESSURE OF 100 kN/m² (TYPICAL FOR SOFT CLAY). FOR OTHER ADVERSE SOIL CONDITIONS, ACTUAL DIMENSIONS MAY BE ALTERED SUBJECT TO THE DEVELOPER SUBMITTING AN ALTERNATIVE DESIGN TO USICE EIREANN FOR REVIEW AND APPROVAL.
8. CONCRETE IN THRUST BLOCKS SHALL BE GRADE C20/25.
9. COMPRESSIBLE FILLER FOR CONCRETE PROTECTION TO BE IN ACCORDANCE WITH BS EN 622-1 AND BS EN 622-4. BITUMINOUS MATERIAL SHALL NOT BE PUT IN CONTACT WITH PLASTIC PIPES. THE THICKNESS OF COMPRESSIBLE FILLER FOR MAINS < 450mm IN DIAMETER IS TO BE 18mm.
10. CONCRETE THRUST BLOCKS FOR POLYETHYLENE PIPE TO COMPLY WITH THE MANUFACTURERS REQUIREMENTS.
11. POLYETHYLENE PIPES SHALL BE WRAPPED IN PLASTIC SHEETING HAVING A COMPOSITION IN ACCORDANCE WITH BS 6076 BEFORE BEING CAST INTO CONCRETE.
12. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.

TABLE OF DIMENSIONS FOR STEEPLY INCLINED PIPELINES

GRADIENT	SPACING
1 IN 2 & STEEPER	5.5m
BELOW 1 IN 2 TO 1 IN 4	11.0m
1 IN 4 TO 1 IN 5	16.6m
1 IN 5 TO 1 IN 6	22.0m

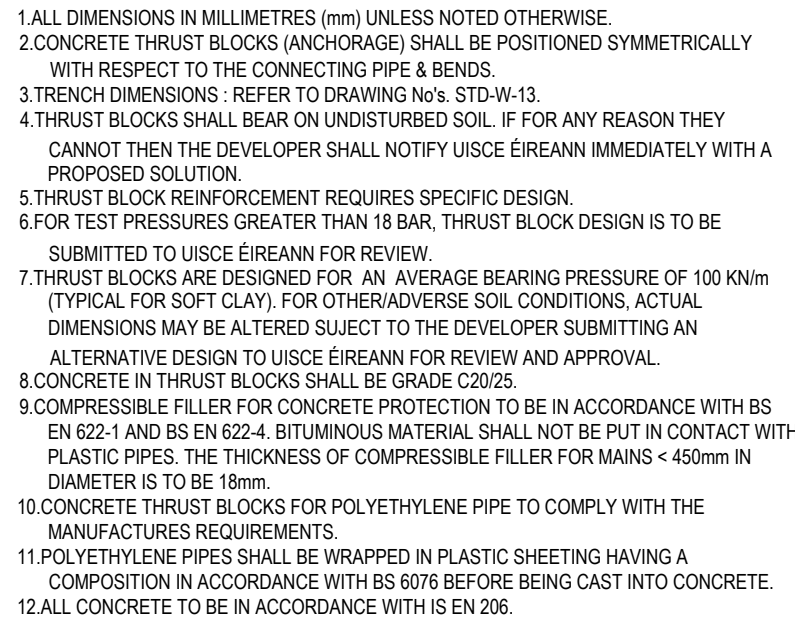
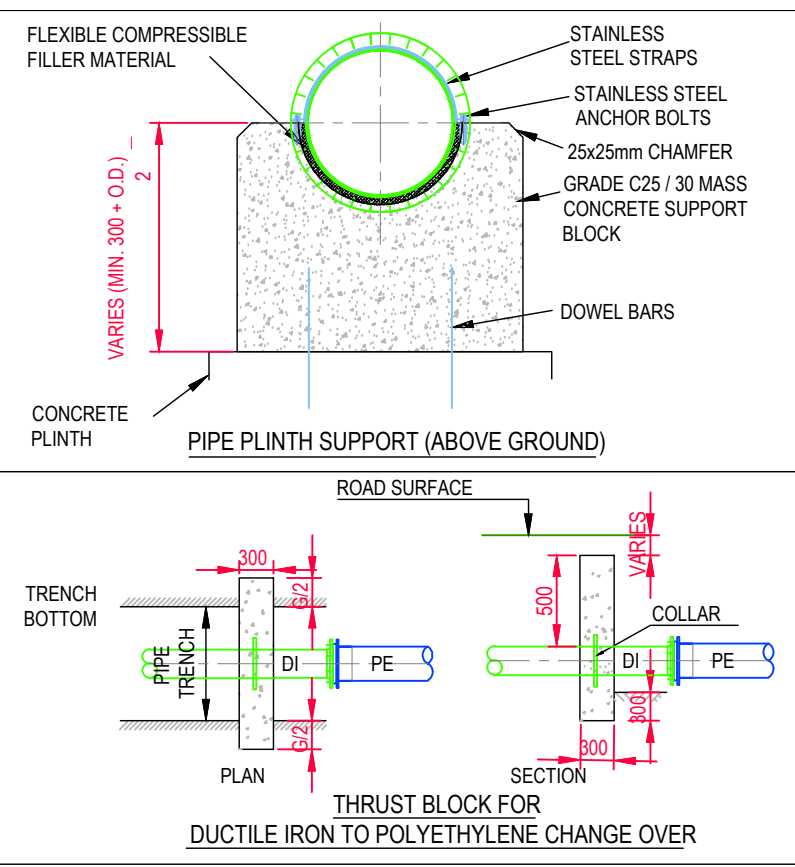


1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. STRUCTURAL DESIGN AND REINFORCEMENT DETAIL TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO USICE EIREANN FOR REVIEW. ROOF SLABS SHALL BE DESIGNED TO CARRY ALL LIVE LOADS & DEAD LOADS, & CONSIST OF A REINFORCED CONCRETE SLAB OF 150mm THICKNESS, GRADE C20/25, WITH A MINIMUM THICKNESS OF 200mm. ALTERNATIVELY, PRE-CAST CONCRETE ROOFS MAY BE USED, IN COMPLIANCE WITH BS EN 1917 & BS 400.
3. CONCRETE FOR FLOW METER CHAMBERS TO BE CAST IN PLACE.
4. ALL TYPICAL AND PERMANENT ROAD REINFORCEMENT TO COMPLY WITH CURRENT VERSIONS OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
5. CONCRETE SURROUNDING TO BE GRADE C20/25 IN ACCORDANCE WITH IS EN 206.
6. METER CHAMBERS SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL, EXPOSED TO EN 124 RATING D400. COVER AND FRAME SHALL BE SUBSTITUTED FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY USICE EIREANN.
7. 200mm ALL ROUND, 18mm DEEP CONCRETE PLATE WITH REINFORCEMENT IN GRASS AREAS.
8. ALL CHAMBERS TO BE CHECKED FOR LEAKS BY THE DEVELOPER BASED ON INSPECTION CONDITIONS WITHIN THE SITE. SHOULD ANY LEAKS BE OBSERVED, THEY SHALL BE SUBJECT TO REVIEW BY USICE EIREANN.
9. PREWORK FOR THE DEVELOPER TO ACCOMMODATE THE REQUIRED RANGE OF THE FLOW METER, STRAIGHT PIPE LENGTHS UPSTREAM AND DOWNSTREAM OF THE METER TO BE PROVIDED. THE METER SHALL BE CAPABLE OF ACCURATE FLOW MEASUREMENTS.
10. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
11. ANY SPECIAL ROAD REINFORCEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
12. NEW ROAD CONSTRUCTION A SURFACE FINISH TO BE TO ROAD AUTHORITY'S REQUIREMENTS.
13. ALL TYPICAL AND PERMANENT ROAD REINFORCEMENT TO COMPLY WITH CURRENT VERSIONS OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
14. DEVELOPER TO PROVIDE SPOOL PIECE, USICE EIREANN TO PROVIDE METER. (SEE TABLE BELOW FOR SPOOL PIECE LENGTHS)
15. KNOCK AND DUCT ARE REQUIRED FOR FLOW METER CHAMBERS.

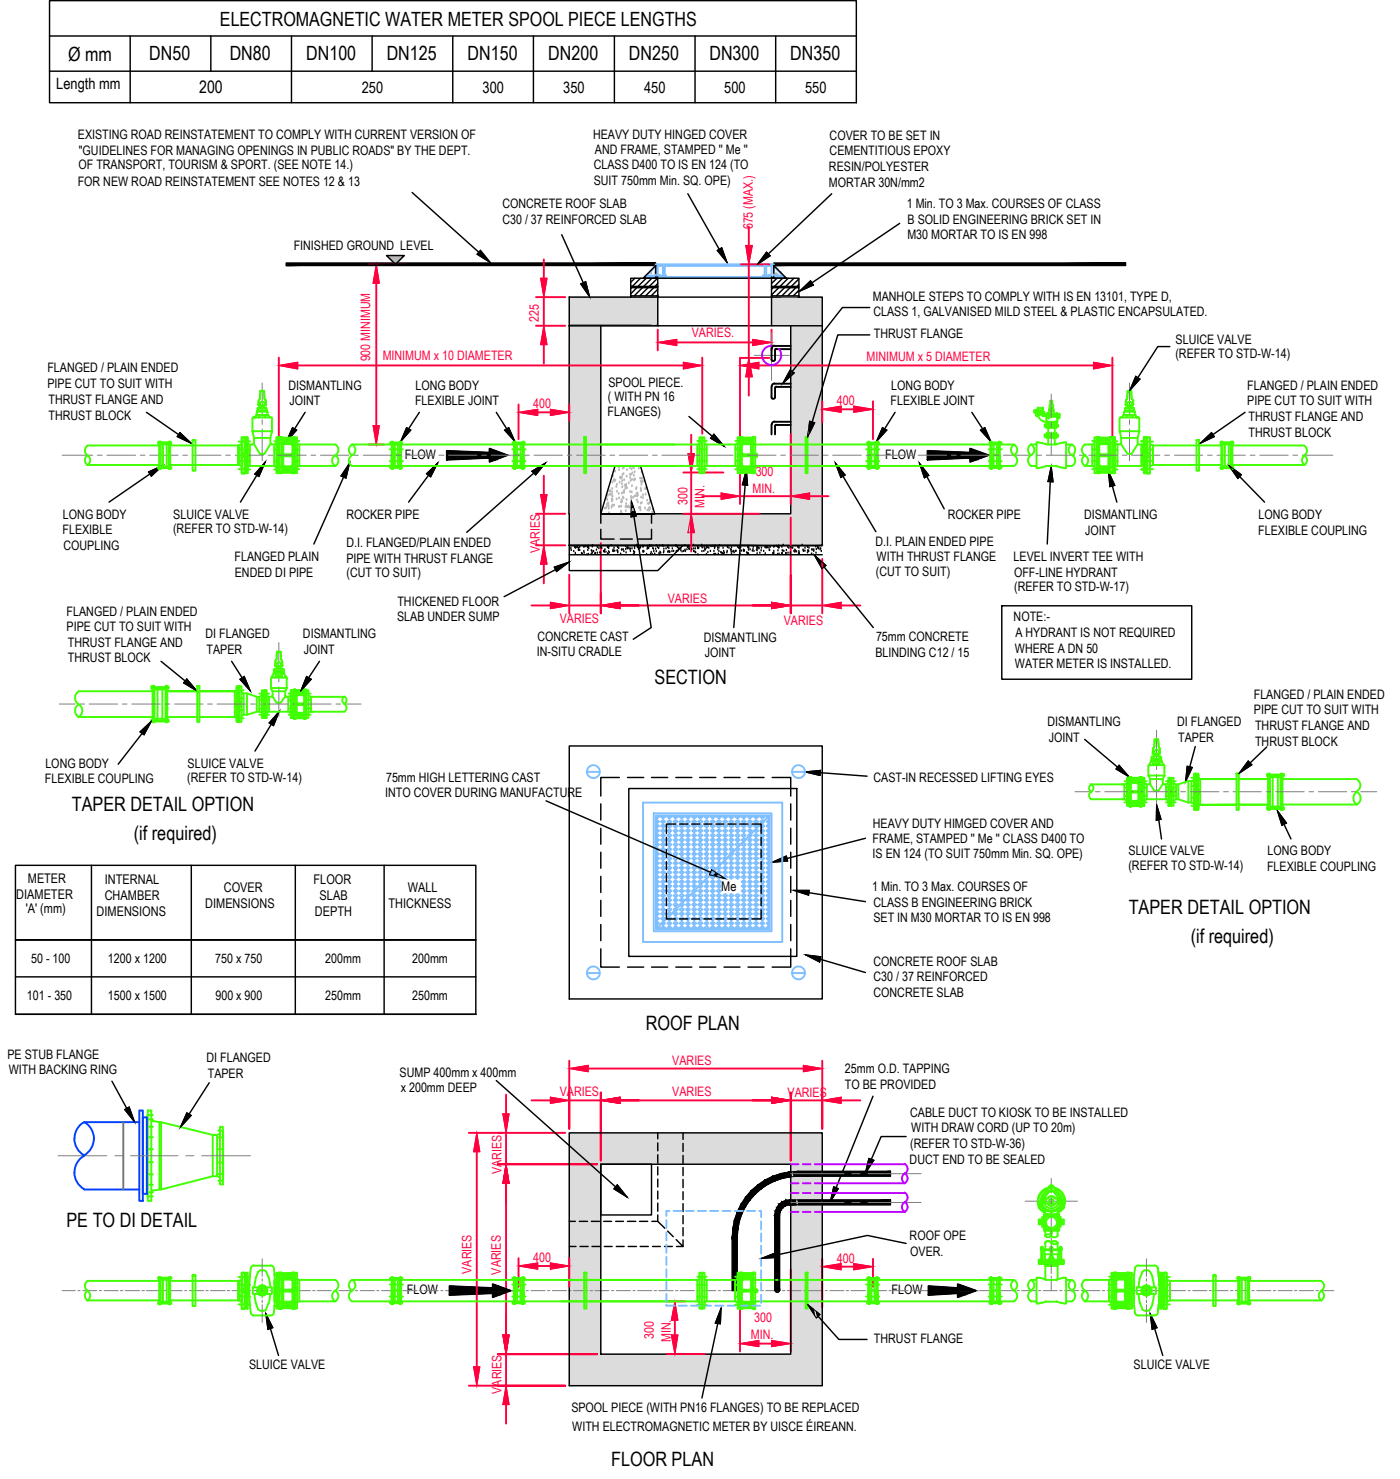


Watermain Thrust and Support Block Details

Scale: NTS

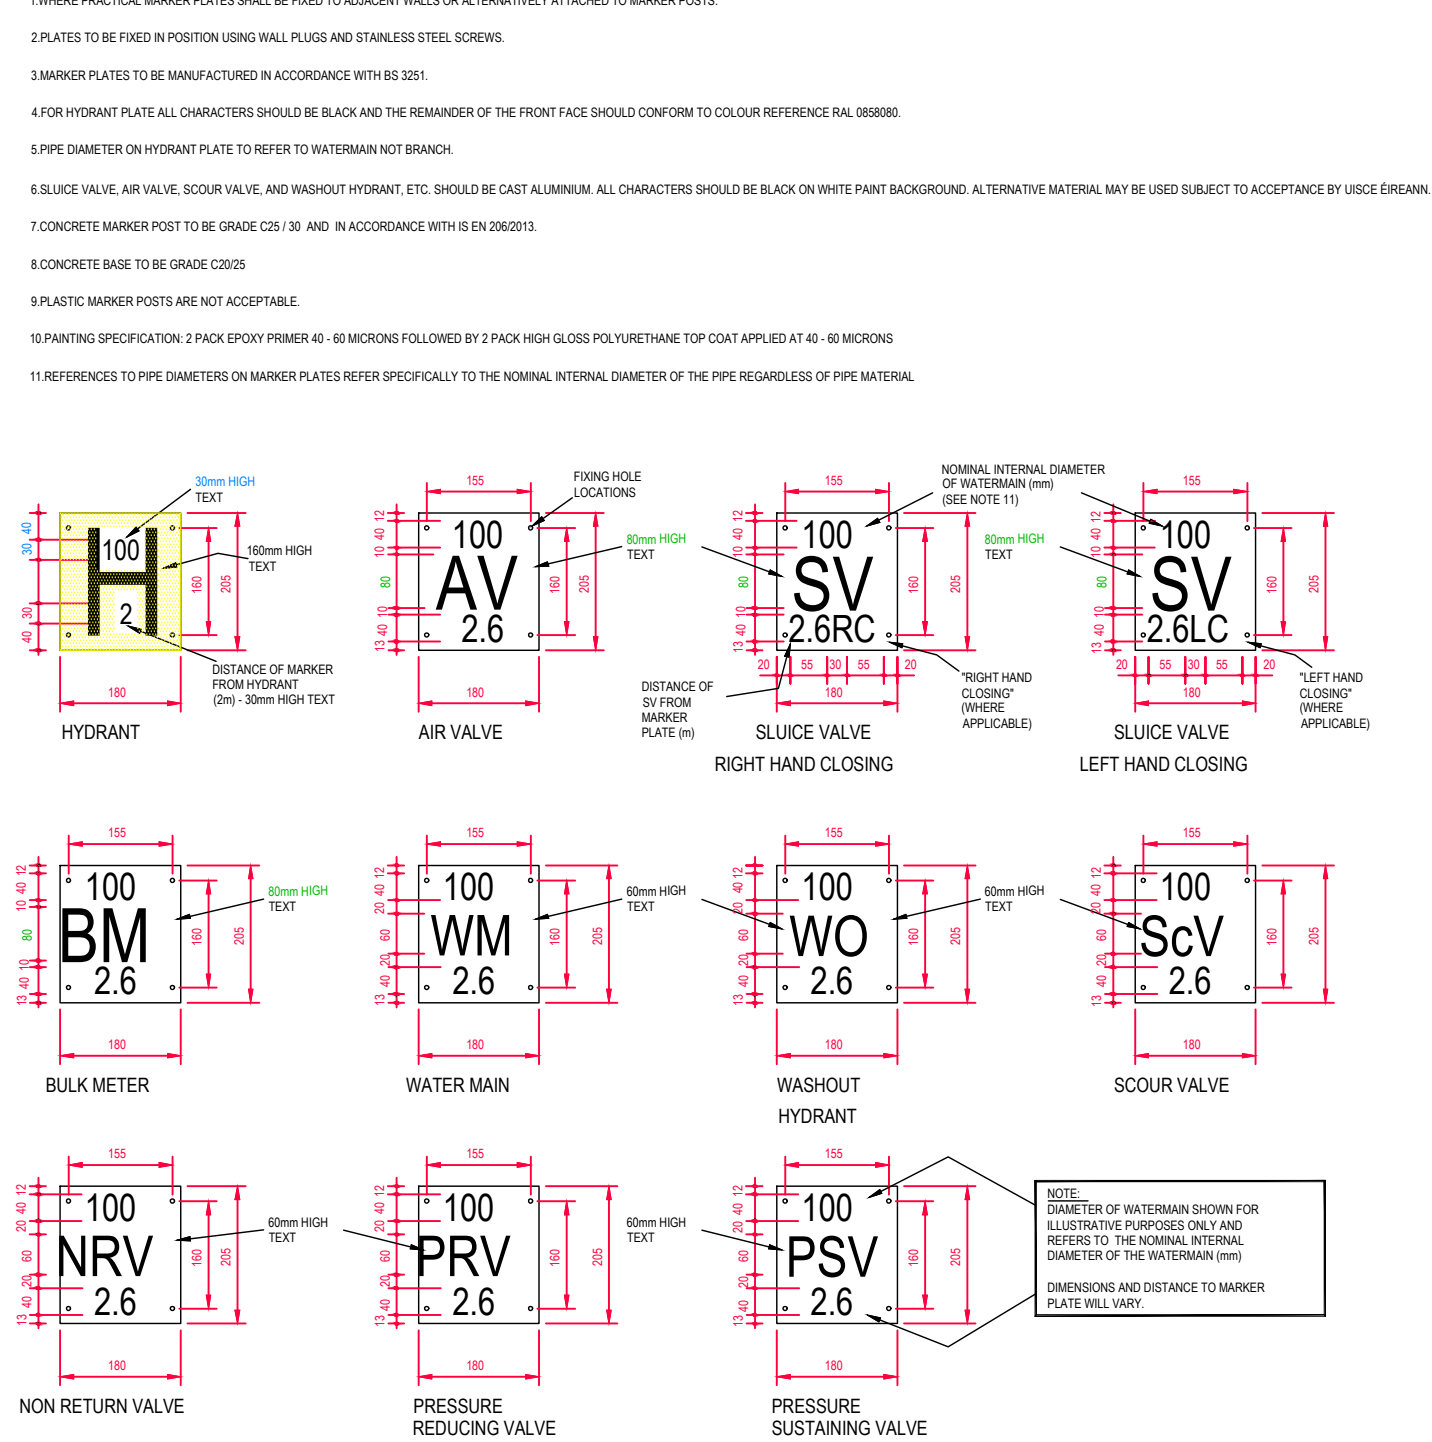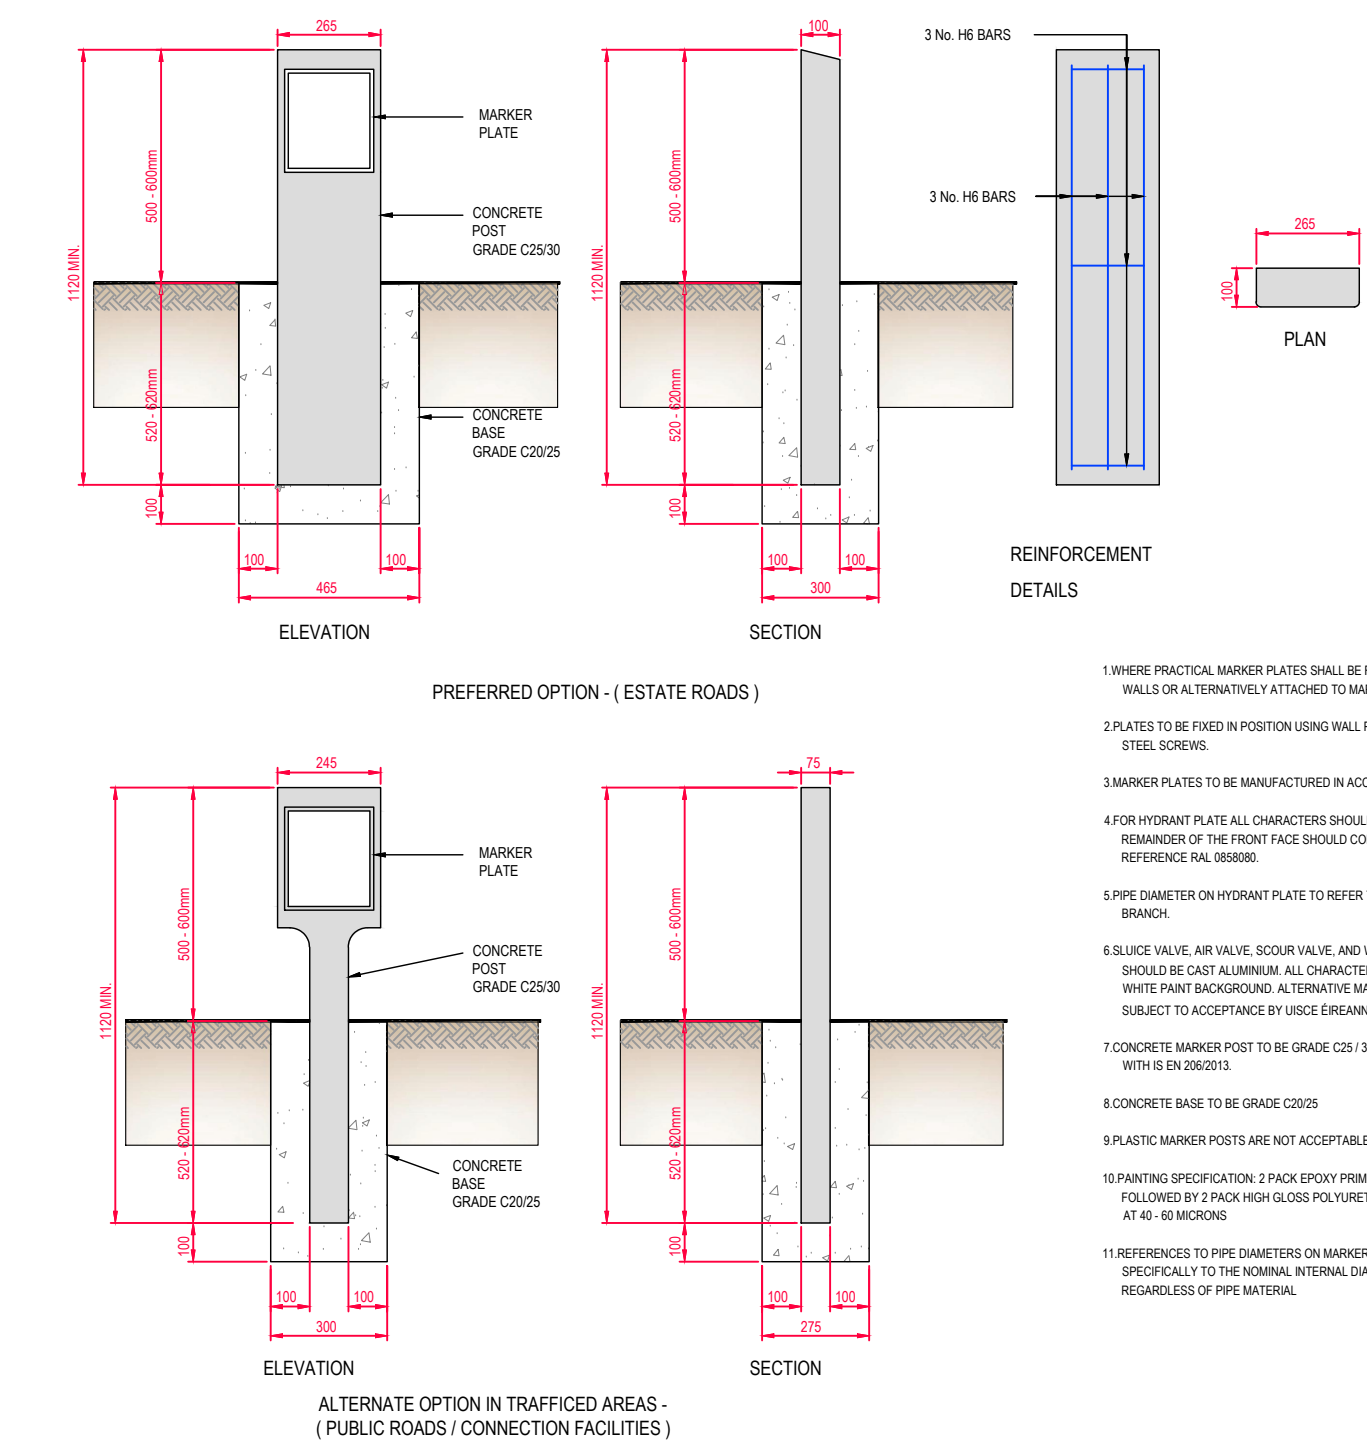

Marker Post Details
Scale: NTS

Marker Plate Details
Scale: NTS

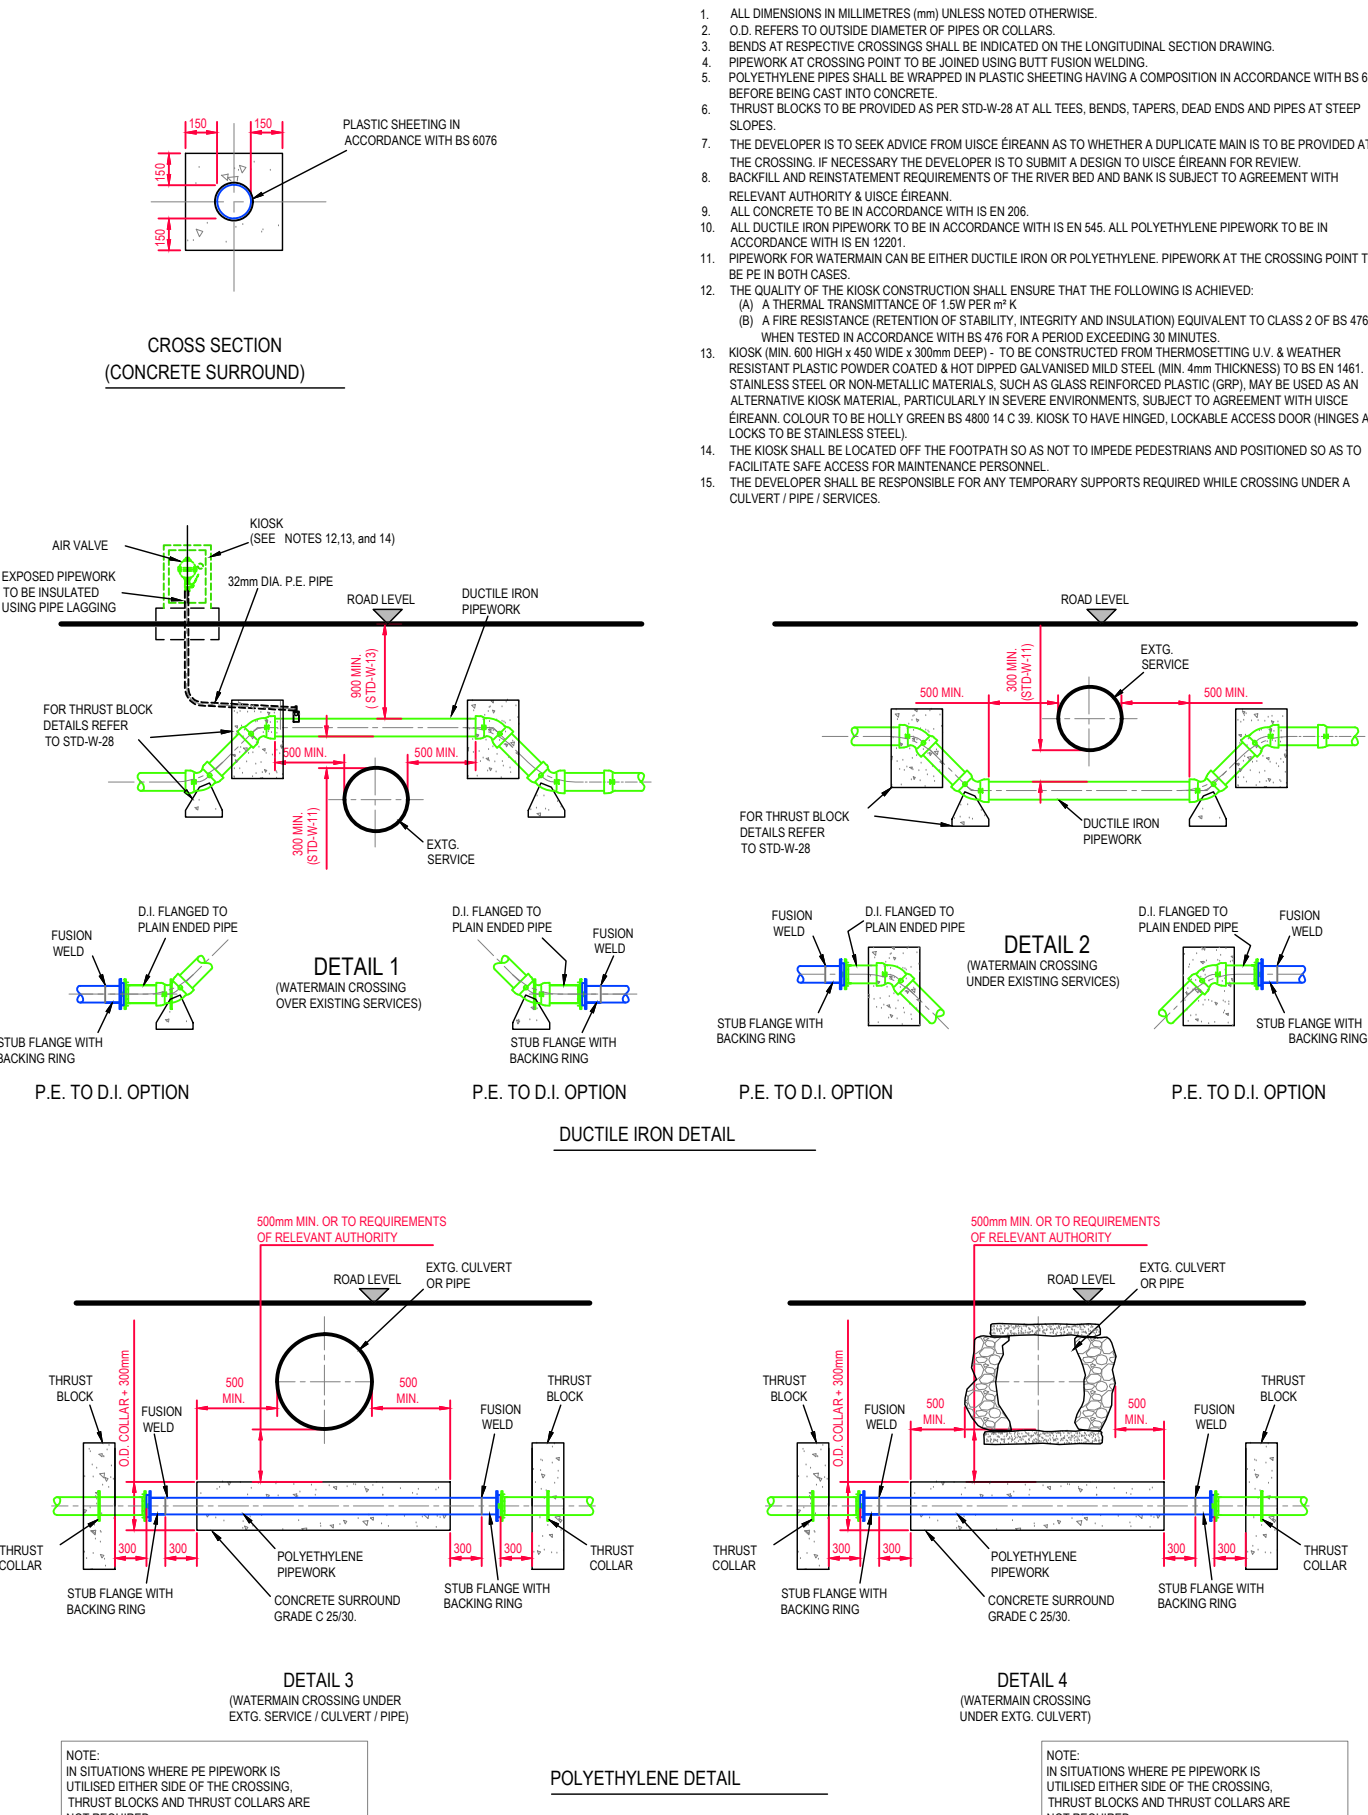

Culvert Crossing Details
Scale: NTS

Rev	Description	Date

Project:
Proposed Upgrade Works for Ardeamush Fernhill Group Water Scheme

Client:
Ardeamush Fernhill GWS Committee

Drawing Title:
Standard Details - Sheet 2

Scale:
As Shown

Drawn By:
JQ

Status:
Tender

Dwg Size:
A1

Date:
20-7-2026

Job No:
267/10

Dwg No.:
26-710-008

Rev:
0

Quinn Consulting Engineers
Unit 9A Tracklands Business Park,
Clonroadmore, Ennis, Co. Clare
Phone/Fax 065 6862620. Mobile 0871731073.
E Mail: info@qcecivil.ie

Copyright and ownership of this drawing is vested in QCE Ltd via Quinn Consulting Engineers. No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of QCE Ltd as copyright holder except as agreed for use on the project for which the document was originally issued.
All rights reserved by the law of copyright and by international copyright conventions are reserved to QCE Ltd via Quinn Consulting Engineers