



Space Heating Typical Details

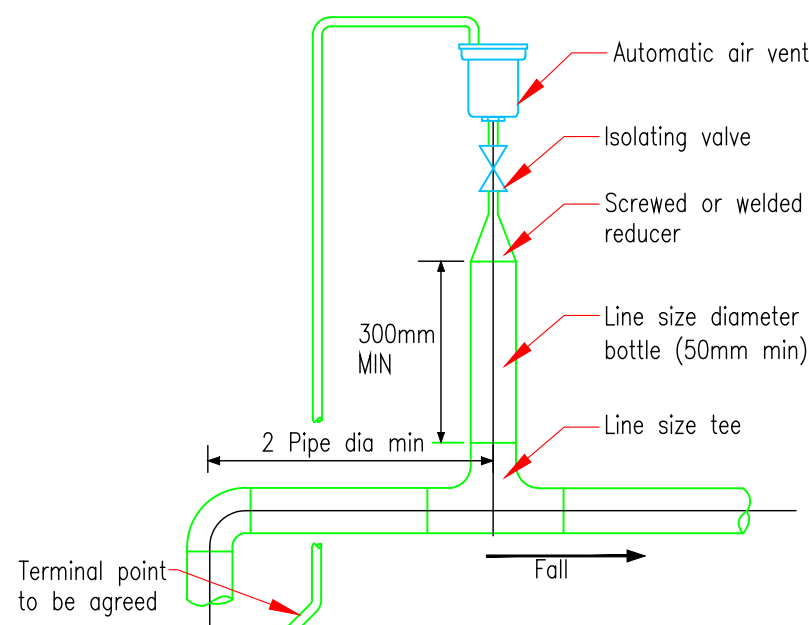


Typical detail showing piping arrangements for AAV'S at high level

Note:
Where pipes pass through internal divisions in the building fabric which are constructed as fire barriers, the sleeves fitted shall be fire sleeves where required by Building Regulations

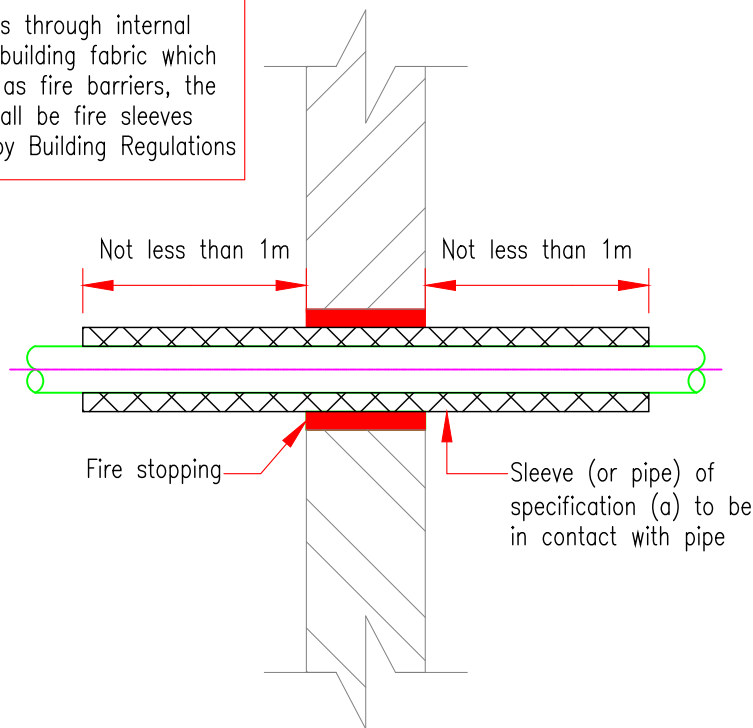

Pipes Penetrating a Compartment Wall or Floor (Sleeving)

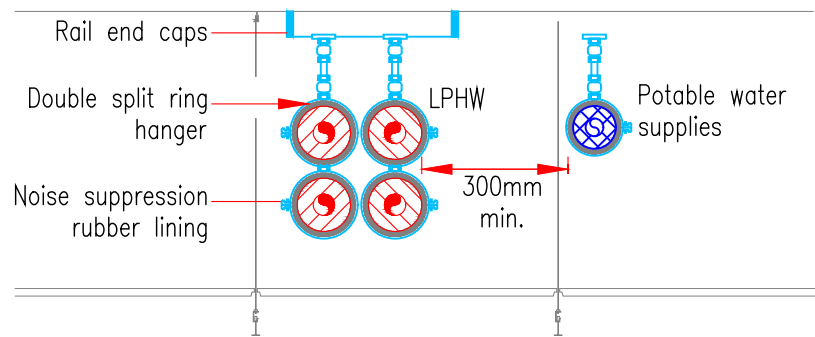

Typical Heating Services Pipework Mounting Detail (Refer to Structural Engineer's Drawings for Roof Structure Type)

GENERAL NOTES:
This drawing is used for indicative purposes only. It should not be used for scaling under any circumstances. The contractor shall agree the exact locations of all equipment with the relevant parties – Client, Architect or Builder.

The contractor shall co-ordinate his services with all other trades prior to commencement of any works on site.

Discrepancies or contradictions in the information indicated on the drawings and contained in the specification should be brought to the Engineers attention and agreement reached before any works commence.

T	04/06/26	TENDER ISSUE	JV	ML
REV	DATE	DESCRIPTION	DRN	CHKD
DO NOT SCALE This drawing is representative only. To be read in conjunction with Architects drawings.				
CONSULTING ENGINEER: Bernard Smith Consulting Engineers Bernard Smith Consulting Engineers Bracetown Business Park Clonee Dublin 15 t: 01-801 4127 w: www.bernardsmith.ie e: info@bernardsmith.ie				
PROJECT: YOUTHREACH CASTLEBLAYNEY CO. MONAGHAN				
TITLE: MECHANICAL TYPICAL DETAILS				
SCALE:	DRAWN BY:	JOB NO.:	DWG NO.:	REV.:
N/A	JV	26-022	59-00	T
DATE:	CHECKED:			
28/04/26	ML			

TENDER