




NOTE:
ALL 220V STATS & CONTROL
VALVES TO BE CONNECTED VIA
SWITCHED FUSED SPUR OUTLET

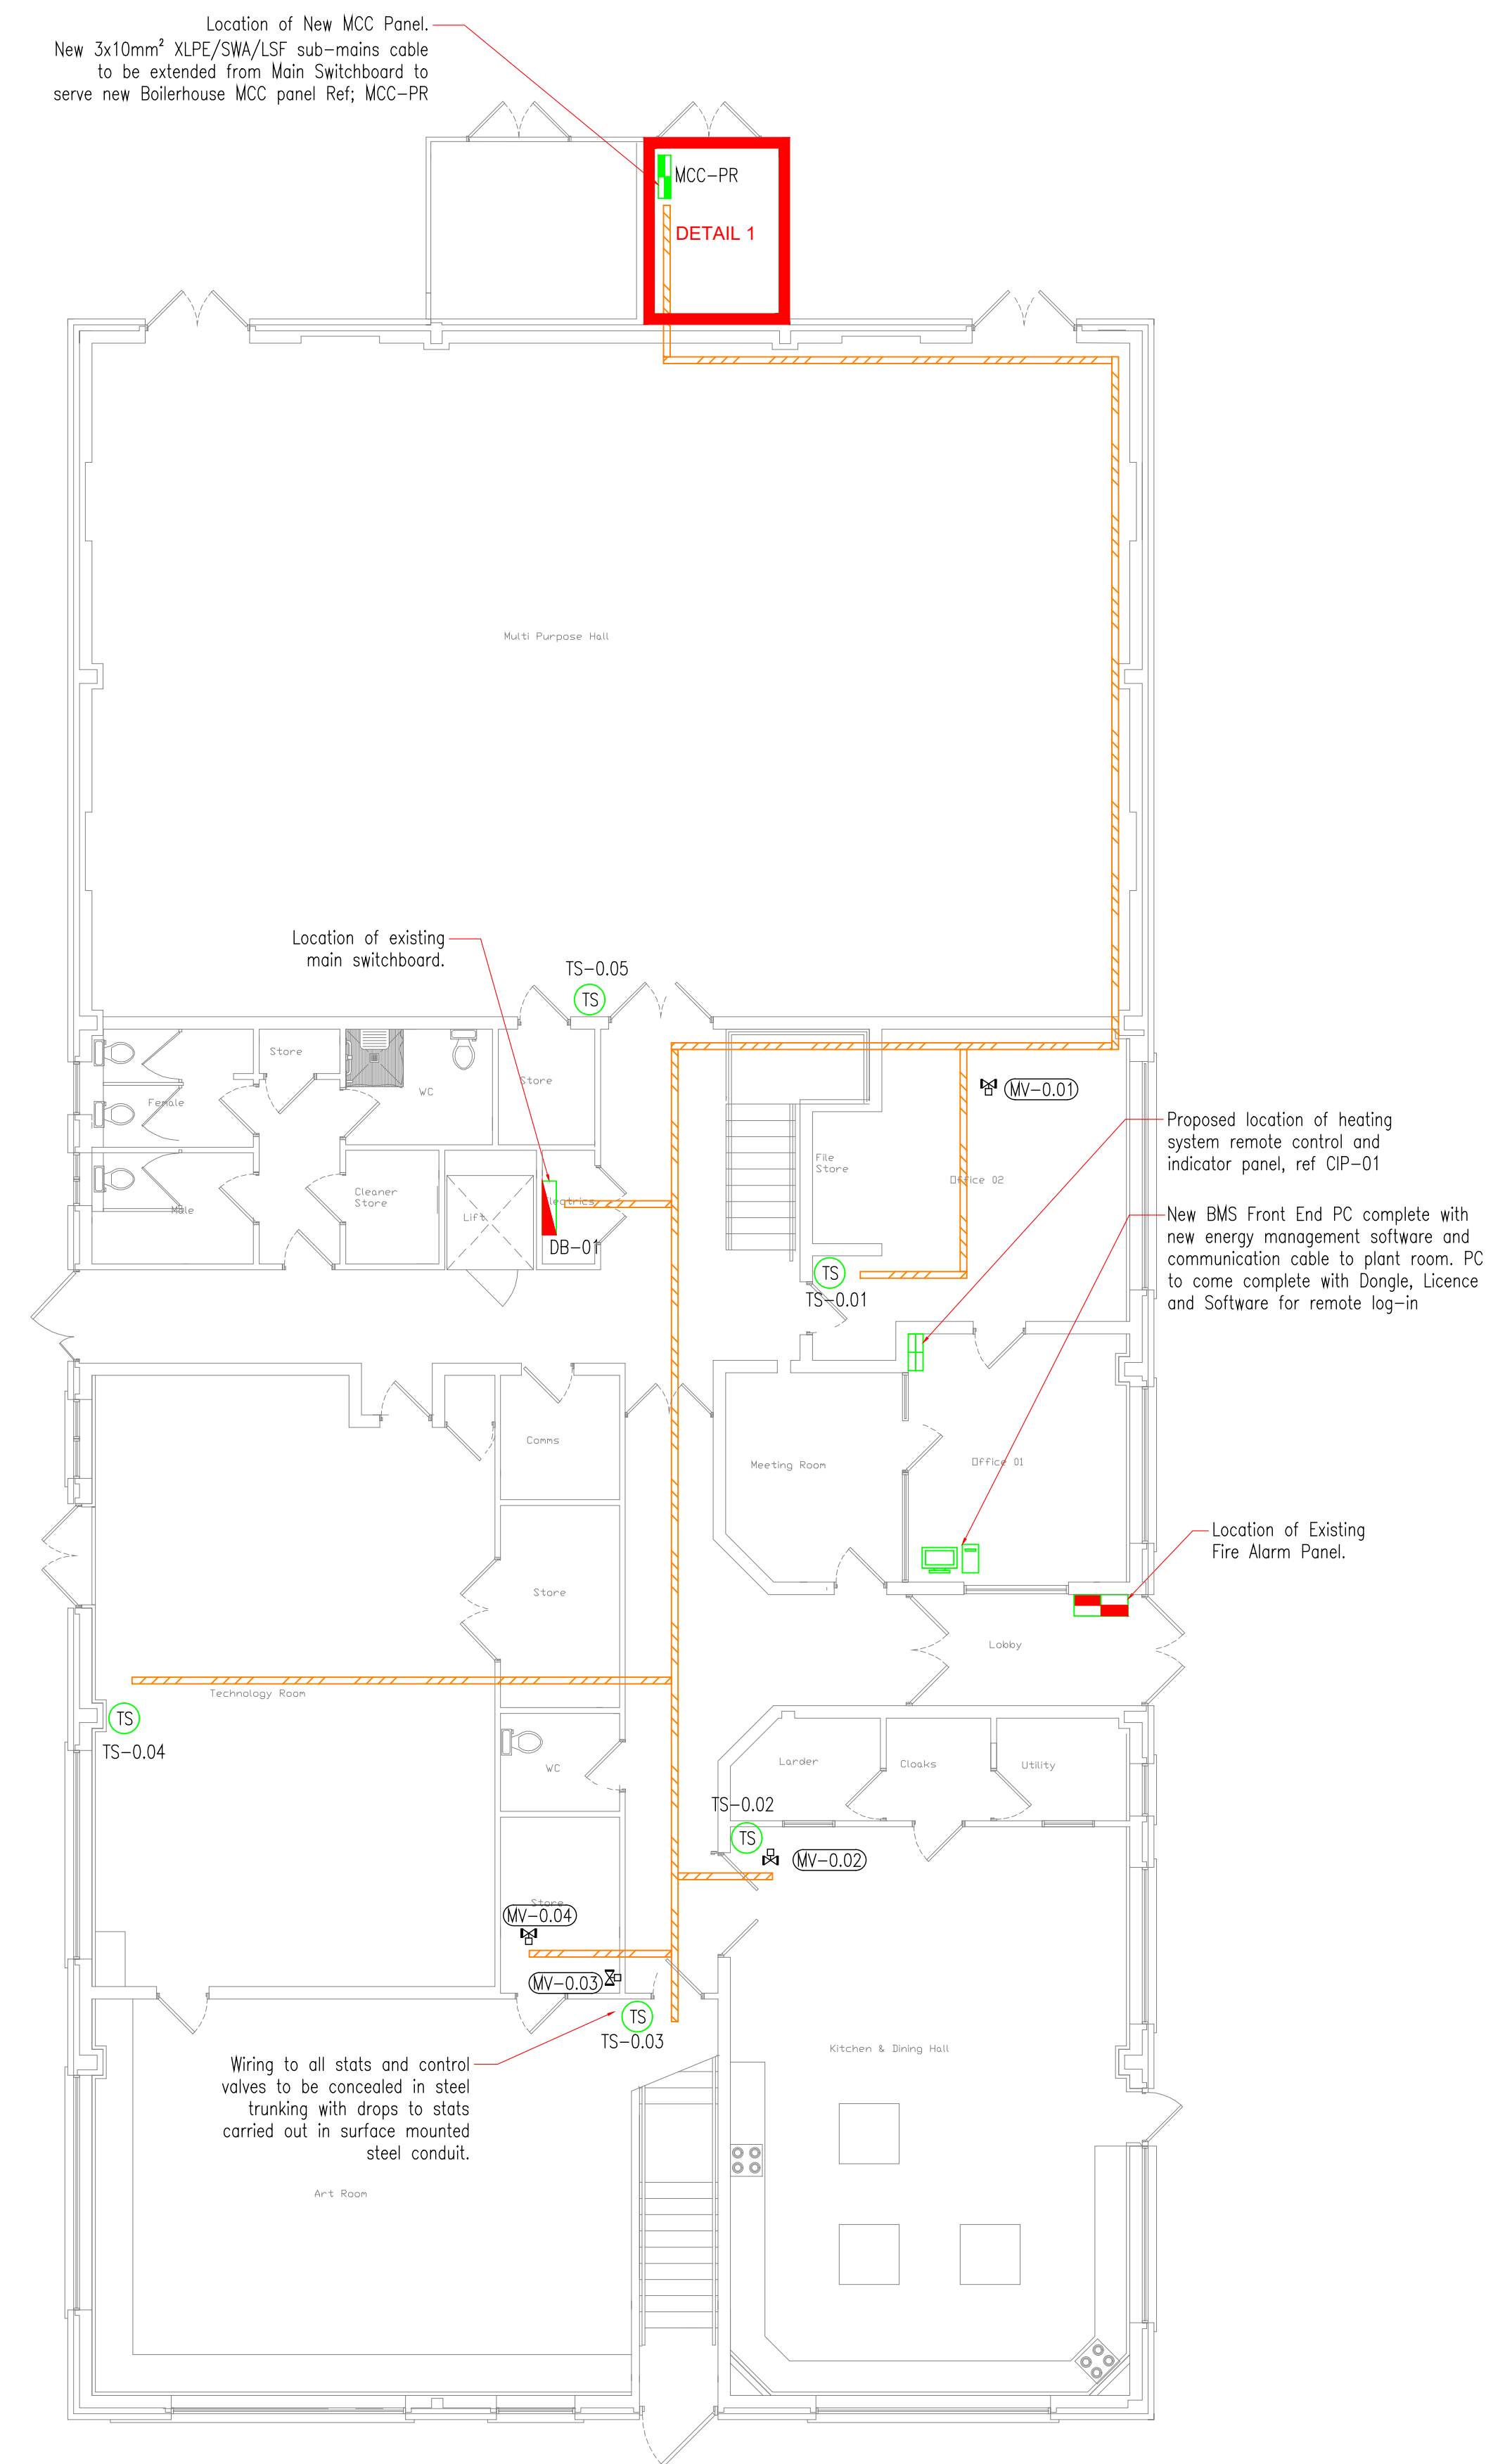

GROUND FLOOR

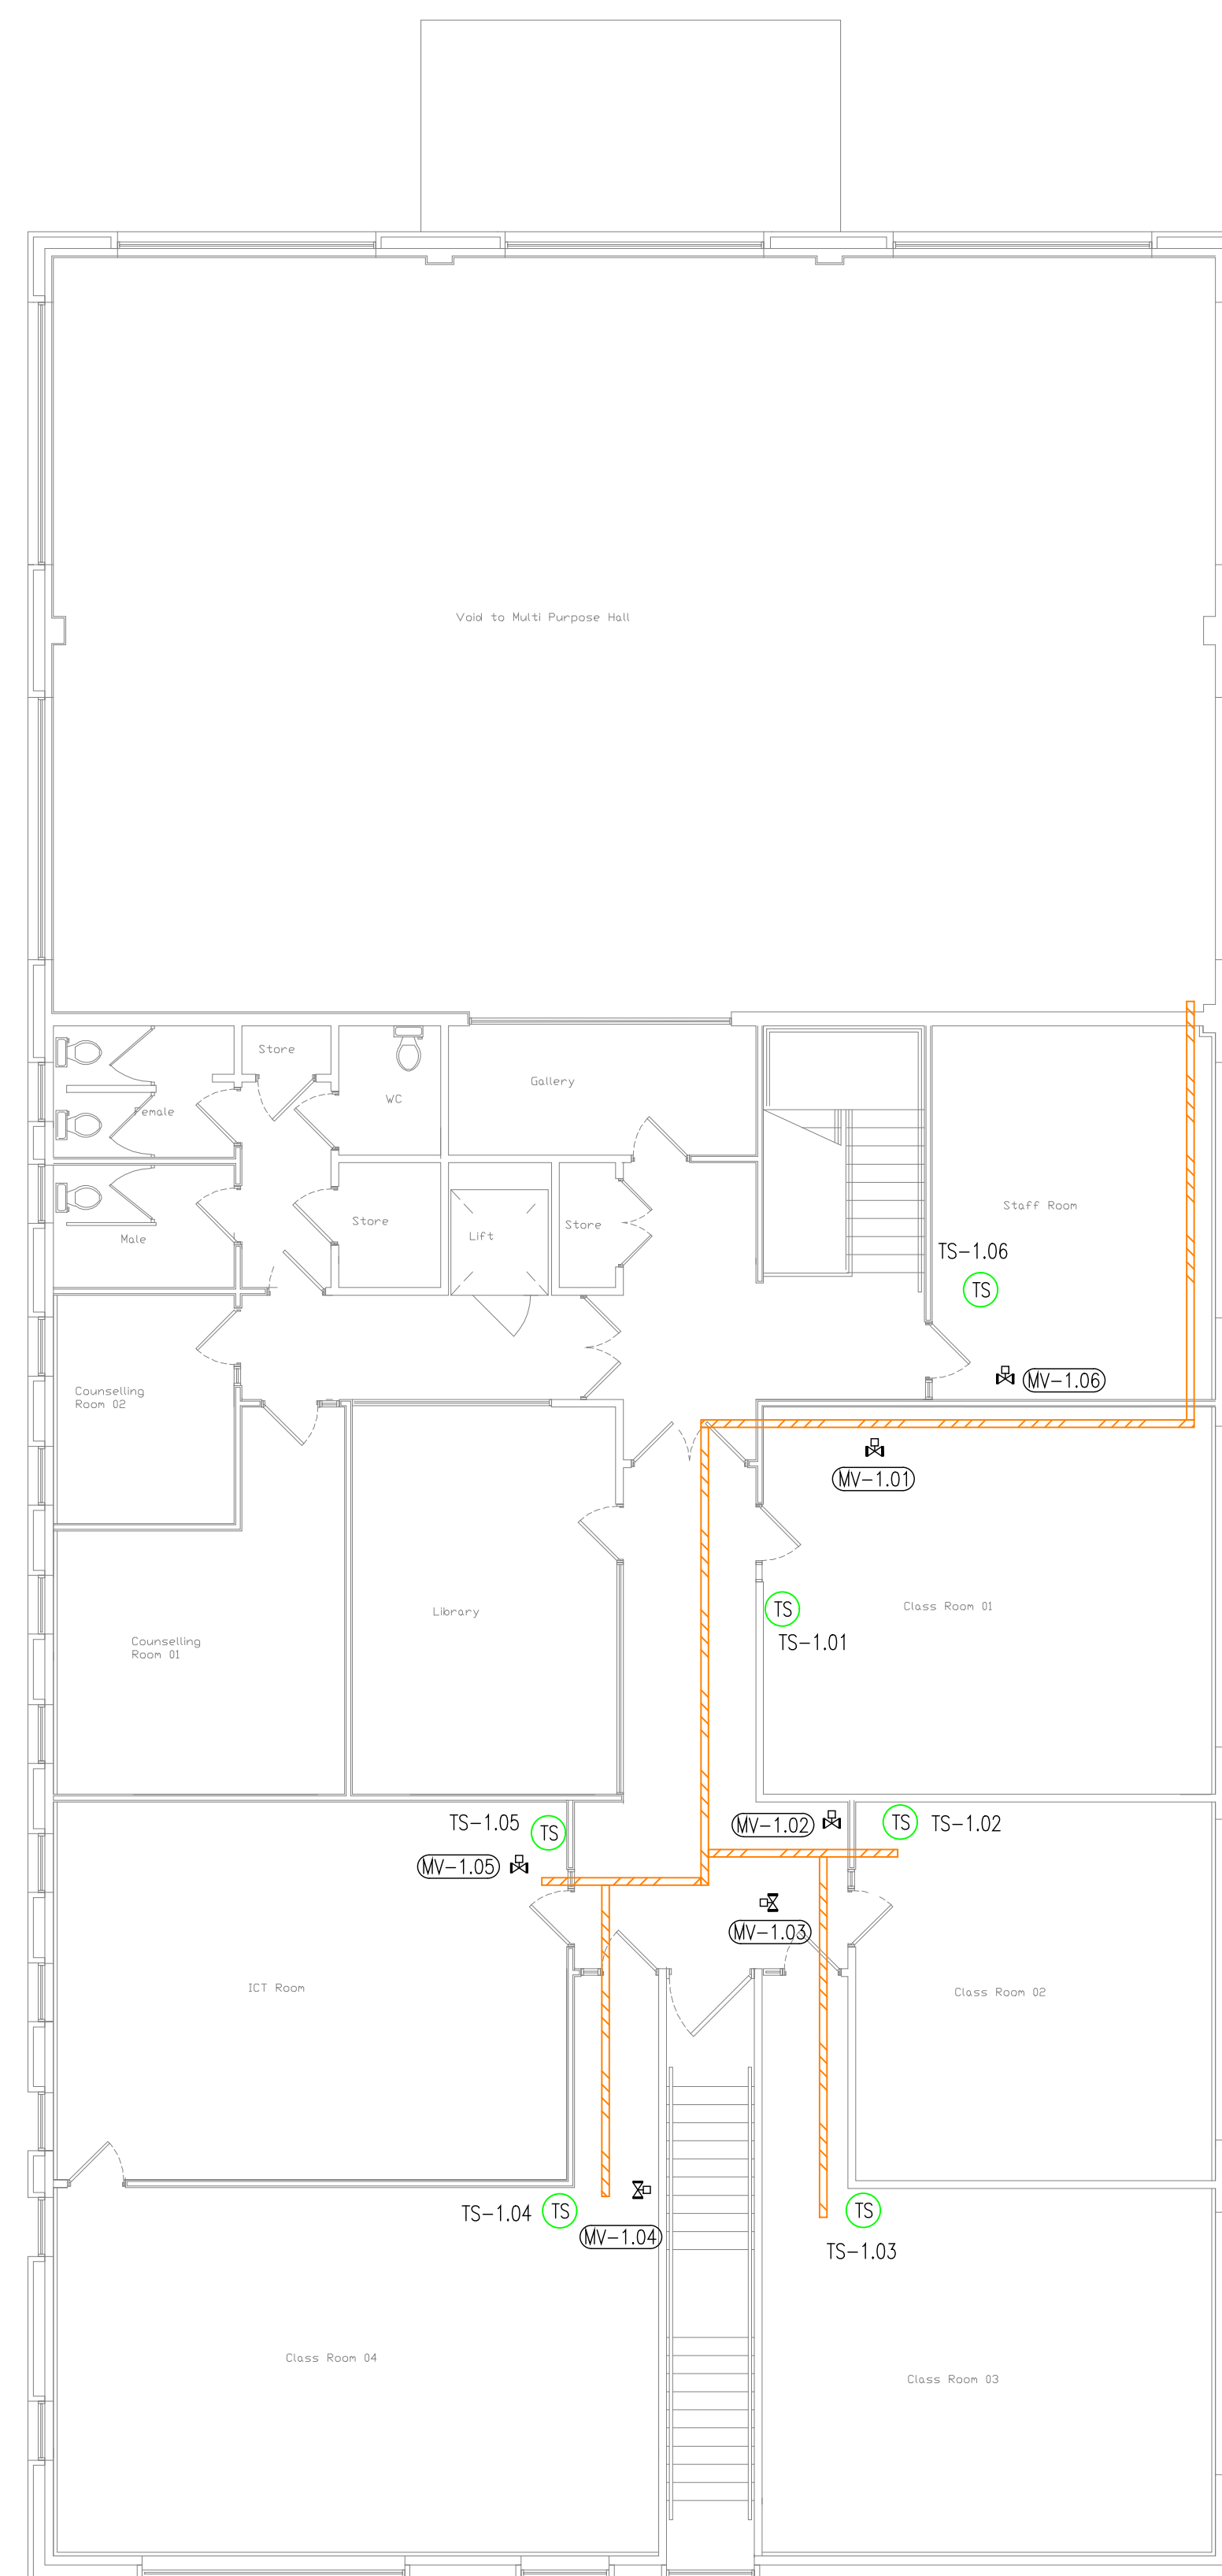

FIRST FLOOR

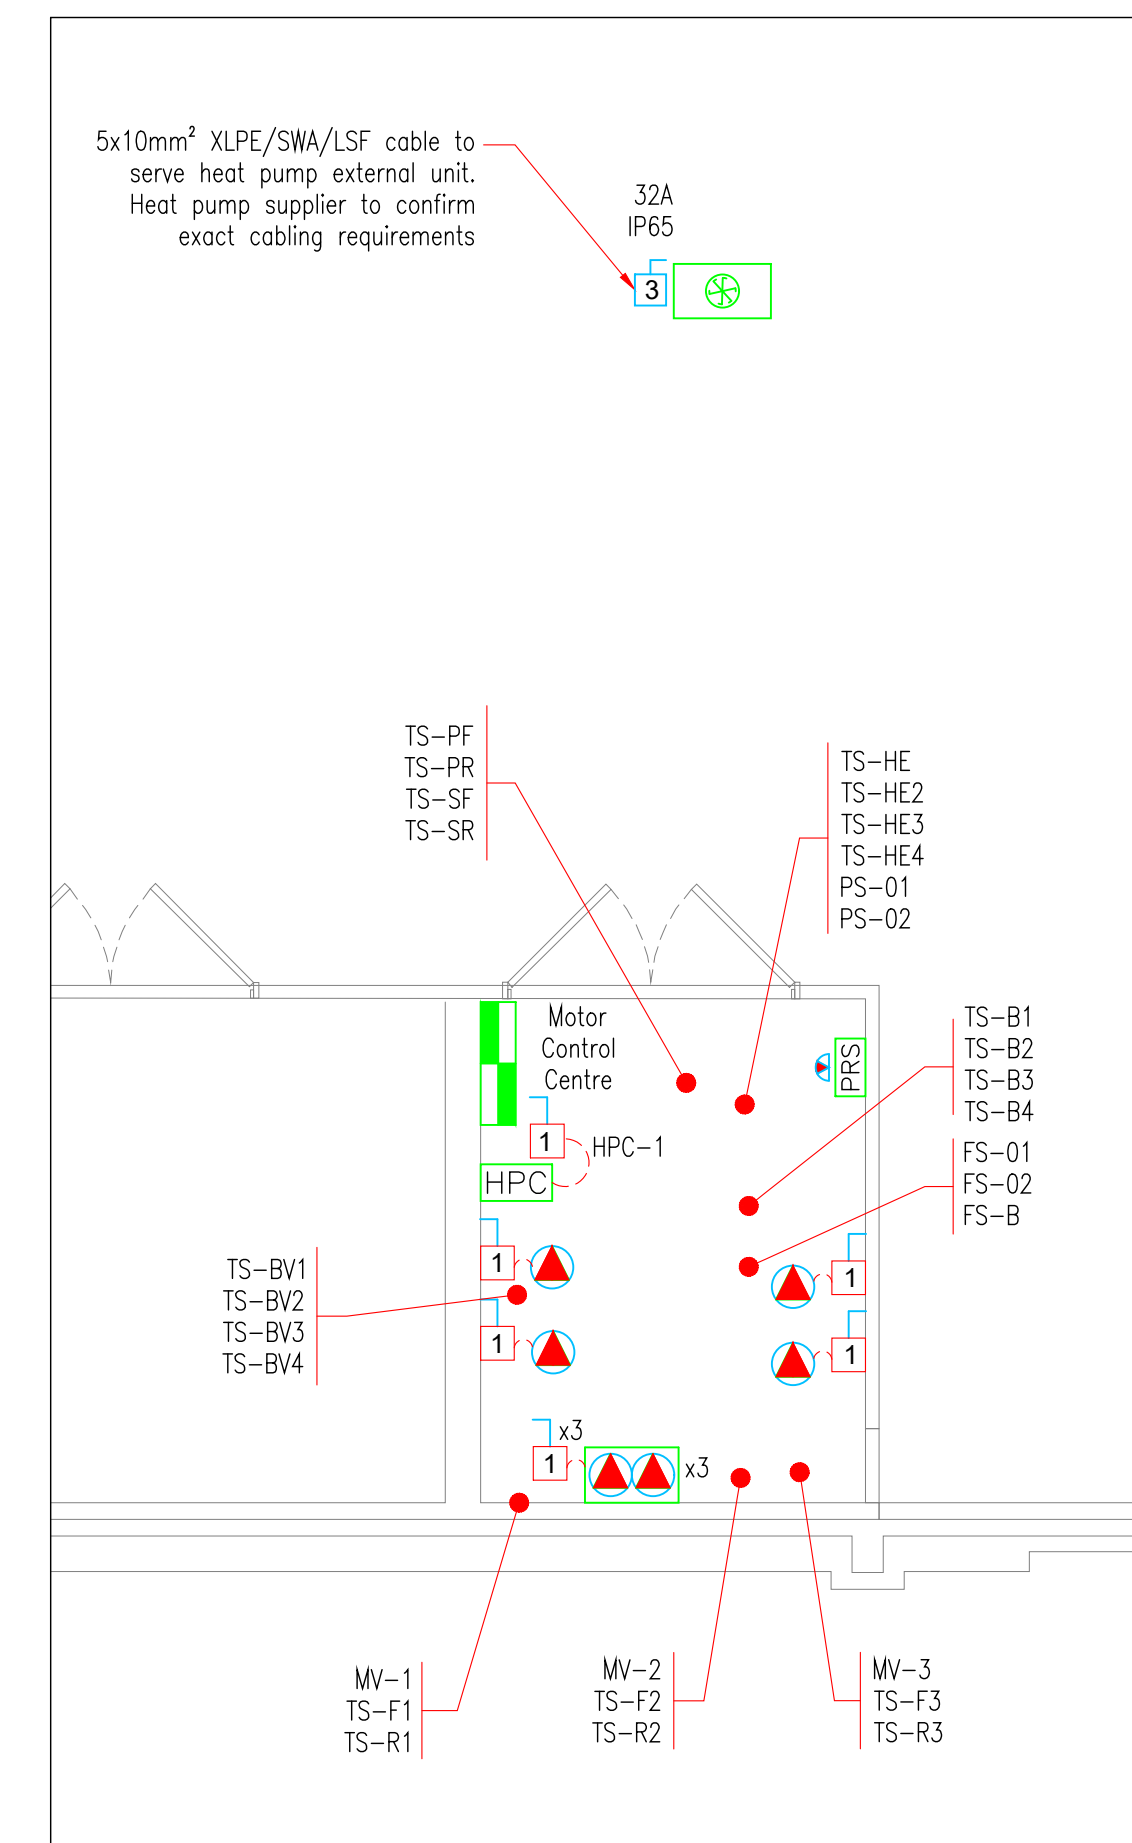

DETAIL 1 (Scale 1:50)

Notes:
This drawing is used for indicative purposes only. It should not be used for scaling under any circumstances. The contractor shall agree the exact locations of all equipment with the relevant parties – Client, Architect or Builder.

The contractor shall co-ordinate his services with all other trades prior to commencement of any works on site.

Discrepancies or contradictions in the information indicated on the drawings and contained in the specification should be brought to the Engineers attention and agreement reached before any works commence.

LEGEND:


- | | |
|---|--|
|  | Existing Sub Distribution Board |
|  | Existing Fire alarm panel |
|  | Motor Control Centre |
|  | Heating System Remote control and indicator panel |
|  | Single phase Isolator switch |
|  | 3-phase isolator switch |
|  | Double pole switch |
|  | Un-switched fused spur outlet with neon indicator |
|  | Switched fused spur outlet with neon indicator |
|  | Wall mounted digital thermostat |
|  | Pressure Independent Control Valve |
|  | External heat pump unit |
|  | Duty Pump |
|  | Duty & Standby Pump |
|  | Pressurisation unit |
|  | BMS Front End PC |
|  | LV cable tray (lighting, general services and power) |

T	04/06/26	TENDER ISSUE	JV	BS
REV	DATE	DESCRIPTION	DRAWN	CHECKED

DO NOT SCALE

This drawing is representative only.
To be read in conjunction with Architects drawings.

CONSULTING ENGINEER:



Bernard Smith
Consulting
Engineers

Bernard Smith Consulting Engineers
Bracetown Business Park | Clonee | Dublin 15
t: 01-801 4127 | w: www.bernardsmith.ie | e: info@bernardsmith.ie

PROJECT:

YOUTHREACH
CASTLEBLAYNEY
CO.MONAGHAN

TITLE:

ELECTRICAL SERVICES LAYOUT

SCALE: 1:100@A1/1:200@A3	DRAWN BY: JV	JOB NO.:	DWG NO.:	REV.:
DATE: 03/04/2026	CHECK'D: BS	26-022	62-00	T

TENDER