



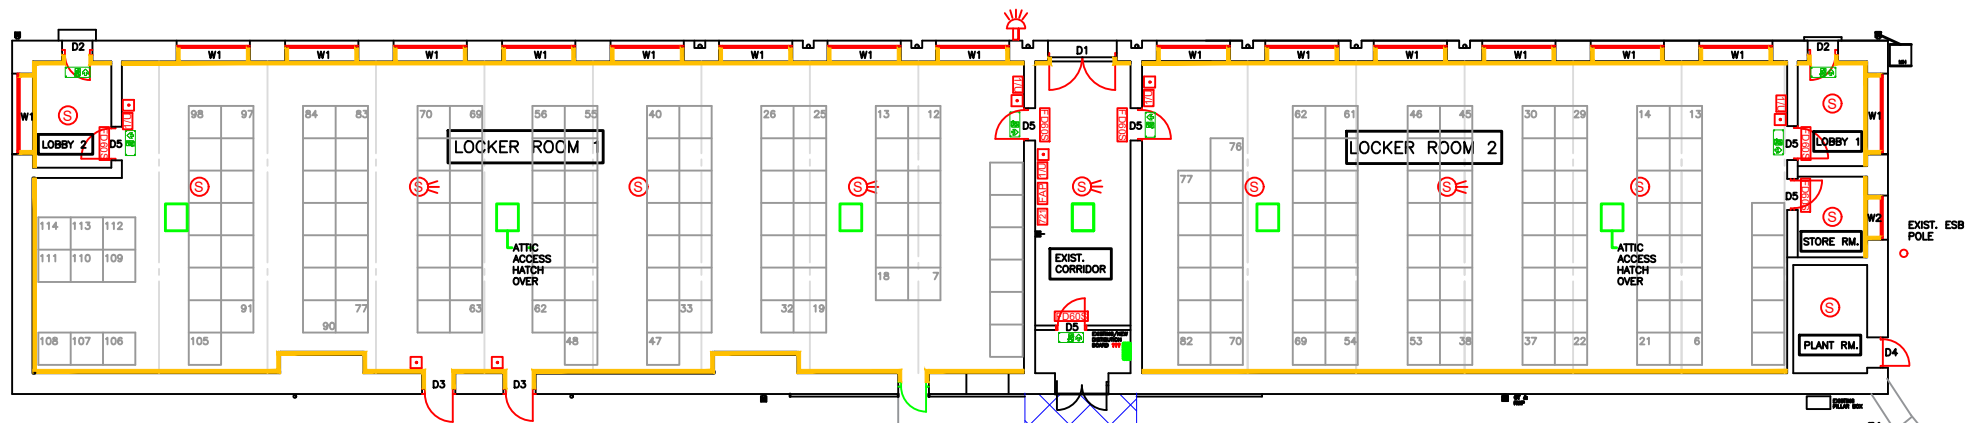


PROPOSED PLAN - FIRE DETECTION

- MAINTAINED FIRE EXIT SIGN.
- ZP720 INTELLIGENT HEAT SENSOR WITH IP PROTECTION.
- SMOKE DETECTOR
- ADDRESSABLE COMBINED SMOKE DETECTOR/SOUNDER.
- ADDRESSABLE MANUAL CALL POINT ZP785 MANUAL CALL POINT.
- ADDRESSABLE FIRE ALARM SOUNDER/STROBE.
- INTERFACE UNIT ZPA51E ADDRESSABLE INTERFACE UNIT. 721 MODULE
- FIRE ALARM PANEL
- FD30S FIRE DOOR SET
- FD60S FIRE DOOR SET
- CABLE TRAY

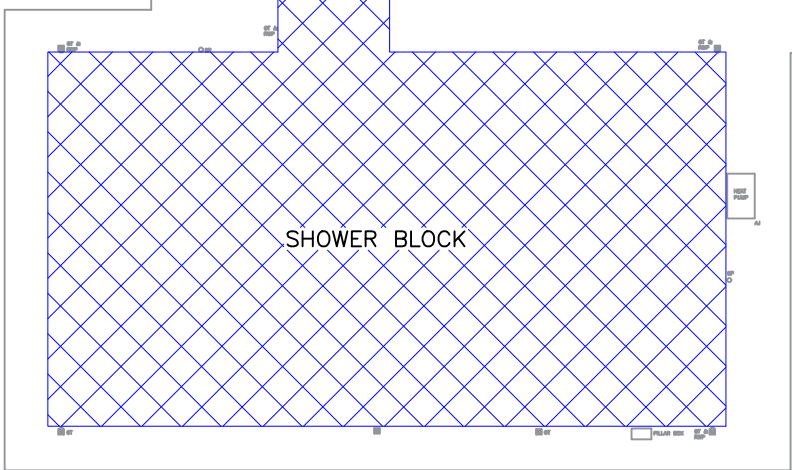

SHOWER BLOCK

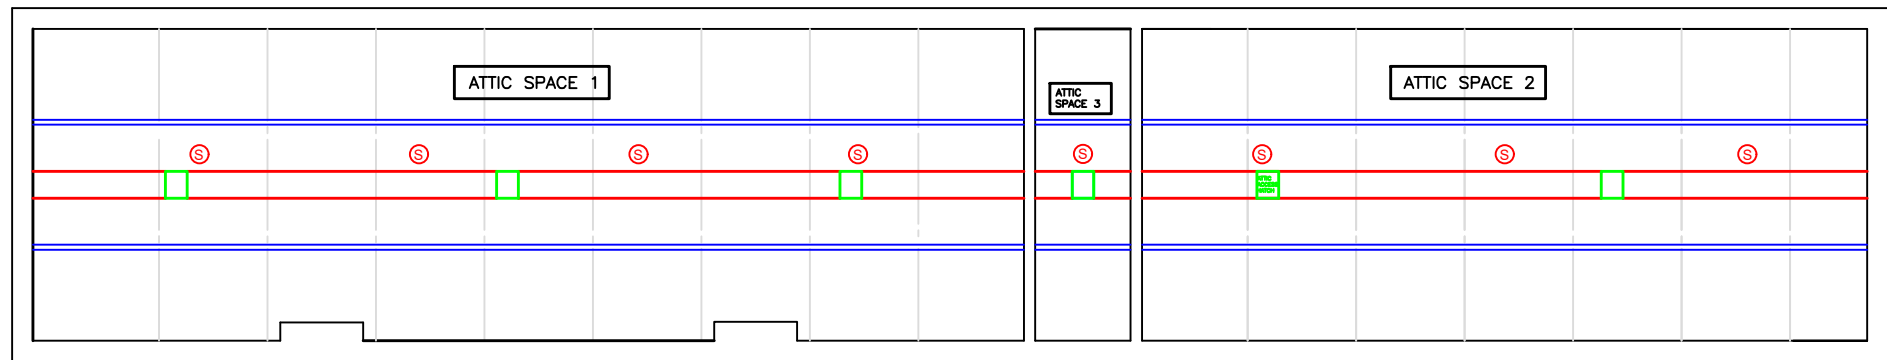

PROPOSED ATTIC - FIRE DETECTION

Date		No. Rev.	By	By
Date				
Date				
Date				
Date				
JOB: Locker Block Upgrade Dun Ui Mhaoliosia Renmore Galway				
DRAWING: Proposed Plan- Fire Detection				
SCALE: 1/100 @A1		FILE NAME:		
DRAWN BY: DK	CHECKED BY: Candit Twomey	DATE: Feb. 2026		
INDEX NO: 1B/385/25		NO OF DRAWINGS: 09 of 12		
UNIT: INFRASTRUCTURE & UTILITIES COY, ENGINEER GROUP, 1 BRIGADE, COLLINS BARRACKS, OLD YOUGHAL ROAD CORK CITY.				
Drawing No. 09				