


LEGEND

- PROPOSED PL TYPE 1
COLUMN DETAILS
HEIGHT - 6m
BRACKET LENGTH - POST-TOP
INCLINATION - 0 DEGREES
COLUMN QUANTITY - 4
LANTERN DETAILS
WATTAGE (CLO) - 13w LED
MAKE & MODEL - C.U.PHOSCO
P852K-12-R38-NW-CB0300
- PROPOSED PL TYPE 2
COLUMN DETAILS
HEIGHT - 6m
BRACKET LENGTH - POST-TOP
INCLINATION - 0 DEGREES
COLUMN QUANTITY - 5
LANTERN DETAILS
WATTAGE (CLO) - 46w LED
MAKE & MODEL - C.U.PHOSCO
P853-128-F2B-740-W5
- LIGHTING COLUMN TO BE PROTECTED IN PLACE
- LIGHTING COLUMN TO BE REMOVED
- LIGHTING COLUMN TO BE RELOCATED
- PROPOSED PUBLIC LIGHTING DUCTING & CABLING.
2x65sq NYCY CABLE LAID IN DUCTING IT
I.S.101:2020. SINGLE WALL DUCTING
HDPE, COLOUR RED TO BE USED,
107mm EXTERNAL DIAMETER, WITH WALL
THICKNESS OF 5mm. THIS DUCTING TO
HAVE THE WORDS "STREET LIGHTING"
STAMPED ON TO BE CLEARLY LEGIBLE AT
1m INTERVALS. THE LETTERING TO FACE
UPPERMOST IN THE TRENCH. ALL WORKS
TO LOCAL AUTHORITY SPECIFICATION.
- PROPOSED ESB DUCTING - 125mm RED
- PROPOSED FOUL SEWER
- PROPOSED WATERMAIN
- SURFACE WATER DRAINAGE. REFER TO
DWG 1792-111 FOR DETAILS

-  EXISTING WATERMAIN
 EXISTING FOUL
 EXISTING SURFACE WATER
 EXISTING ESB NETWORK
 EXISTING GAS NETWORK
 EXISTING EIR
 EXISTING ESAT
 EXISTING VIRGIN MEDIA
 EXISTING PUBLIC LIGHTING
 EXISTING UNKNOWN

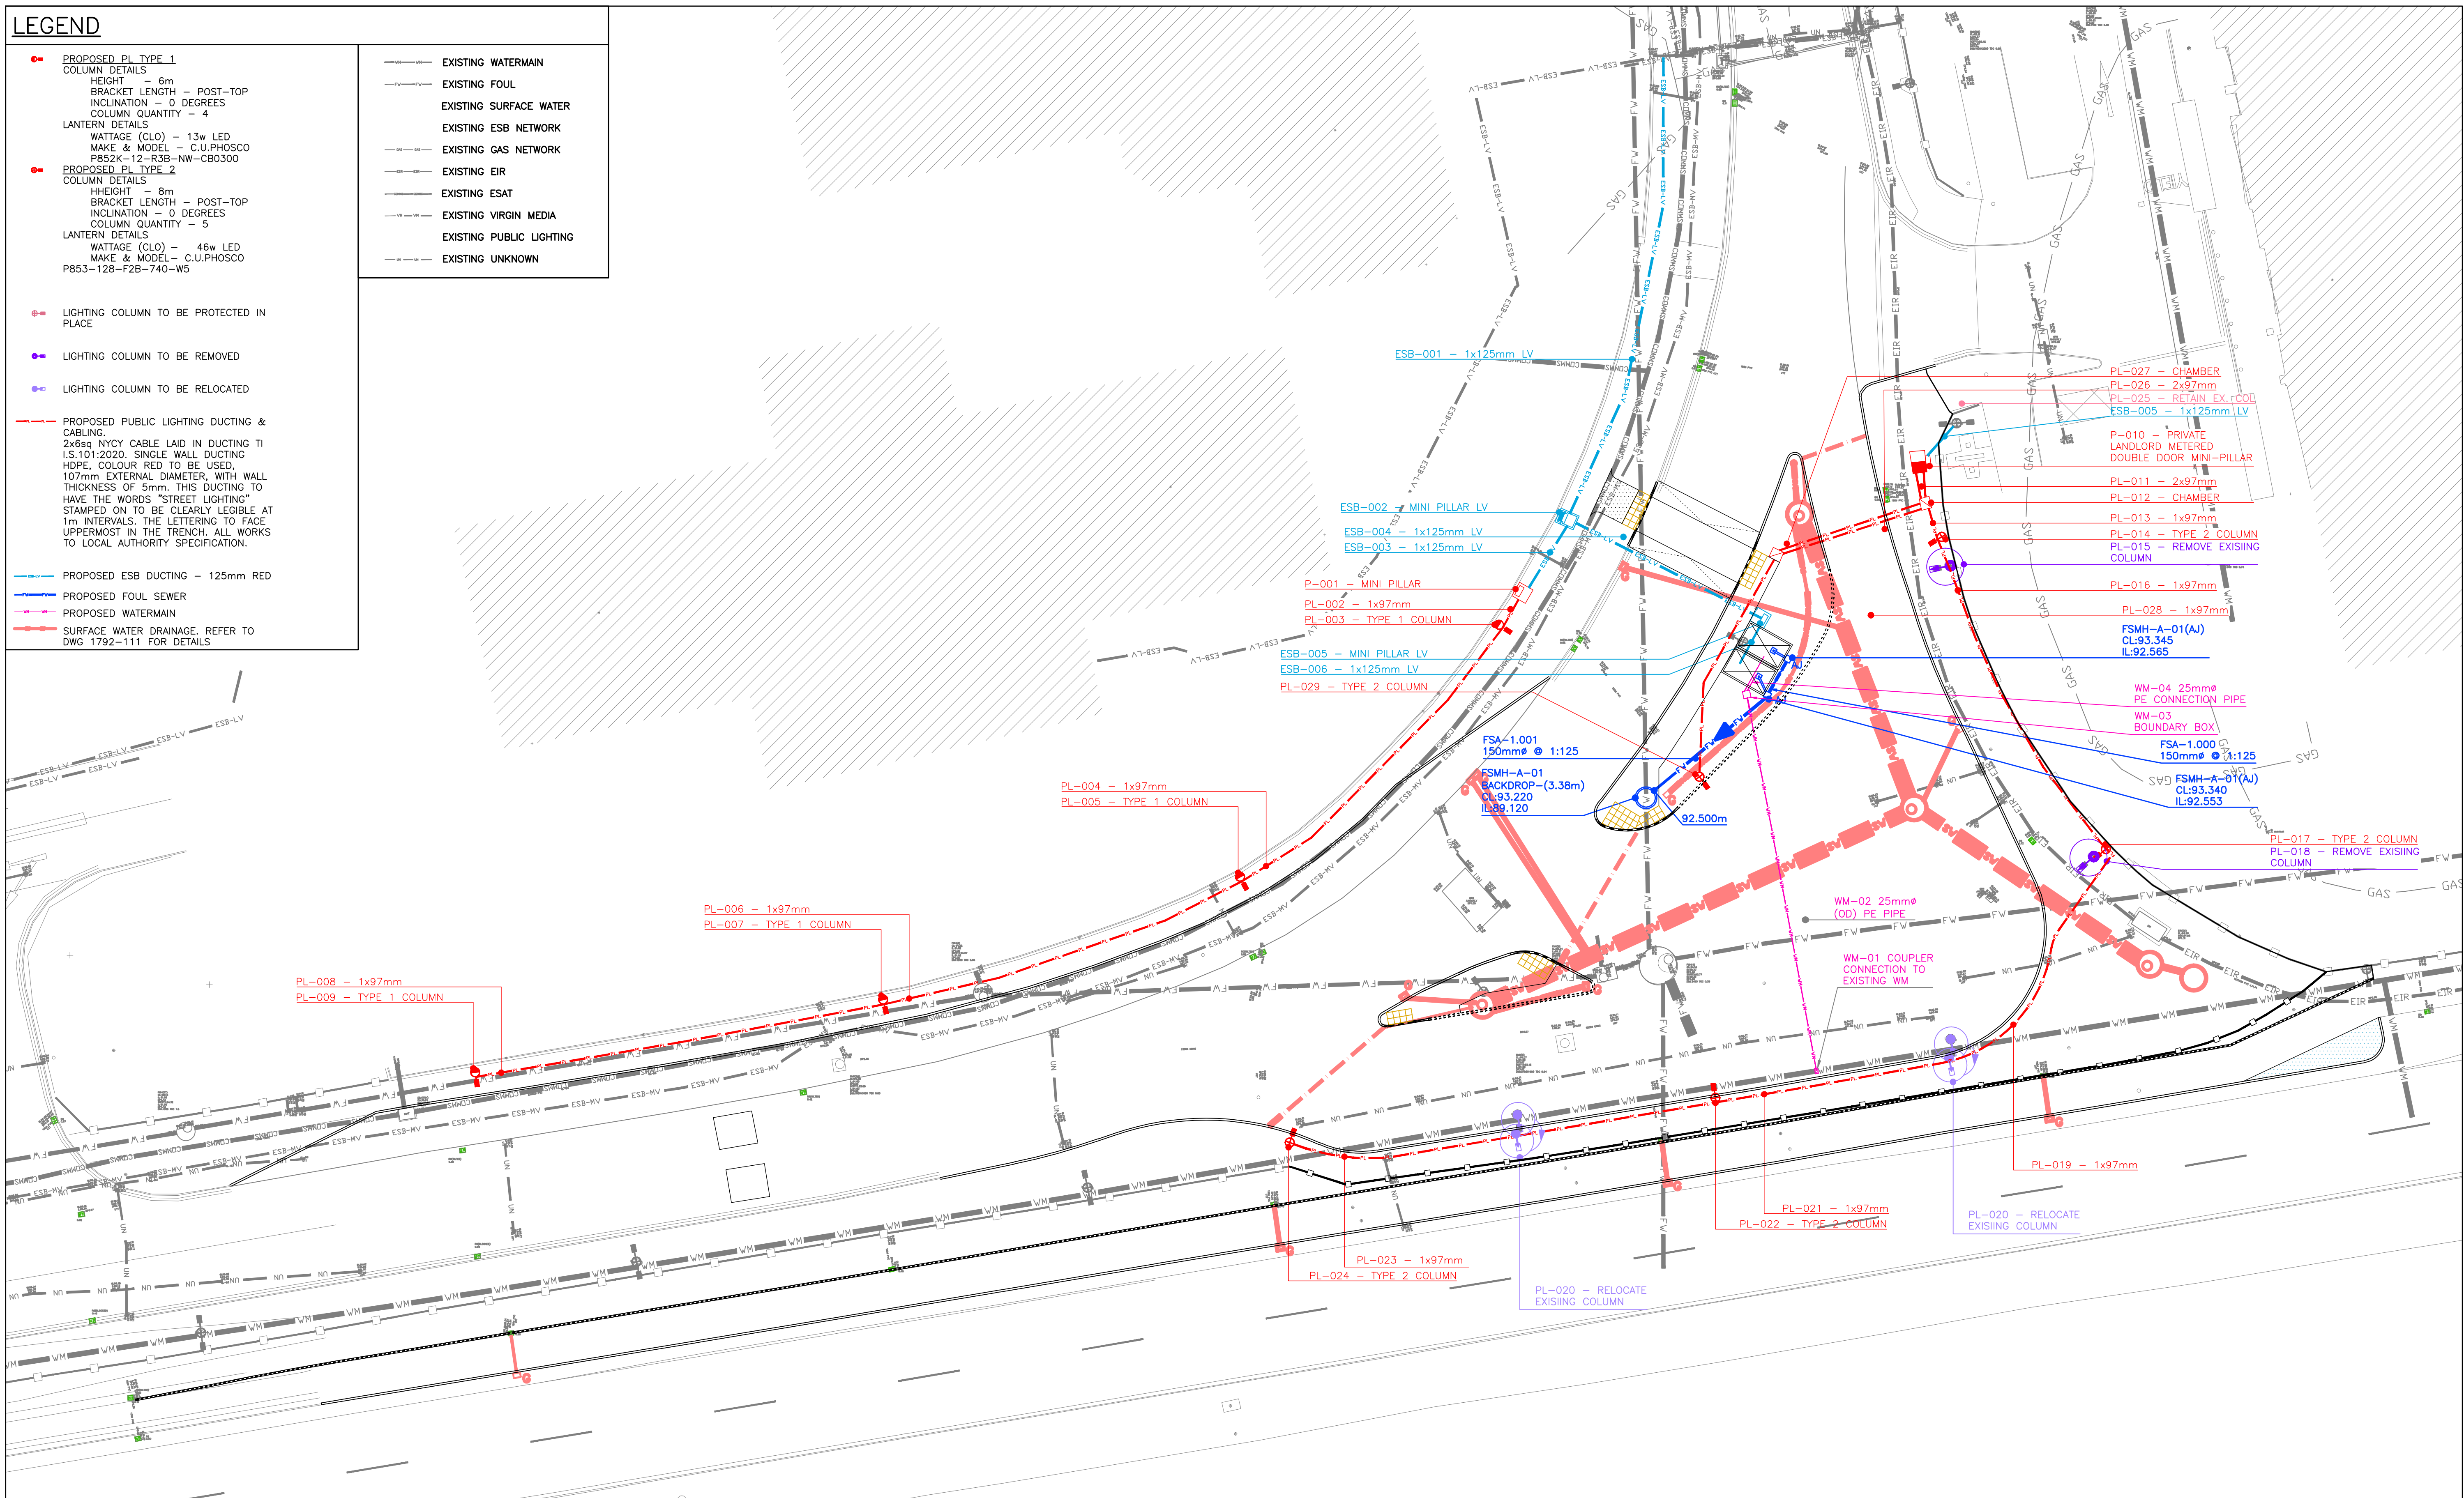

NOTES

NOTE: THESE NOTES APPLY EXCEPT WHERE OTHERWISE NOTED ON THE DRAWING OR IN THE SPECIFICATION

1. DO NOT SCALE, USE GIVEN DIMENSIONS
2. EXISTING SERVICES SHOWN ARE INDICATIVE ONLY. SITE INVESTIGATIONS ARE TO BE CARRIED OUT TO DETERMINE ACCURATE LOCATION OF EXISTING SERVICES.

NOTE
ALL LED LANTERNS MUST HAVE CONSTANT LIGHT OUTPUT (CLO).
AUTOMATICALLY DIMMED TO 75% EACH NIGHT FROM 12 MIDNIGHT TO 6AM. (U14 PROFILE)
ALL LANTERNS TO HAVE 7 PIN NEMA SOCKETS FITTED.

ELECTRONIC PHOTOCELLS SWITCHED AT 35/18LUX
ALL COLUMNS, LUMINAIRES, CABLE AND PILLARS, SHALL BE
WITH LOCAL AUTHORITY GENERAL SPECIFICATION FOR PUBLIC
LIGHTING.

NO TREES TO BE LOCATED WITHIN FALLING DISTANCE OF PL
COLUMNS.
MINIMUM SET-BACK OF COLUMNS IS 800mm FROM THE
FACE OF THE KERB

THE COPYRIGHT OF THIS DRAWING IS THE PROPERTY OF
CARROLL & BROWNE CONSULTANTS AND THE DRAWING MAY
NOT BE REPRODUCED IN WHOLE OR IN PART, IN ANY
FORM WHETHER BY PHOTOGRAPH, PHOTOCOPYING OR
REPRODUCTION AS A THREE DIMENSIONAL ARTICLE WITHOUT
THE WRITTEN PERMISSION OF CARROLL & BROWNE
CONSULTANTS

C	04/02/26	REVISED FOR NEW LAYOUT	GB
B	25/11/25	PL AND ESB ADDED	GB
A	14/11/25	ISSUED FOR DESIGN	GB
REV.	DATE	DESCRIPTION	APPR.
ORIGINAL DRAWING SIZE : 594 x 841 - A1			

EMPLOYER



**NATIONAL TRANSPORT
AUTHORITY**



**Carroll & Browne Consultants
Design and Management**

10 The Square,
Kilcock,
Co. Kildare.

Tel: +353-(0)1-460-2977

Email: info@carrollbrowne.com

DRAWN		JOB TITLE BELGARD SQUARE SOUTH BUS LAYOVER FACILITY		
DM				
CHECKED		DRAWING TITLE PROPOSED SERVICES		
GB				
APPROVED				
GB				
SCALE		JOB NO. 1792		
1:200				
DATE		STATUS DESIGN		REV. C
02/10/25				
		DRAWING NO. 104		