


GENERAL NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL, AND STRUCTURAL SPECIFICATIONS & REQUIREMENTS.
2. THE MECHANICAL CONTRACTOR SHALL CO-ORDINATE PLUMB WITH ALL OTHER TRADES BEFORE COMMENCING WORK. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE HVAC CONTRACTOR TO CO-ORDINATE ALL SERVICES.
3. THE MECHANICAL CONTRACTOR SHALL ALLOW FOR CO-ORDINATING THE MECHANICAL INSULATION WITH THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MECHANICAL CONTRACTOR TO CO-ORDINATE ALL SERVICES.
4. ALL DIMENSIONS NOT SPECIFIED HEREIN SHALL BE TAKEN ON THE FACE UNLESS OTHERWISE NOTED.
5. THE MECHANICAL CONTRACTOR SHALL ALLOW FOR THE SUPPLY AND INSULATION OF ALL MECHANICAL SERVICES INDICATED ON THIS DRAWING.
6. ALL DIMENSIONS NOT SPECIFIED HEREIN SHALL BE TAKEN ON THE FACE UNLESS OTHERWISE NOTED.

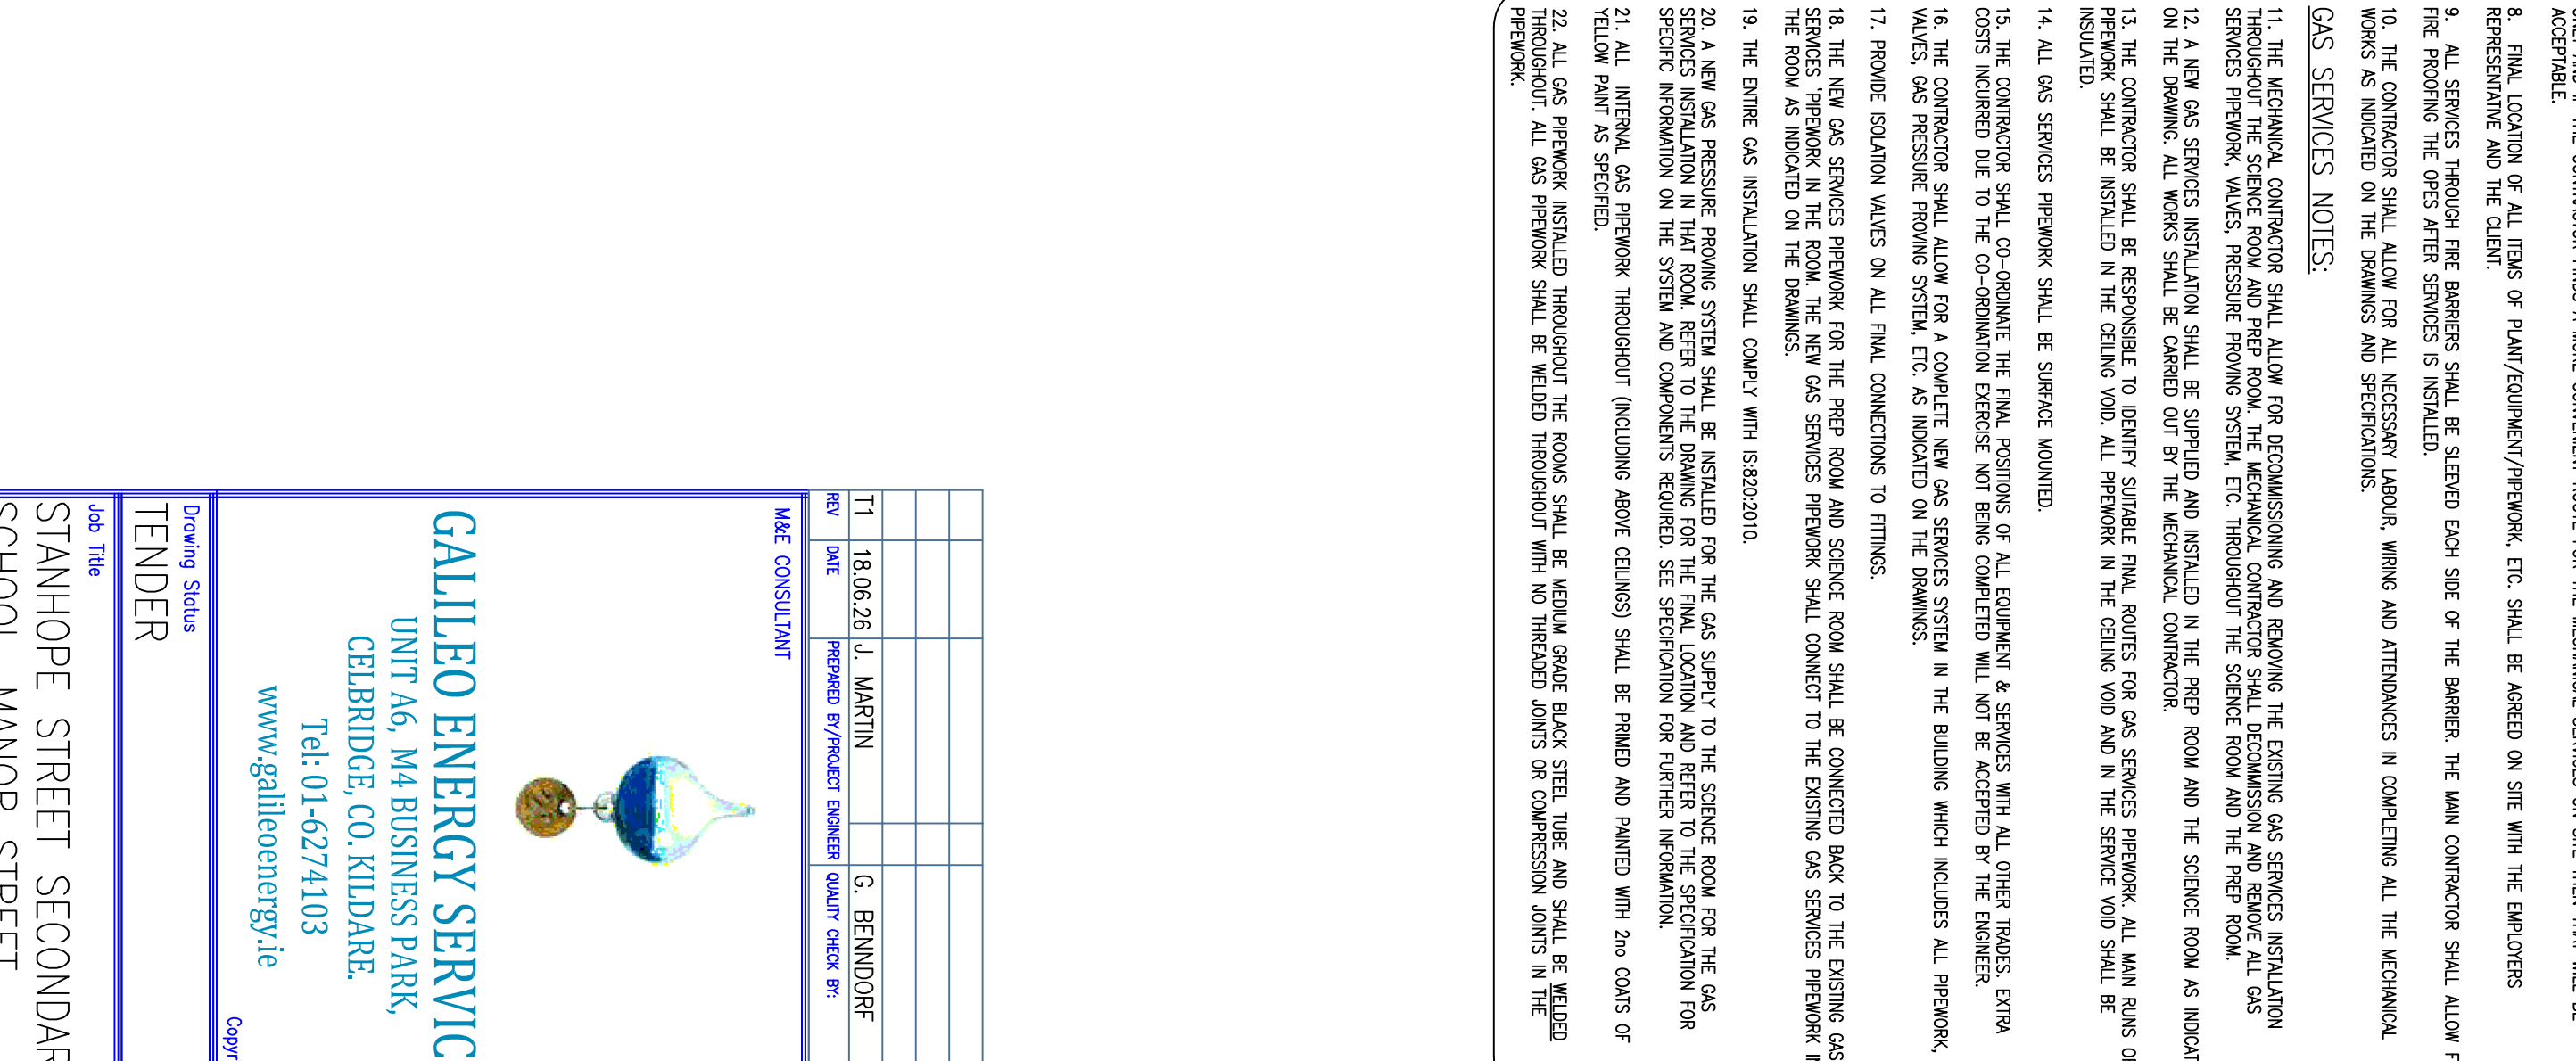

THE ROOM AS INDICATED ON THE DRAWINGS.

2. ALL GAS SERVICES, PENWORK SHALL BE SURFACE MOUNTED.
3. THE CONTRACTOR SHALL BE RESPONSIBLE TO IDENTIFY SURFACE FINAL ROUTES FOR GAS SERVICES PENWORK. ALL MAIN LINES OF PENWORK SHALL BE INSTALLED IN THE CEILING VOID AND IN THE SERVICE VOID SHALL BE INSTALLED.
4. DO NOT SCALE THIS DRAWING. ALL DIMENSIONS TO BE TAKEN ON SITE.
5. THE MECHANICAL CONTRACTOR SHALL ALLOW FOR THE SUPPLY AND INSTALLATION OF ALL MECHANICAL SERVICES INDICATED ON THE DRAWING.
6. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO IDENTIFY SURFACE FINAL ROUTES FOR PENWORK, MECHANICAL SERVICES, ETC. AS INDICATED ON THE DRAWINGS.
7. NEW MAIN RUN OF MECHANICAL, PENWORK AND SERVICES SHALL BE INSTALLED IN THE AREAS AS INDICATED. THIS IS UNQUOTE "AS NEAR AS POSSIBLE" TO THE EXISTING SERVICES.
8. ANY MAIN RUN OF THE CONTRACTOR HITS A WORKING CONDUIT FOR THE MECHANICAL SERVICES ON SITE THEN IT WILL BE ACCEPTABLE.
9. FINAL LOCATION OF ALL ITEMS OF PLUMBING/FITTING/PENWORK, ETC. SHALL BE AGREED ON SITE WITH THE EMPLOYERS REPRESENTATIVE AND THE CLIENT.
10. ALL SERVICES THROUGH ROOF BARBERS SHALL BE SITED EACH SIDE OF THE BARBER. THE MAIN CONTRACTOR SHALL ALLOW FOR THE PROTECTING THE ROOF AFTER SERVICES IS INSTALLED.
11. THE CONTRACTOR SHALL ALLOW FOR ALL NECESSARY LIFTING, WELDING AND ATTENDANCES IN COMPLETING ALL THE MECHANICAL WORKS AS INDICATED ON THE DRAWINGS AND SPECIFICATION.
12. GAS SERVICES NOTES:
 1. THE MECHANICAL CONTRACTOR SHALL ALLOW FOR RECOMMENDING AND PROVIDING THE EXISTING GAS SERVICES INSTALLATION THROUGHOUT THE SERVICE ROOM AND PREP ROOM. THE MECHANICAL CONTRACTOR SHALL RECOMMENDING AND REMOVE ALL GAS SERVICES PENWORK, VALVES, PRESSURE RISING SYSTEM, ETC. THROUGHOUT THE SERVICE ROOM AND THE PREP ROOM.
 2. A NEW GAS SERVICES INSTALLATION SHALL BE SITED AND INSTALLED IN THE PREP ROOM AND THE SERVICE ROOM AS INDICATED ON THE DRAWING. ALL WORK SHALL BE CARRIED OUT BY THE MECHANICAL CONTRACTOR.
13. THE CONTRACTOR SHALL BE RESPONSIBLE TO IDENTIFY SURFACE FINAL ROUTES FOR GAS SERVICES PENWORK. ALL MAIN LINES OF PENWORK SHALL BE INSTALLED IN THE CEILING VOID AND IN THE SERVICE VOID SHALL BE INSTALLED.

19. THE ENTIRE GAS INSTALLATION SHALL COMPLY WITH IS820:2010.

20. A NEW GAS PRESSURE PROVING SYSTEM SHALL BE INSTALLED FOR THE GAS SUPPLY TO THE SCIENCE ROOM FOR THE GAS SERVICES INSTALLATION IN THAT ROOM. REFER TO THE DRAWING FOR THE FINAL LOCATION AND REFER TO THE SPECIFICATION FOR SCIENTIFIC INFORMATION ON THE SYSTEM AND COMPONENTS REQUIRED. SEE SPECIFICATION FOR FURTHER INFORMATION.

21. ALL INTERNAL GAS PIPework THROUGHOUT (INCLUDING ABOVE CEILINGS) SHALL BE PRIMED AND PAINTED WITH TWO COATS OF YELLOW PAINT AS SPECIFIED.

22. ALL GAS PIPework INSTALLED THROUGHOUT THE ROOMS SHALL BE MEDIUM GRADE BLACK STEEL. THREE AND SHALL BE WELDED THROUGHOUT. ALL GAS PIPework SHALL BE WELDED THROUGHOUT WITH NO THREADED JOINTS OR COMPRESSION JOINTS IN THE PIPework.

INSTALLED IN THE SCIENCE ROOMS AND PREP ROOM.

Architect	McLaughlin Architects Unit 48, Elm House Millennium Park, Naples, Co. Kildare	
Drawing No:	54(M001)	
Job No.	Drawn By	Scale:
26-027	J.M.	1:50 on A1