



FIRST FLOOR

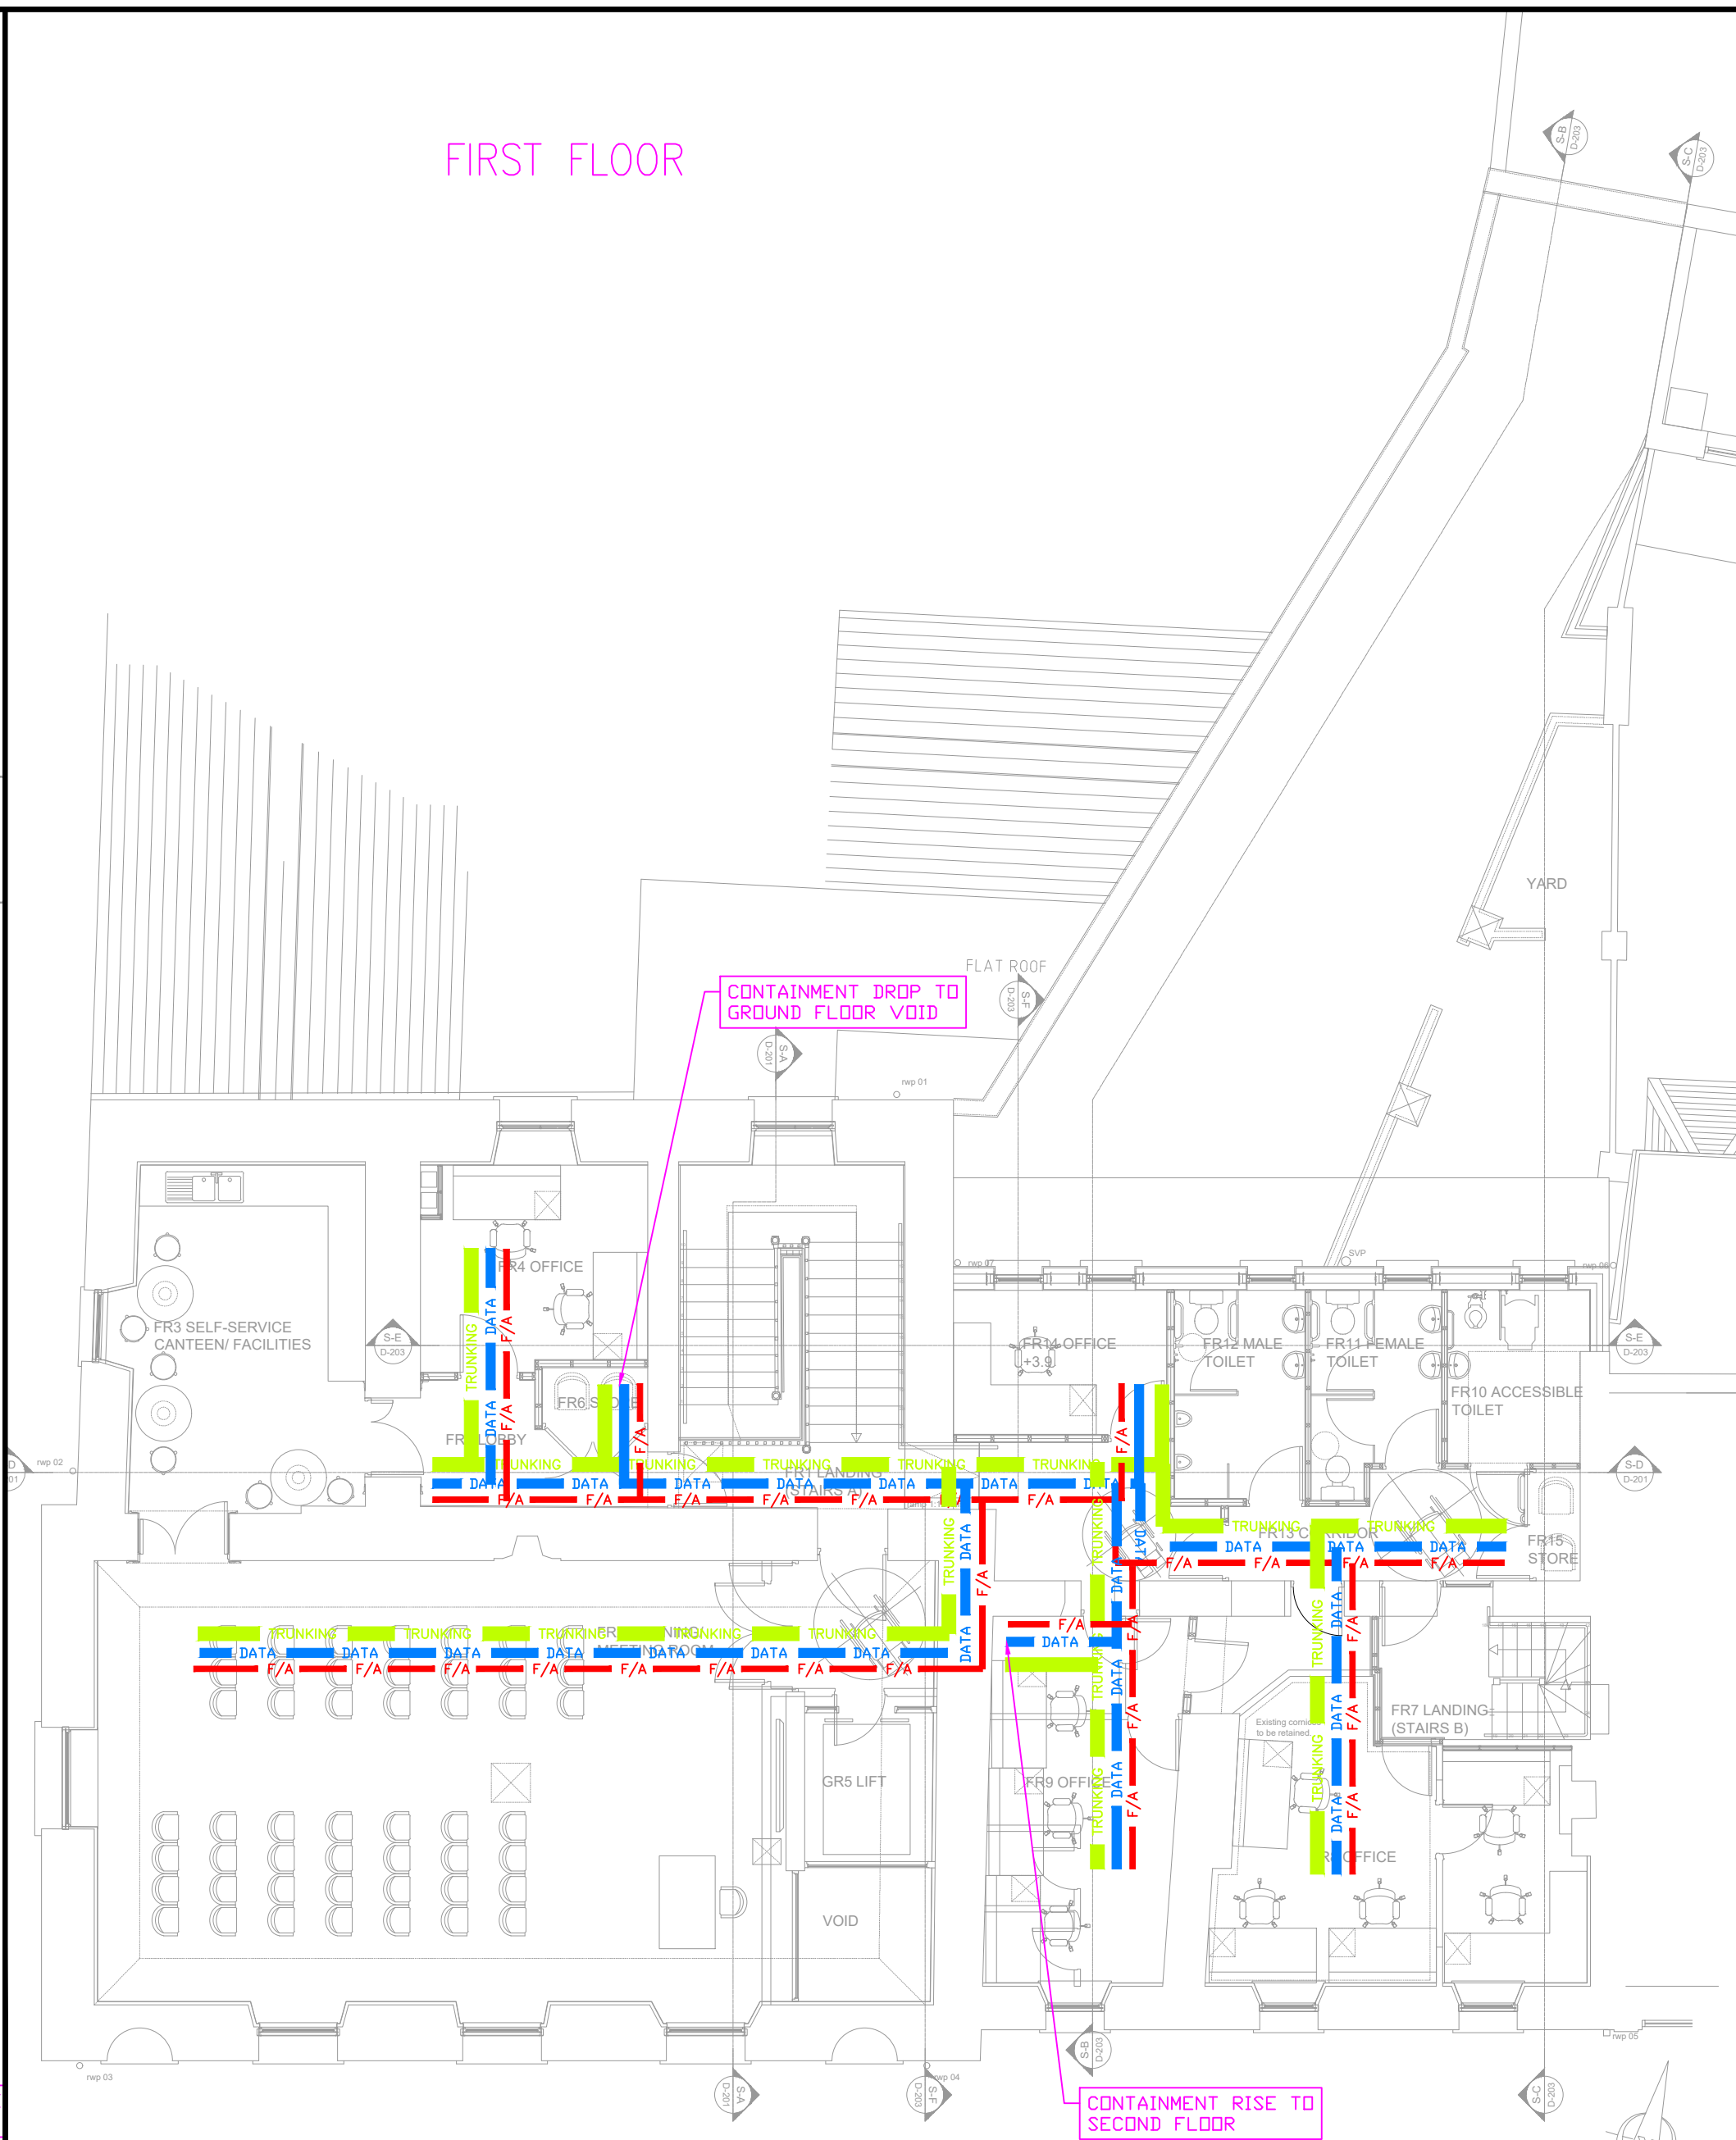

ATTIC

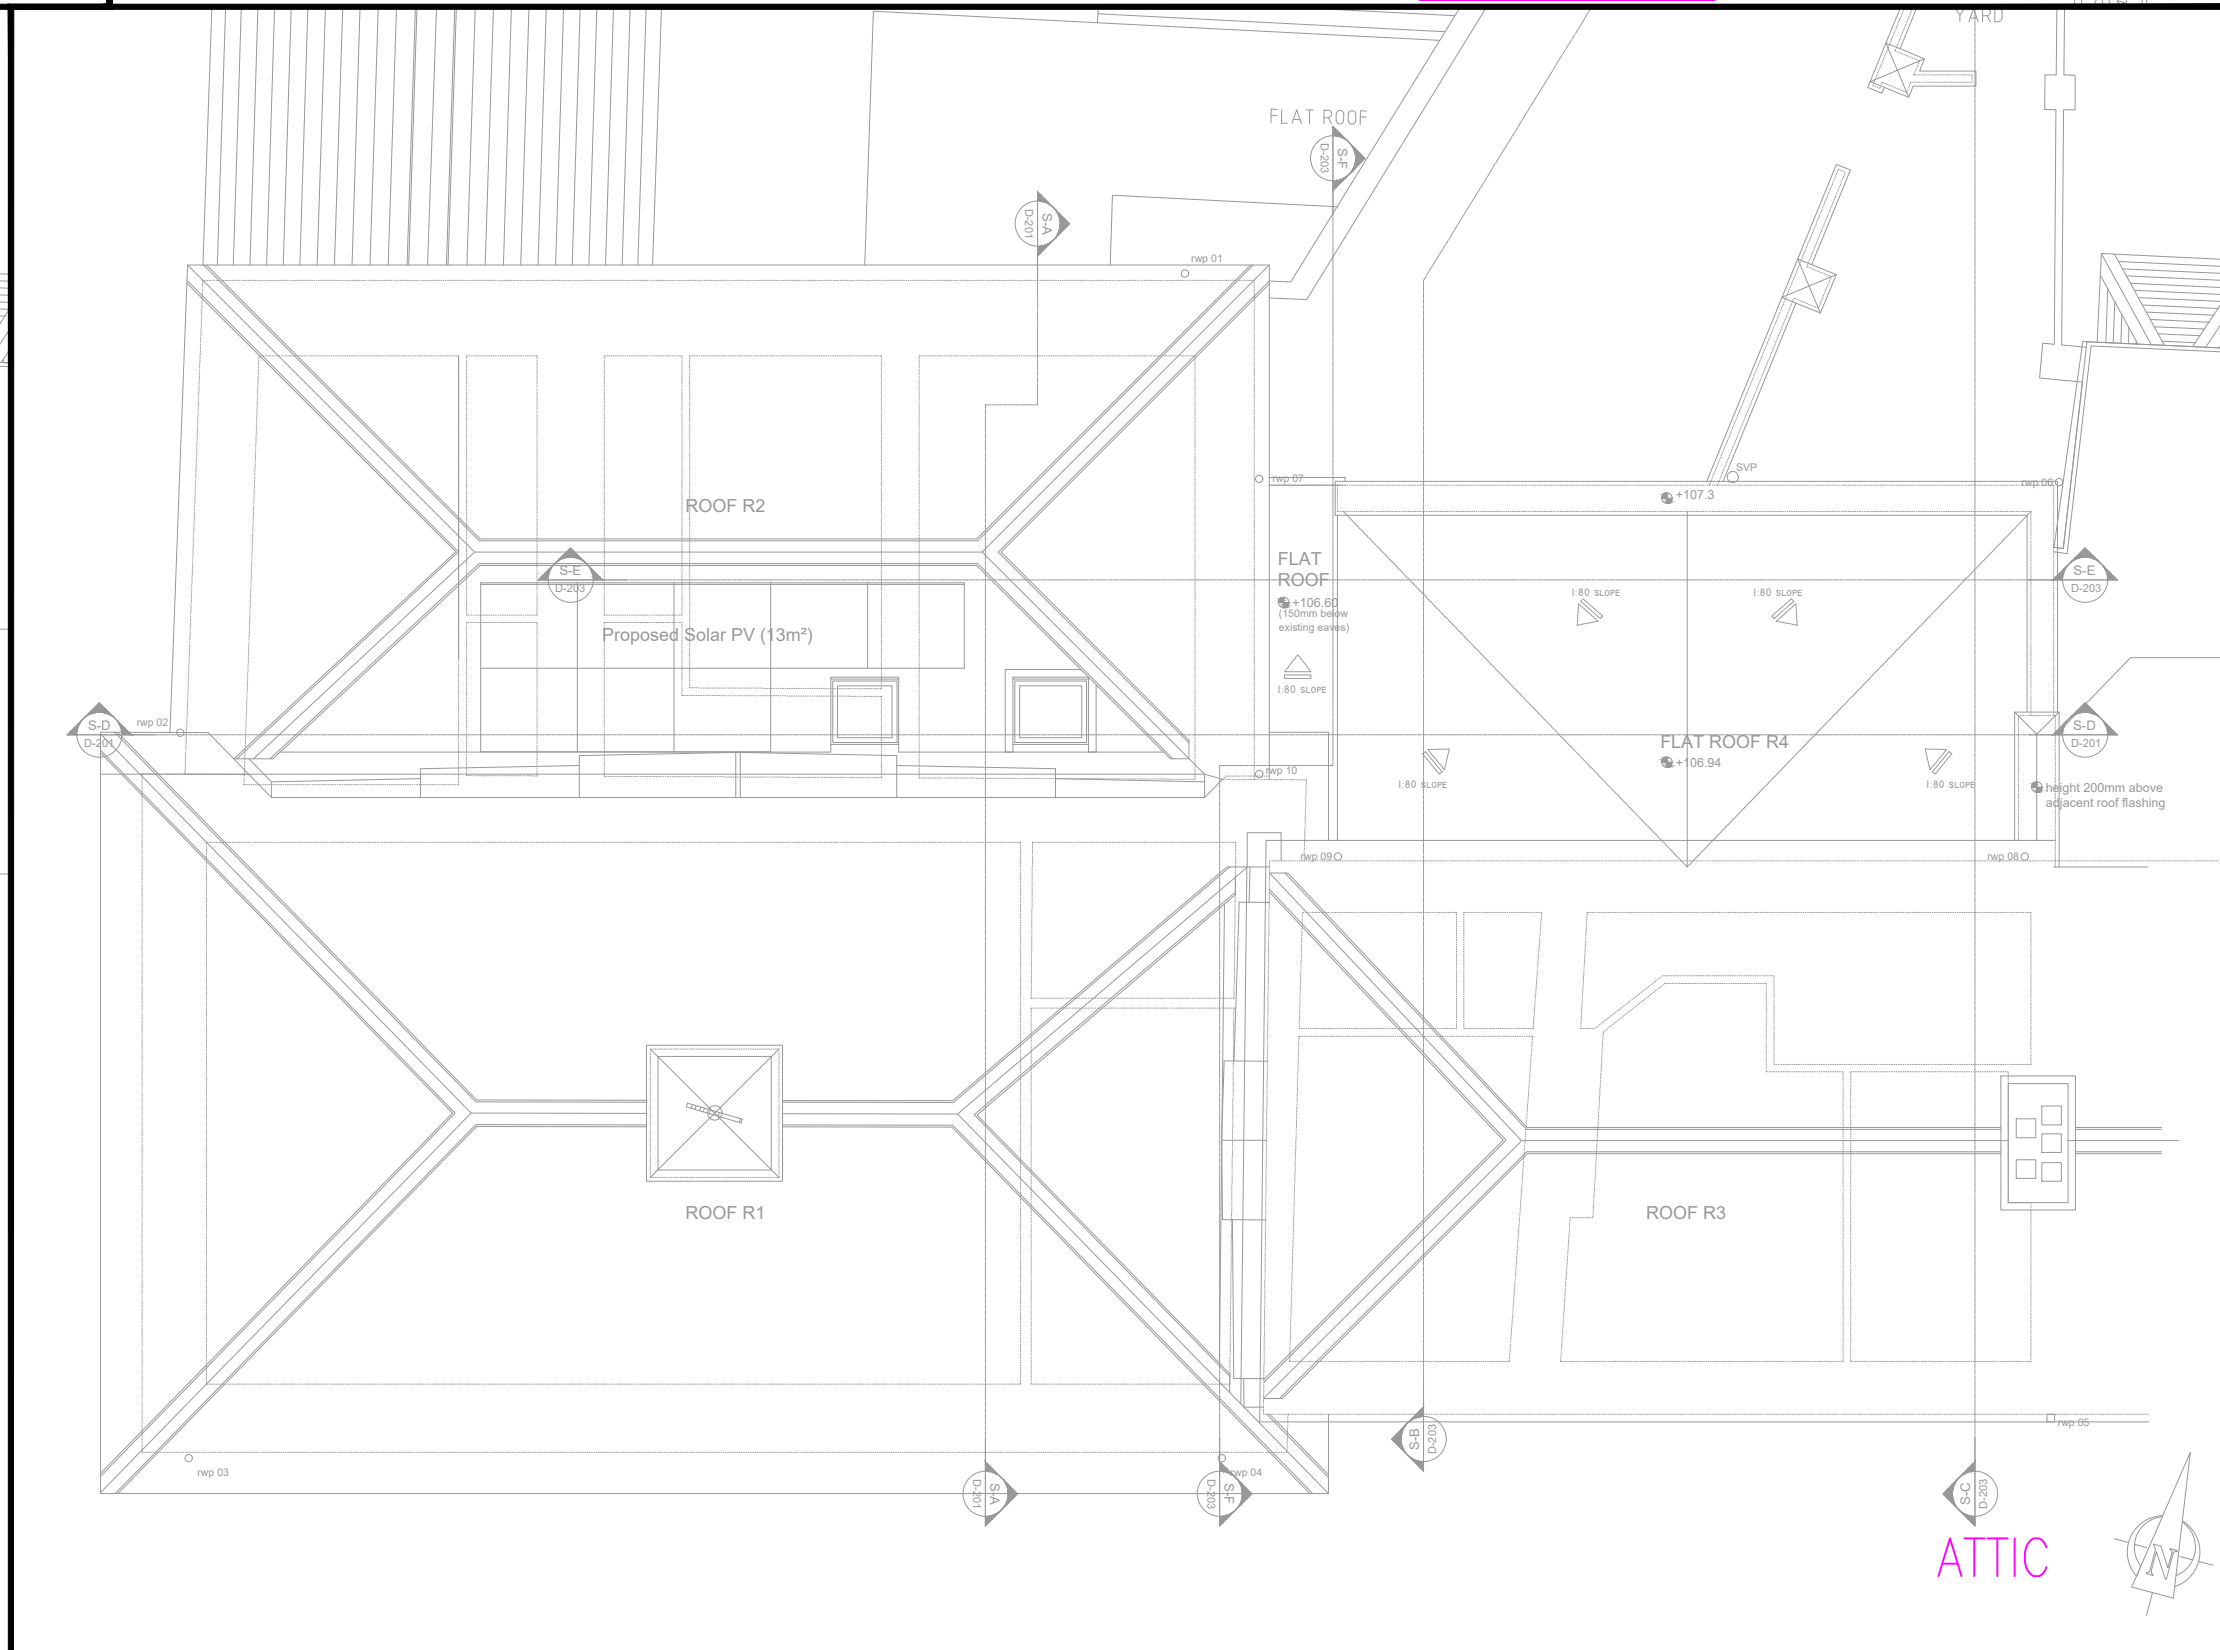

	CABLE TRUNKING (SIZE AS NOTED)
	LV CABLE TRAY (SIZE AS NOTED)
	DATA/ELV CABLE MESH TRAY (SIZE AS NOTED)
	FIRE RATED METAL FIRE ALARM CONTAINMENT 75mm x 25mm
	DISTRIBUTION BOARD
	MECHANICAL CONTROL PANEL (MCC)
	ELECTRICAL POWER DUCTS (SIZE AS NOTED)
	ESB SUPPLY DUCTS (SIZE AS NOTED)
	TELECOMMUNICATIONS SERVICE PROVIDER DUCTS (SIZE AS NOTED)

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, C&S ENGINEERS DRAWINGS & SPECIFICATIONS.
2. ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH THE RELEVANT BUILDING REGULATIONS.
3. DO NOT SCALE - WORK TO FIGURE DIMENSIONS ONLY.

[illegible]

ENTERTAINMENT SERVICES LAYOUT



Hayes Higgins
Partnership

Gas House Lane, Kilkenny.

 Gas House Lane, Kilkenny
(056) 7764771 info@h20.ie

 The Gages House, 11 Gage Lane, Smithfield,
Dublin 7 (01) 6625804 ash@h20hayeshiggins.ie

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH THE RELEVANT SECTIONS OF THE SPECIFICATION, SCHEDULES, ARCHITECTS AND STRUCTURAL ENGINEERS DRAWINGS.
2. THIS INFORMATION IS INDICATIVE ONLY, THE CONTRACTOR SHALL PROVIDE ALL BENDS, TEES AND CROSS-OVERS THAT ARE REQUIRED TO MEET CURRENT ETCI STANDARDS. THE ROUTES INDICATED ARE MAIN ROUTES ONLY, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROVISION OF ALL TRAY AND TRUNKING TO ENSURE MECHANICAL PROTECTION OF ALL CABLING.
3. LOCATION OF MAIN BOARD & ESB METER SHALL INSURE THAT A 1.2M THROW BACK IS MAINTAINED.
4. 150MM X 150MM HEADER TRUNKING TO BE PROVIDED ABOVE ALL DISTRIBUTION BOARDS.
5. THIS DRAWING IS SCHEMATIC ONLY, CONTRACTOR TO ALLOW FOR ALL TEE-OFFS REQUIRED WHETHER THEY ARE INDICATED ON THE DRAWING OR NOT
6. THE CONSULTING ENGINEERS SHALL BE NOTIFIED BY THE CONTRACTOR OF ANY OMISSIONS OR ERRORS.
7. 25% CAPACITY SHALL BE LEFT IN ALL CONTAINMENT.
8. THE CONTRACTOR SHALL CO-ORDINATE THE INSTALLATION OF ALL POWER SERVICES WITH ALL OTHER EQUIPMENT AND TRACES.
9. CONTRACTOR SHALL ALLOW FOR ALL CONTAINMENT DROPS AND RISERS NOT INDICATED ON THE DRAWINGS.
10. MAIN CABLE CONTAINMENT ROUTES SHOWN ONLY, CONTRACTOR SHALL ALLOW FOR ALL ADDITIONAL BRANCH CONTAINMENT AS NECESSARY TO COMPLETE THE INSTALLATION.
11. CONDUIT DROPS TO SERVICES SHALL BE STEEL TYPE
12. THE ROUTES SHOWN ARE INDICATIVE ONLY, THE CONTRACTOR SHALL ALLOW FOR TRUNKING AND TRAY WITHIN EACH ROOM.
13. FIRE ALARM CONTAINMENT TO BE ALLOWED FOR AS NECESSARY.
14. THE CONTRACTOR SHALL PROVIDE FOR ALL ASSOCIATED BUILDERS WORK FOR TIE-INS TO THE EXISTING SCHOOL, INCLUDING THE REMOVAL AND REINSTALLATION OF EXISTING CEILING TILES / CEILINGS