


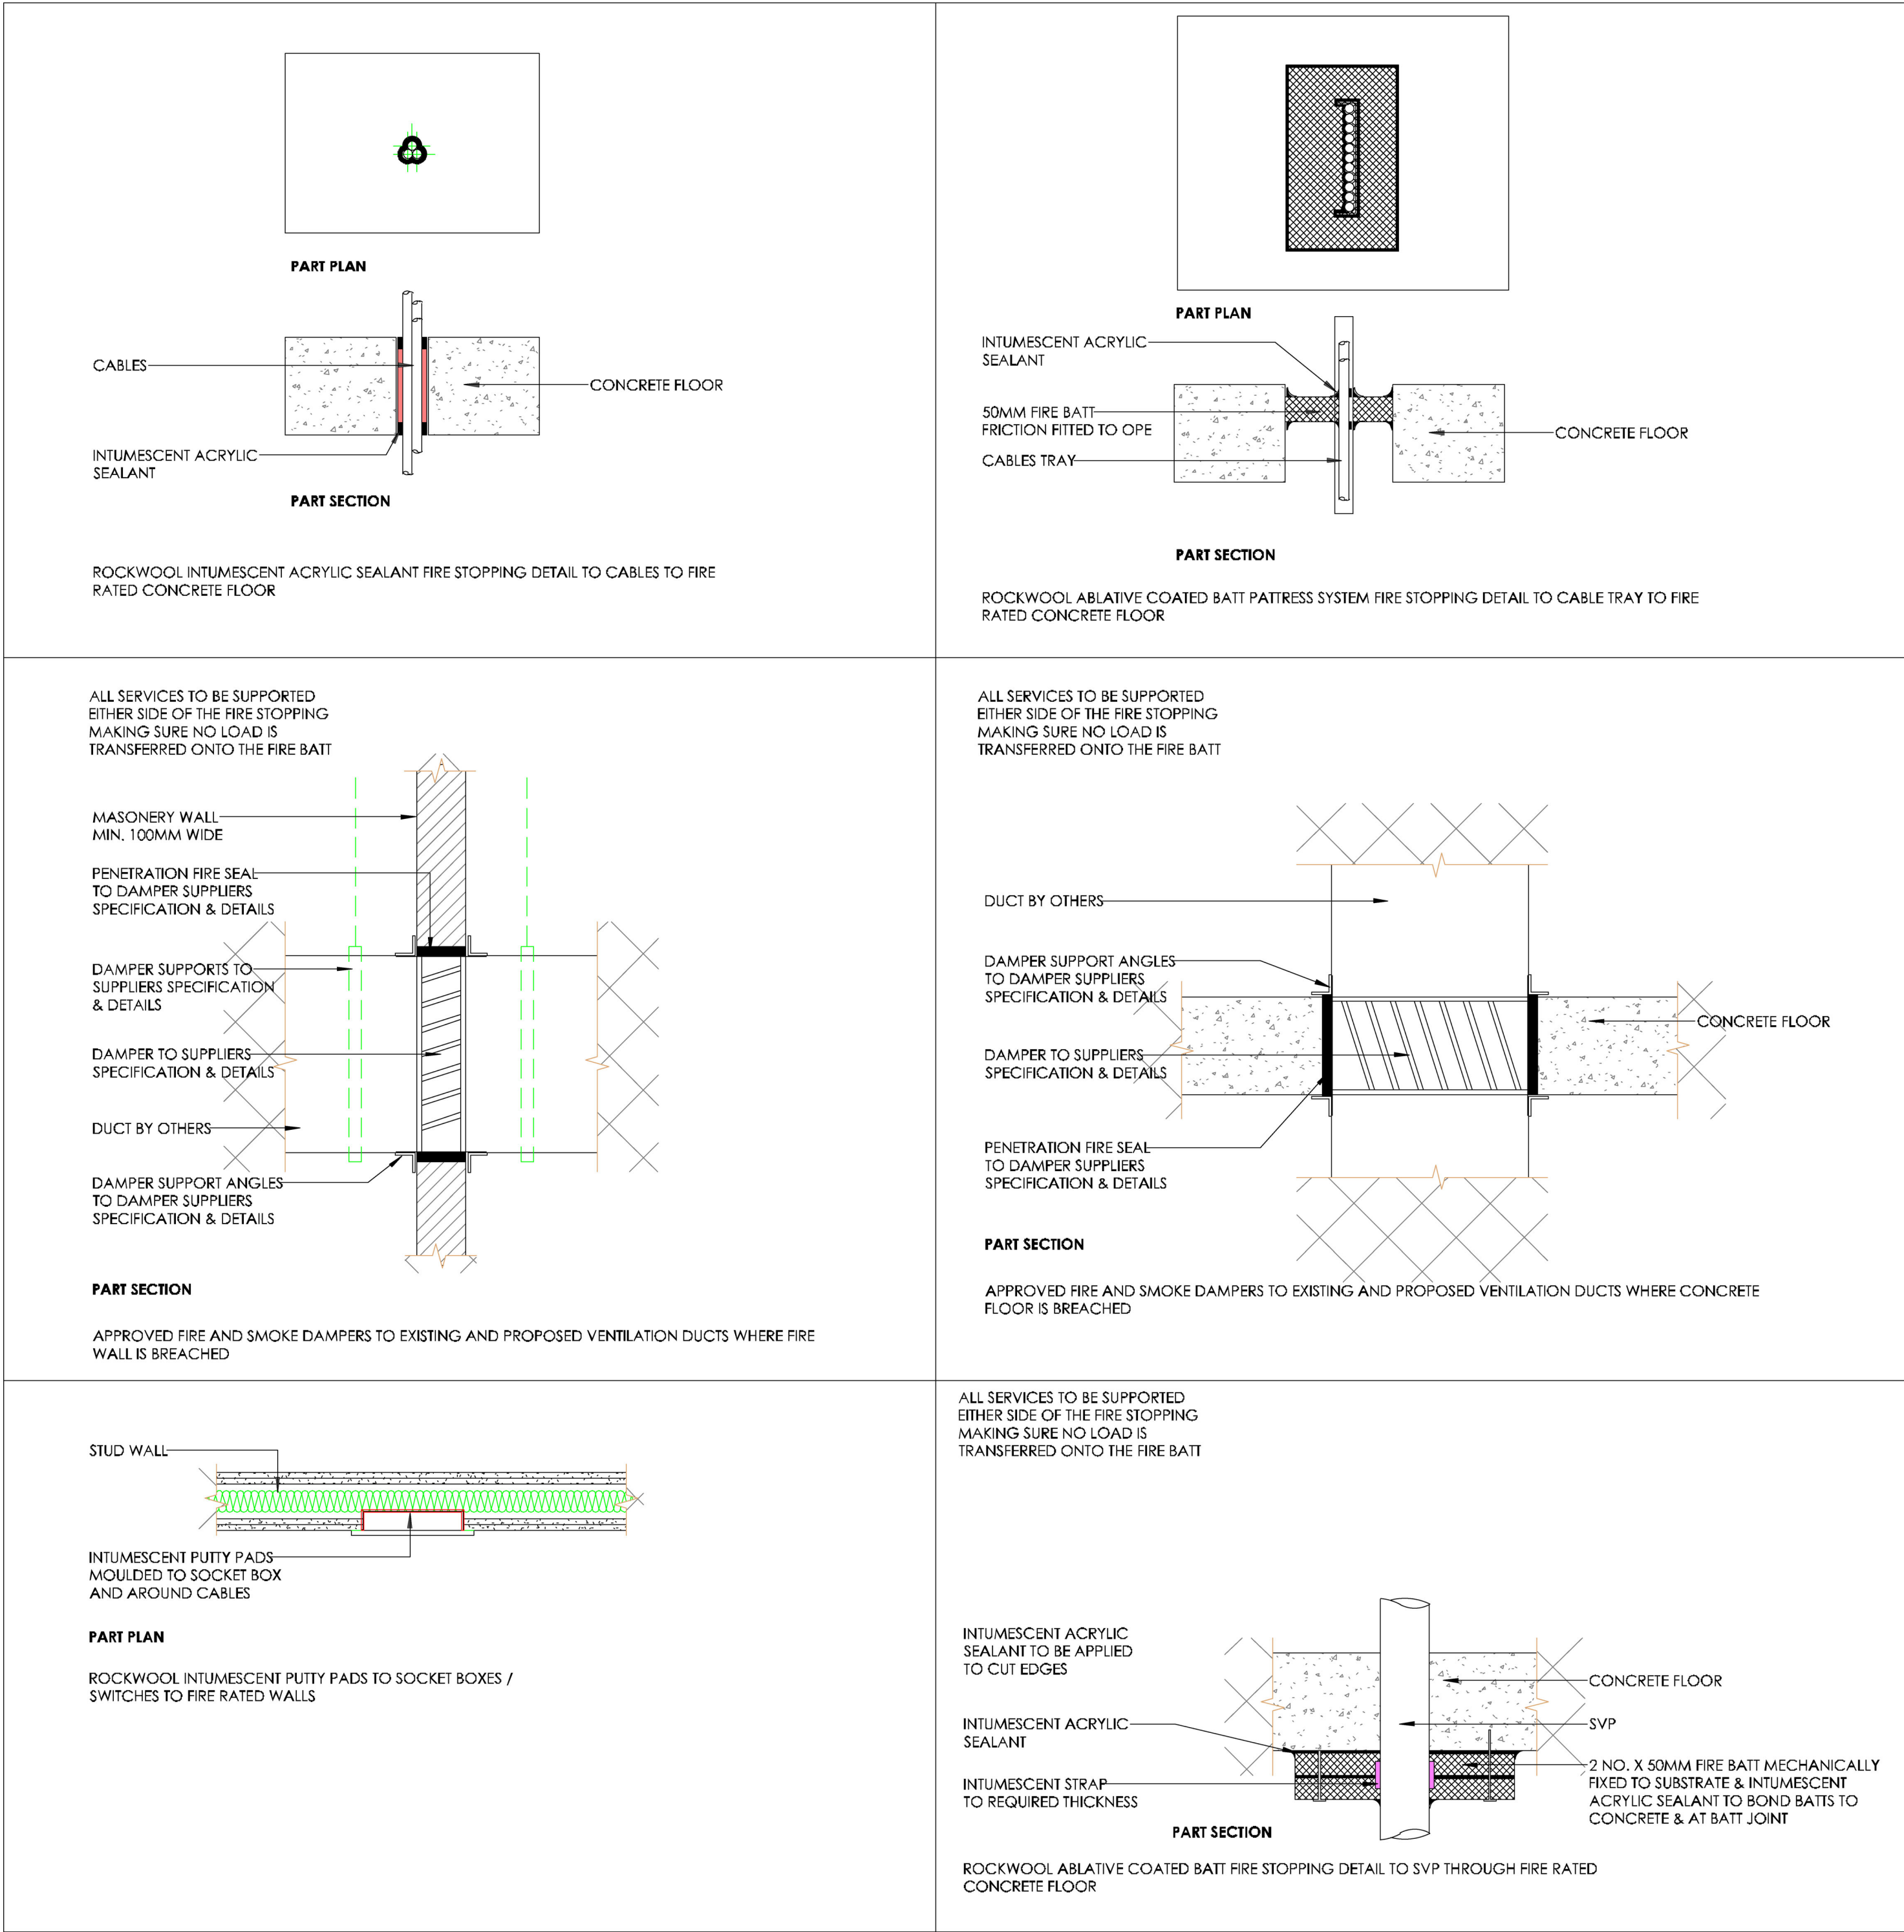

NOTES:

GENERAL:

ROCKWOOL FIRE STOPPING SYSTEMS TO BE INSTALLED TO SUPPLIERS/MANUFACTURES DETAILS AND IN ACCORDANCE THE RELEVANT CURRENT BUILDING REGULATIONS AND EUROPEAN/BRITISH STANDARDS. ENSURE FIRE STOPPING METHOD BEING INSTALLED IS APPROVED FOR USE WITH THE SELECTED PIPE/CABLE DIAMETER, PIPE/CABLE MATERIAL, TYPE OF SERVICE AND SUBJECTED TO THE APPROPRIATE TESTS. TECHNICAL SUBMITTALS TO BE PROVIDED. CONTRACTORS RESPONSIBILITY TO ENSURE FIRE STOPPING PRODUCTS ARE PROVIDING THE REQUIRED FIRE RESISTANCE FOR THE LOCATION OF SUCH PRODUCTS.

ROCKWOOL ABLATIVE COATED (FIRE) BATT:

ENSURE WITHIN ALL APERTURE ARE CLEAN AND FREE OF DEBRIS, LOOSE CEMENT AND REMOVE ALL DUST FROM SURFACES REQUIRING INSULATION. UNLESS STATED ROCKWOOL FIRE BATTS TO BE FRICTION FITTED TO APERTURE. ROCKWOOL FIRE BATT THICKNESS TO ACHIEVE REQUIRED FIRE RESISTANCE AND FIRE RESISTANCE TO MATCH THE REQUIREMENTS OF THE SUBSTRATE. ROCKWOOL FIRE BATTS FOR PATRESS DETAIL TO BE MECHANICALLY FIXED TO SUBSTRATE. ALL ROCKWOOL FIRE BATTS TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL INTUMESCENT ACRYLIC SEALANT:

ROCKWOOL INTUMESCENT ACRYLIC SEALANT. SEALANT JOINTS WIDTHS AND DEPTHS TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. WHERE REQUIRED POLYETHYLENE/POLYUTETHANE BACKING MATERIAL TO BE USED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL FIREPRO PIPE COLLAR CE (FIRE COLLARS):

ROCKWOOL FIREPRO COLLAR CE TO BE APPROPRIATELY SIZED ON SITE. COLLARS TO BE FIXED IN PLACE USING NON-COMBUSTIBLE FIXINGS SUITABLE FOR APPROPRIATE SUBSTRATES. ROCKWOOL FIREPRO COLLAR CE TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL PILLOW CE (SEAL BAGS / PILLOWS):

ROCKWOOL PILLOW CE TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL FIRE BARRIER (FRICTION FIT):

ROCKWOOL BARRIER SYSTEM TO BE CUT TO APPROPRIATE HEIGHT AND FRICTION FITTED WITHIN OPENING. ROCKWOOL INTUMESCENT ACRYLIC SEALANT TO BE INTUMESCENT ACRYLIC SEALANT APPLIED TO JOINTS AND PERIMETER OF BARRIER. ROCKWOOL BARRIER SYSTEM TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL FIRE BARRIER SYSTEM (CLAMPED):

ROCKWOOL BARRIER SYSTEM WITH CLAMPING PLATES AND SUPPORT ANGLES WITH SELF TAPING SCREWS AT 450mm C/C. ADJACENT BARRIERS MUST BE CLOSELY BUTT JOINTED OR OVERLAPPED AND THROUGH STITCHED WITH 0.9mm GLAVANISHED ANNEALED WIRE. WHERE THE BARRIER ABUTS A PROFILE SUCH AS A TRAPEZOIDAL DECK THE MATERIAL MUST BE CUT TO SUIT AND SECURED TO FIRE STOP GAP. ROCKWOOL FIRE BARRIER SYSTEM TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

DAMPERS DUCTWORK:

APPROVED DAMPERS TO SUPPLIER/MANUFACTURES SPECIFICATION AND DETAILS WITH DATA SHEETS. DUCTWORK SUPPLIERS TO PROVIDE A TESTED FIRESTOPPING SOLUTION FOR AROUND THEIR DAMPER SYSTEM. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKWOOL INTUMESCENT PUTTY PADS:

ROCKWOOL INTUMESCENT PUTTY PADS TO ENSURE HIGH QUALITY SEAL ENSURE THE SOCKET BOX IS CLEAN, DRY AND FREE OF DUST AND DIRT. FIRMLY PRESS AND MOULD THE PUTTY PAD INTO THE BACK OF THE BOX AND AROUND CABLES ENSURING PAD IS SUFFICIENTLY BONDED. TRIM ACCESS MATERIAL. ROCKWOOL INTUMESCENT PUTTY PADS TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

ROCKFON CEILING SYSTEM:

ROCKFON MEDICARE CEILING SYSTEM TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS. TECHNICAL SUBMITTALS TO BE PROVIDED.

GYPROC WALLING SYSTEM:

GYPROC WALLING SYSTEM TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS.

GYPROC HABITO:

GYPROC HABITO SYSTEM TO BE INSTALLED TO SUPPLIERS/MANUFACTURES SPECIFICATION AND DETAILS.

0	Tender Issue	RO	ROF	25/06/2026
Rev	Description	By	Chk. By	Date
 VINCENT HANNON ARCHITECTS E: info@vincenthannon.ie W: www.vha.ie SLIGO Second Floor Hanson Building Doory Park Road Sligo F91 P792 071 915 0022 GALWAY Suite 4, Clonk Mills, Dublin 1, Galway H91 W97E 091 483 934 DUBLIN 81 Amiens Street Dublin 1, 001 N075 01 876 4600				
Client: ENVIRONMENTAL PROTECTION AGENCY (EPA) - WEXFORD				Purpose: P4
Project: WEXFORD RECEPTION & STORE REFURB				T
Description: FIRE DETAILS - SHEET 02 OF 02				Scale:
Date: 03/09/2025				Drw by: BBT,LH
Chk by: ROF,EH				Rev: 0
VHA Proj. # 250101	Drawing No: 250101 - DR - VHA - AR - 5003			