


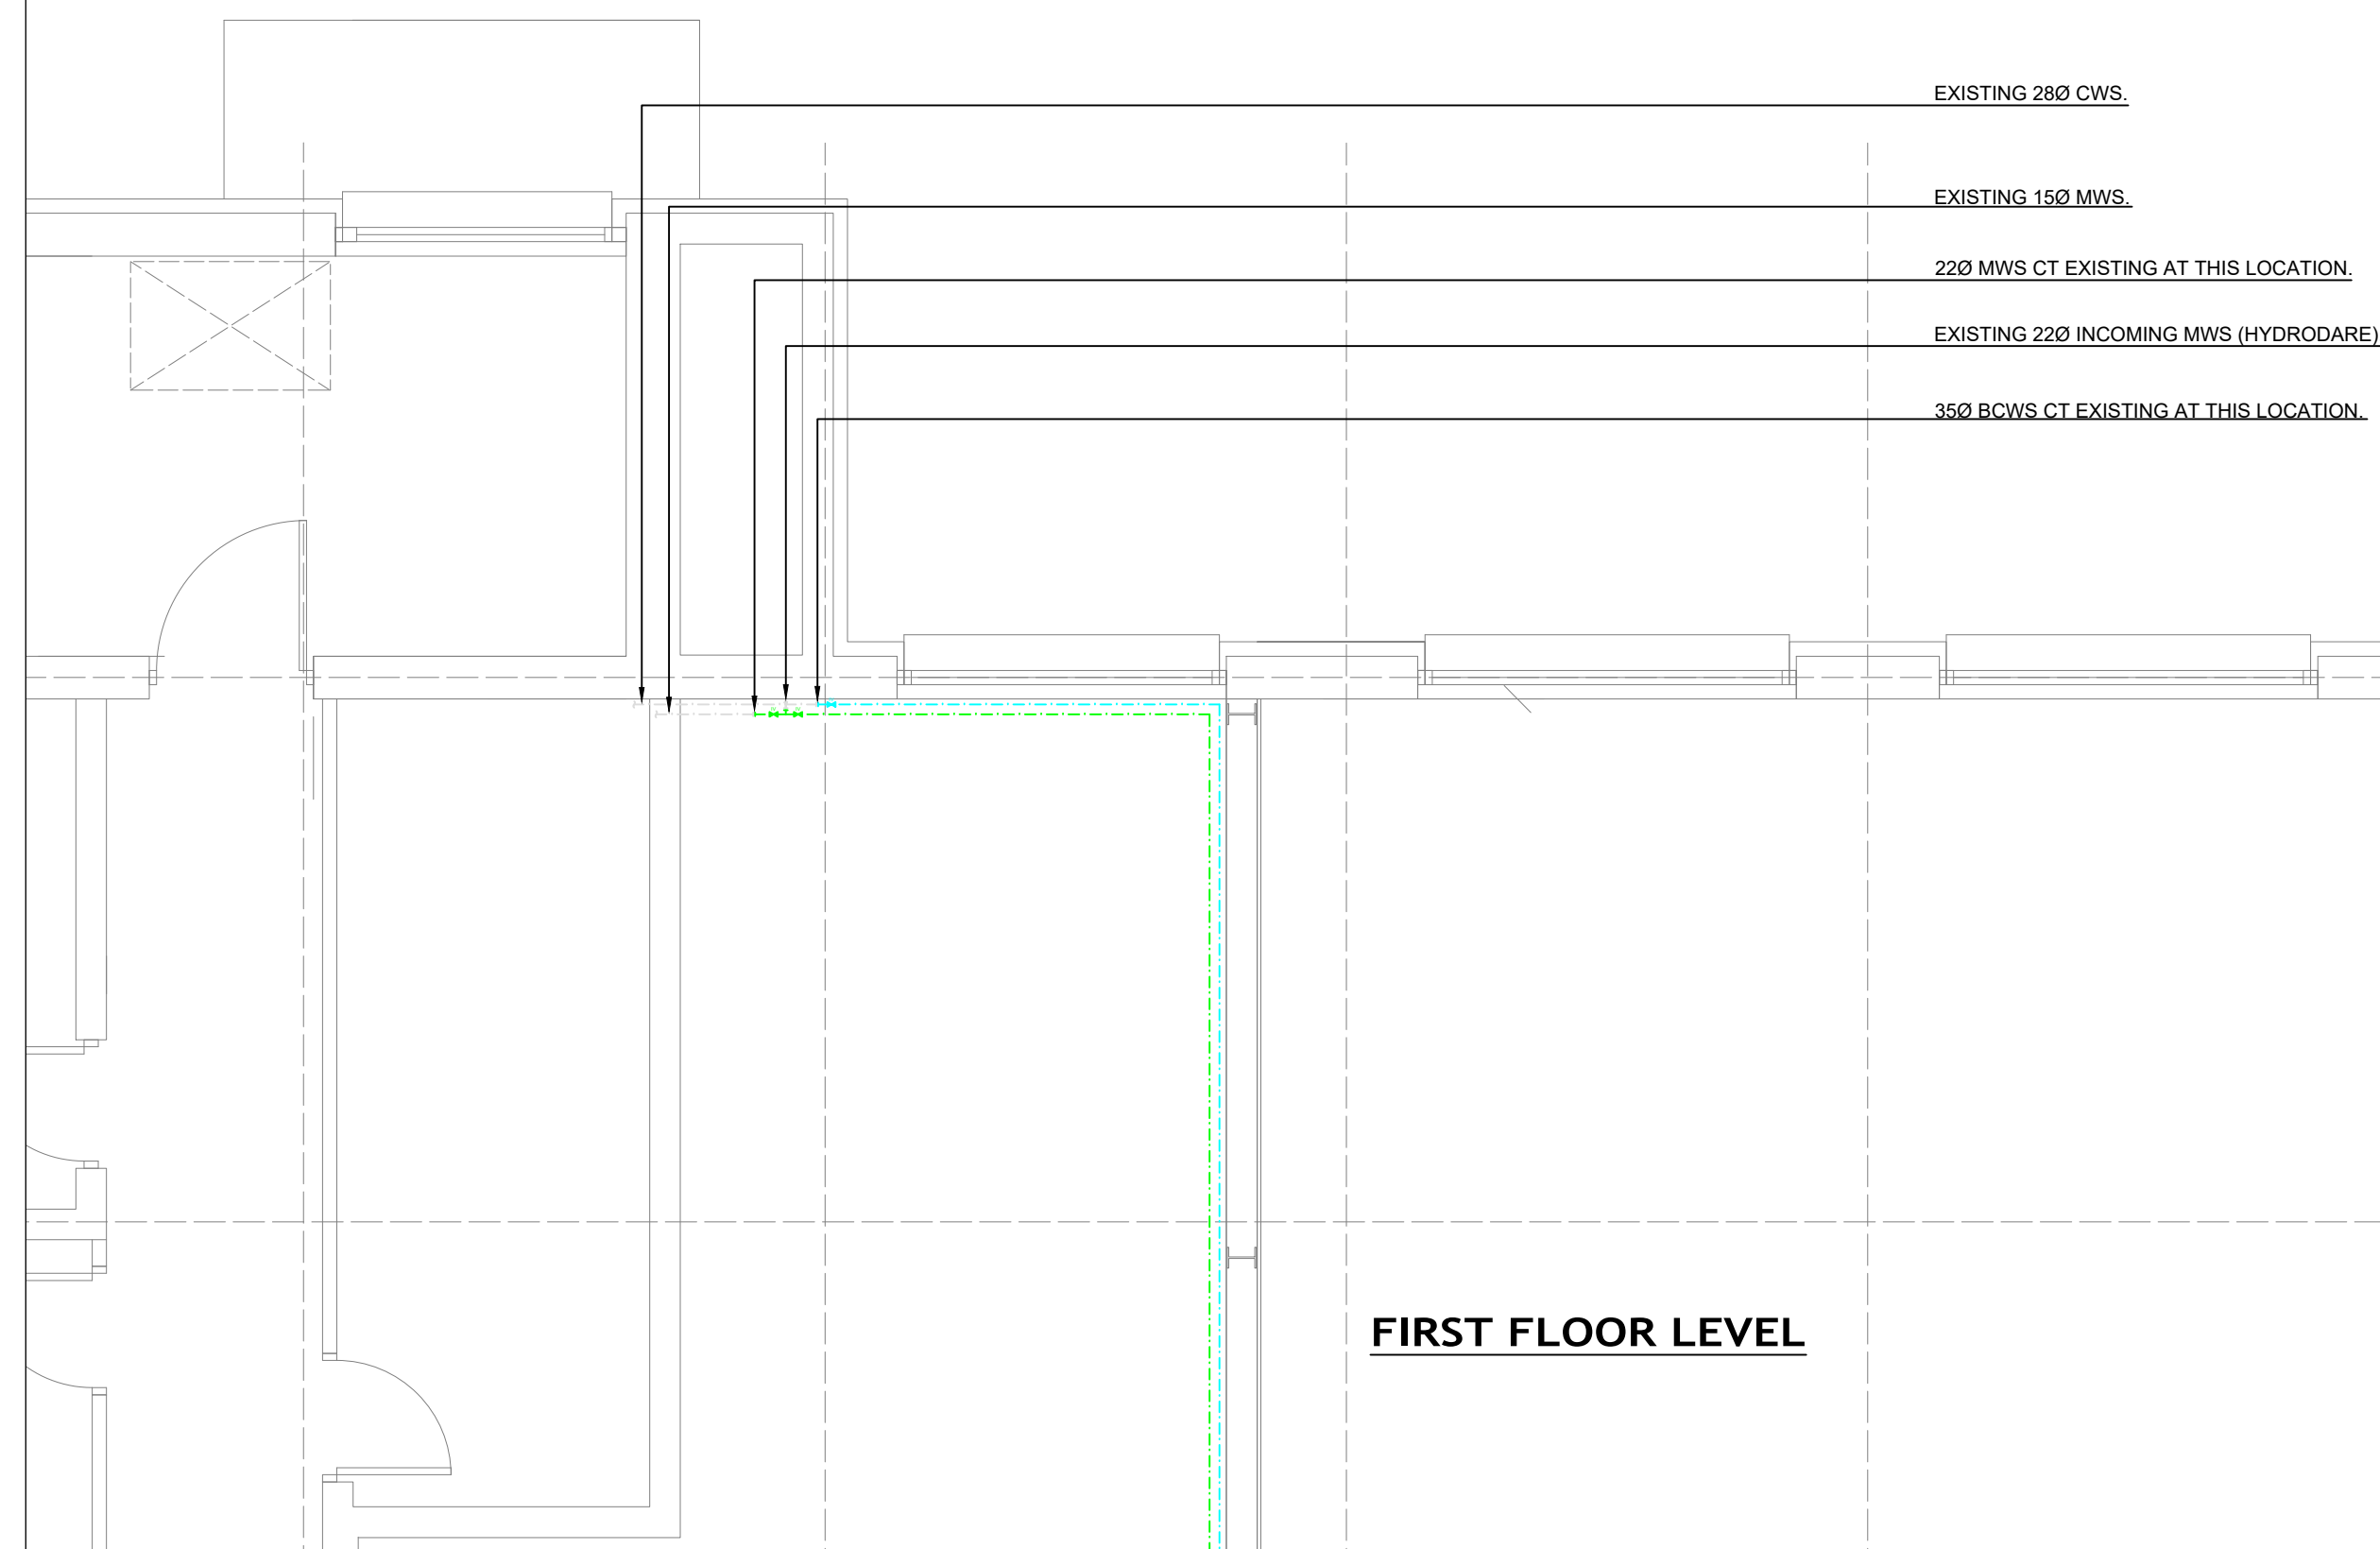

- () ALL HOT, COLD, MAINS, COLD FEED & OPEN VENTS SHALL BE FULLY INSTALLED THROUGHOUT IN CEILING VOIDS, WITHIN PARTITIONS, RISERS ETC. INSULATION SHALL BE AS PER SPECIFICATION.
- () ALL HWS/CWS & MWS TO FIXTURES SHALL BE INDIVIDUALLY VALVED, MINI BALL SINGLE TURN ISOLATING VALVES OF CHROMIUM PLATED FINISH. PENNY VALVES ARE NOT PERMITTED IN UCD.
- () ALL WATER SERVICES PIPEWORK HOT, COLD, FWS & MAINS WATER SHALL BE OF COPPER TUBE TO BS 2871 (CUO) WELDED THROUGHOUT EXCEPT WHERE EXPOSED AT SANITARY FITTINGS ABOVE FLOOR LEVEL, WHERE A COMPRESSION FITTING WILL BE ACCEPTABLE.
- () FINAL VALVE POSITIONS TO BE AGREED FOR ACCESS/CONCEALMENT.
- () ALL PIPEWORK TO BE TESTED TO 7 BAR BEFORE CONNECTION TO EQUIPMENT.
- () ALL WATER SERVICES PIPEWORK TO BE CHLORINATED

T	Issued for Tender				SEPT. 2026	
						
Client: UCD ESTATE SERVICES						
Architect: NA						
Project: NEWSTEAD COLD WATER STORAGE TANK						
DATE: SEPT. 2026						
REV: T						
SCALE: 1:50						
SIZE A1	DESIGNED BY LK	CHECKED BY LK	DRN BY LK	APPROV CR		
TENDR AS NOTED						
TITLE WATER SERVICES LAYOUT						
M200						
STATUS						
TENDER						