


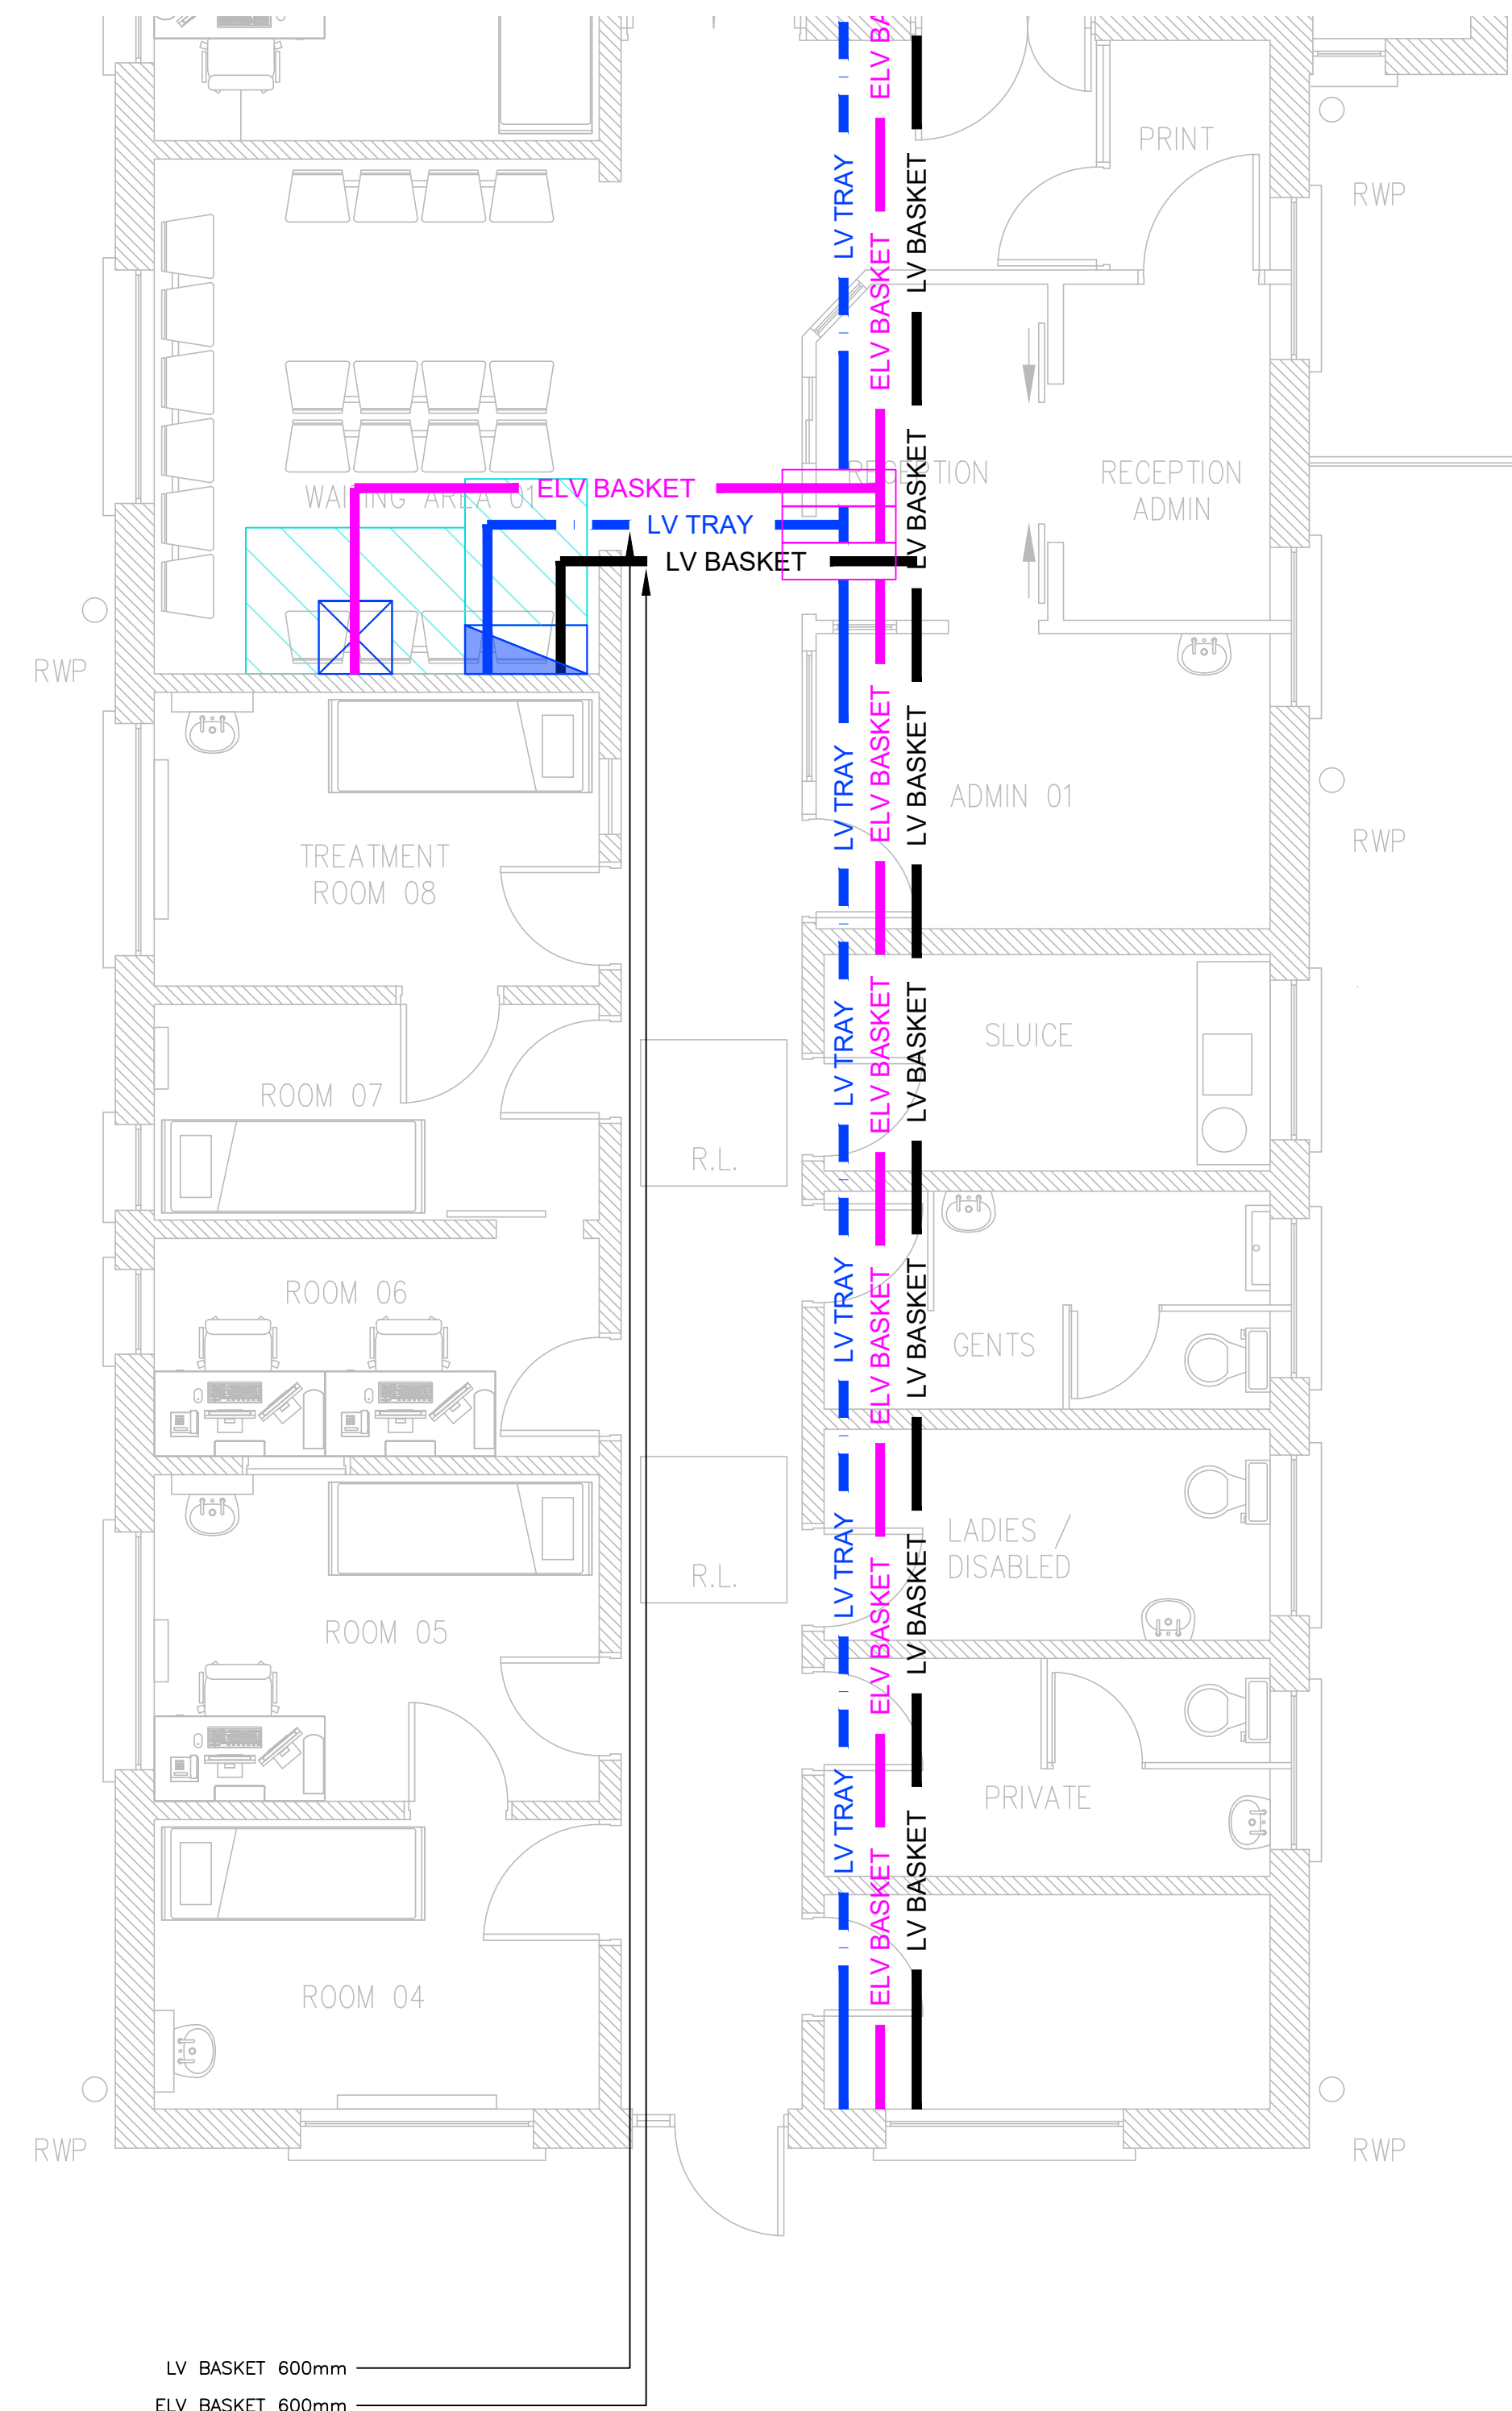

	ELV BASKET		ELV BASKET		MAIN ELV CABLE BASKET 300mm
	LV BASKET		LV BASKET		MAIN LV CABLE BASKET 300mm
	LV TRAY		LV TRAY		MAIN LV (SUBMAIN) CABLE TRAY 300mm

- | | | | | | | | |
|---|------------|----------|-------------|------|--|--|--|
| | | | | | | | |
| C01 | A4 | Sept 26 | Tender | K.M. | | | |
| Rev | Status | Date | Description | D.E. | | | |
| Revision Project Drawing Reference
C01 25714-VCE-ZZ-DR-E-100 | | | | | | | |
| Status Varming Project Number
A4 25714 | | | | | | | |
| Date | Checked By | Drawn By | Scale | | | | |
| Aug. '26 | J.G. | K.M. | 1:50 @ A1 | | | | |
| Client Health Service Executive | | | | | | | |
| Project Title OPD Rewire Roscommon University Hospital | | | | | | | |
| Drawing Title Electrical Services Distribution Services Layout | | | | | | | |
| | | | | | | | |
|
Varming
Consulting Engineers Ltd. | | | | | | | |
| Dublin 01 4872300
Cork 021 2375080
Roscommon 090 6602380
Website www.varming.ie | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| QUALITY HEALTH & SAFETY ENVIRONMENT
NSAI certified NSAI certified NSAI certified
NSAI certified NSAI certified NSAI certified | | | | | | | |
| | | | | | | | |