
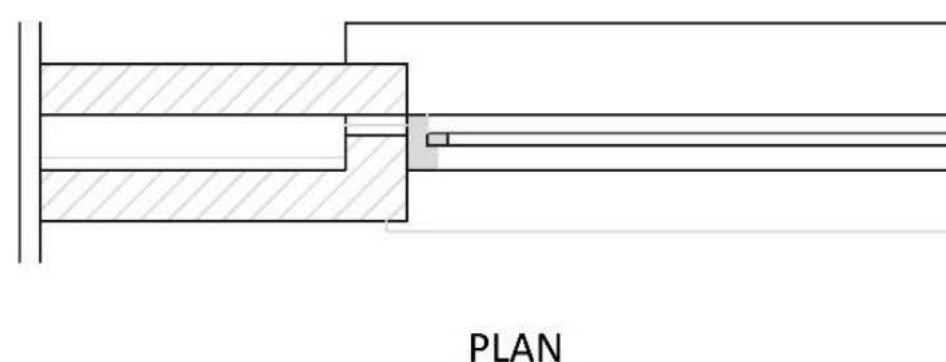


Diagram 83 Masonry Cavity Walls Excluded From Provisions for Cavity Barriers

Para 7.3.6.1

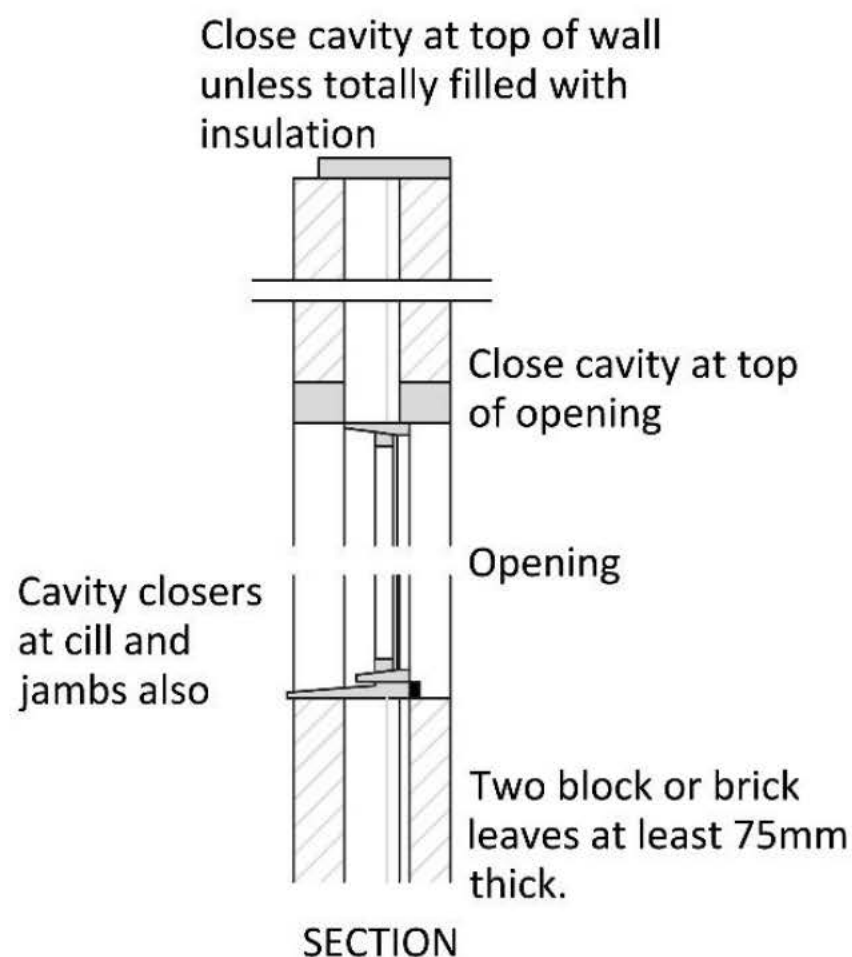

Note:

Combustible material should not be placed in or exposed to the cavity except for:

- (a) timber lintel, window or door frame, or end of timber joists;
- (b) pipe, conduit or cable;
- (c) DPC, flashing closer or wall tie;
- (d) domestic meter cupboard provided that
 - (i) there are not more than two cupboards to a dwelling
 - (ii) the opening in the outer wall leaf is not more than 0.8 m x 0.5 m for each cupboard, and
 - (iii) the inner leaf is not penetrated except by a sleeve not more than 80 mm x 80 mm which is fire-stopped;
- (e) thermal insulating material;
- (f) membranes (air tightness / breather membranes / DPC / DPM).