


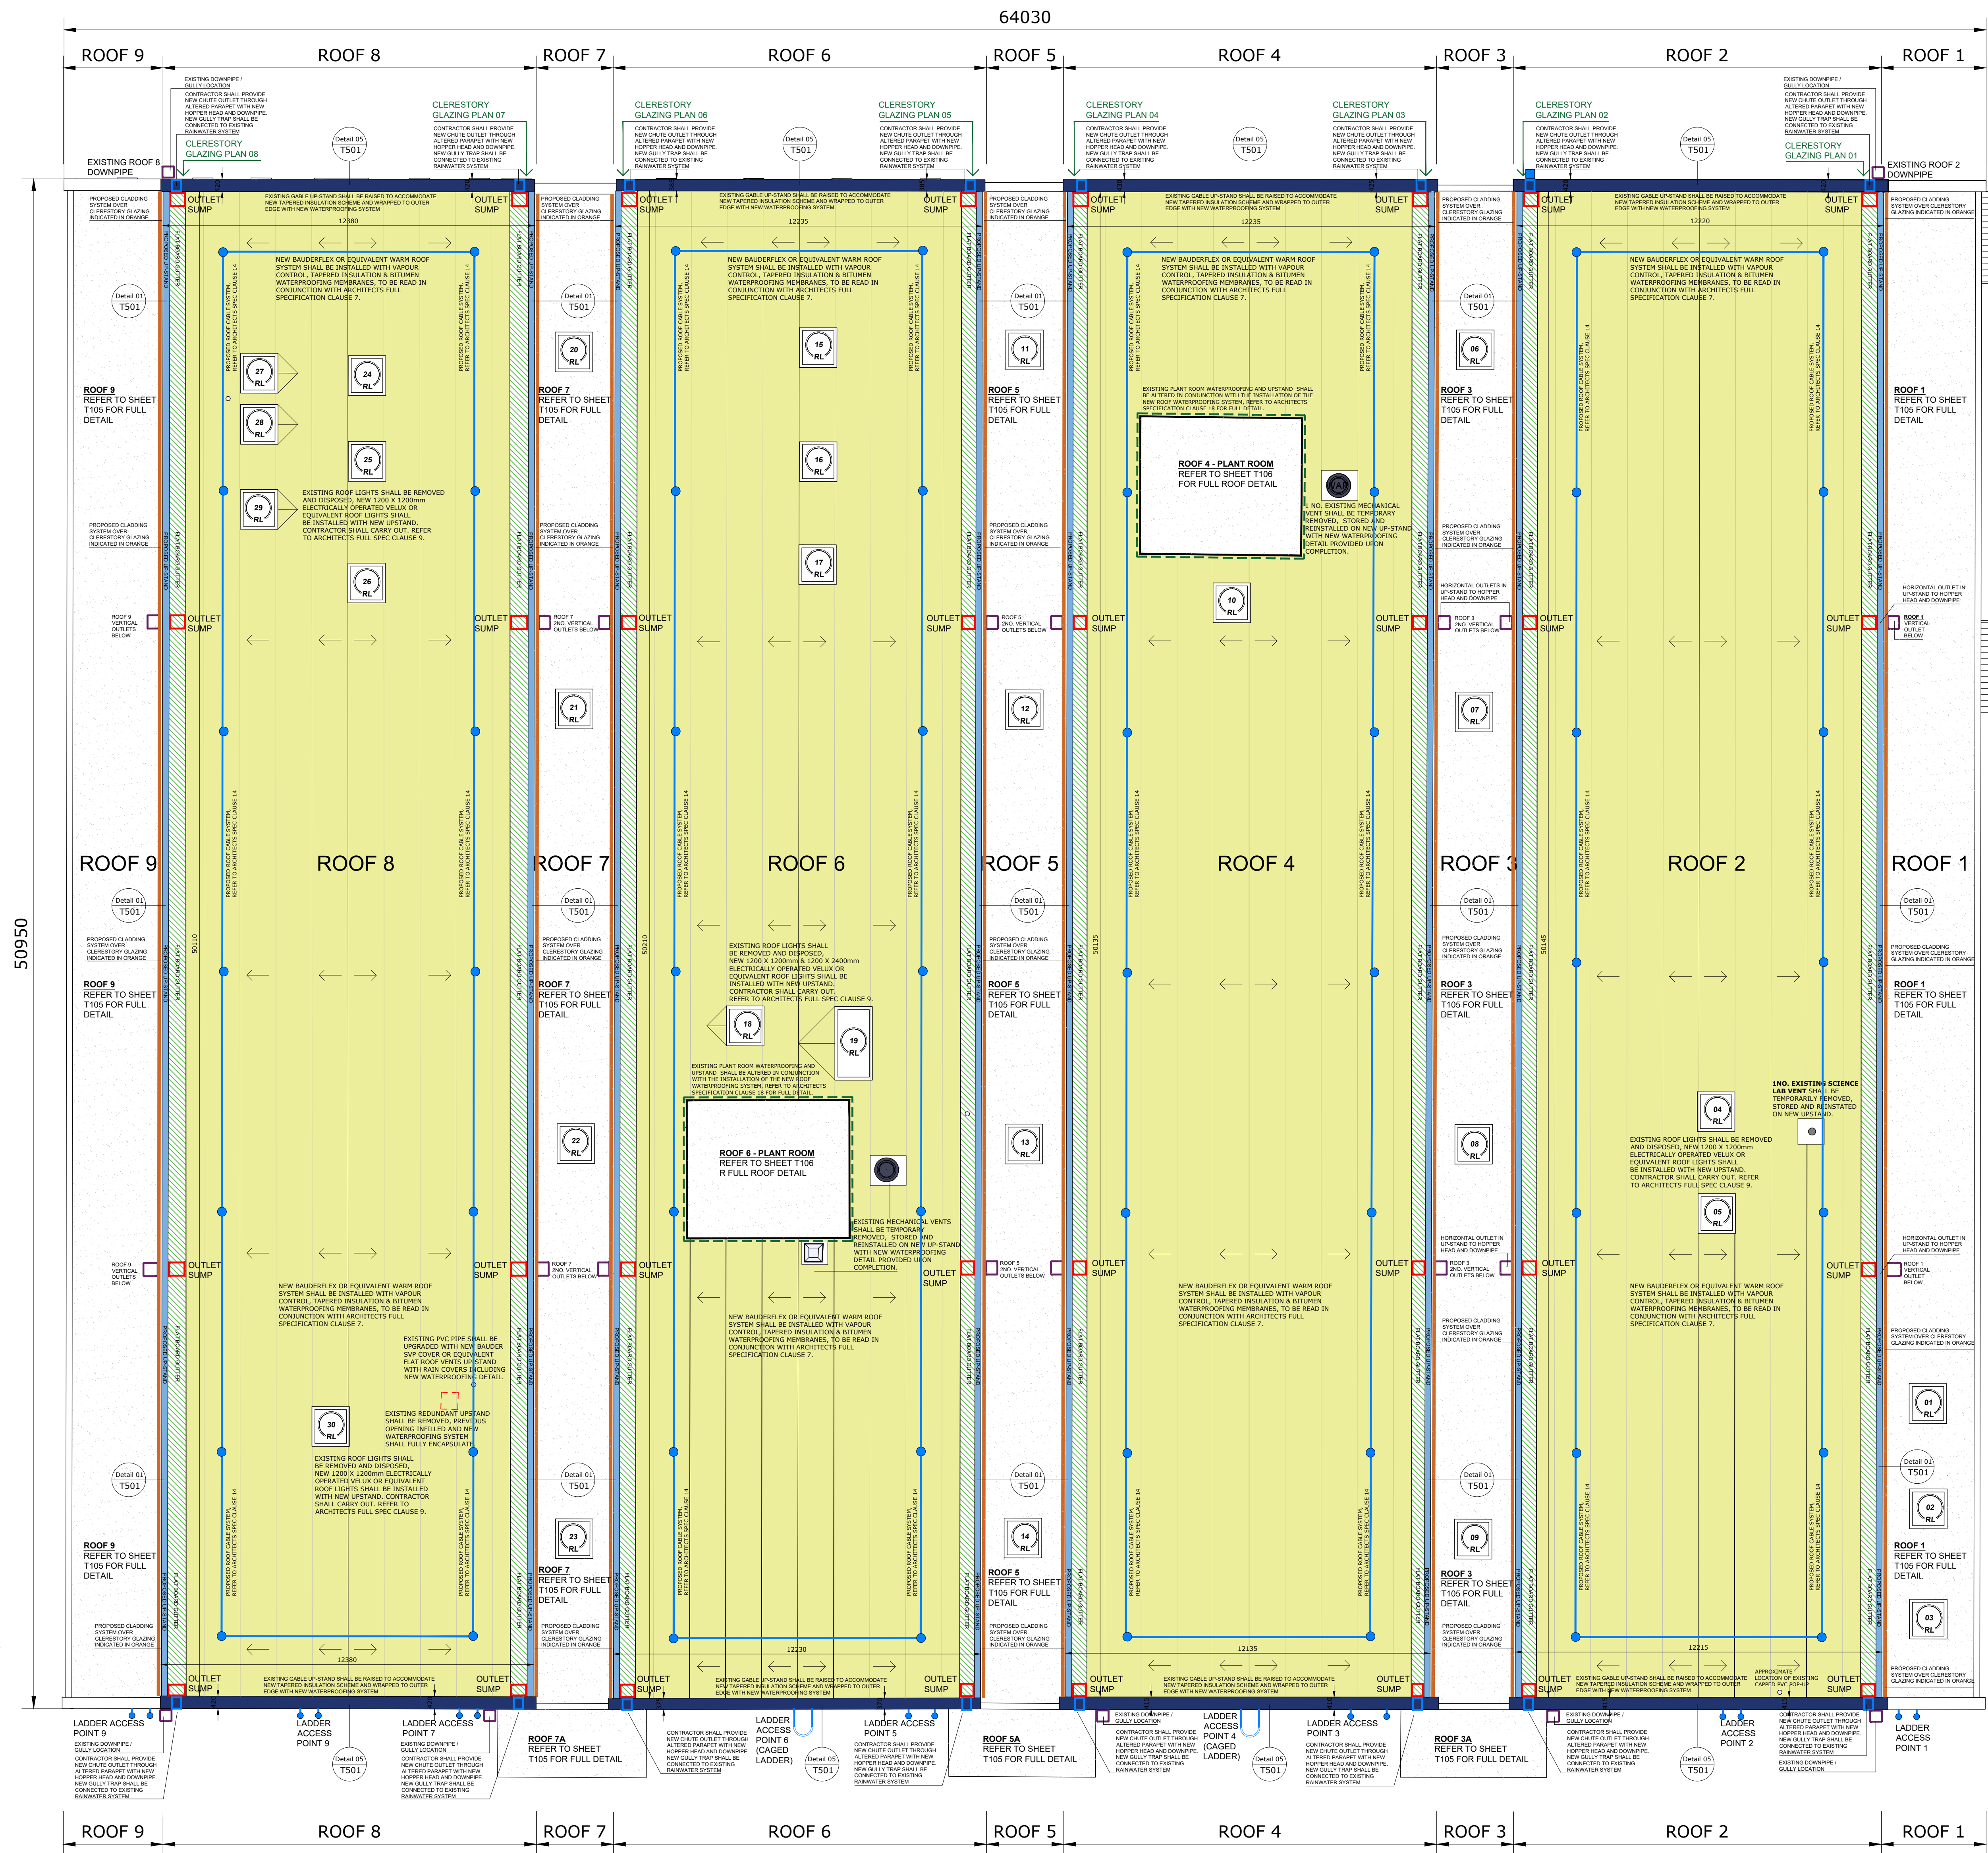

PROPOSED ROOF PLAN 1 (HIGH LEVEL ROOFS)
SCALE 1:100

TO BE READ IN CONJUNCTION
WITH TAPERED INSULATION
SCHEME DRAWING

BUILDING LEGEND

NOTE: LEGEND TO BE READ IN CONJUNCTION WITH ACCOMPANYING DRAWINGS, SCHEDULES AND SPECIFICATION DOCUMENTS.

EXTENT OF EXISTING ROOF SYSTEM TO BE REMOVED AND DISPOSED. NEW BAUDERFLEX OR EQUIVALENT ROOF WATERPROOFING SYSTEMS WITH TAPERED INSULATION. REFER TO ARCHITECTS FULL SPEC

DIRECTION OF 1:60 TAPERED FALL

PROPOSED FLAT BOARD GUTTER AS INCLUDED IN TAPERED INSULATION DESIGN INDICATED THUS.

PROPOSED NEW PERIMETER UP-STAND INDICATED THUS. REFER TO DETAIL 01, SHEET T501

EXISTING GABLE UP-STAND TO BE ALTERED / RAISED INDICATED THUS

PROPOSED CLADDING SYSTEM OVER CLERESTORY GLAZING (GLAZING HEAD TO TOP OF UP-STAND) INDICATED THUS

LOCATION OF PROPOSED OUTLET SUMPS INDICATED THUS. HORIZONTAL OUTLET IN UP-STAND TO HOPPER HEAD AND DOWNPIPE TO OUTLET BELOW.

LOCATION OF EXISTING OUTLET TO BE UPGRADED IN ROOF BELOW INDICATED THUS

ALL EXISTING ROOF LIGHTS AND ASSOCIATED UP-STANDS SHALL BE REMOVED, DISPOSED AND NEW ROOFLIGHTS / UPSTANDS SHALL BE INSTALLED IN CONJUNCTION WITH NEW WATERPROOFING SYSTEM.

LOCATION OF EXISTING WATER TANK UP-STANDS AND CLADDING TO BE ALTERED INDICATED THUS.

PROPOSED ROOF ACCESS & ROOF FALL ARREST CABLE SYSTEM LAYOUT. REFER TO ARCHITECTS SPECIFICATION FOR FULL DETAIL.

CLERESTORY GLAZING LOCATION REFERENCE INDICATED THUS

PROPOSED ROOF WORKS SHALL BE WHOLLY IN ACCORDANCE WITH THE WORKS REQUIREMENTS / SPECIFICATION TOGETHER WITH THE REQUIREMENTS OF D0ES T01 01 - 7 MINIMUM PERFORMANCE STANDARDS OF ROOF FINISHES.

NOTWITHSTANDING THE ABOVE, THE DESIGN AND CONSTRUCTION OF ALL ROOFS SHALL COMPLY WITH THE RELEVANT I.S., EN AND BS STANDARDS AND MEET THE REQUIREMENTS OF THE CURRENT BUILDING REGULATIONS PARTS 4 TO 6 AS APPLICABLE.

PROPOSED WATERPROOFING SYSTEM MUST HAVE A SINGLE SOURCE MANUFACTURER RELATES TO THE ENTIRE SYSTEM AS A SINGLE ENTITY INCLUDING THE WATERPROOFING MEMBRANES, INSULATION, ROOF LIGHTS AND THE WORKMANSHIP IN INSTALLING ALL OF THE ABOVE. THIS IS REQUIRED TO ELIMINATE SPLIT LIABILITY ON THIS PROJECT.

FLEXIBLE WATERPROOF MEMBRANES MUST HAVE A 30-YEAR MANUFACTURER DURABILITY STATEMENT, ALONG WITH A MINIMUM OF 2-YEAR MANUFACTURER INSURANCE BACKED GUARANTEE FOR MATERIALS, WORKMANSHIP AND THE ENTIRE INSTALLATION ON SITE FOR THE SPECIFIC PROJECT.

20-YEAR PRODUCT & WORKMANSHIP INSURANCE SUPPORTED COMPANY BACKED GUARANTEE SHALL BEGIN ON THE DATE OF FINAL INSPECTION BY MANUFACTURER OF THE ROOFING WORKS.

MECHANICAL & ELECTRICAL SERVICES
REFER TO GALILEO ENERGY SERVICES DRAWINGS & SPECIFICATION

NOTE: DRAWINGS FOR TENDER PURPOSES ONLY ALL DIMENSIONS TO BE MEASURED ON SITE AND CONFIRMED BY CONTRACTOR BEFORE ORDER IS COMPLETE.