

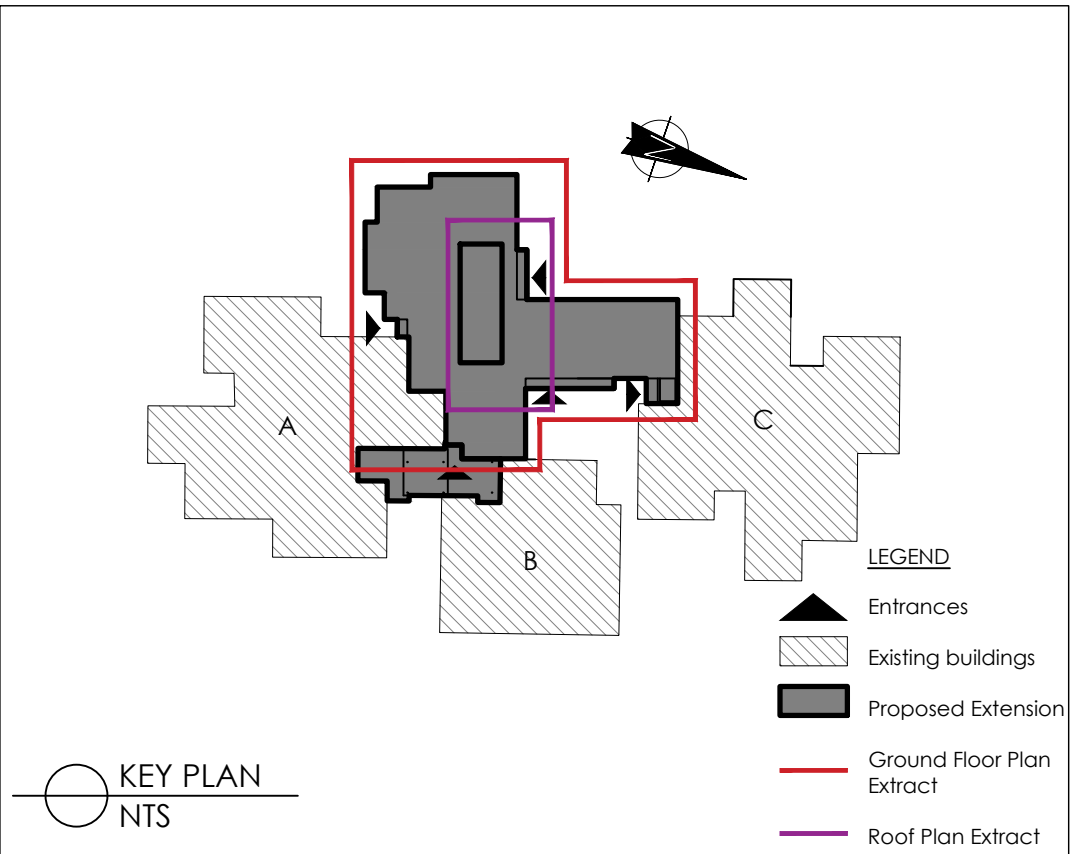
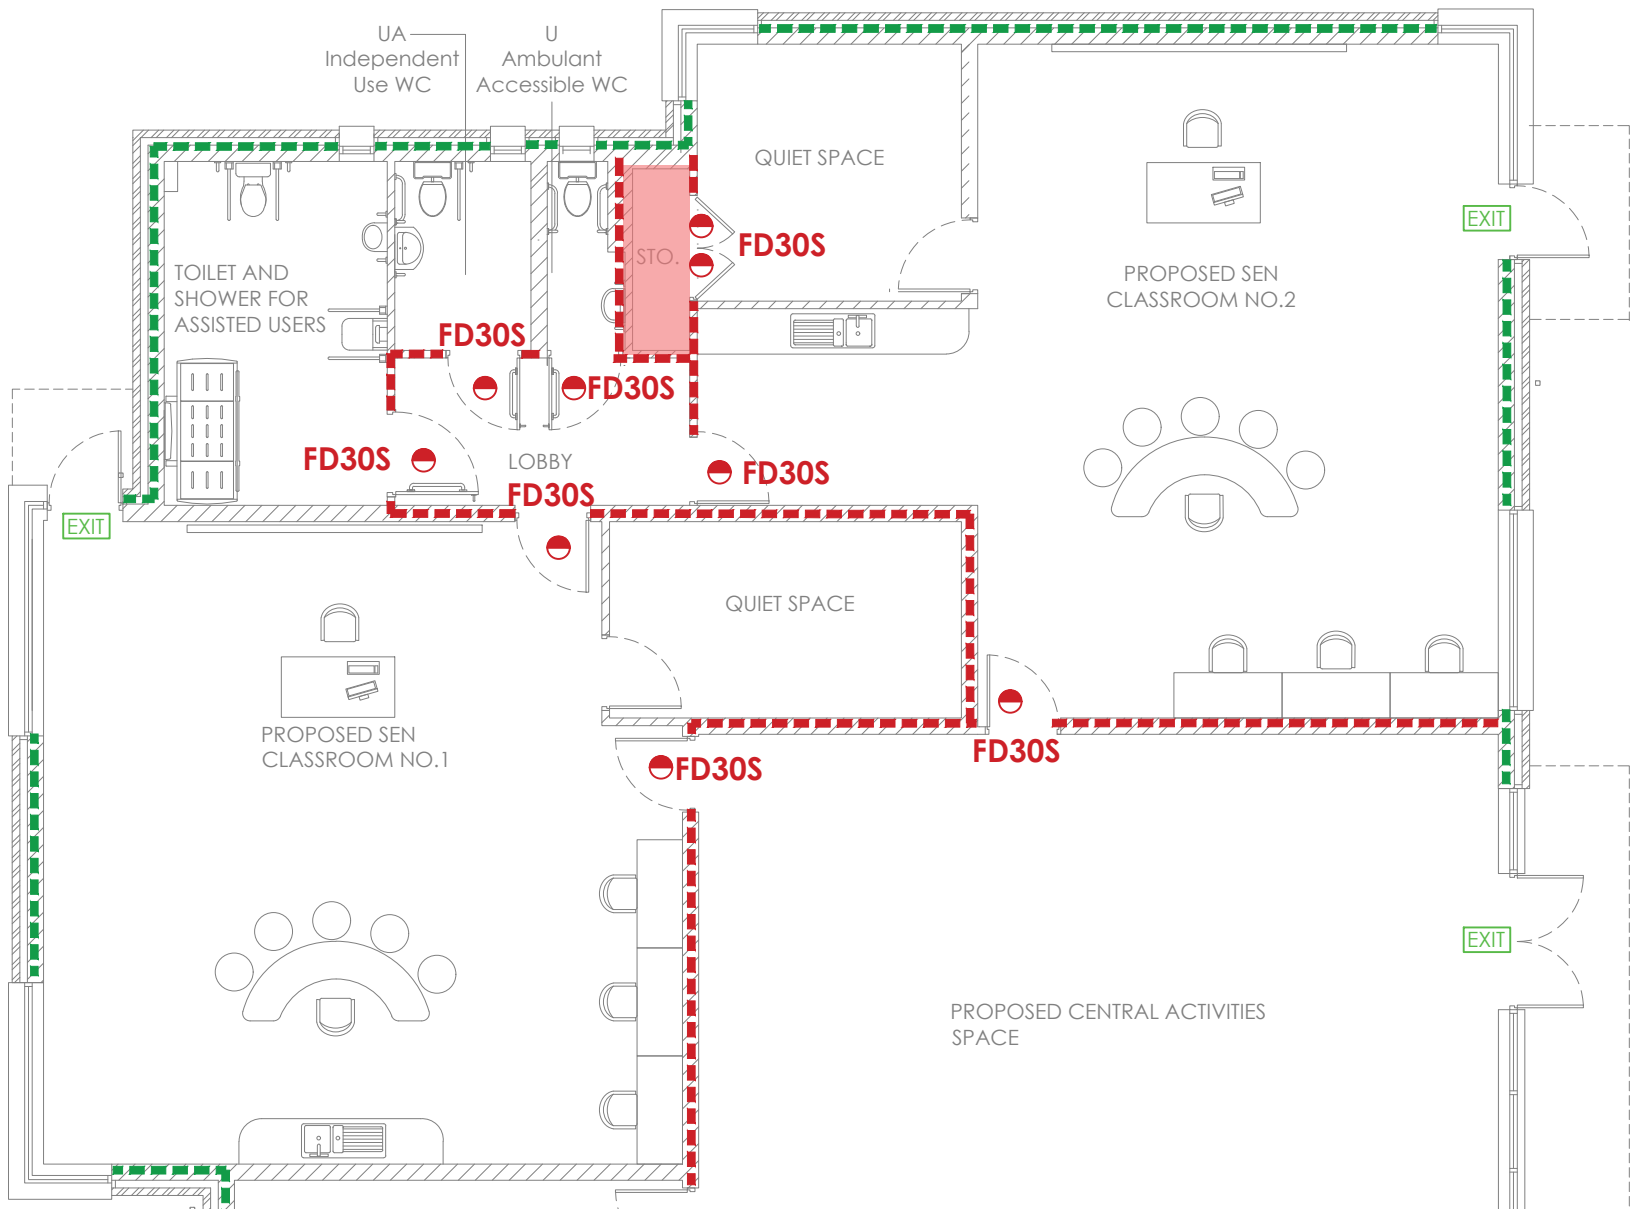


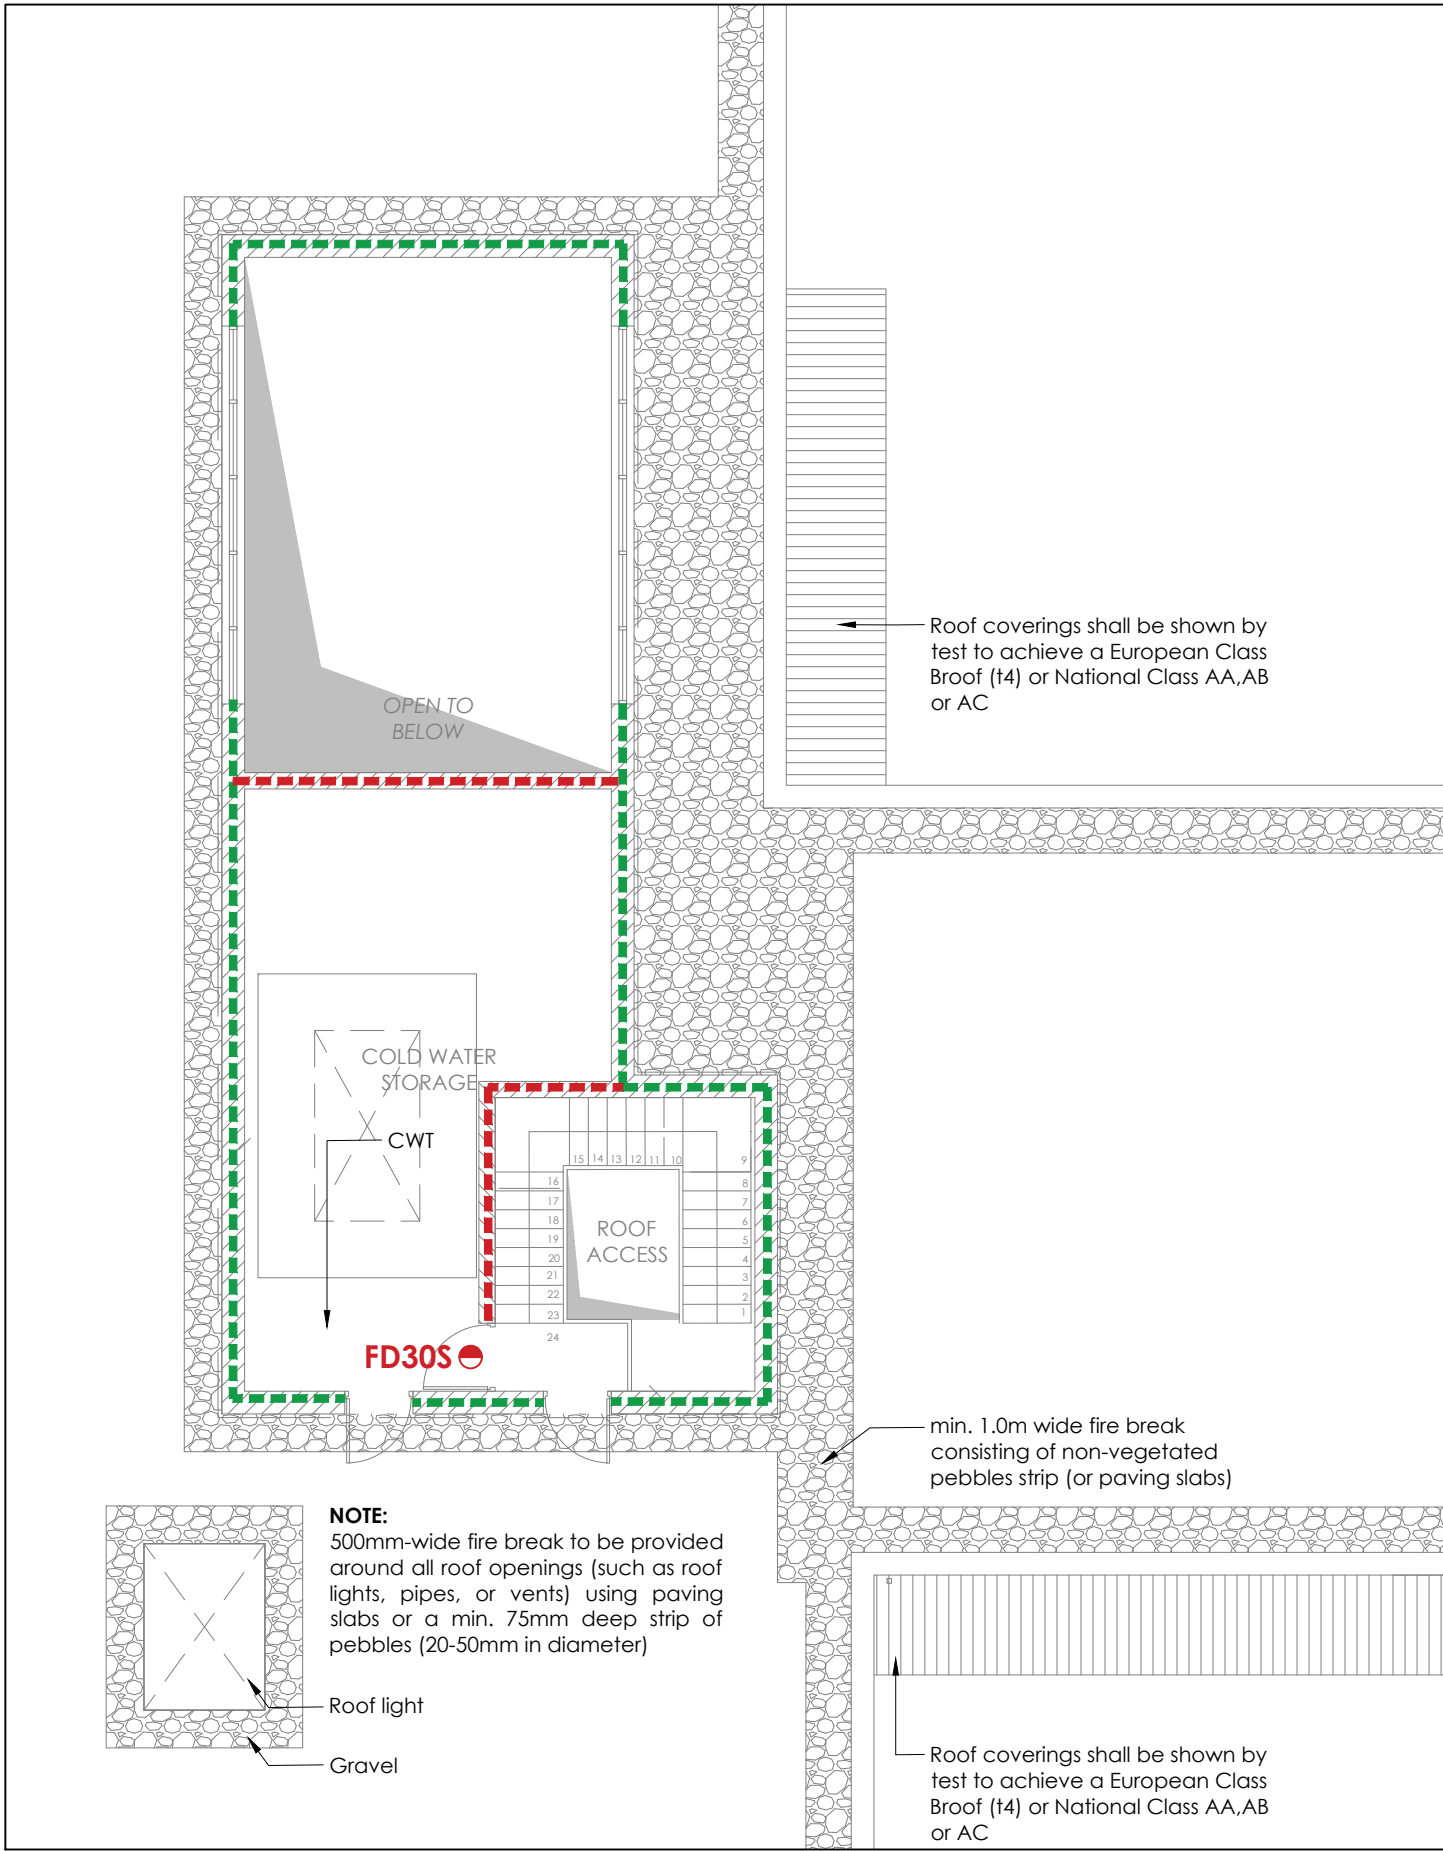

NOTE: Emergency lighting system to be designed, installed and maintained in accordance with I.S. 3217:2023. Fire detection and alarm system to be designed, installed and maintained in accordance with I.S. 3218:2024. Hydrants to be in accordance with BS 750:2015, Type 2 - Refer to FSC Condition 8: Refer to Site Layout for Hydrants locations.

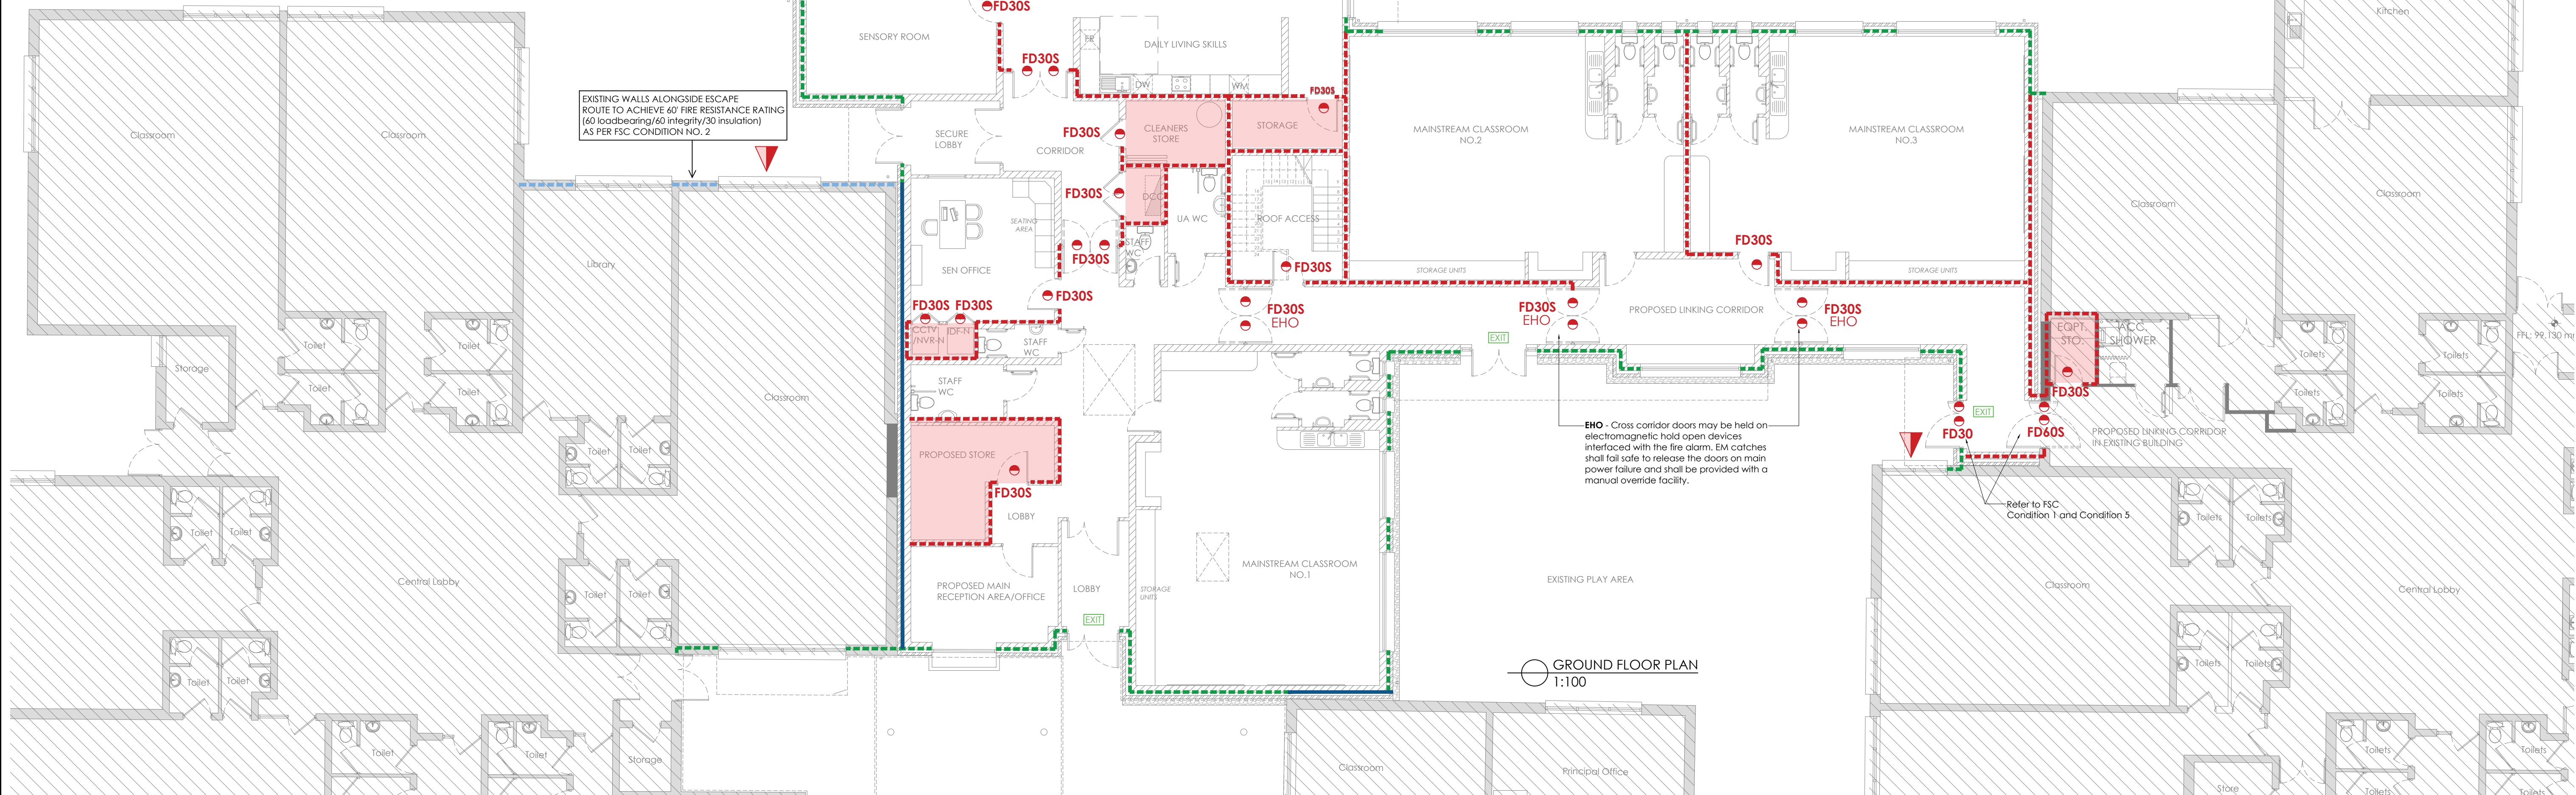

NOTES:

This drawing is copyright and may not be copied or altered without permission.

Use only figured dimensions. Do not scale this drawing.

The contractor is responsible for checking all dimensions on site prior to construction.

The Architects are to be notified of any discrepancies prior to work commencing.

Levels and contours, shown on drawings, are relative to local datum unless specified

REVISION	DATE	DESCRIPTION	INITIAL	REVISION	DATE	DESCRIPTION	INITIAL

CLIENT	QUEEN OF ANGELS PRIMARY SCHOOL
PROJECT	Additional Accommodation
ADDRESS	Wedgewood, Sandford, Dublin, 16
DRAWING	
FIRE STRATEGY	
DRAWN BY	MC
CHECKED BY	MC
DATE	06.10.2025
SCALE	As Shown
DWG. NO.	22518-TEN-500

SWEENEY architects

043 234 2400
info@sweeneyarchitects.ie
www.sweeneyarchitects.ie

RIA 2008 63 P