


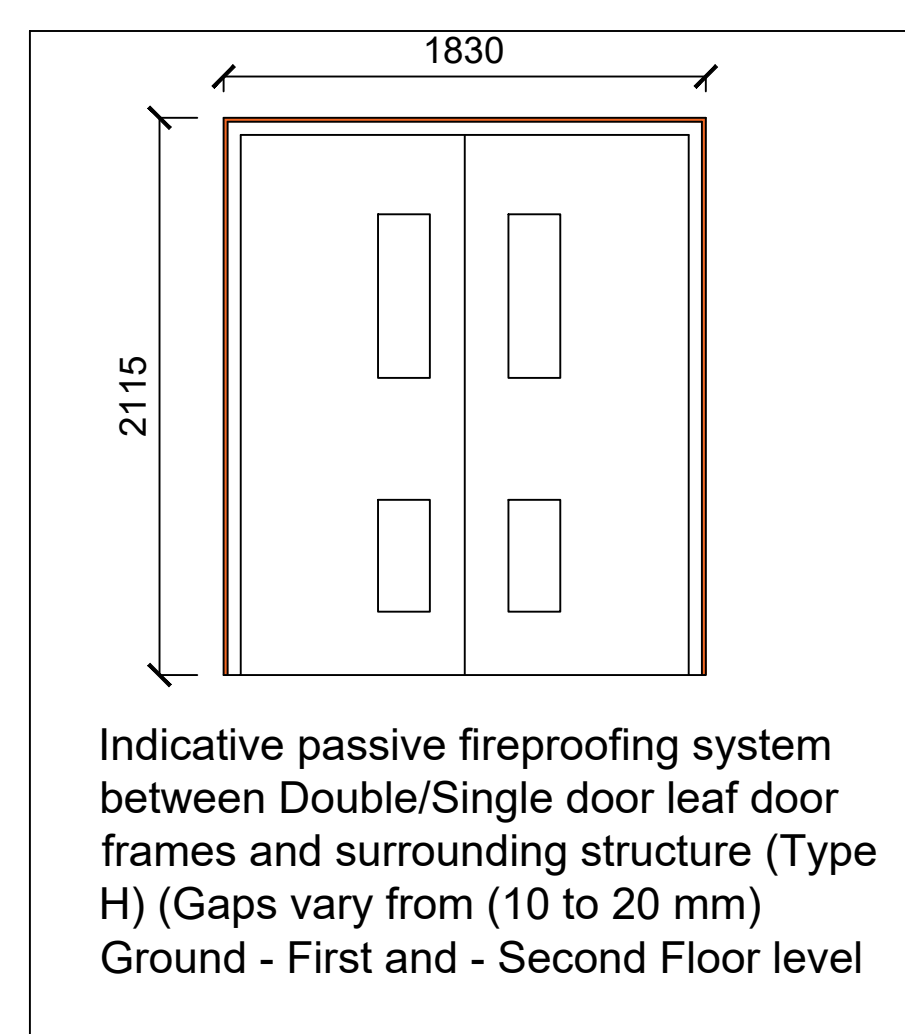
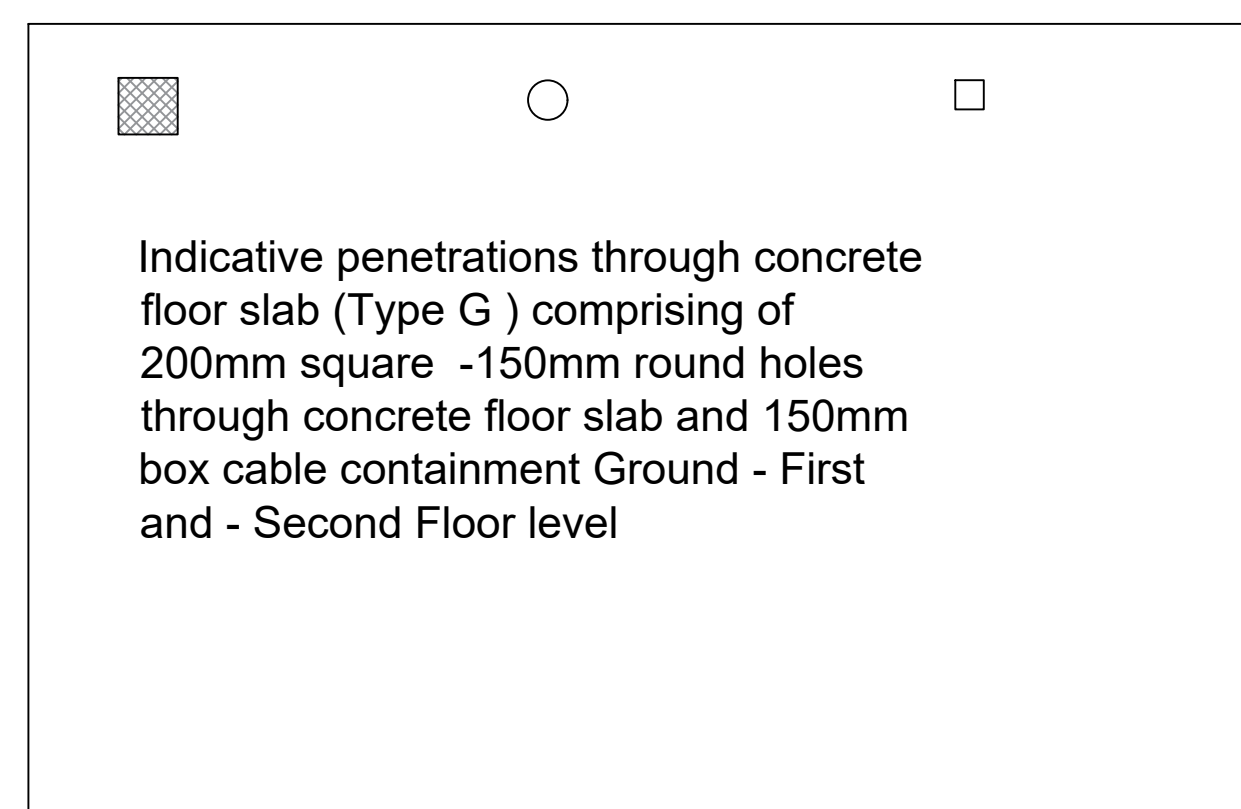
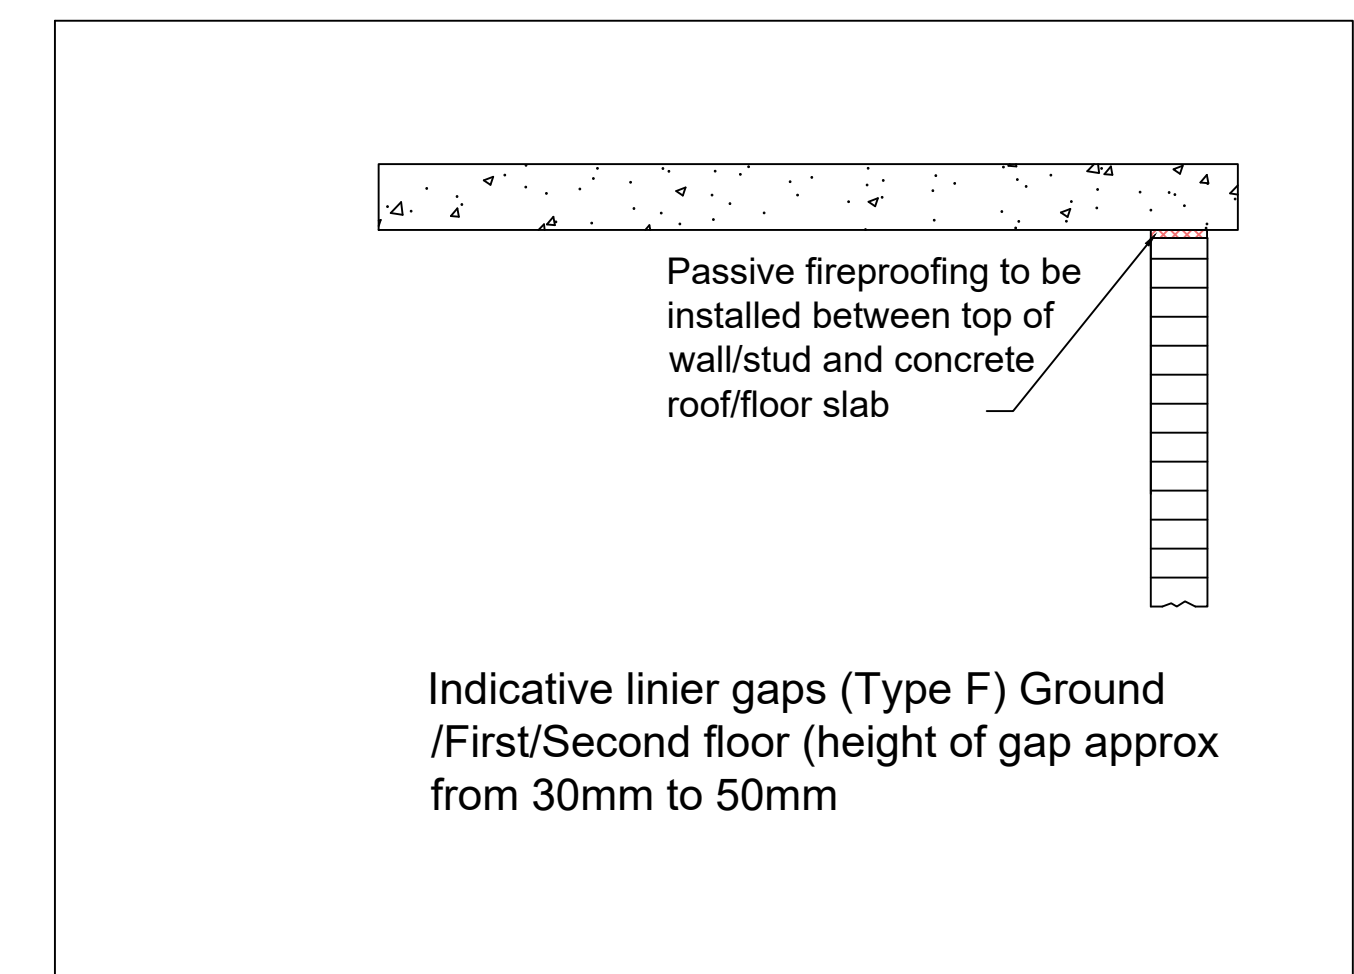
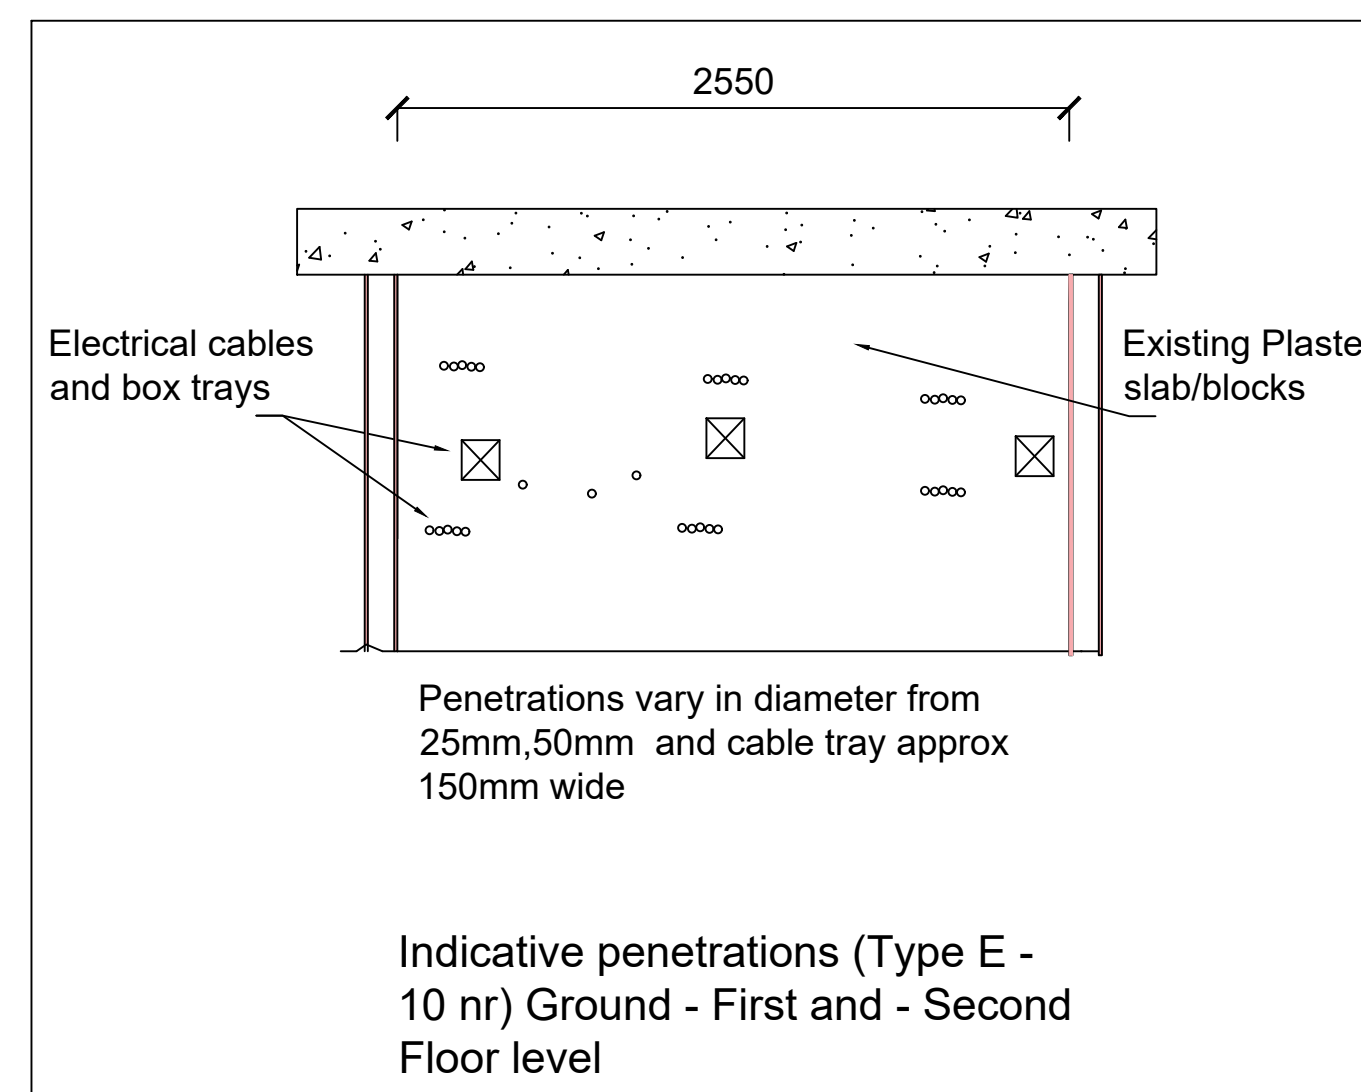
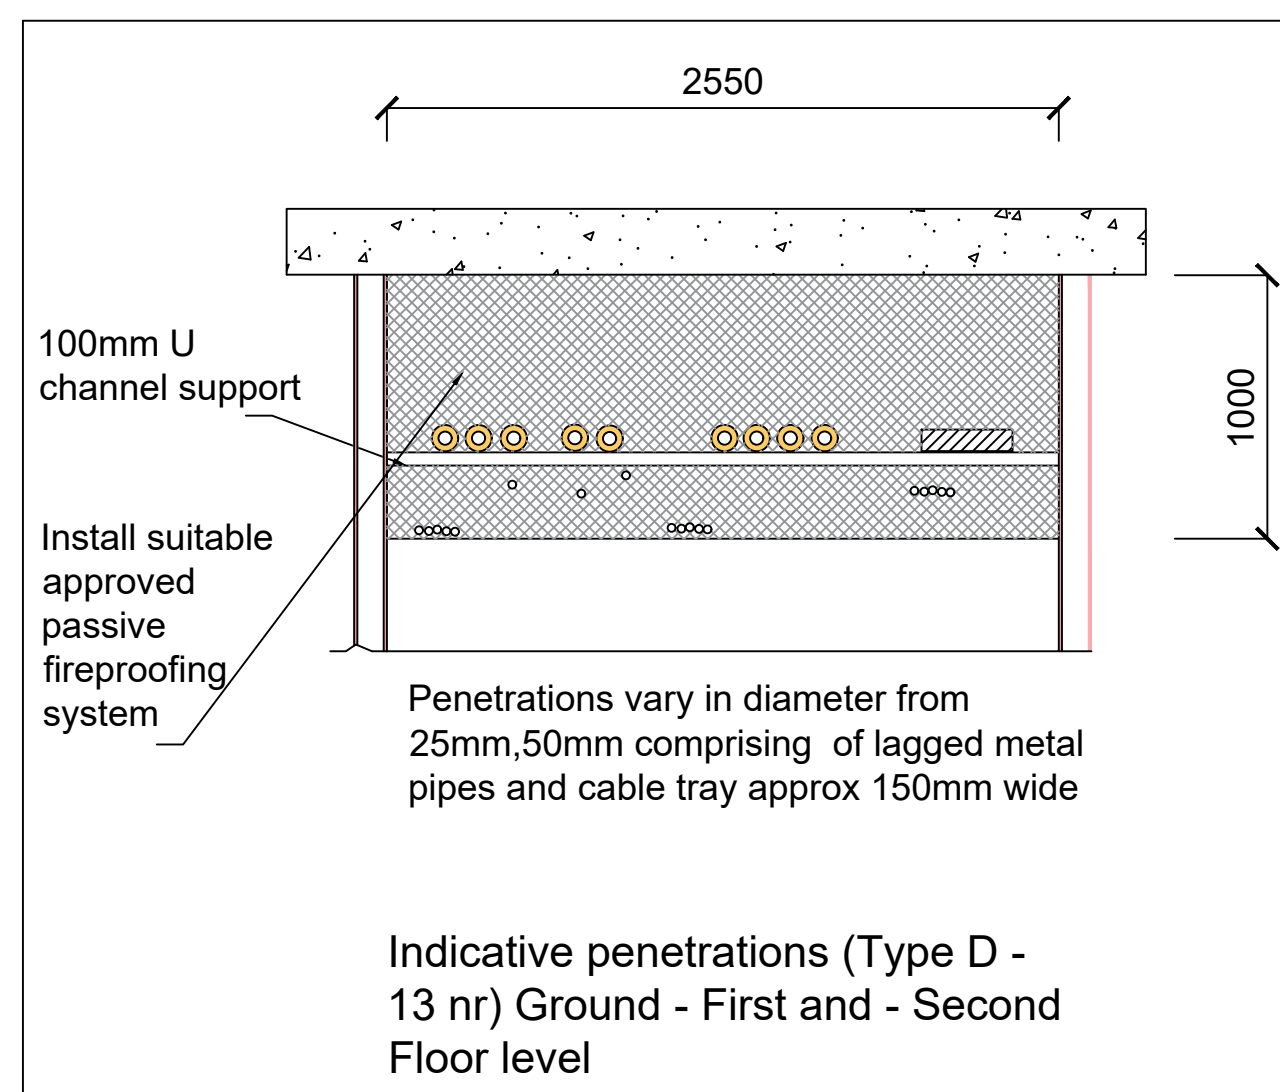
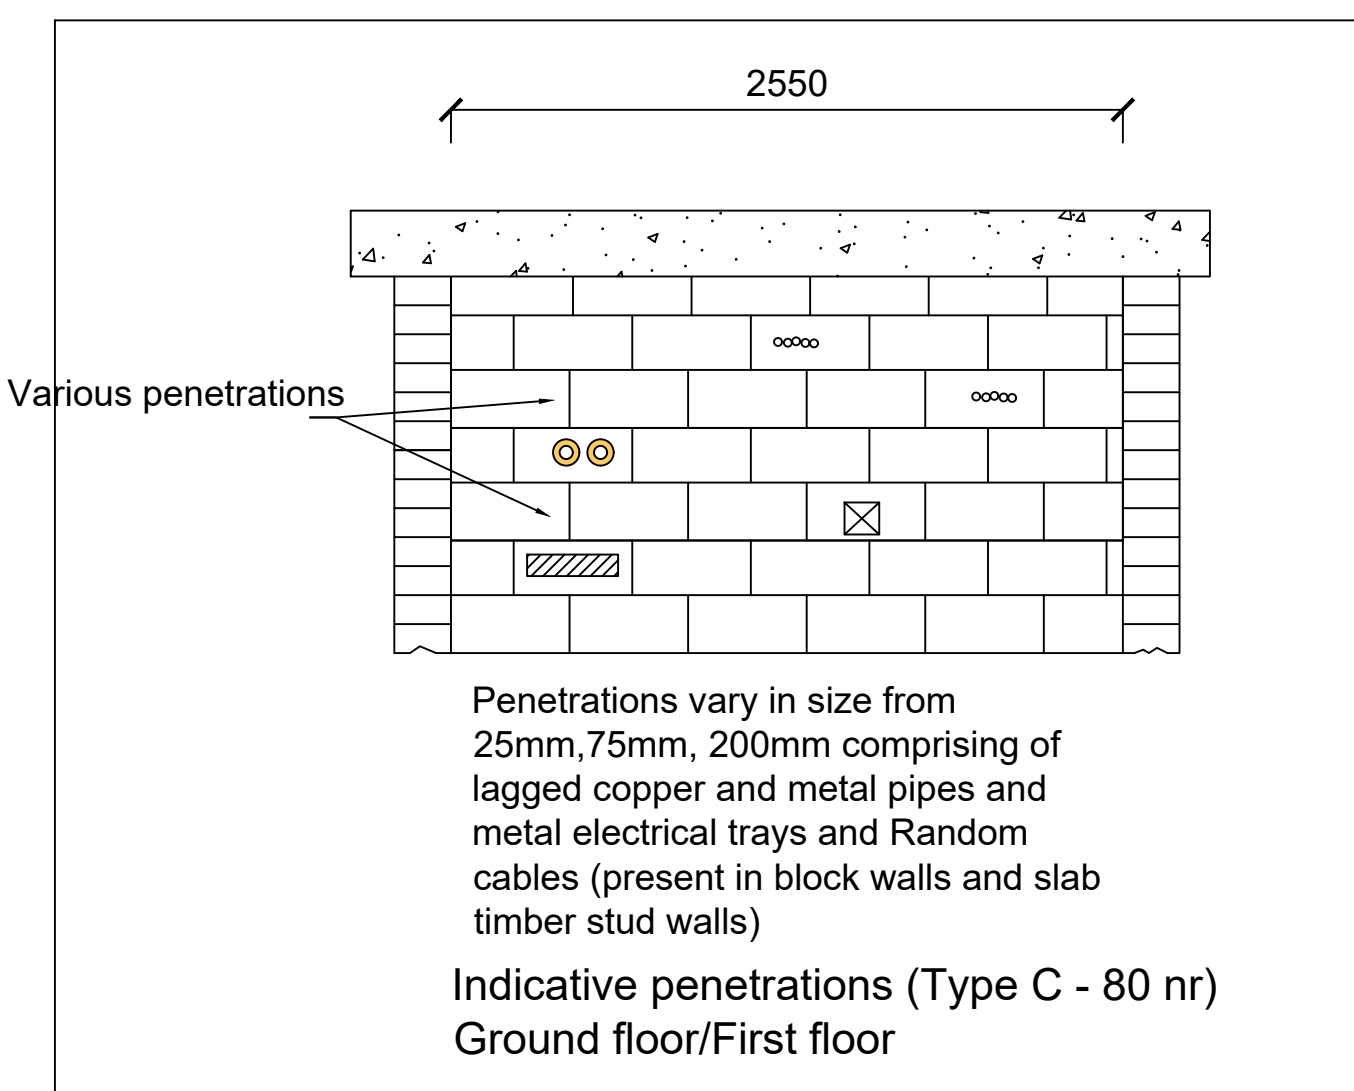
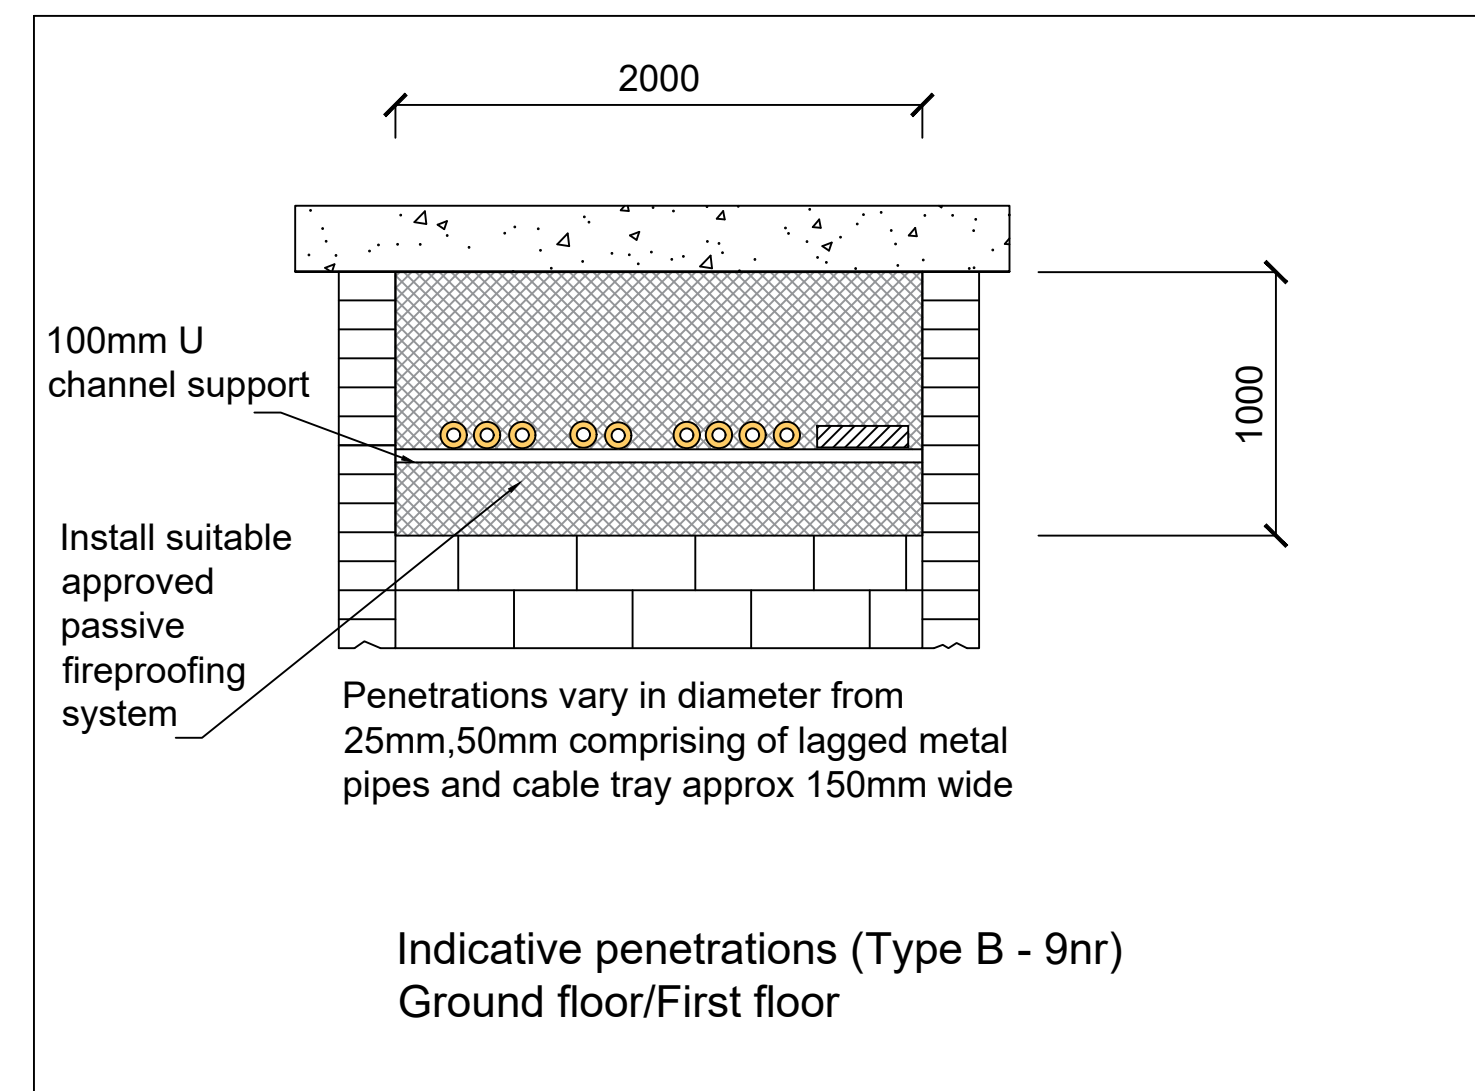


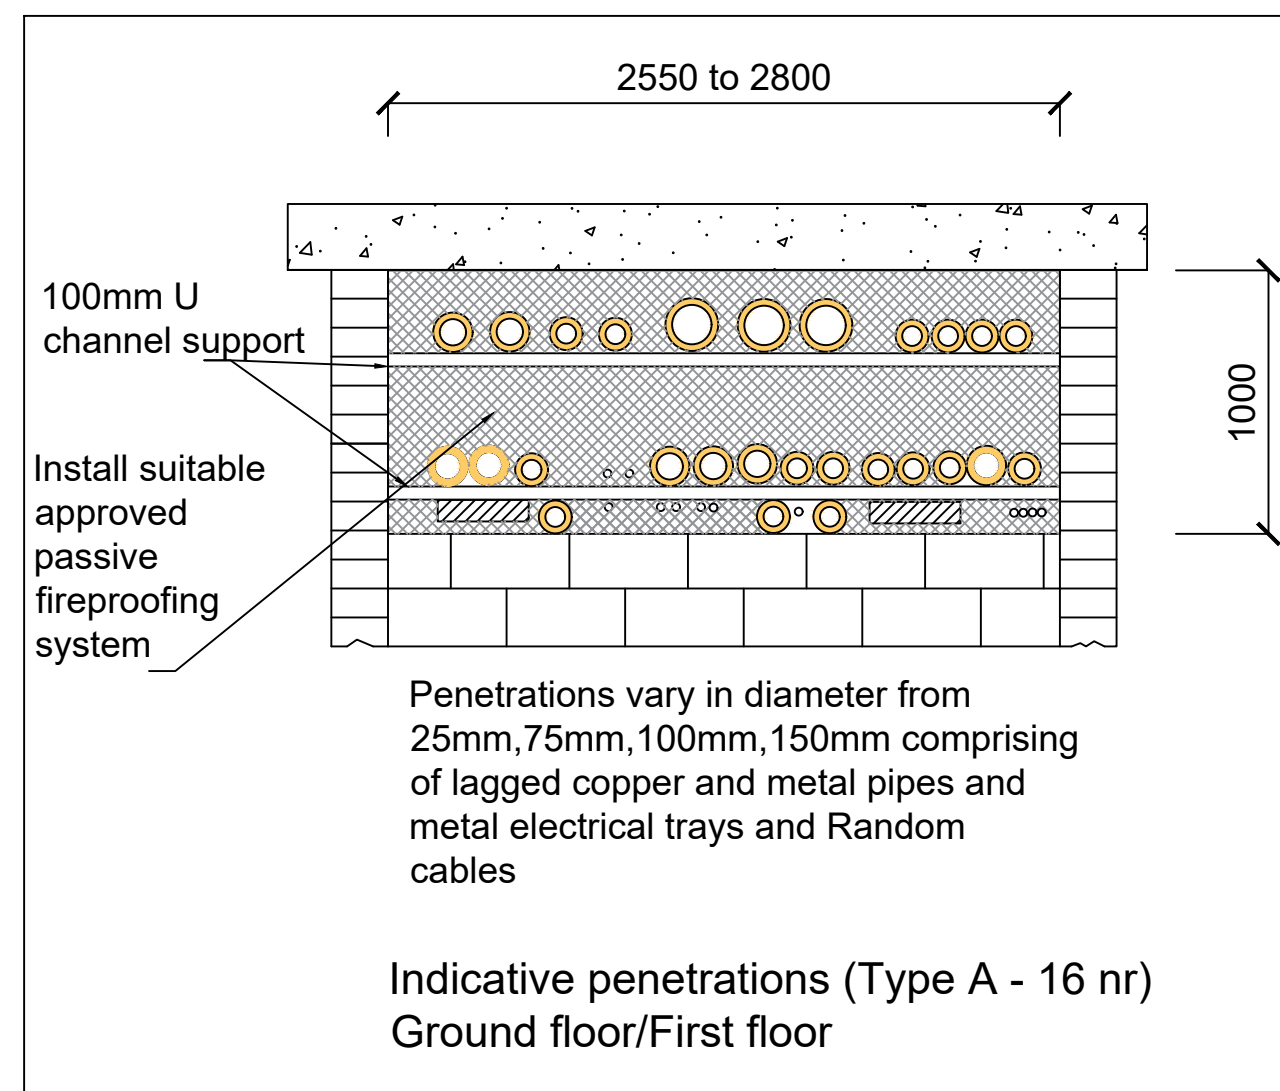


Pipe collar (Type 1)

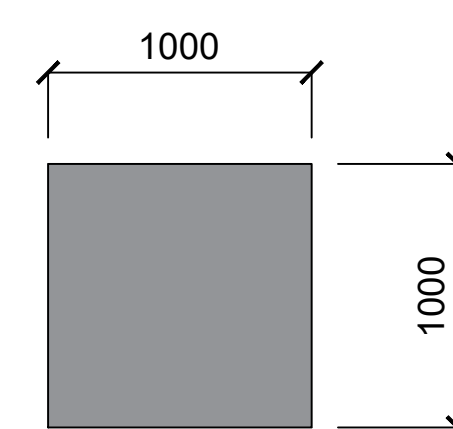


Horizontally installed Fire stopping mortar infill to floor slab 1000mm x 1000mm 100mm deep (Type 4)

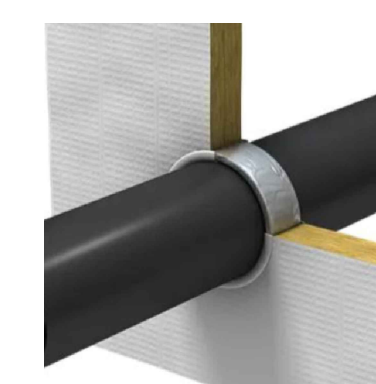

Fire wraps (Type 2)

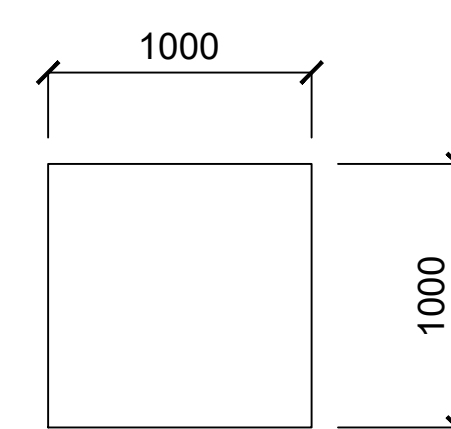

Vertically installed Fire bat 1000mm x 1000mm x 50mm (Type 5)

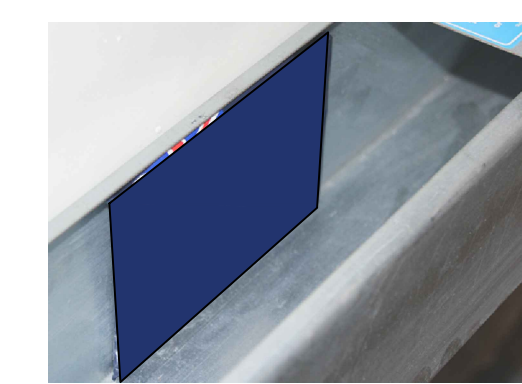

Intumescent pad installed in electrical box trunking (Type 3)

Indicative works details

Notes

All walls and floors where it is proposed to install passive fireproofing systems are 60 minute rated compartment Walls/Floors. All passive fireproofing systems proposed for installation must at minimum achieve or surpass all standards and requirements applicable to same