



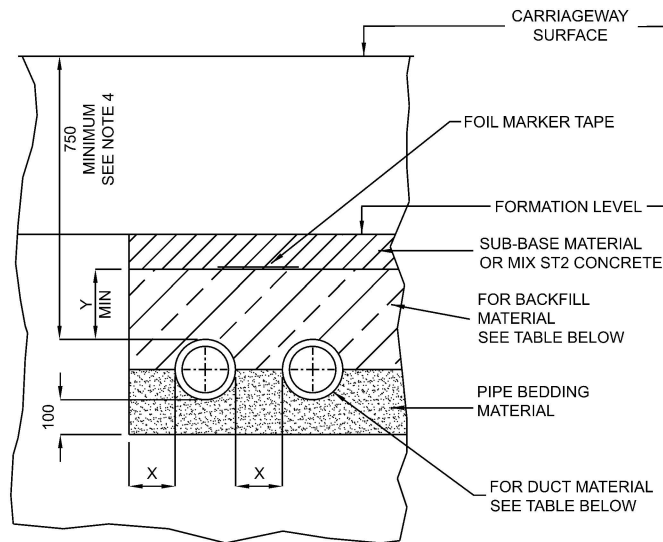


TYPE A
SHALLOW DUCTS (750 TO 1200
COVER)

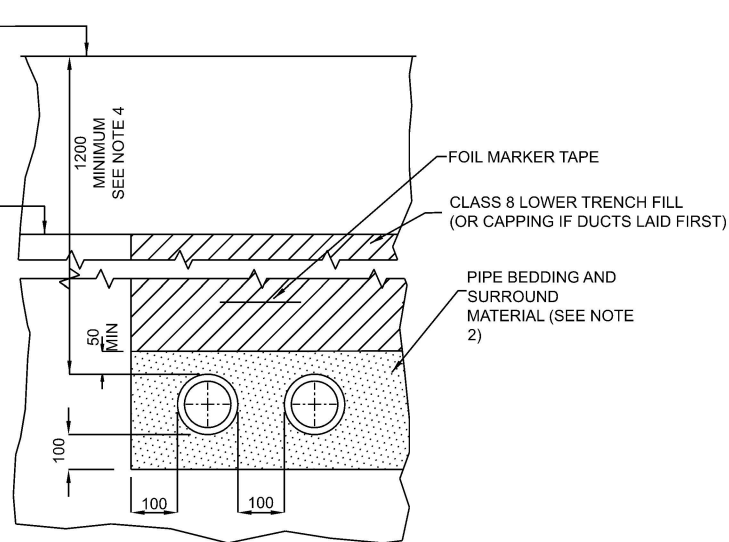

TYPE B
DEEP DUCTS (OVER 1200 COVER)



DUCT MATERIAL	BACKFILL MATERIAL	X	Y
UPVC	MIX ST2 CONCRETE	75	150
DUCTILE IRON	MIX ST2 CONCRETE OR SUB-BASE MATERIAL	AS ABOVE 150	0



MINIMUM CLEARANCE BETWEEN
DUCT AND DRAIN

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES EXCEPT WHERE STATED.
2. PIPE BEDDING AND SURROUND MATERIAL SHALL BE SAND COMPLYING WITH TABLE 3.2
3. CLASS 8 LOWER TRENCH FILL SHALL COMPLY WITH CC-SPW-00600 TABLE 6/1.
4. ALTERNATIVELY DUCTS SHALL BE LAID TO LIMITS DESCRIBED IN APPENDIX 5/2, 14/4 OR 15/1 OR SHOWN ON THE DRAWINGS.
5. MANDREL DETAIL IS SHOWN ON DRAWING No CC-SCD-00562.

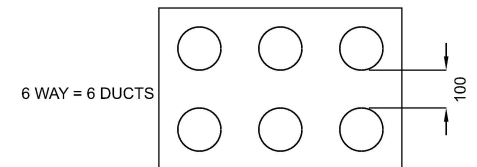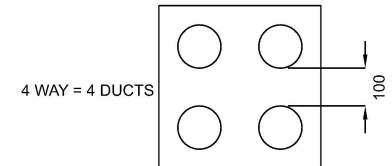

LAYOUT OF
DUCTS

NOT TO SCALE