



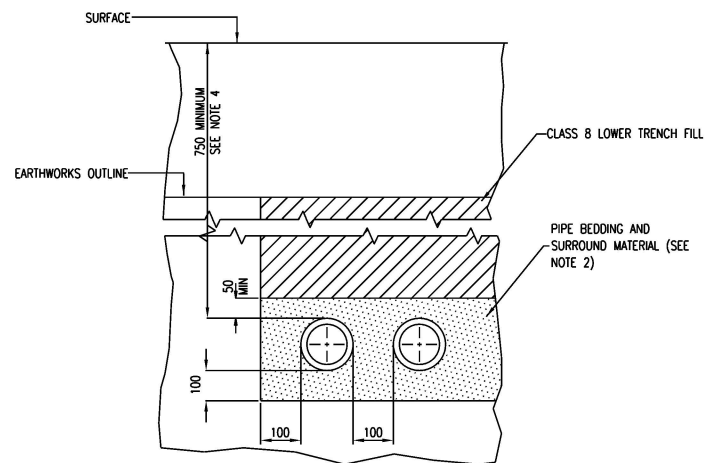

TYPE C
NON-TRAFFICKED DUCTS (MINIMUM 750
COVER)



DETAIL OF
MANDREL

(REQUIRED TO PASS THROUGH THE
WHOLE LENGTH OF COMPLETED
DUCTS WITH CURVED ENDS)

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. PIPE BEDDING AND SURROUND MATERIAL SHALL BE SAND COMPLYING WITH CC-SPW-00500 TABLE 3.2.
3. CLASS 8 LOWER TRENCH FILL SHALL COMPLY WITH CC-SPW-00600 TABLE 6/1.
4. ALTERNATIVELY DUCTS SHALL BE LAID TO LIMITS DESCRIBED IN APPENDIX 5/2, 14/4 OR 15/1 OR SHOWN ON THE DRAWINGS.

NOT TO SCALE