


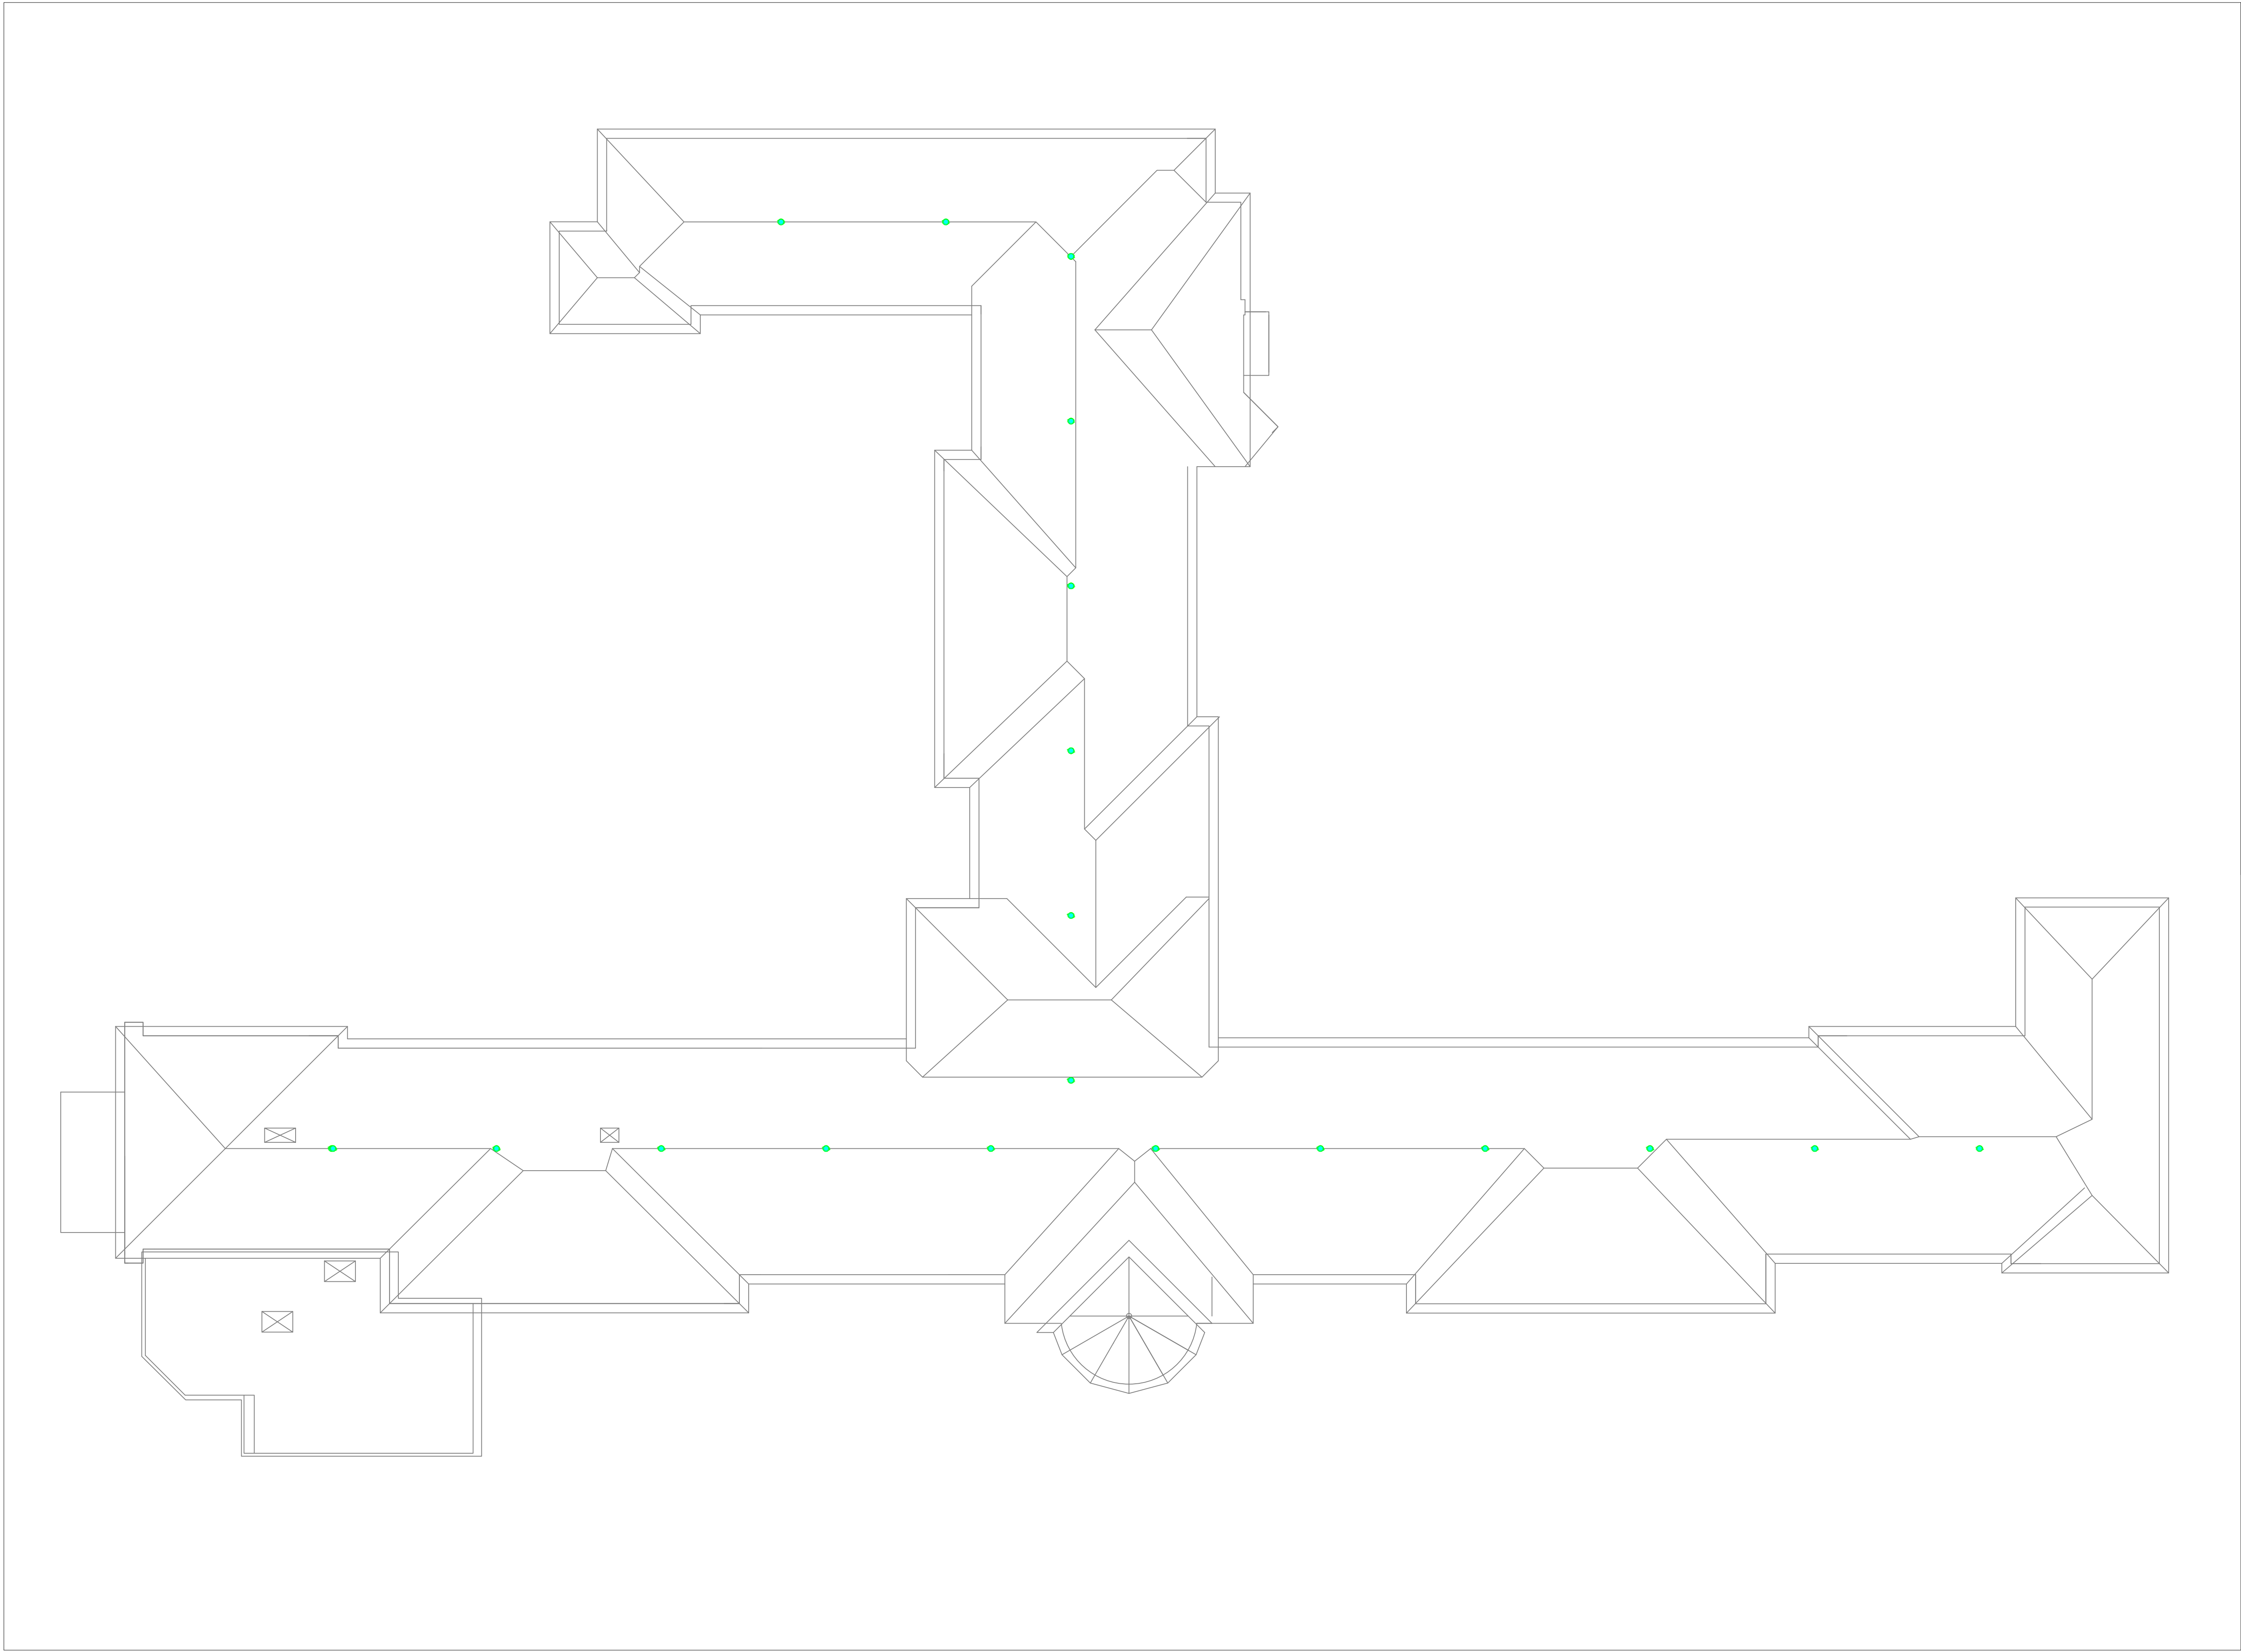

LEGEND

-  Em Fitting LED Self-Test
-  Bulkhead LED Self-Test
-  External Bulkhead IP68 Rated LED Self-Test
-  Exit Sign LED Self-Test
-  Twin Spot LED Self-Test

NOTES

- ATS Type PERC (All Self test fittings - Automatic testing & reporting, 24hr luminaire monitoring)
- ATS locations to be agreeded on site
- Installation to comply with IS3217:2023
- Fire-stopping of all opes is the responsibility of main contractor
- Allow for 10no. external twin-spots - Assembly points, locations to be confirmed on site