


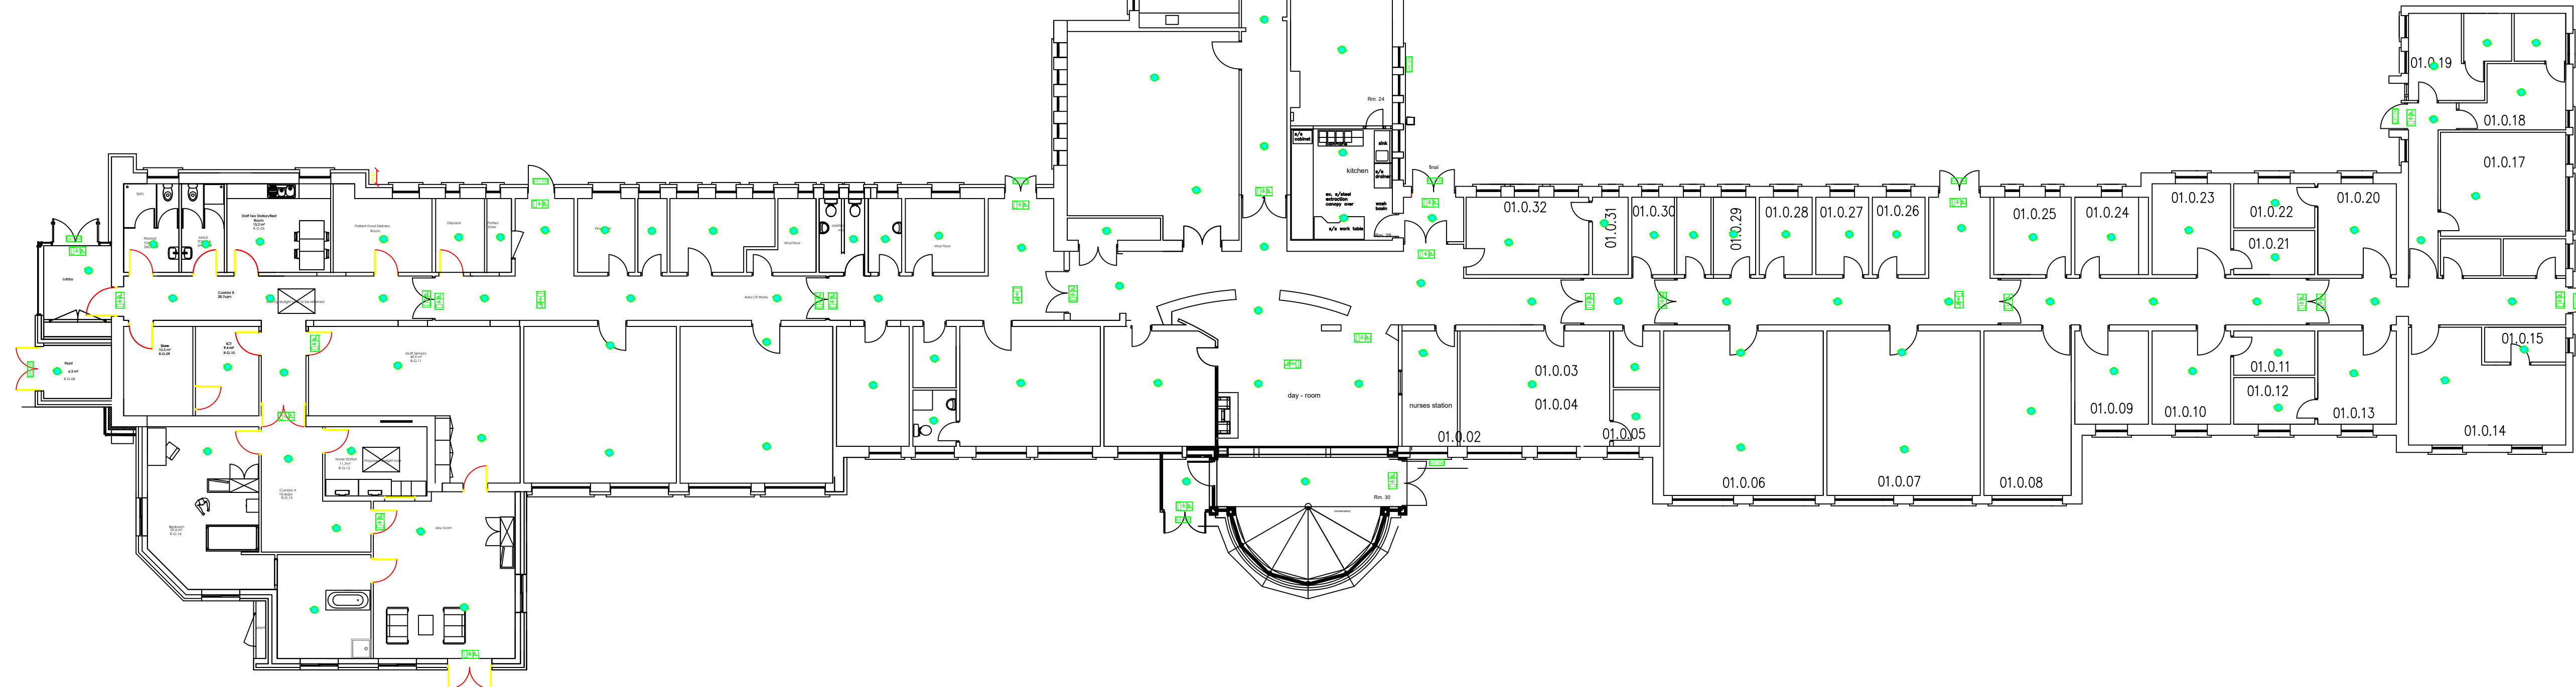

LEGEND

-  Em Fitting LED Self-Test
-  Bulkhead LED Self-Test
-  External Bulkhead IP68 Rated LED Self-Test
-  Exit Sign LED Self-Test
-  Twin Spot LED Self-Test

NOTES

1. ATS Type PERC (All Self test fittings - Automatic testing & reporting, 24hr luminaire monitoring)
2. ATS locations to be agreed on site
3. Installation to comply with IS3217:2023
4. Fire-stopping of all opes is the responsibility of main contractor
5. Allow for 10no. external twin-spots - Assembly points, locations to be confirmed on site

REV. NO.	DATE:	COMMENT:	TITLE:	An Collin	
			CLIENT:	HSE	
			DWG NO.	TFS-HSE-ACMHH-001	FLOOR: Ground
			DRAWN:	R.D.	SCALE: NTS
			CHECKED:	G.D.	DATE: 01/010/2026
			PROJECT:	Emergency Escape Lighting Design	



Titan Fire Safety Ltd.

Titan Fire Safety Ltd. Dun Eimear, Drogheda, Co. Louth
Tel: 085 151 9509
Email: ray@titanfiresafety.ie