


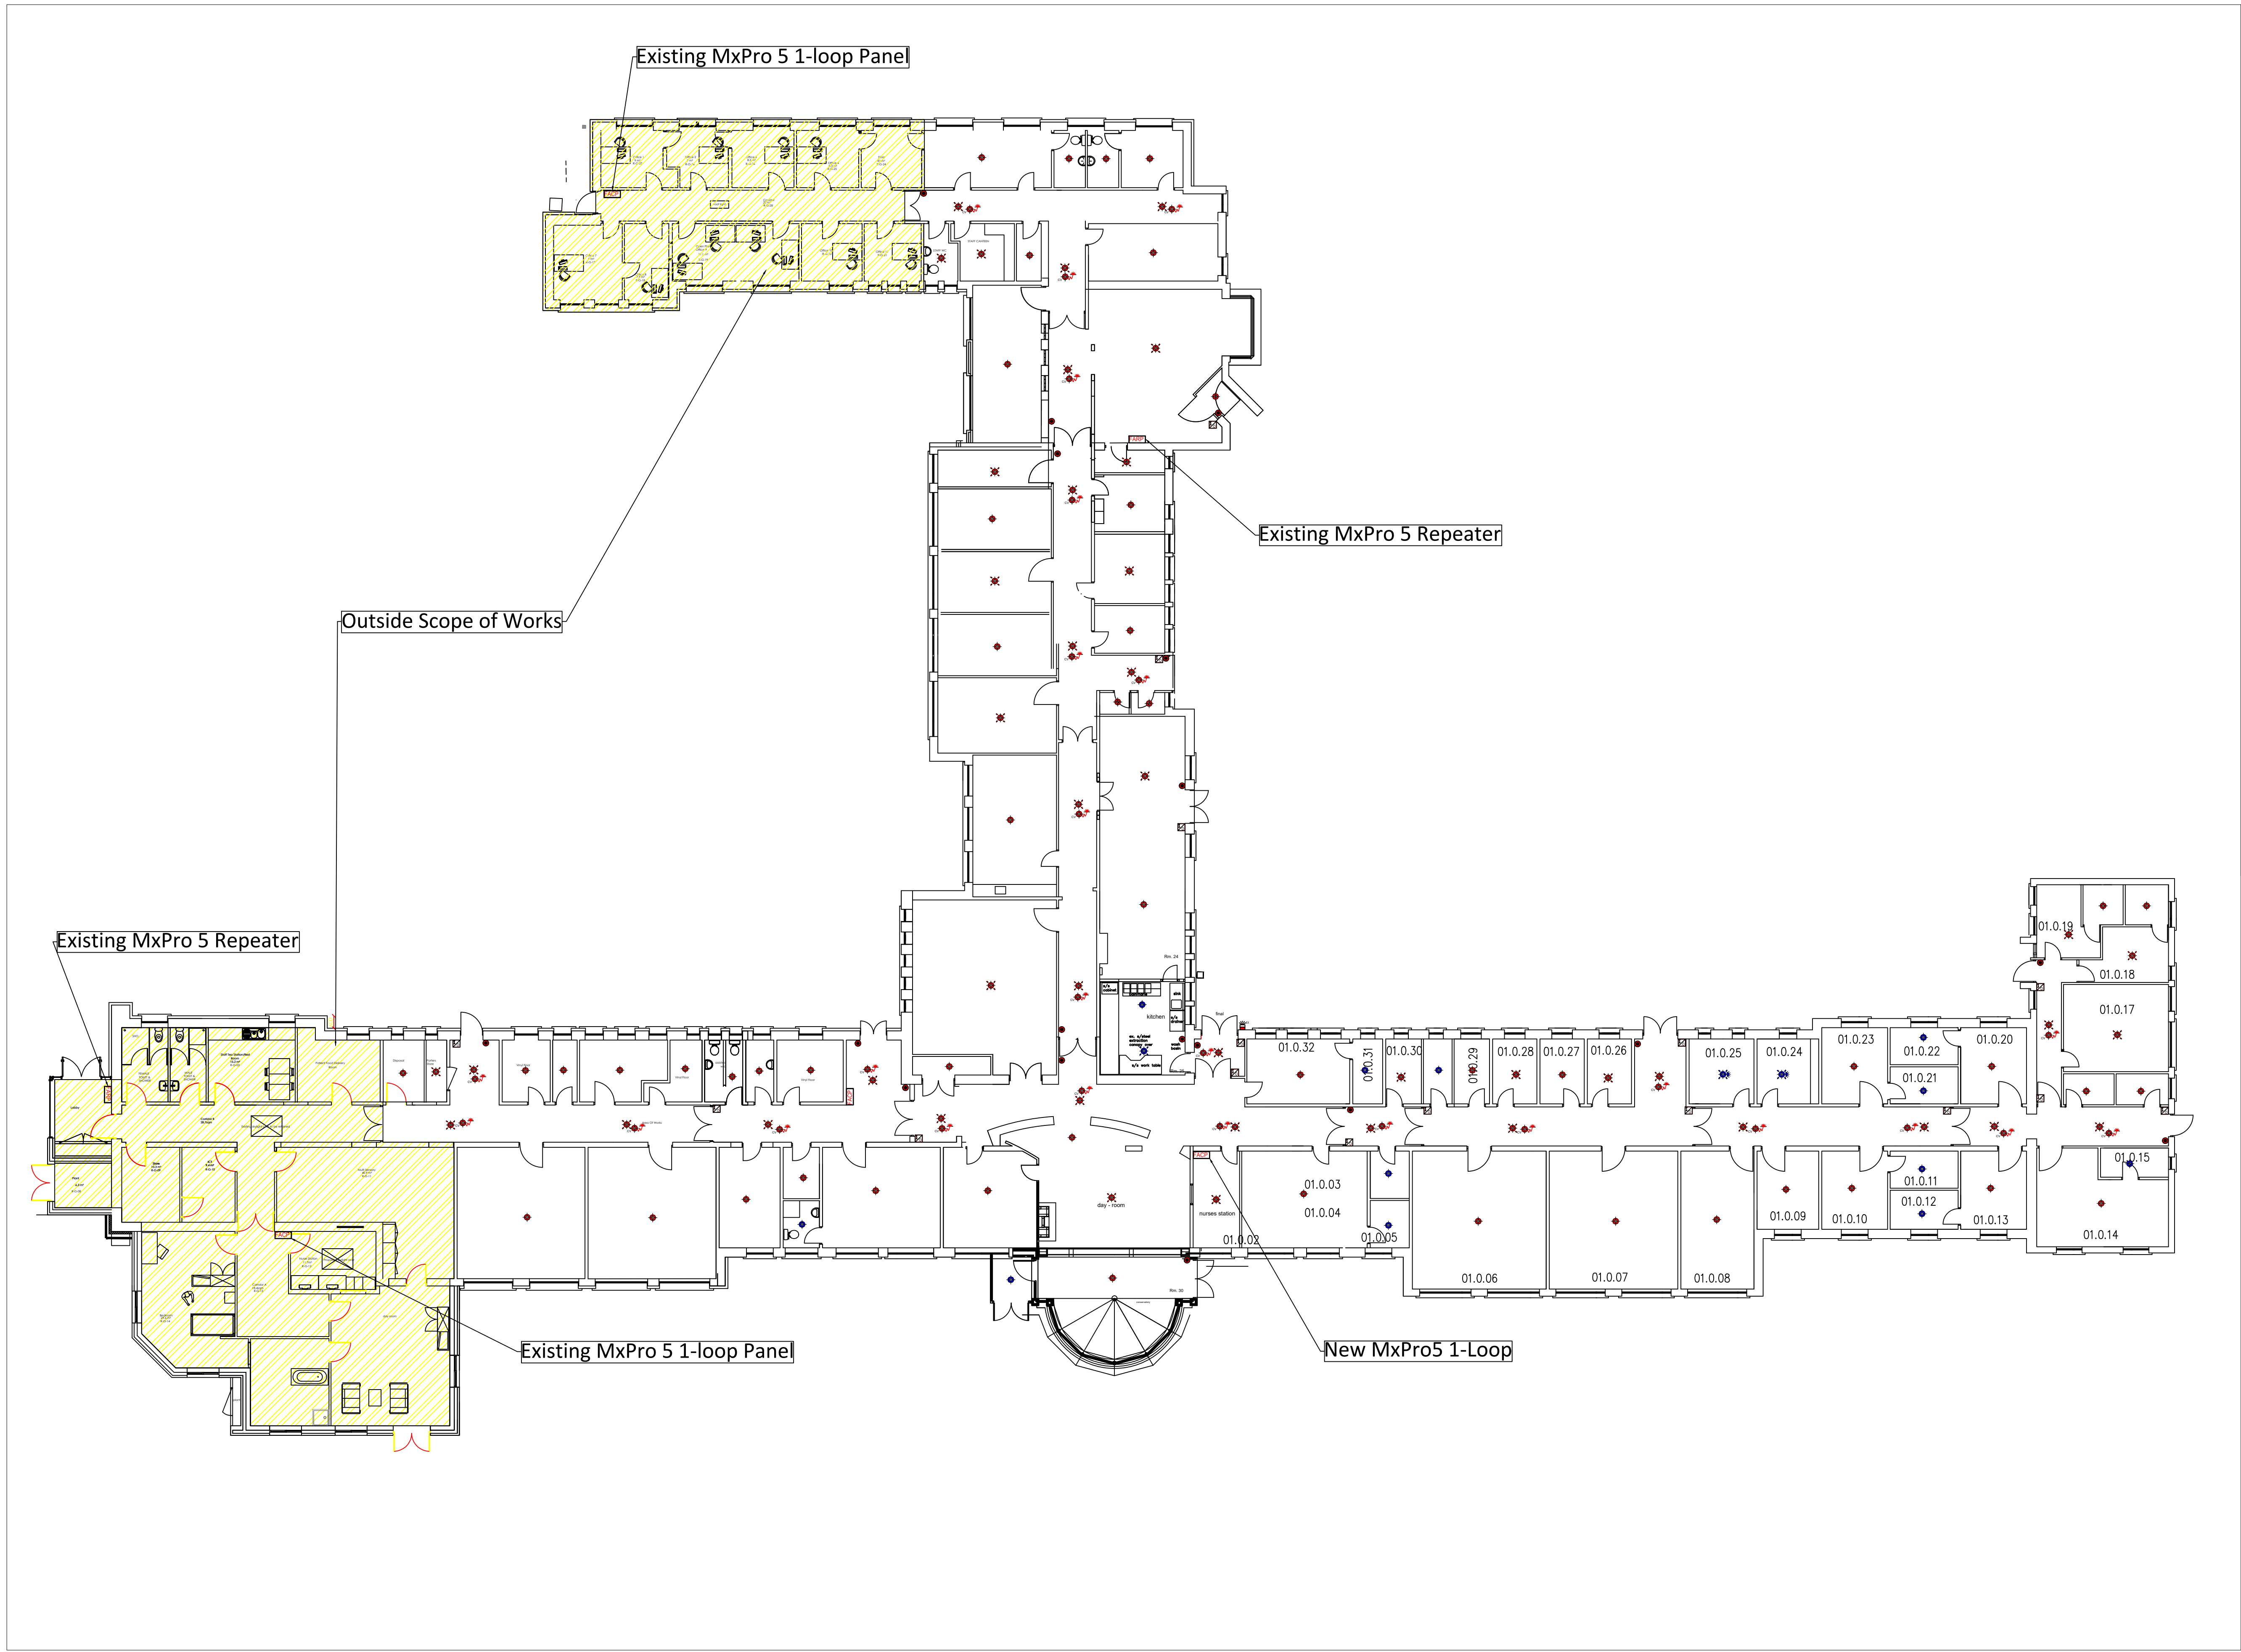


LEGEND

- FIRE ALARM CONTROL PANEL
- FIRE ALARM REPEATER PANEL
- OPTICAL DETECTOR
- OPTICAL DETECTOR C/W SOUNDER BEACON BASE
- OPTICAL DETECTOR C/W BEACON BASE
- OPTICAL DETECTOR C/W REMOTE LED
- BREAK GLASS UNIT
- HEAT DETECTOR
- HEAT DETECTOR C/W SOUNDER BEACON BASE
- HEAT DETECTOR C/W BEACON BASE
- I/O UNIT
- EXTERNAL SOUNDER/BEACON
- Air-Sampling Unit

- Notes:
1. All works to be compliant with IS3218:2024
 2. Fire Alarm Panel - Advanced Pro5 Series with Hochiki Detection & Alarm devices
 3. Final location of Fire alarm panel to be confirmed on site
 4. Upgrade network to fault-tolerant type
 5. Allow for 30 no. Universal Anti-Ligature Bases, - to be fitted in Bedrooms and ensuites
 6. All opes Firestopped as per specification
 7. Final location of Interfaces for DHO's to be confirmed on site
 8. Interfaces that are not required need not be installed

REV. NO.	DATE	COMMENT	TITLE
			An Collin
			HSE
			CLIENT
			TFS-HSE-ACMHU-001
			FLOOR
			Ground
			DRAWN
			R.D.
			CHECKED
			G.D.
			DATE
			01/10/2026
			PROJECT
			Fire Alarm Design



Titan Fire Safety Ltd. Dun Eimear, Drogheda, Co. Louth
Tel: 085 151 9509
Email: ray@titanfiresafety.ie



Titan Fire Safety Ltd.