Roinn Cumarsáide, Gníomhaithe ar son na hAeráide & Comhshaoil
Department of Communications, Climate Action & Environment

Geological Survey
Suirbhéireacht Gheolaíochta
Ireland | Éireann

Geological Survey Ireland

Establishment of Groundwater Zones of Contribution
Kilconieron Group Water Scheme, Co. Galway
April 2018

Prepared by:

Laura McGrath, Alison Orr and Les Brown, Arup

Geological Survey Ireland

(Monica Lee, Caoimhe Hickey, Taly Hunter Williams, Sophie O'Connor)

And with assistance from:

Kilconieron Group Water Scheme

National Federation of Group Water Schemes

ARUP

Acknowledgements

We would like to acknowledge Pat Ward for his input and provision of data.

Document Information

Project title: Establishment of Groundwater Zone of Contribution

Current Document version 1.0

Date

Prepared By	Date	Comment
Laura McGrath, Alison Orr and Les Brown	06/04/2018	

Reviewed By	Date	Comment
Caoimhe Hickey	23/03/2018	

Approved By	Date	Comment
Caoimhe Hickey	13/04/2018	

Version History

Ver. No.	Ver. Date	Comment	Revised By
1.0	00/00/0000		Insert name

Project description

Since the 1980s, the Geological Survey of Ireland (GSI) has undertaken a considerable amount of work developing Groundwater Protection Schemes throughout the country. Groundwater Source Protection Zones are the surface and subsurface areas surrounding a groundwater source, i.e. a well, well field or spring, in which water and contaminants may enter groundwater and move towards the source. Knowledge of where the water is coming from is critical when trying to interpret water quality data at the groundwater source. The 'Zone of Contribution' (ZOC) also provides an area in which to focus further investigation and is an area where protective measures can be introduced to maintain or improve the quality of groundwater.

This report has been prepared for the Kilconieron Group Water Scheme as part of the Rural Water Programme funding initiative of grants towards specific source protection works on Group Water Schemes (DECLG Circular L5/13 and Explanatory Memorandum).

The report has been prepared in the format developed during an earlier pilot project "Establishment of Zones of Contribution" which was undertaken by the Geological Survey of Ireland (GSI), in collaboration with the National Federation of Group Water Schemes (NFGWS), and with support from the National Rural Water Services Committee (NRWSC).

The methodology undertaken by the GSI included: liaising with the GWS and NFGWS to facilitate data collection, a desk study, a site visit to inspect the supply, the local area, and to record groundwater level(s). The data was then analysed and interpreted in order to delineate the ZOC.

The maps produced are based largely on the readily available information in the area, a field walkover survey, and on mapping techniques which use inferences and judgements based on experience at other sites. As such, the maps cannot claim to be definitively accurate across the whole area covered, and should not be used as the sole basis for site-specific decisions, which will usually require the collection of additional site-specific data.
The report and maps are hosted on the GSI website (www.gsi.ie). A glossary of acronyms and terms used in this report is included in the Appendices.

Table of Contents

1. Overview: Groundwater, Groundwater Protection and Groundwater Supplies 1

2. Location, Site Description, Supply Details and Wellhead Protection 3

3. Physical Characteristics and Hydrogeological Considerations 7

3.1 Physical characteristics of the area 7

3.2 Hydrochemistry and water quality 8

4. Zone of Contribution 11

4.1 Conceptual model 11

4.2 Boundaries 13

4.3 Recharge and water balance 13

5. Conclusions 14

6. Recommendations 15

7. References 17

Diagrams

Diagram 1. Rural Landscape highlighting the Interaction between Surface Water, Groundwater and Potential Hazards 3

Diagram 2. Aerial photo showing location of GWS abstraction point 5

Diagram 3. Conceptual model of groundwater flow 12

Photos

Photo 1 Kilconieron GWS borehole 5

Photo 2 Kilconieron GWS water treatment plant 6

Figures

Figure 1 Location Map (OSI 1:50,000 scale for main map) 19
Figure 2 Topography, hydrology and karst features 20
Figure 3 Subsoils 21
Figure 4 Groundwater Vulnerability Map 22
Figure 5 Rock Unit Group Map with karst features 23
Figure 6 Aquifer Map 24
Figure 7 ZOC boundaries 25

Appendices

Appendix 1. Groundwater Vulnerability I
Appendix 2. Groundwater Recharge IV
Appendix 3. Water Quality and Results VI
Appendix 4. Acronyms and Glossary VII
Appendix 5. ZOC Boundary Calculations XIII

1. Overview: Groundwater, groundwater protection and groundwater supplies

Groundwater is an important natural resource in Ireland. It originates from rainfall that soaks into the ground. If the ground is permeable, the rainfall will filter down until it reaches the main body of groundwater, which is usually within either the bedrock, or a sand/gravel deposit. If the bedrock or sand/gravel deposit can hold enough groundwater and allow enough flow to supply a useful abstraction, it is referred to as an aquifer.

In Irish bedrock aquifers, groundwater predominantly flows through interconnected fractures, fissures, joints and bedding planes, which can be envisaged as a 'pipe network', of various sizes, with varying degrees of interconnectivity. The speed of flow through this network is relatively fast, delivering groundwater, and a large proportion of the contaminants present in the groundwater, to its destination e.g. borehole, spring, river and sea.

In sand/gravel aquifers, the groundwater flows in the interconnected pore spaces between the sand/gravel grains. Generally, this is equivalent to a filter system that may physically filter out contaminants to varying degrees, depending on the nature of the spaces and grains. It also slows down the speed of flow giving more time for pathogens to die off before they reach their destination e.g. borehole, spring, river and sea.

Further filtration of contaminants may occur where the aquifers are protected by the overlying soil and subsoil; thick, impermeable clay soil and subsoil provide good protection while thin gravel will provide limited protection. Therefore, variation in subsoil type and thickness is important when characterising the 'vulnerability' of groundwater to contamination.

The karst limestone aquifers provide significant and important groundwater supplies in Ireland. Karst landscapes develop in rocks that are readily dissolved by water e.g. limestone (composed of calcium carbonate). Consequently, conduit, fissure and cave systems develop underground. Groundwater typically travels very fast in karst aquifers,

which has a significant impact on the water quality; neither filtration nor pathogen die-off are associated with these aquifers.

The interaction between abstraction and geology is shown in Diagram 1. In this scenario, a borehole is pumping groundwater from the bedrock aquifer. As the water is abstracted through the well, the original water table (a) is drawn down to level (b), where it induces a drawdown curve of the natural water table (c). The shape of this curve depends on the properties of the aquifer, for example, if the borehole is intersecting an aquifer with few fractures that are poorly interconnected, the groundwater from that system will soon be exhausted, and therefore the pumping will have to pull from deeper depths to maintain supply, which results in the steep, deep drawdown curve. Alternatively, if the borehole is intersecting an aquifer with a large number of well-connected groundwater-filled fractures, the abstraction will be met by pulling water from farther away, at a shallower depth, resulting in a shallow, wide drawdown curve.

By knowing the rate of abstraction (output), how much rainfall there is (input), and by assessing the geological elements outlined above (nature of the bedrock fractures or sand/gravel deposit; how permeable the soil and subsoil are) to determine what happens in between input and output, the catchment area, or 'Zone of Contribution' (ZOC), to any groundwater water supply can be determined.

Kilconieron GWS (NFGWS ref no g188) is supplied by a borehole which abstracts groundwater flowing through fractures and conduits in a Regionally Important karstified limestone aquifer. The GWS abstracts 380 m^3/d.

[1] Geological Survey of Ireland, 2000.

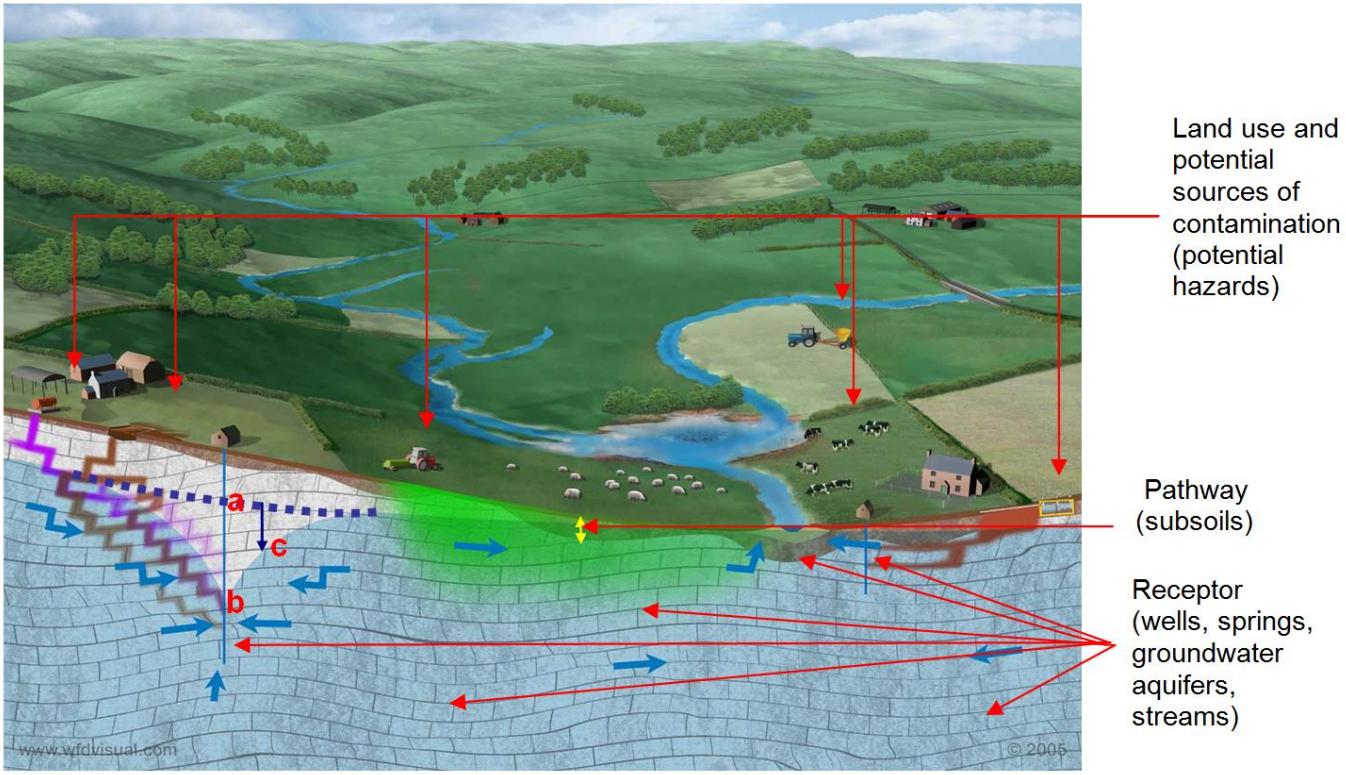


Diagram 1. Rural Landscape highlighting the Interaction between Surface Water, Groundwater and Potential Hazards

2. Location, Site Description, Supply Details and Wellhead Protection

The zone of contribution (ZOC) for the Kilconieron Group Water Scheme (GWS) has been delineated according to the principles and methodologies set out in 'Groundwater Protection Schemes' and in the GSI/EPA/IGI Training course on Groundwater SPZ Delineation.

Kilconieron GWS is supplied from a borehole located in Carrowrevagh, approximately 5 km northeast of Craughwell and approximately 500 m northwest from the R349 and Carrowrevagh Road junction (Figure 1). The borehole is enclosed in a sealed circular concrete chamber. The well head construction is good, sealed at the top and is raised above the chamber floor preventing ingress of contamination. Water in the base of the chamber suggests that there is leakage from rainfall through the chamber cover.

The surrounding area is predominantly used for agricultural. There are approximately seven domestic houses within 350 m of the borehole and one farmyard approximately

400 m from the borehole. These properties are likely to have septic tanks. There is a gas pipeline approximately 20m northwest of the borehole.

The scheme has 219 connections, 156 of which are for domestic use and 63 are agricultural connections. The pump is located approximately 21 m below ground level and pumps a reported average yield of approximately 15.7 m^3/hr (377 m^3/d). This remains the same throughout the year. The borehole was drilled by Mulcairs Well Drilling in the late 70s. The depth of the borehole is unknown. In 2011 the pump house was upgraded. The current scheme was amalgamated from four individual group water schemes in April 2012; Rathgorgan GWS, St. Cleran's GWS, Ganty GWS and Lissalondoon GWS, and is currently owned by Glan Aqua Ltd.

The scheme pumps to a reservoir from which it feeds into the distribution network. The pump is typically operational for six to eight hours at night until the tank is full. A back-up supply is located at the church, approximately 680 m northwest of the borehole. However, the scheme has never needed to rely on this back-up supply.

The disinfection system includes UV, chlorination, coagulation and sand filtration. Sodium hypochlorite 14% is automatically injected into the water and chlorine residual concentrations are maintained between 0.2 and 0.7 mg/l. Concentrations may be altered depending on the residual concentrations at the end of the network detected in the samples. The coagulation system is also operated automatically to deal with turbidity i.e. if turbidity levels are greater than 1NTU for 15 minutes, potassium permanganate 5% is automatically injected into the reservoir to reduce turbidity levels.

Summary details are presented in **Table 1.**



Diagram 2. Aerial photo showing location of GWS abstraction point and backup supply



Photo 1 Kilconieron GWS well head chamber (left) and well head (right)



Photo 2 Kilconieron GWS water treatment plant

Table 1. Water Supply Details

NFGWS No. g188	Kilconieron Borehole	Back-up supply
Grid reference	ITM: 555737, 722163	ITM: 555232, 722534
Townland	Carrowrevagh	Carrowrevagh
Source type	Borehole	Borehole
Drilled	Late 1970s	Unknown
Drilling Contractor	Mulcairs	Unknown
Owner	Glan Aqua Ltd	Glen Aqua Ltd
Elevation in metres above Ordnance Datum	c. 40 m aOD (estimated based on topographical mapped contours)	c. 40 m aOD (estimated based on topographical mapped contours)
Total depth (m)	unknown	Unknown
Construction details	6" outer steel casing installed to unknown depth.	Unknown
Depth to rock in metres below ground level (mbgl)	Rock close to or at the surface	Unknown
Inflow zones (water strikes) mbgl	Unknown	Unknown
Static water level (SWL) (mbgl) (during site visit)	12	Unkown
Pumping water level (PWL) (mbgl)	Unknown	Unknown
Pump intake depth (mbgl)	21	Unknown
Current abstraction rate (GWS)	15.7 m^3/hr (376.8 m^3/day) (based on information provided by caretaker)	Not applicable
Number of Connections	150	150
Specific Capacity (m^3/d/m)	Not available	Not available
Transmissivity (m^2/d)	Not available	Not available

3. Physical Characteristics and Hydrogeological Considerations

3.1 Physical characteristics of the area

An overview of the relevant information on rainfall, land use, topography, hydrology and geology for the area around the GWS is provided in Table 2.

Table 2. Physical Characteristics of the Area of Interest

	GWS Well	Description/Comments
Topography (**Figure 1 & Figure 2**)	The borehole is situated at an elevation of c. 40 m OD and is situated in a flat to gently sloping area. Land within 2.5km of the borehole ranges between 44mOD to 30mOD.	
Land use	The land use dominated by grassland for grazing and agricultural use. A forested area is located approximately 850 m west of the borehole.	
Surface Hydrology (**Figure 1 & Figure 2**)	The borehole is in an area which is well drained. The Craughwell River is located approx. 540 meters south of the borehole and the Dooyertha River is located approx. 1.5km northwest of the borehole. Both rivers flow in a northeast to southwest direction.	
Topsoil http://gis.epa.ie/envision	The soils surrounding the borehole are mapped as deep well-drained soils. These soils transition into alluvium along the banks of the Craughwell River approx. 600 m southwest of the borehole. Cut peat is located approximately 1.2km east of the borehole along the Craughwell River.	
Subsoil (**Figure 3**) www.gsi.ie/mapping	The subsoils are dominated by till derived from limestone. Alluvium and peat are mapped along the banks of the Craughwell River. There are also pockets of karstified bedrock outcrop or subcrop.	
Groundwater Vulnerability (**Figure 4**) www.gsi.ie/mapping	The area around the borehole is mapped as Rock at or Near Surface or Karst (X) vulnerability. The area north and southeast of the borehole is mapped as Extreme (E) vulnerability and the area to the southwest and northeast is mapped as High (H) vulnerability. Areas of peat soil are considered Low (L) vulnerability and areas of alluvium are considered Moderate (M) vulnerability.	
Geology (**Figure 5**) www.gsi.ie/mapping	The water supply borehole is located in pure bedded limestone bedrock. Impure limestone is mapped in the east and south of the borehole. The boundary between pure and impure limestone is mapped approximately 440 m southeast of the borehole, on the northwest side of the Craughwell River**.**	
Aquifer Classification (**Figure 6**) www.gsi.ie/mapping	The pure bedded limestone bedrock is classified as a Regionally important karstified aquifer (**Rk_c**), dominated by conduit flow. The impure limestone bedrock to the southeast is classified as a Locally important aquifer which is moderately productive in local zones only (**Ll**).	
Groundwater Body (GWB) www.wfdireland.ie	The borehole is located in the GWDTE-Rahasane Turlough groundwater body, which is categorised as having "good" status but is classified as being "possibly at risk of not achieving good status". (www.gsi.ie/Programmes/Groundwater/Projects/Groundwater+Body+Descriptions)	
Recharge Coefficient (**Appendix 2**)	60% to 85%	Higher recharge rates in this area occur in locations of bedrock outcrop or in areas of Rock at or Near Surface or Karst (X) groundwater vulnerability.
Recharge (mm/yr) www.gsi.ie/mapping	430 to 615	Recharge in the area is moderate to high due to permeable, well drained soils overlying bedrock close to the ground.

3.2 Hydrochemistry and water quality

Kilconieron drinking water returns for the years 2012 and 2015, Glan Agua Monthly Status Reports raw water results, and GWS rural monitoring data (2017) were used to assess the hydrochemistry and water quality for Kilconieron GWS. All available water quality data are presented in **Appendix 3**.

The untreated data are summarised in **Table 3** and treated data are summarised in **Table 4**, where they have been compared to the drinking water limits (DWL) from the Drinking Water Regulations (S.I. No. 122 of 2014) and/or threshold values (TV) from the European Communities Environmental Objectives (Groundwater) Regulations 2010 (S.I. No. 9 of 2010).

Table 3. Key Hydrochemistry and Water Quality values in untreated water samples

Parameter	No. of samples	Min	Max	Average	Drinking Water Limit (DWL) or Threshold Value (TV)
Total Hardness (mg/l as $CaCO_3$)	1			361	[-]
Electrical Conductivity (µS/cm)	1			533	800 (TV), 2,500 (DWL)
pH (laboratory)	9	6.90	7.20	7.01	6.5 – 9.5 (DWL)
Turbidity	1			0.12	Acceptable to consumers, no abnormal changes
Total Coliforms (MPN[1]/100 ml)	8	0	**1203**	**2 exceedances (>100 counts)**	0 (DWL)
Faecal Coliforms (*E. Coli*) (MPN/100 ml)	8	0	**162**	**1 exceedance (<100 counts) 1 exceedance (>100 counts)**	0 (DWL)
Nitrate (mg/l NO_3)	3	<2	9.21	5.58	50 (DWL) 37.5 (TV)
Chloride (mg/l)	2	11.02	15.28	13.15	250 (DWL), 24 (TV)
Ammonium (mg/l NH_4)	3	<0.01	0.17	0.06	0.3 (DWL), 0.225 [0.175 as N] (TV)
Iron (µg/l)	9	<7.2	20.00	7.73	200 (DWL)
Manganese (µg/l)	9	<0.7	5.00	1.00	50 (DWL)
Potassium:sodium ratio	2	0.22	0.29	0.26	0.4 (indicator)

[1] MPN is most probable number

Table 4. Key Hydrochemistry and Water Quality values in treated water samples

Parameter	No. of samples	Min	Max	Average	Drinking Water Limit (DWL) or Threshold Value (TV)
Total Hardness (mg/l as $CaCO_3$)	30	16	465	246	[-]
Electrical Conductivity (µS/cm)	475	28	**1587**	506	800 (TV), 2,500 (DWL)
pH (laboratory)	475	6.5	8.8	7.20	6.5 – 9.5 (DWL)
Turbidity	342	0.11	8.38	0.51	Acceptable to consumers, no abnormal changes
Total Coliforms (MPN[2]/100 ml)	509	-	**579**	42 exceedances (<100 counts) 7 exceedances (>100 counts)	0 (DWL)
Faecal Coliforms (*E. Coli*) (MPN/100 ml)	509	-	**326**	22 exceedances (<100 counts) 4 exceedances (>100 counts)	0 (DWL)
Nitrate (mg/l NO_3)	95	0.64	23.1	6.6	50 (DWL) 37.5 (TV)
Chloride (mg/l)	81	7.1	181	20.1	250 (DWL), 24 (TV)
Ammonium (mg/l NH_4)	227	0.009	**0.54**	0.04	0.3 (DWL), 0.225 [0.175 as N] (TV)
Iron (µg/l)	287	10	**941**	53	200 (DWL)
Manganese (µg/l)	35	1	**384**	42	50 (DWL)
Potassium:sodium ratio	Not recorded				0.4 (indicator)

The water in the area is very hard which is typical of limestone aquifers since the limestone dissolves readily into the groundwater. This can be problematic and the scheme requires use of a softener to address the hardness.

High concentrations of total and faecal coliforms have been recorded on two occasions in the raw water samples (**Table 3**). This indicates contamination from nearby organic sources including farmyard manure, slurry and dirty water or from on-site wastewater treatment systems (such as septic tanks or similar). It is particularly concerning that elevated levels have also been recorded in the treated water (**Table 4**), indicating failures of the treatment system. Elevated ammonium concentrations occurred on a single occasion in 2012. The sources of ammonium are similar to that of coliforms including animal and human waste as well as ammonium based fertilisers.

[2] MPN is most probable number

In 2012 manganese concentrations in the treated water samples exceeded the threshold limits on seven occasions and iron exceeded the threshold limits on eleven occasions. Sudden significant increase in manganese and iron concentrations may be due to a change in the redox conditions within the aquifer or borehole. Exceedances of iron and manganese were not recorded at all locations on the same date suggesting a complex set of conditions controlling the iron and manganese in the distributed water network.

Trihalomethane above its threshold limit was recorded on 20 occasions in 2012 and one occasion in 2015. Trihalomethane is a by-product of chlorination in water treatment and does not represent groundwater quality.

4. Zone of Contribution

4.1 Conceptual Model

The current understanding of the geological and hydrogeological setting is given as follows and as shown schematically in **Diagram 3**.

The groundwater is replenished by rainfall percolating diffusely though the soils and subsoils down to the water table in the bedrock, or directly into the bedrock where the bedrock is exposed at the surface. The low permeability subsoils vary in thickness across the zone of contribution (ZOC). Where present, the subsoil allows the majority of rainfall to percolate downwards, while the remaining rainfall is taken up by plants or redirected to local drains. The subsoil provides little protection to the underlying aquifer from infiltrating contamination where it is thin and the vulnerability is classified as Extreme (E) or Rock at or near surface (X). Where the subsoil is slightly thicker more protection is afforded to the underlying aquifer and the aquifer vulnerability is classified as High (H).

The Kilconieron GWS is supplied by one borehole which abstracts groundwater from the underlying limestone bedrock. The limestone is a Regionally Important Aquifer which is dominated by karstified conduit flow (Rk_c). There are no karst landforms recorded within the ZOC and this suggests that the recharge is diffuse. Also, the lack of surface water drainage within the ZOC further indicates that the recharge readily infiltrates to the groundwater system.

The general groundwater flow direction within the ZOC is from the east to west parallel to the contact between the lower permeability Locally Important aquifer and towards the Craughwell River. This is supported by tracer tests which show underground connections in a north east to south west and east to west direction (Figure 2). When the infiltrating water reaches the bedrock aquifer it easily enters the groundwater system and travels through the conduit and fracture network within the bedrock.

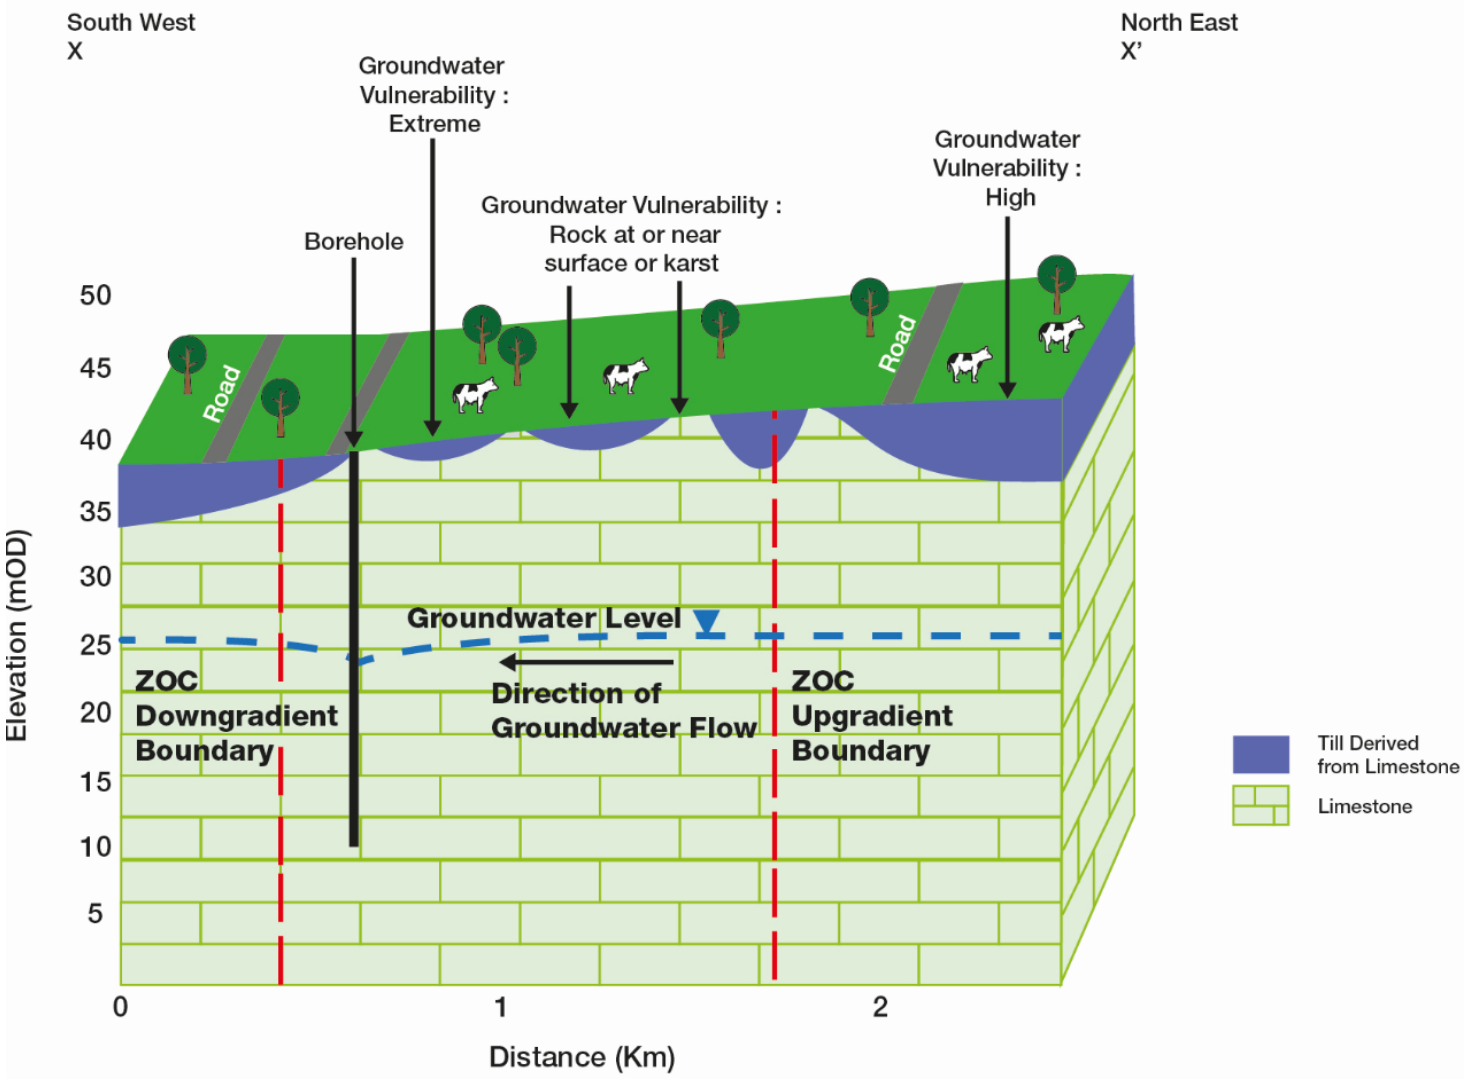


Diagram 3. Conceptual model of groundwater flow

4.2. Boundaries

The Zone of Contribution (ZOC) delineated for Kilconieron GWS is based mainly on a combination of hydrogeological mapping and inferences. The shape of the ZOC is a slightly elongated shape to reflect the karstic flow paths and direction.

The **northern, eastern** and **southern** boundaries are based on an assessment of the local groundwater flow. The local topography is relatively flat and therefore the ZOC boundary is relatively circular as it assumes that the groundwater divide is a subdued reflection of topography.

The **south western** boundary is based on the assessment of the local groundwater flow and topography and supported by calculations of the downgradient boundary, as outlined in **Appendix 5**.

4.3. Recharge and water balance

The recharge and water balance calculations are used to support the hydrogeological mapping and to confirm that the ZOC delineated is big enough to supply the quantity of water at the source.

The average daily abstraction from the GWS source is 377 m^3/day. An additional 50% was added onto this to account for uncertainity which increases the average abstraction rate to 565 m^3/day. Members of the GWS advised the borehole does not dry up during in extended dry periods and when running at maximum capacity. It is therefore assumed that this value is representative.

The recharge rate is assumed to be 491 mm/yr based on the recharge rate for the area available from GSI data. The area required to supply the pumping rate is estimated to be 0.42 km^2 (4.47 ha) as shown in the calculations in **Appendix 5**. The mapped ZOC area is 1.1 km^2 as a conservative approach to account for potential longer flow paths associated with the Regionally Important karstified aquifer.

5. Conclusions

Kilconieron GWS is sourced by a borehole from which 377 m^3/d is pumped for 24 hours per day from a limestone aquifer. The borehole meets the scheme water demand even in dry weather.

Rainfall infiltrates to the groundwater system through the soils and subsoils or directly into the bedrock where the bedrock is exposed at the surface. There are no karst landforms recorded within the ZOC and this suggests that the recharge is diffuse across the ZOC, although karst features may exist that have not been mapped yet. When the infiltrating water reaches the limestone it travels through the conduit and fracture network within the bedrock. The general groundwater flow direction within the ZOC is from the north east to south west. The GWS is supplied by one borehole which abstracts groundwater from the underlying limestone bedrock. The ZOC for the GWS encompasses an area of 1.1 km^2.

The available water quality data suggest the borehole is susceptible to coliform contamination. The elevated faecal coliforms and occasionally elevated iron and manganese concentrations, suggest rapid influxes of shallow groundwater linked to rainfall. The groundwater vulnerability within the ZOC varies from 'High' to 'Extreme'. The occurrence of total and faecal coliforms in the treated samples suggests potential issues in the treatment process.

The maps produced are based on the readily available information in the area, a field walkover survey, and on mapping techniques which use inferences and judgements based on experience at other sites. As such, the maps cannot claim to be definitively accurate across the whole area covered, and should not be used as the sole basis for site-specific decisions, which will usually require the collection of additional site-specific data. Based on the collection and analysis of the available data for this project, it is recognised that this scale of study (i.e. predominantly desk study) cannot delineate a definitive ZOC for the GWS borehole with a high degree of confidence, due to the complicated nature of the karst aquifer in this region. It is possible that additional areas are also contributing to the borehole so the GWS may want to consider further hydrogeological work/measures if water quality issues persist, which will provide supporting evidence as to the most likely areas that should be included within the ZOC.

6. Recommendations

Essential:

- A regular survey of water quality parameters of untreated water that would include coliforms (total and faecal), pH, alkalinity, hardness, electrical conductivity, nitrate, ammonia, chloride, iron, manganese, potassium and sodium. This survey should be taken on a monthly basis for the first year and should incorporate samples following a variety of wet and dry rainfall conditions in the preceding week. The results should be shared with the GSI. The need for future monitoring can be determined on the basis of these results, and in discussion with a hydrogeologist.
- The GWS should consider upgrading the water treatment based on the presence of total and faecal coliforms in treated water. Although the system includes UV, chlorination, coagulation and sand filtration, the maintenance and condition of the components needs to be addressed to ensure good water quality is consistently achieved.
- The GWS should also consider a cryptosoridium risk assessment based on the vulnerability of the abstraction.
- Effort should be made to prevent standing water from collecting at the base of the well head chamber through sealing the chamber lid and/or installing a pump.

Desirable:

- The site could be revisited during the winter time to assess the catchment area in wet conditions.
- A dip tube should be installed to allow groundwater level measurements.

Other:

- The following EPA guidelines may serve as future useful reference documents for the GWS:
    - EPA Guidance on Landspreading of Organic Waste[3]
    - EPA Drinking Water Advice Note No. 7: Source Protection and Catchment Management to Protect Groundwater Sources. Of particular interest would be Section 4.1 – Step 2 – Hazard Mapping[4].

[3] http://www.epa.ie/pubs/advice/waste/waste/EPA_landspread_organic_waste_guide.pdf
[4]]http://www.epa.ie/pubs/advice/drinkingwater/epadrinkingwateradvicenote-advicenoteno7.html#.UpNP_eJ9KEp

- EPA Drinking Water Advice Note No. 8: Developing Drinking Water Safety Plans. This document contains checklists for hazards which would assist in hazard mapping within the ZOC[5].
- EPA Drinking Water Advice Note No. 14. Borehole Construction and Wellhead Protection[6]

[5] http://www.epa.ie/pubs/advice/drinkingwater/epadrinkingwateradvicenote-advicenoteno8.html#.UpNQf-J9KEo
[6] http://www.epa.ie/pubs/advice/drinkingwater/advicenote14.html#.UpNR8eJ9KEo

7. References

DELG/EPA/GSI, 1999. Groundwater Protection Schemes. Dept. of the Environment & Local Government; Environmental Protection Agency; Geological Survey of Ireland.

EPA website www.epa.ie

EPA (2004) Guidance on Landspreading of Organic Waste.

EPA (2011) Drinking Water Advice Note No. 7: Source Protection and Catchment Management to Protect Groundwater Sources.

EPA (2011) Drinking Water Advice Note No. 8: Developing Drinking Water Safety Plans.

EPA (2013) Drinking Water Advice Note No. 14. Borehole Construction and Wellhead Protection

European Communities (Drinking Water) Regulations (2014). S.I. No. 122 of 2014.

European Communities Environmental Objectives (Groundwater) Regulations (2010) S.I. No. 9 of 2010.

GSI website www.gsi.ie

Hunter Williams, N.H., Misstear, B.D., Daly, D. and Lee, M. (2013) Development of a national groundwater recharge map for the Republic of Ireland. Quarterly Journal of Engineering Geology and Hydrogeology. Vol. 46, No. 4, pp. 493-506.

IGI (2007) Guidelines for Drilling Wells for Private Water Supplies (March 2007). http://www.igi.ie/publications/codes-guidelines.htm

Figures

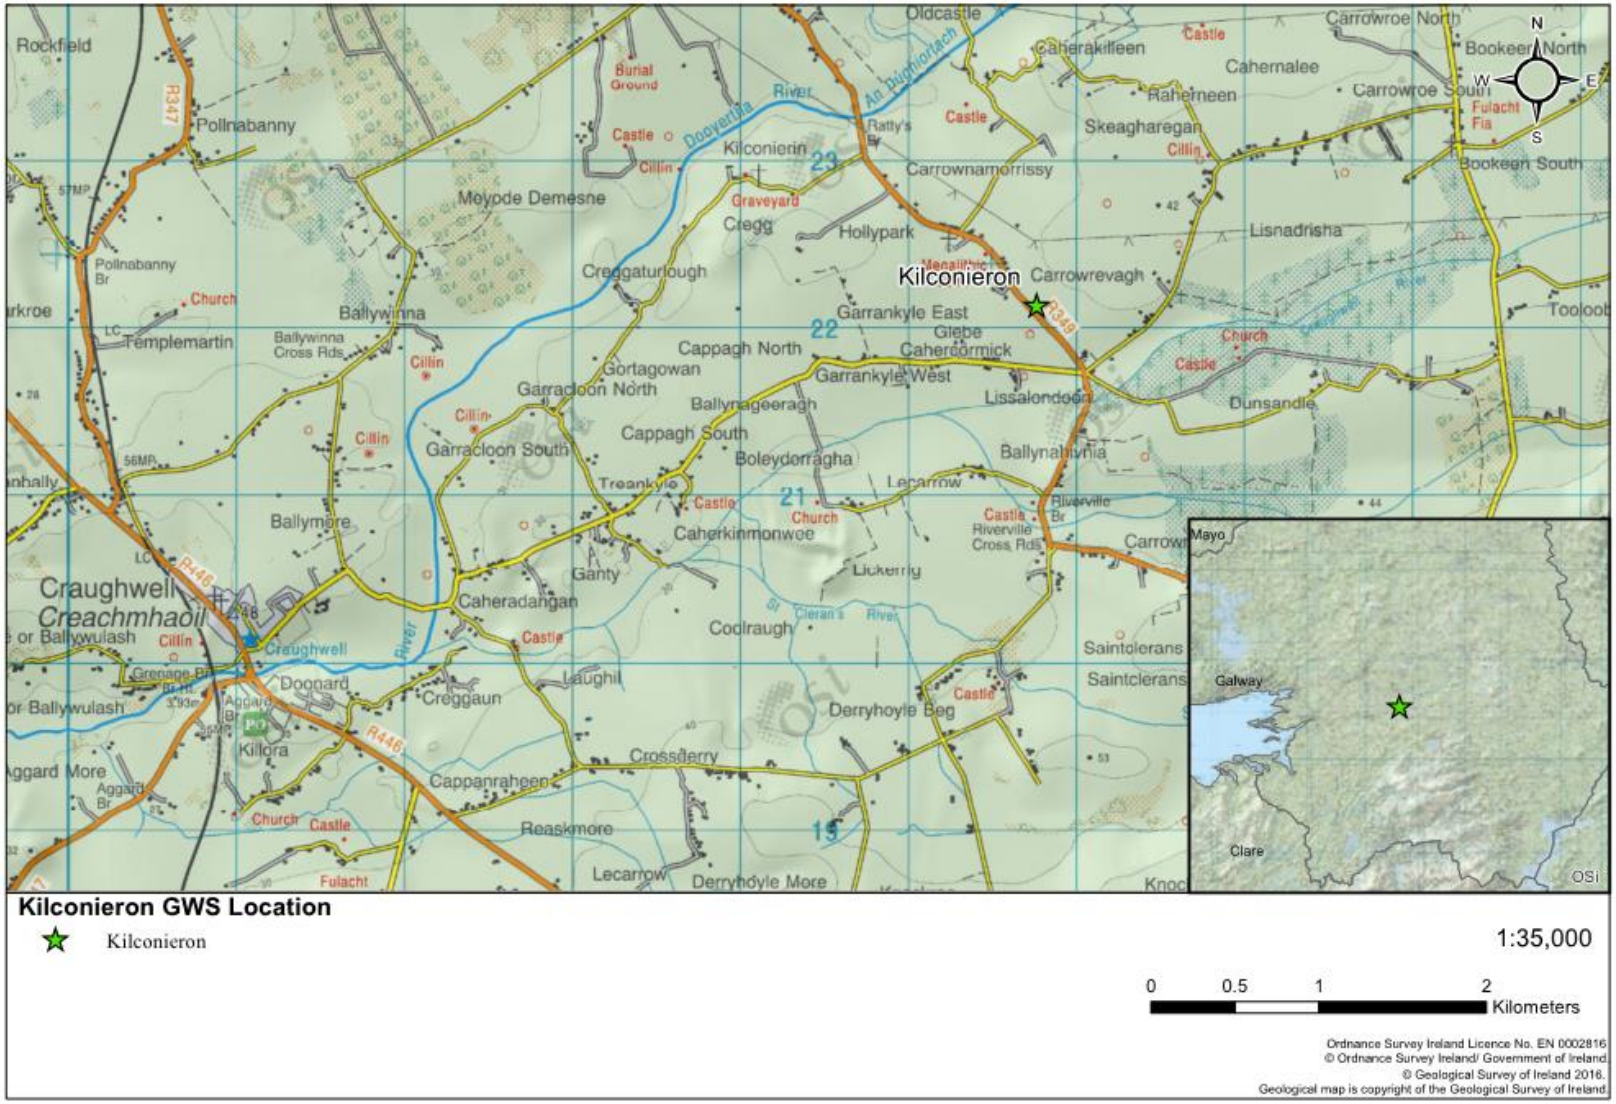


Figure 1 Location Map (OSI 1:50,000 scale for main map)



Figure 2 Topography, hydrology and karst features

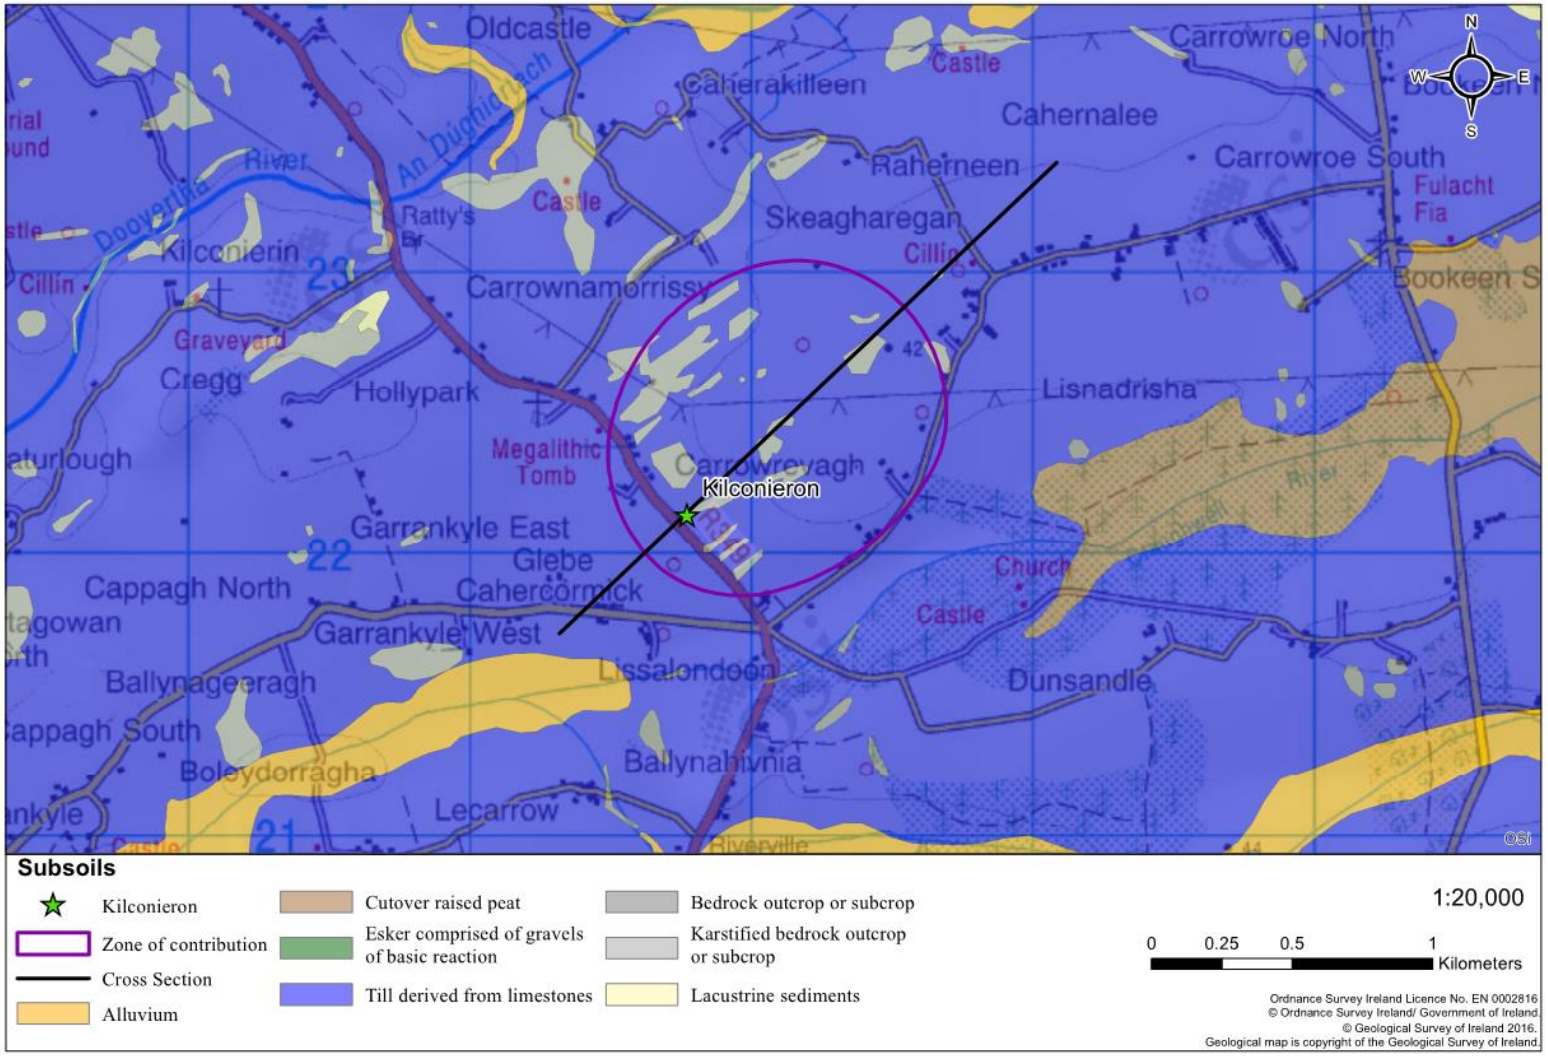


Figure 3 Subsoils

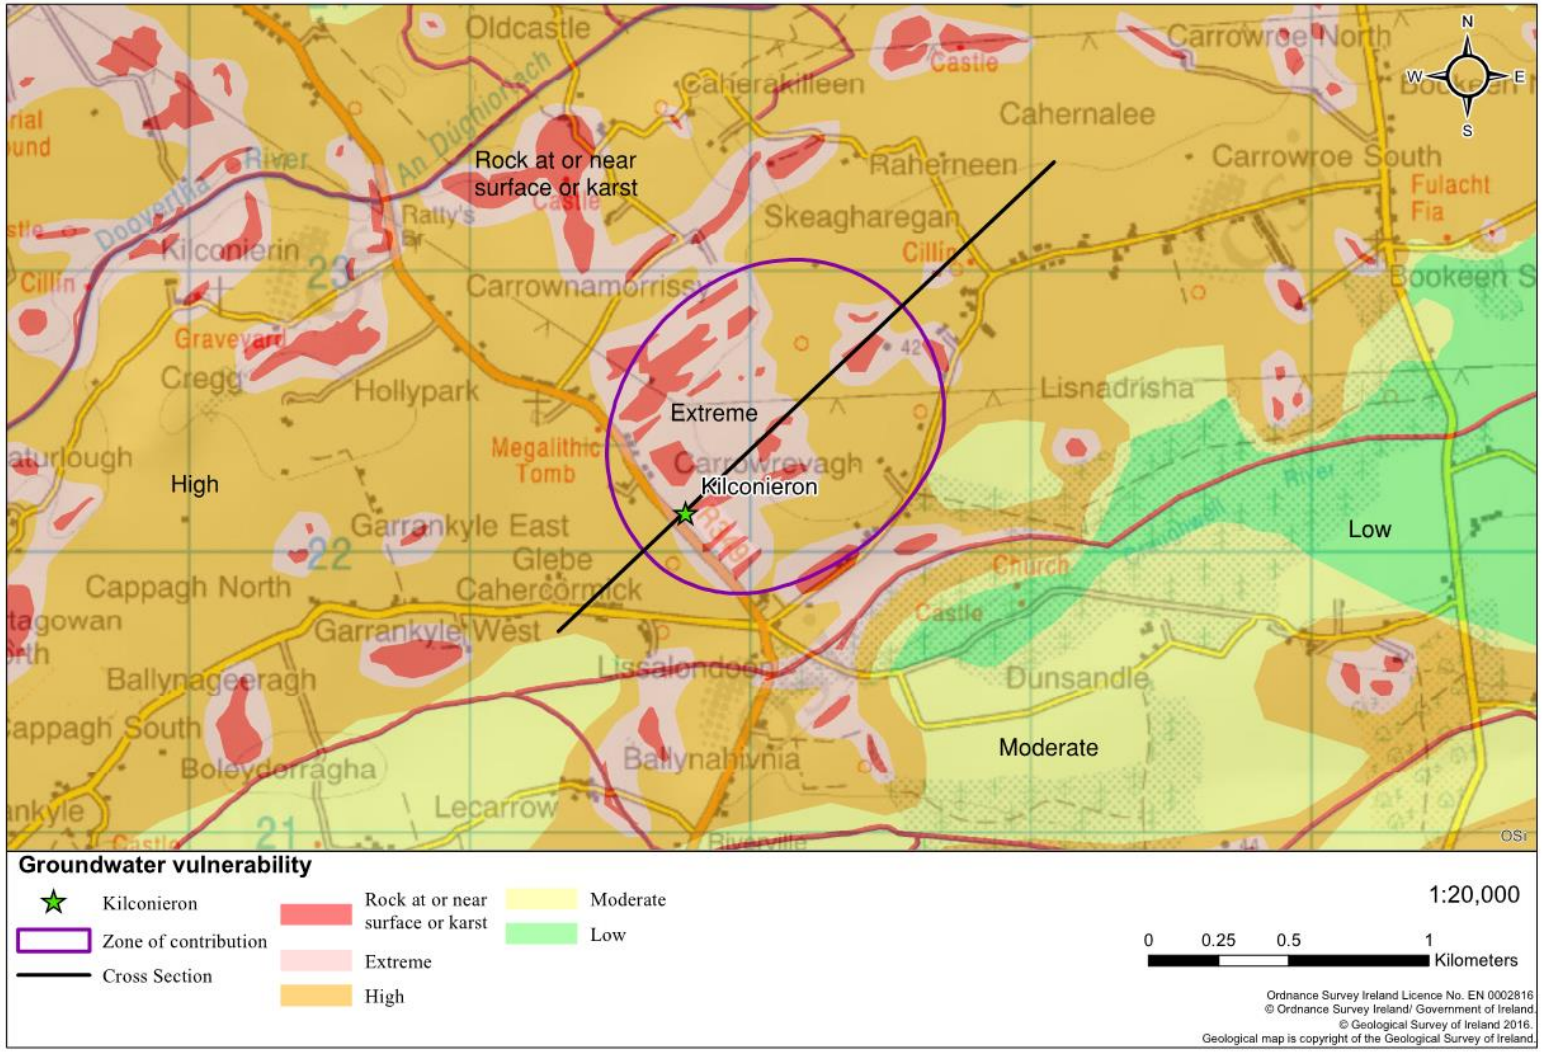


Figure 4 Groundwater Vulnerability Map

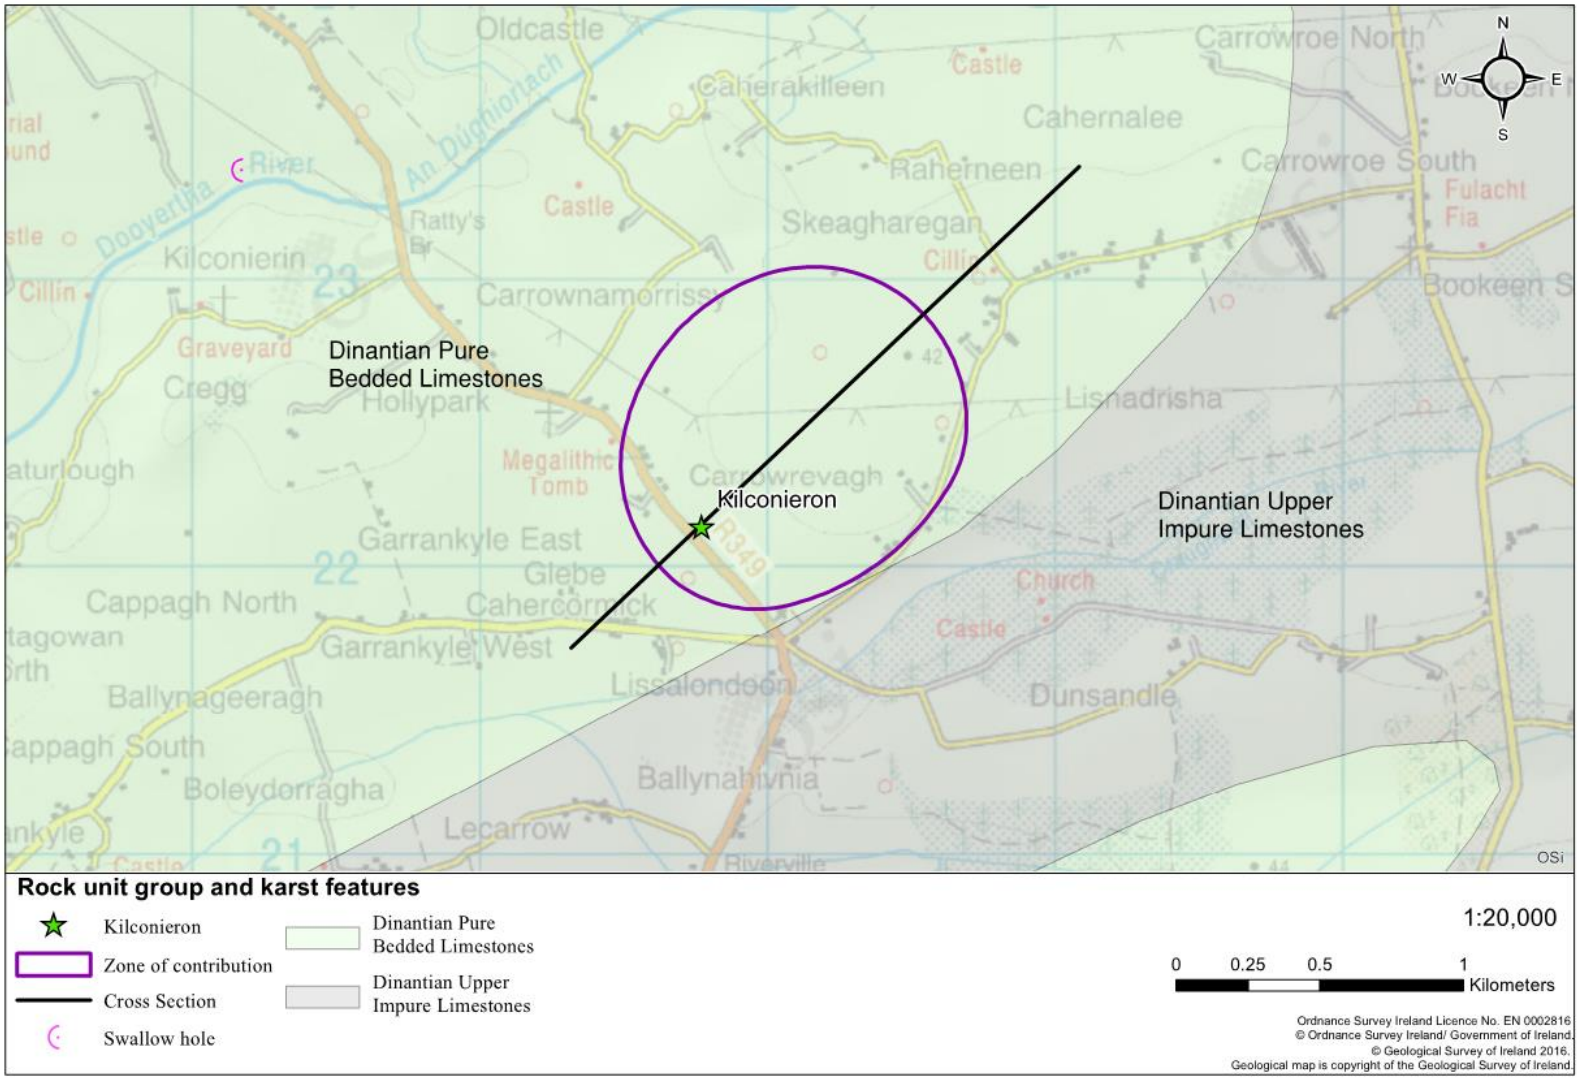


Figure 5 Rock Unit Group Map with karst features

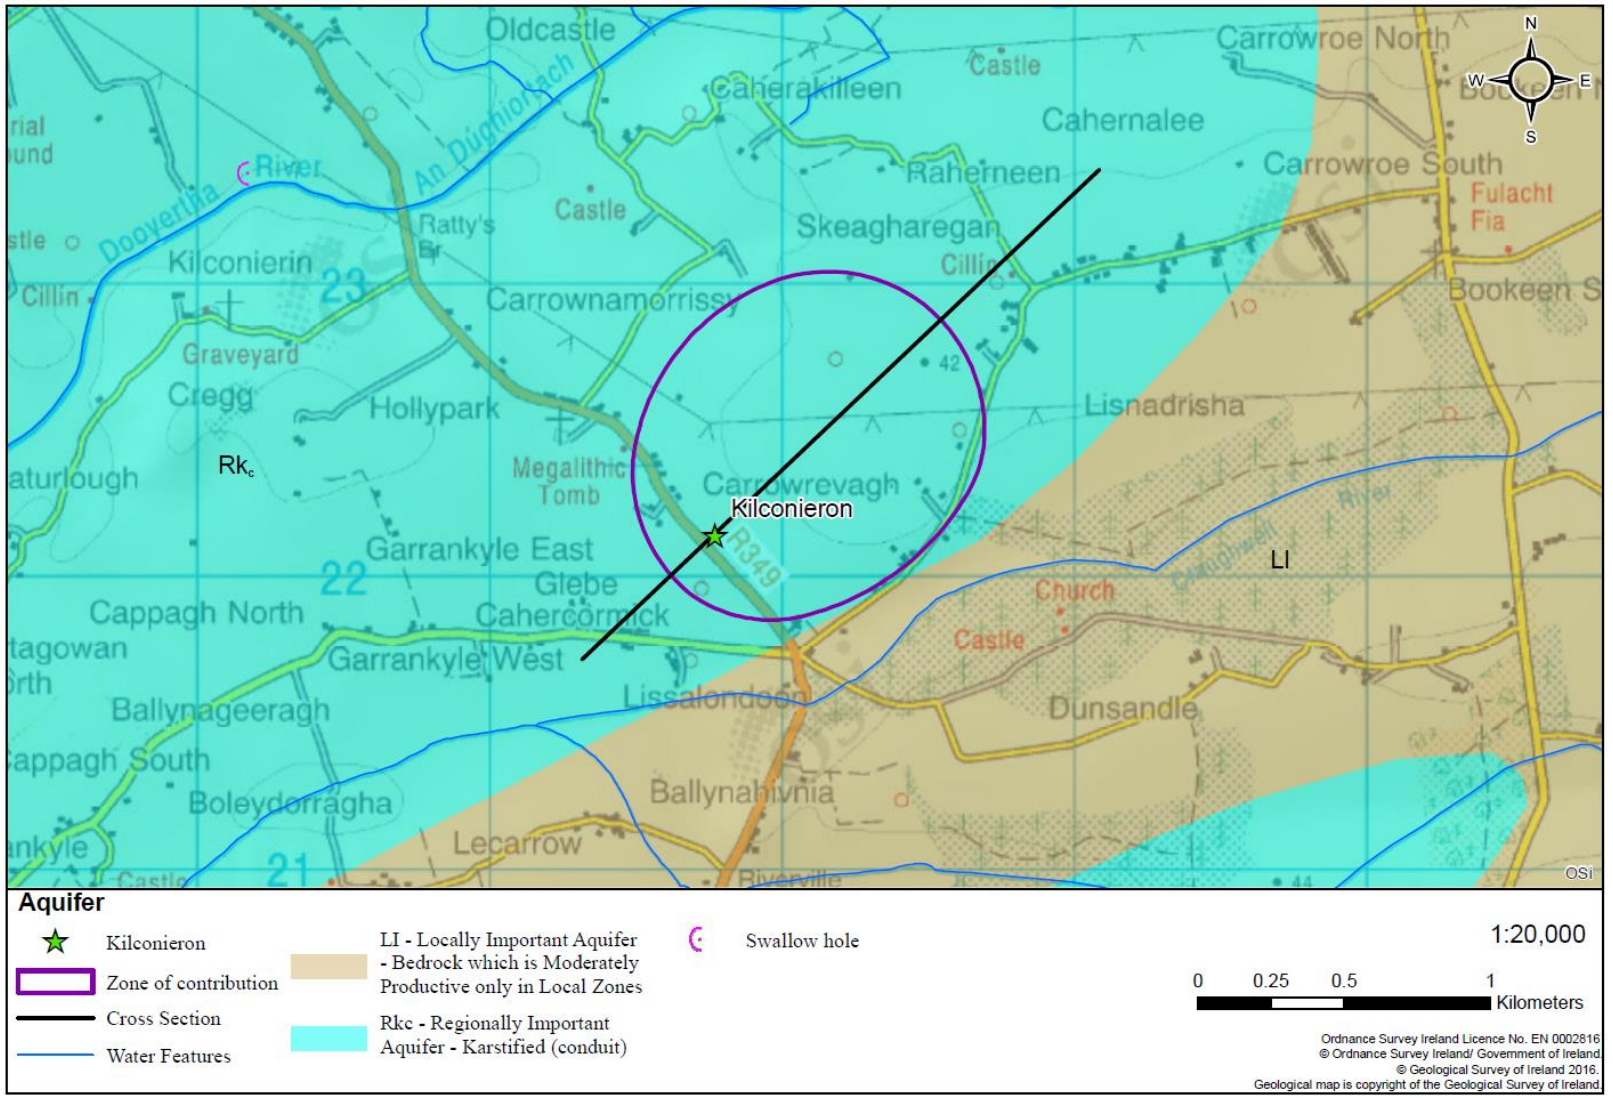


Figure 6 Aquifer Map

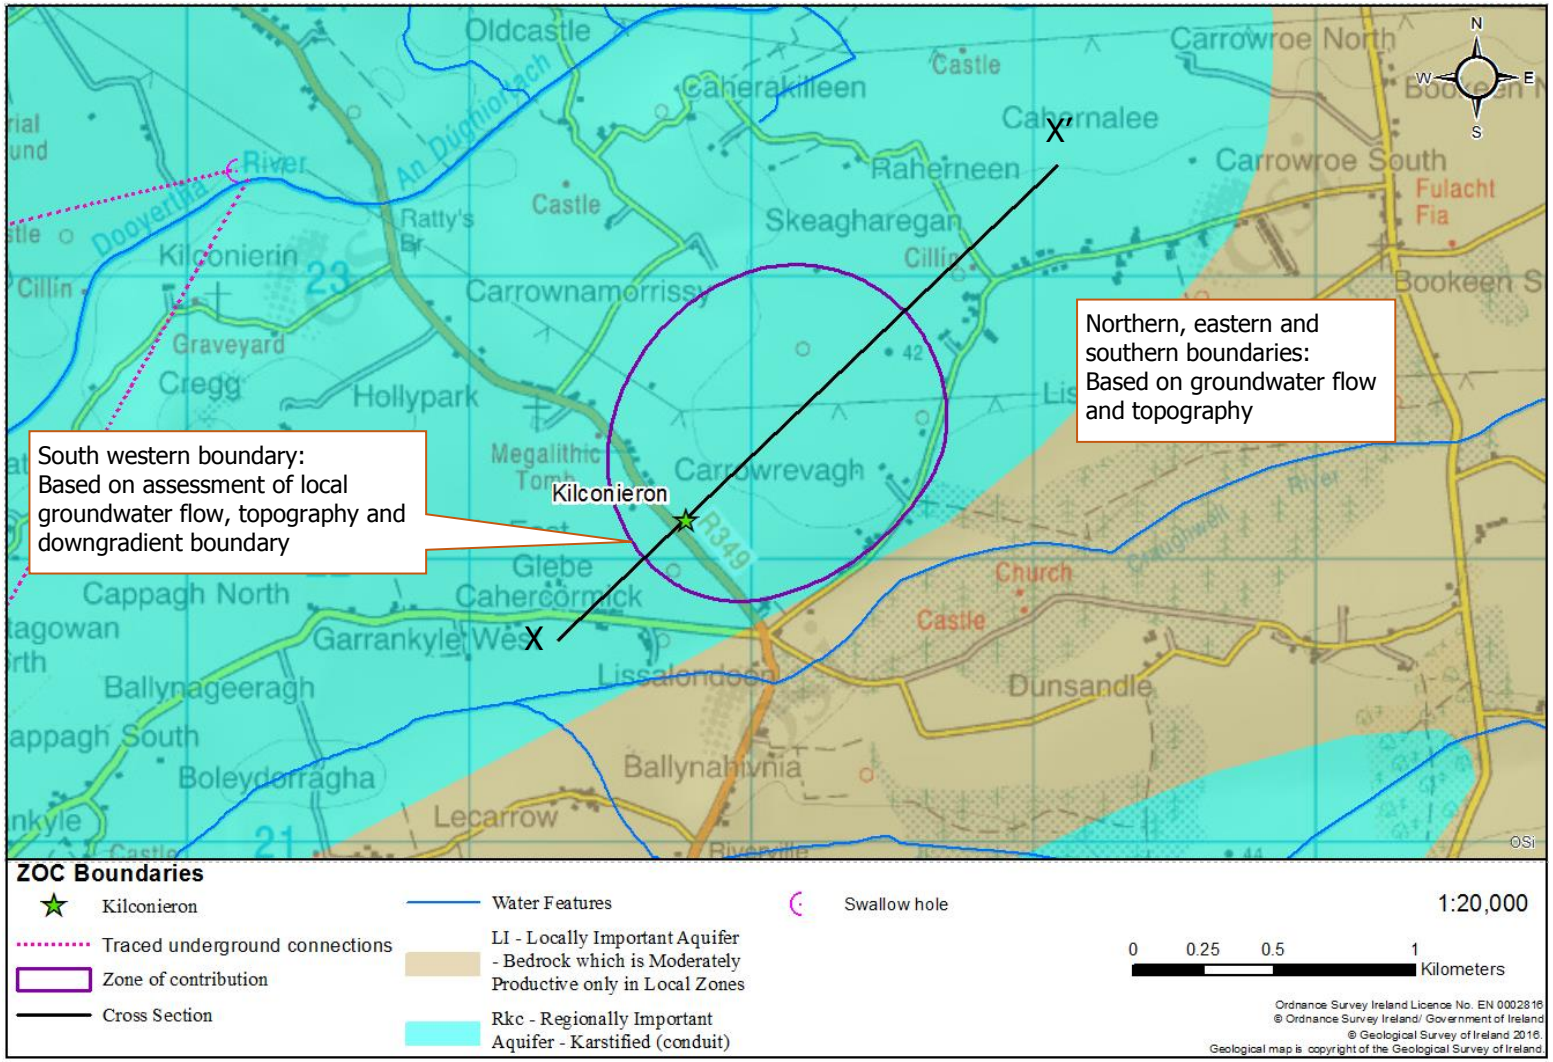


Figure 7 ZOC boundaries

Appendix 1

Groundwater Vulnerability

Introduction

The term 'vulnerability' is used to represent the intrinsic geological and hydrogeological characteristics that determine the ease with which groundwater may be contaminated by human activities (DELG *et al.,* 1999). The vulnerability of groundwater depends on:

- the time of travel of infiltrating water (and contaminants)
- the relative quantity of contaminants that can reach the groundwater
- the contaminant attenuation capacity of the geological materials through which the water and contaminants infiltrate.

All groundwater is hydrologically connected to the land surface; the effectiveness of this connection determines the relative vulnerability to contamination. Groundwater that readily and quickly receives water (and contaminants) from the land surface is more vulnerable than groundwater that receives water (and contaminants) more slowly and in lower quantities. The travel time, attenuation capacity and quantity of contaminants are a function of the following natural geological and hydrogeological attributes of any area:

- the type and permeability of the subsoils that overlie the groundwater
- the thickness of the unsaturated zone through which the contaminant moves
- the recharge type – whether point or diffuse.

In other words, vulnerability is based on evaluating the relevant hydrogeological characteristics of the protecting geological layers along the pathway, and the possibility of bypassing these layers. In summary, the entire land surface is divided into four vulnerability categories: **E**xtreme, **H**igh, **M**oderate and **L**ow, based on the geological and hydrogeological characteristics. Further details of the hydrogeological basis for vulnerability assessment can be found in 'Groundwater Protection Schemes' (DELG et al., 1999).

The Groundwater Vulnerability Map shows the vulnerability of the first groundwater encountered, in either sand/gravel or bedrock aquifers, by contaminants released at depths of 1-2 m below the ground surface. Where the water-table in bedrock aquifers is below the top of the bedrock, the target needing protection is the water-table. However, where the aquifer is fully saturated, the target is the top of the bedrock. The vulnerability map aims to be a guide to the likelihood of groundwater contamination, if a pollution event were to occur. It does not replace the need for site investigation. Note also that the characteristics of individual contaminants are not considered.

Except where point recharge occurs (*e.g*. at swallow holes), the groundwater vulnerability depends on the type, permeability and thickness of the subsoil.

The groundwater vulnerability map is derived by combining the permeability and depth to bedrock maps, using the three subsoil permeability categories: high, moderate and low; and four depths to rock categories: <3m, 3–5m, 5–10m and >10m. The resulting vulnerability classifications are shown below.

Vulnerability mapping guidelines (adapted from DELG et al, 1999)

Thickness of Overlying Subsoils	Hydrogeological Requirements for Vulnerability Categories				
	Diffuse Recharge			**Point Recharge**	**Unsaturated Zone**
	Subsoil permeability and type				
	High permeability (*sand/gravel*)	moderate permeability (*sandy subsoil*)	low permeability (*clayey subsoil, clay, peat*)	*(swallow holes, losing streams)*	(*sand & gravel aquifers only)*
0–3 m	**Extreme**	**Extreme**	**Extreme**	**Extreme (30 m radius)**	**Extreme**
3–5 m	**High**	**High**	**High**	**N/A**	**High**
5–10 m	**High**	**High**	**Moderate**	**N/A**	**High**
>10 m	**High**	**Moderate**	**Low**	**N/A**	**High**

Notes: (i) N/A = not applicable.
(ii) Release point of contaminants is assumed to be 1–2 m below ground surface.
(iii) Permeability classifications relate to the engineering behaviour as described by BS5930.
(iv) Outcrop and shallow subsoil (i.e. generally <1.0 m) areas are shown as a sub-category of extreme vulnerability
(amended from Deakin and Daly (1999) and DELG/EPA/GSIa (1999))

Sources of Vulnerability Data

Specific vulnerability field mapping and assessment of previously collected data were carried out as part of this project. Fieldwork focused on assessing the permeability of the different subsoil deposit types so that they could be subdivided into the three permeability categories. This involved:

- Describing selected exposures/sections according to the British Standard Institute *Code of Practice for Site Investigations* (BS 5930:1999).
- Collection of subsoil samples for laboratory particle size analyses
- Assessing the recharge characteristics of selected sites using natural and artificial drainage, vegetation and other recharge indicators.

The following additional sources of data were used to assess the vulnerability and produce the map:

- Subsoils Map (EPA/Teagasc Subsoil Map, 2006), which is the basis for the main permeability boundaries. 'Clean' sands and gravels are usually high permeability. Alluvium deposits are either moderate or low permeability.
- Depth to bedrock map, compiled by the mapping team for the current project in the Geological Survey of Ireland, using data compiled from GSI, consultant and county council reports, along with purpose-drilled auger holes
- Geological Survey of Ireland Bedrock Geology Map
- Geological Survey of Ireland well and karst database, which supplied information on well yields and depth to bedrock, as well as locations of point recharge.
- General Soils Map of Ireland (Gardiner and Radford, 1980). This gives additional, indirect information on subsoil permeability in the areas mapped by Teagasc as 'till'.

Thickness of the Unsaturated Zone

The thickness of the unsaturated zone, or the depth of ground free of intermittent or permanent saturation, is only relevant in vulnerability mapping over unconfined sand and gravel aquifers. As described in Table 6.1, the critical unsaturated zone thickness is 3m; unconfined gravels with unsaturated zones thicker than 3m are classed as having a 'high' vulnerability, while those with unsaturated zones thinner than 3m are classed as having an 'extreme' vulnerability.

Appendix 2

Groundwater Recharge

Introduction

The term 'recharge' refers to the amount of water replenishing the groundwater flow system. The recharge rate is generally estimated on an annual basis, and is assumed to consist of the rainfall input (i.e. annual rainfall) minus water loss prior to entry into the groundwater system (i.e. annual evapotranspiration and runoff). The estimation of a realistic recharge rate is critical in source protection delineation, as this dictates the size of the zone of contribution to the source (i.e. the outer Source Protection Area).

The main parameters involved in the estimation of recharge are: annual rainfall; annual evapotranspiration; and a recharge coefficient (Table 1). The recharge coefficient is estimated using Hunter Williams et al (2013), which is based on Guidance Document GW5 (Groundwater Working Group 2005).

Table 1. Recharge coefficients for different hydrogeological settings.

Groundwater vulnerability category	Hydrogeological setting		Recharge coefficient (RC)		
			Min (%)	*Inner Range*	*Max (%)*
Extreme	1.i	Areas where rock is at ground surface	30	80-90	100
(X or E)	1.ii	Sand/gravel overlain by 'well drained' soil	50	80-90	100
	1.iii	Sand/gravel overlain by 'poorly drained' (gley) soil	15	35-50	70
	1.iv	Till overlain by 'well drained' soil	45	50-70	80
	1.v	Till overlain by 'poorly drained' (gley) soil	5	15-30	50
	1.vi	Sand/ gravel aquifer where the water table is ≤ 3 m below surface	50	80-90	100
	1.vii	Peat	1	15-30	50
High	2.i	Sand/gravel aquifer, overlain by 'well drained' soil	50	80-90	100
(H)	2.ii	High permeability subsoil (sand/gravel) overlain by 'well drained' soil	50	80-90	100
	2.iii	High permeability subsoil (sand/gravel) overlain by 'poorly drained' soil	15	35-50	70
	2.iv	Sand/gravel aquifer, overlain by 'poorly drained' soil	15	35-50	70
	2.v	Moderate permeability subsoil overlain by 'well drained' soil	35	50-70	80
	2.vi	Moderate permeability subsoil overlain by 'poorly drained' (gley) soil	10	15-30	50
	2.vii	Low permeability subsoil	1	20-30	40
	2.viii	Peat	1	5-15	20
Moderate	3.i	Moderate permeability subsoil and overlain by 'well drained' soil	35	50-70	80
(M)	3.ii	Moderate permeability subsoil and overlain by 'poorly drained' (gley) soil	10	15-30	50
	3.iii	Low permeability subsoil	1	10-20	30
	3.iv	Peat	1	3-5	10
Low	4.i	Low permeability subsoil	1	5-10	20
(L)	4.ii	Basin peat	1	3-5	10

The recharge coefficients in this table are summarised in a paper by Hunter Williams *et al.* (2013) in the Quarterly Journal of Engineering Geology and Hydrogeology. Aquifer recharge acceptance capacity is generally limited in Ll aquifers (200 mm/yr) and Pl and Pul aquifers (100 mm/yr). Made ground has recharge coefficient of 20%.


Appendix 3

Water Quality Results

Railway House,
Station Road,
Loughrea,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

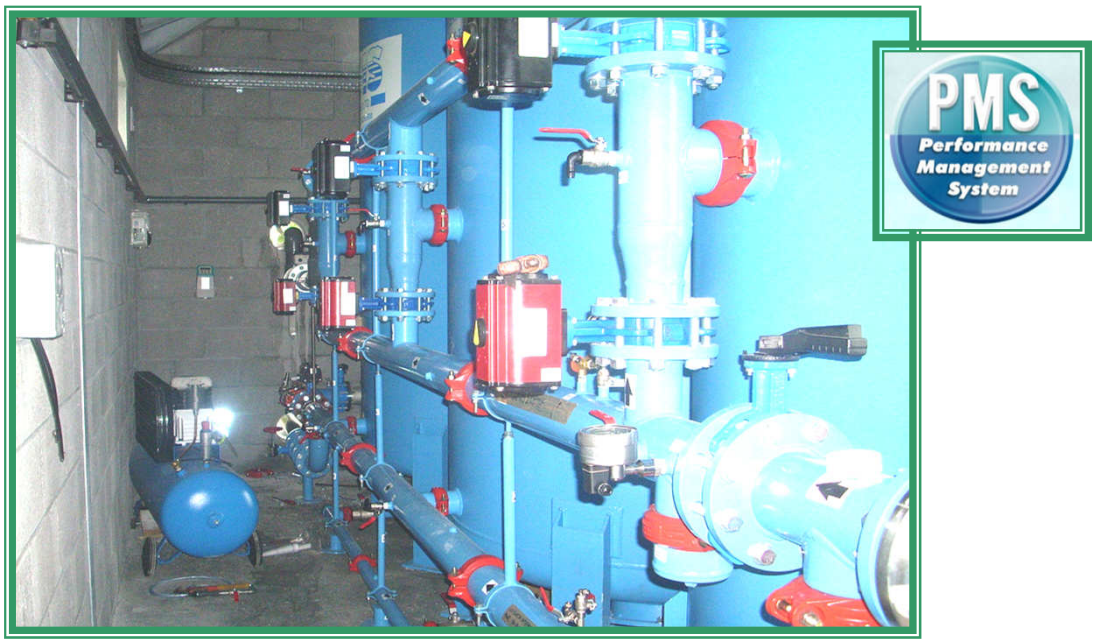

Glan Agua Ltd. is fully accredited to: ISO 9001 CERTIFICATION EUROPE, ISO 14001 CERTIFICATION EUROPE, OHSAS 18001 CERTIFICATION EUROPE

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**8-2017 71**
Operational Period:	**1 August 2017/31 August 2017**
Prepared by:	**Cathal Keighrey**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP NATIONAL DEVELOPMENT PLAN

wsntg


National Federation of Group Water Schemes

Printed:07/09/2017

Railway House,
Station Road,
Loughrea,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

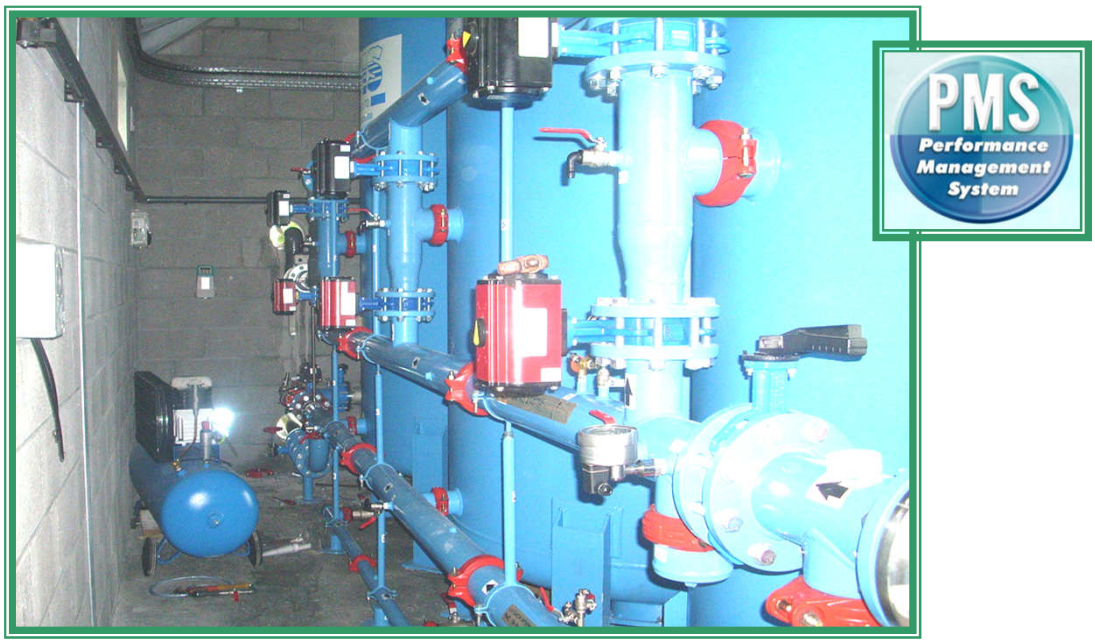

Glan Agua Ltd. is fully accredited to: ISO 9001 CERTIFICATION EUROPE, ISO 14001 CERTIFICATION EUROPE, OHSAS 18001 CERTIFICATION EUROPE

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**6-2017 69**
Operational Period:	**1 June 2017/30 June 2017**
Prepared by:	**Cathal Keighrey**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP NATIONAL DEVELOPMENT PLAN

wsntg

National Federation of Group Water Schemes

Printed:11/07/2017

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Sumary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analytical Results**	
Section 6:	**Process Operational Changes Record**	
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	- Not Appicable
Section 9:	**Complaint Record**	- Not Appicable
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	
Section 13:	**Equipment Service Record**	- Not Appicable
Section 14:	**Plant Maintenance Schedule Report**	- Not Appicable
Section 15:	**Non-Sludge Waste Disposal Record**	- Not Appicable
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	-
Section 18:	**Emergency Event Record**	- Not Appicable
Section 19:	**Random Analysis by Employer**	- Not Appicable

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	Jun-17	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 122 of 2014 and Employer's Requirements.
Report No.:	6-2017	
Number of Reports To Date Including This One	68	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.6-2017 is for June 2017.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the Operational Period

- Treatment water met the required standards at all times.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Sumary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	Changeable, unsettled and dull, but it was warm. Average rainfall totals were above their Long Term Average across Ireland. Temperatures averaged between 1.7℃ - 15.2℃.
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Quantity of Water Treated and distributed to public	cubic meters	**2,155m^3**
Treated Water Flowmeter	31/05/2017	**193331m3**
Treated Water Flowmeter	28/06/2017	**195486m3**
Analytical Results	results in or out of specs	All on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	None recorded
Alarm Callouts	what they were	1 No. Callouts. See Section 10 for further details.
Heath & Safety Issues	what since last report or	None recorded
Equipment	taken off line and why or placed into service	None recorded
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present in water.
Electricity Disruption		None recorded

Notes:

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for June 2017.

Date	**Colour** (Pt Co)	**Turbidity** (NTU)	
	Treated	**Raw**	**Treated**
01/06/2017	5.46	0.20	0.11
02/06/2017	5.47	0.18	0.13
03/06/2017	5.54	0.20	0.13
04/06/2017	5.20	0.25	0.17
05/06/2017	5.57	0.21	0.15
06/06/2017	5.46	0.17	0.12
07/06/2017	5.62	0.17	0.10
08/06/2017	5.61	0.16	0.10
09/06/2017	5.62	0.18	0.11
10/06/2017	5.65	0.21	0.13
11/06/2017	5.94	0.39	0.22
12/06/2017	5.88	0.12	0.11
13/06/2017	5.92	0.10	0.08
14/06/2017	5.96	0.09	0.08
15/06/2017	5.97	0.09	0.08
16/06/2017	5.89	0.09	0.08
17/06/2017	5.89	0.09	0.07
18/06/2017	5.82	0.08	0.07
19/06/2017	5.84	0.51	0.07
20/06/2017	5.85	0.11	0.05
21/06/2017	5.84	0.20	0.10
22/06/2017	5.81	0.20	0.09
23/06/2017	5.76	0.16	0.08
24/06/2017	5.74	0.14	0.06
25/06/2017	5.72	0.11	0.05
26/06/2017	3.00	0.11	0.09
27/06/2017	5.75	0.12	0.05
28/06/2017	9.57	0.75	0.59
29/06/2017	1.66	0.33	0.28
30/06/2017	3.01	0.19	0.15
Turbidity Limit (NTU):			1
Colour Limit (mg/l Pt Co) :			20

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS


Section 3: ***Operator: Stephen Costello***

Tabular Data Presentation


Daily averages of Free Chlorine in Final Water for June 2017.

Date	Chlorine (mg/l Cl_2)			
Day | Time	**06:00:00**	**12:00:00**	**18:00:00**	**23:59:59**
01/06/2017	0.47	0.49	0.45	0.43
02/06/2017	0.44	0.44	0.41	0.39
03/06/2017	0.41	0.46	0.43	0.40
04/06/2017	0.40	0.42	0.38	0.36
05/06/2017	0.37	0.39	0.36	0.33
06/06/2017	0.36	0.40	0.36	0.34
07/06/2017	0.35	0.38	0.35	0.33
08/06/2017	0.34	0.37	0.34	0.32
09/06/2017	0.34	0.37	0.34	0.33
10/06/2017	0.34	0.36	0.33	0.31
11/06/2017	0.32	0.36	0.32	0.29
12/06/2017	0.31	0.33	0.30	0.27
13/06/2017	0.28	0.31	0.27	0.24
14/06/2017	0.25	0.30	0.26	0.28
15/06/2017	0.27	0.26	0.25	0.48
16/06/2017	0.40	0.29	0.25	0.30
17/06/2017	0.34	0.28	0.24	0.28
18/06/2017	0.30	0.31	0.28	0.25
19/06/2017	0.31	0.41	0.36	0.32
20/06/2017	0.34	0.44	0.39	0.35
21/06/2017	0.36	0.45	0.40	0.36
22/06/2017	0.37	0.43	0.39	0.35
23/06/2017	0.36	0.42	0.37	0.34
24/06/2017	0.36	0.40	0.36	0.33
25/06/2017	0.35	0.39	0.35	0.33
26/06/2017	0.34	0.37	0.34	0.31
27/06/2017	0.34	0.40	0.36	0.33
28/06/2017	0.32	0.28	0.35	0.29
29/06/2017	0.26	0.31	0.32	0.35
30/06/2017	0.28	0.33	0.38	0.38
Lower Limit:		**0.2** mg/l Cl		
Upper Limit:		**0.7** mg/l Cl		

Graph of Daily Treated Water

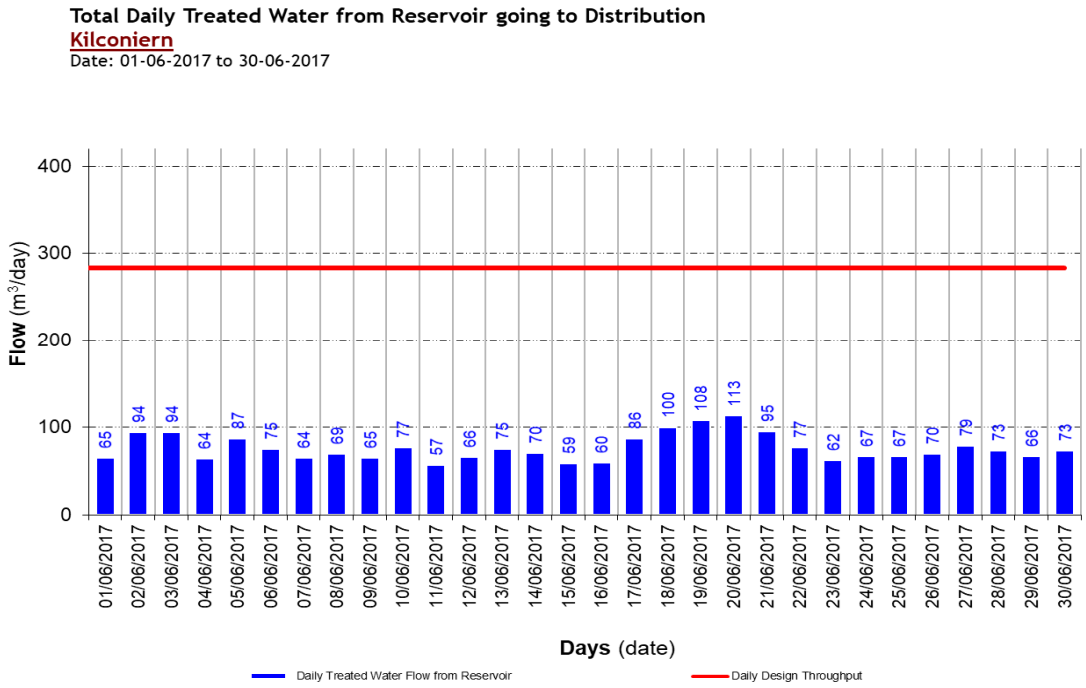

Graph of Reservoir Levels

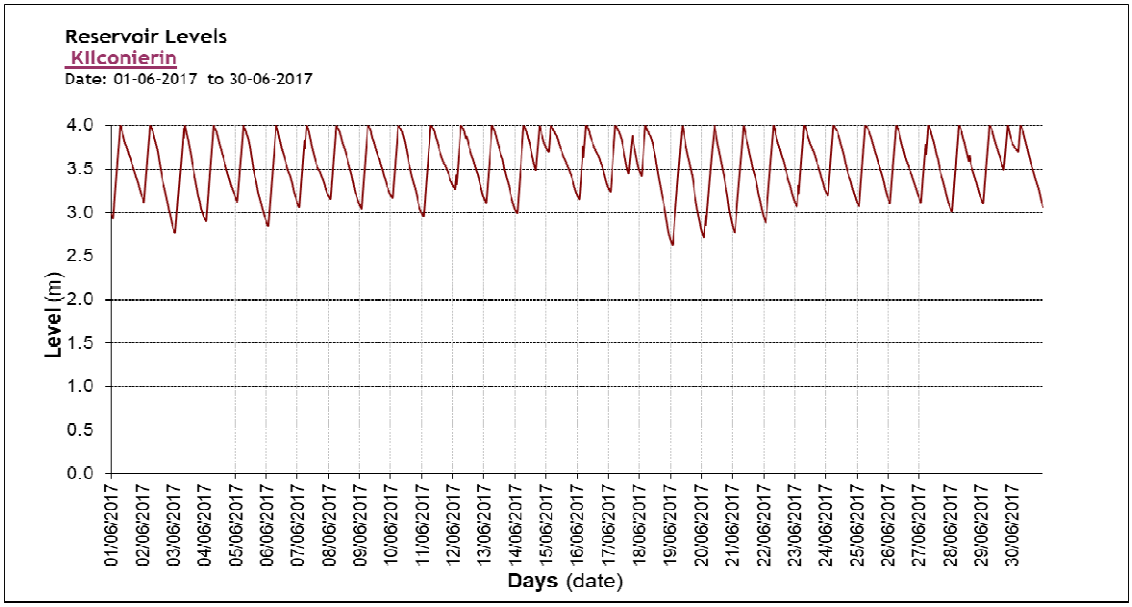

Monthly Status Report


Contract: Galway GWS DBO

Plant: Kilconierin GWS

Section 4: Graphical Presentation of Data

Operator: Stephen Costello

Graph of Daily Flows of Raw and Treated Water

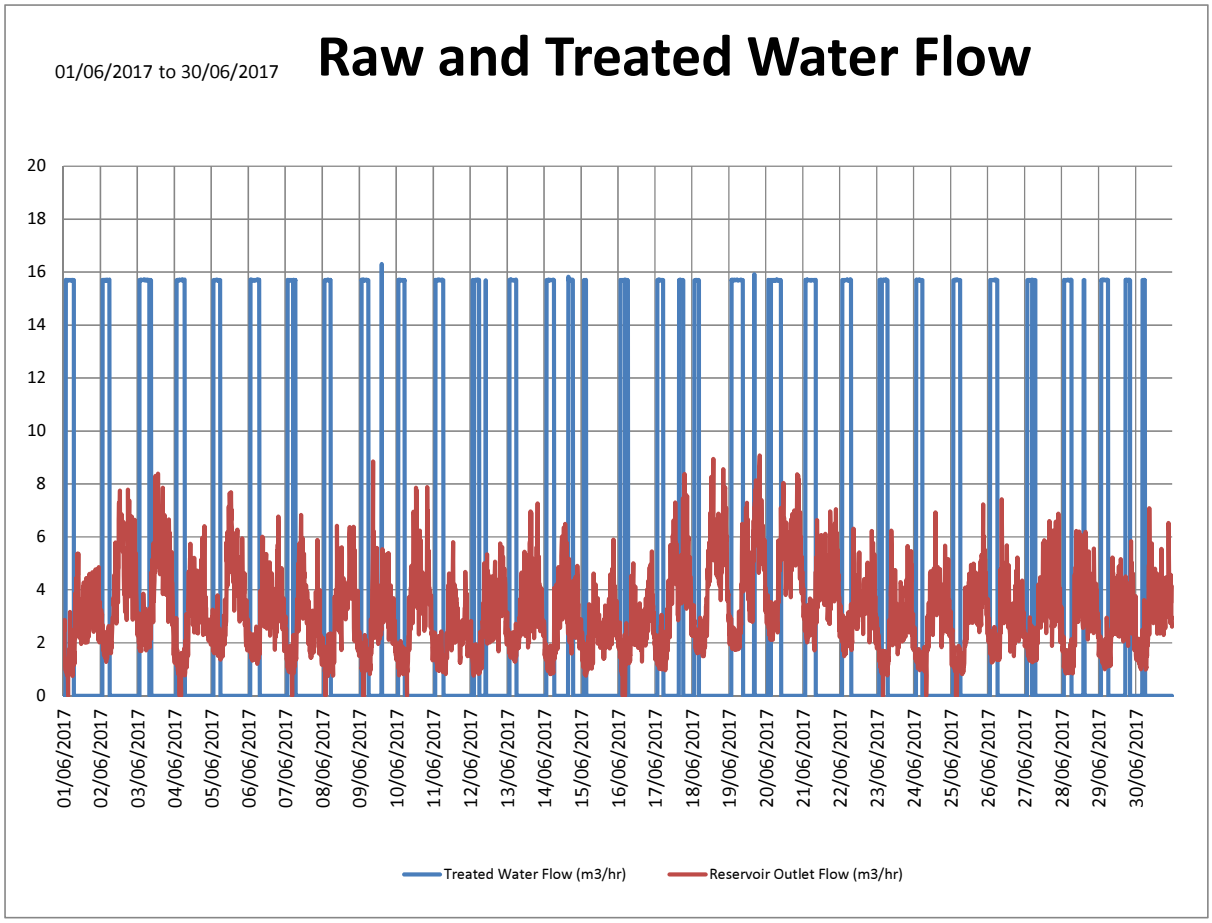

Monthly Status Report


Contract: Galway GWS DBO

Plant: Kilconierin GWS


Section 4: Graphical Presentation of Data

Operator: Stephen Costello


Average Daily Graph of Colour in Treated Water

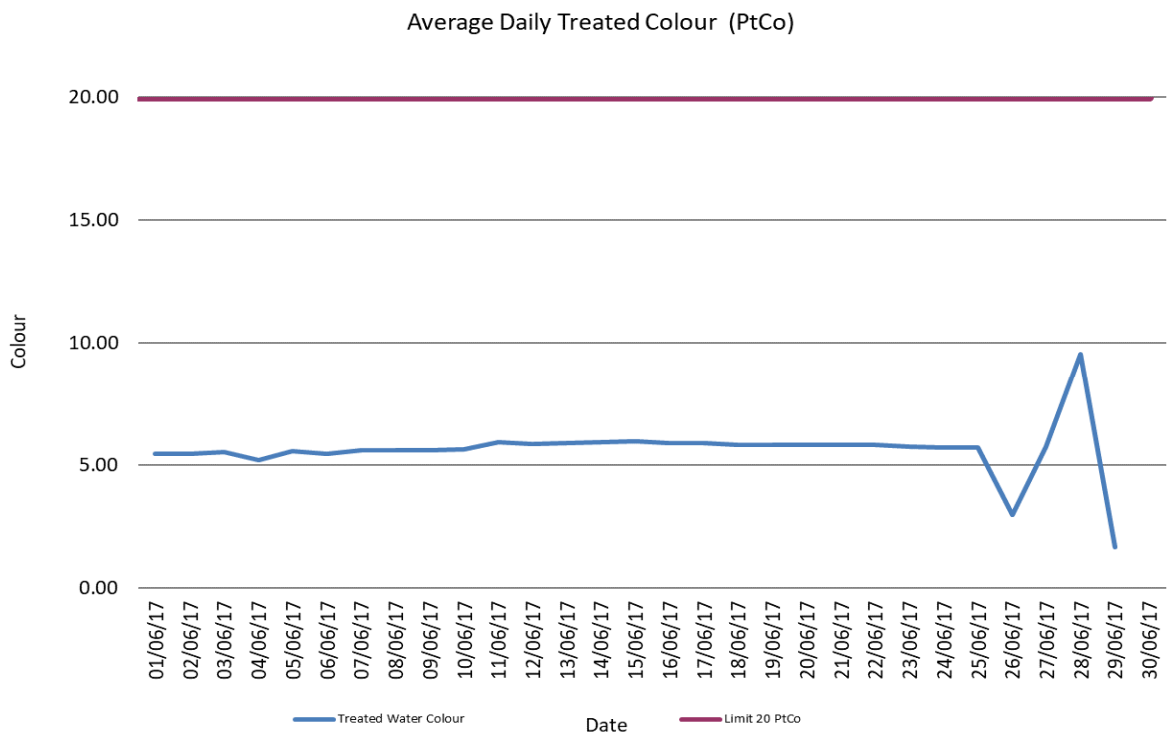


Average Daily Graph of Turbidity in Raw and Treated Water

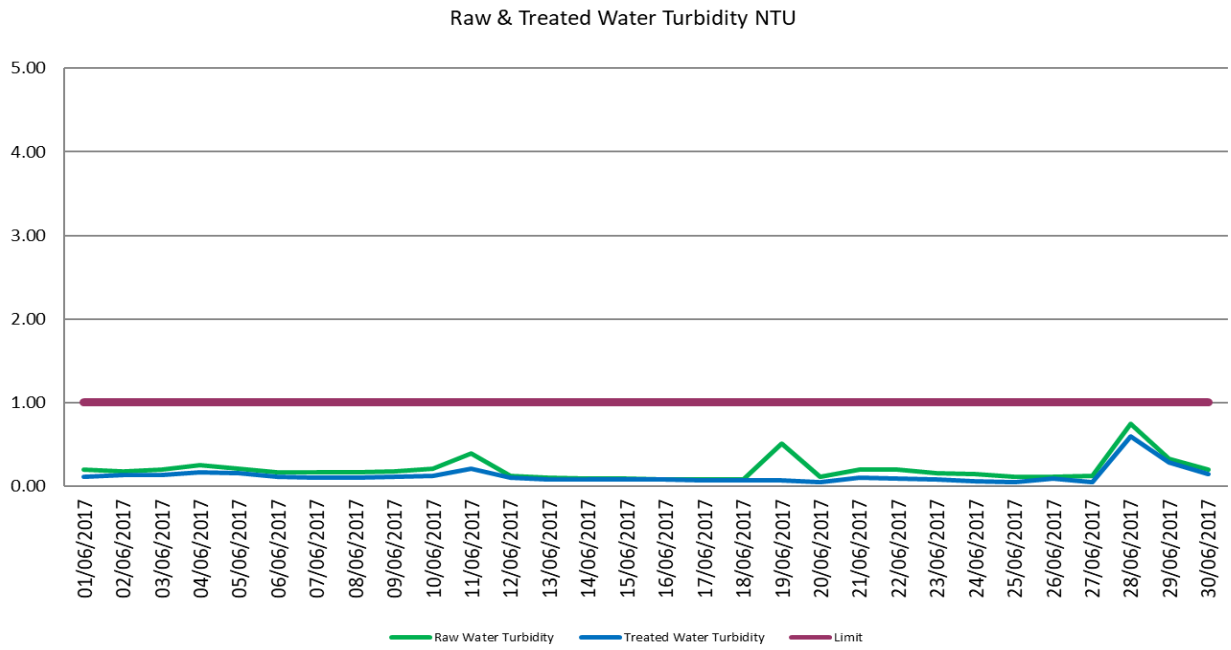

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution

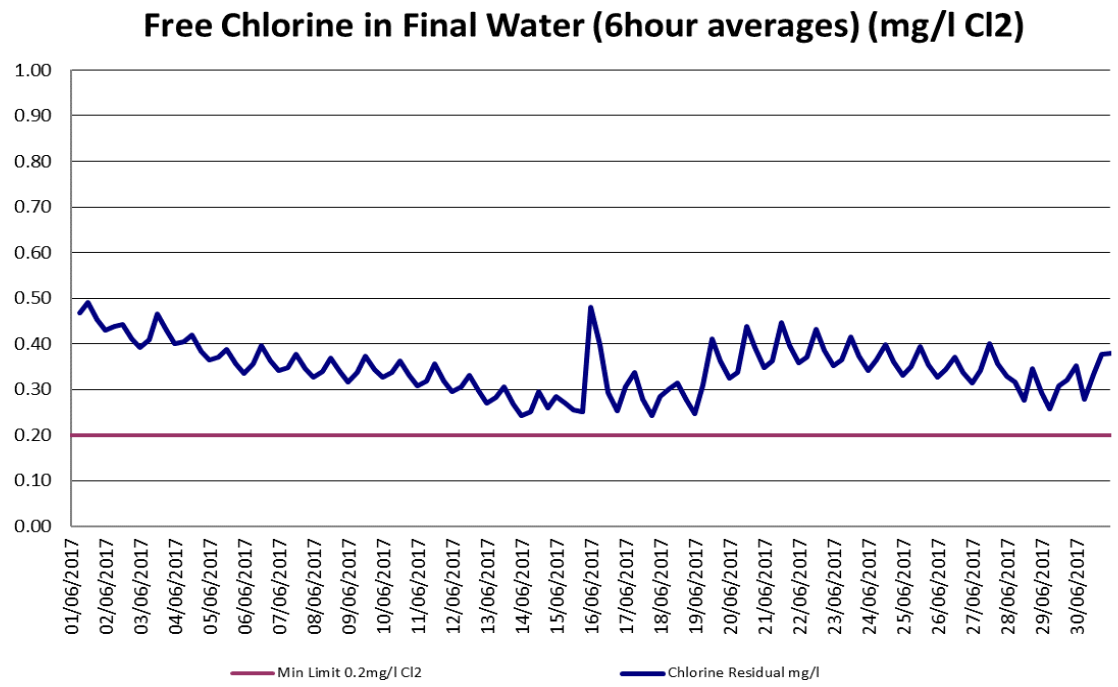

UV in Treated Water going to Distribution

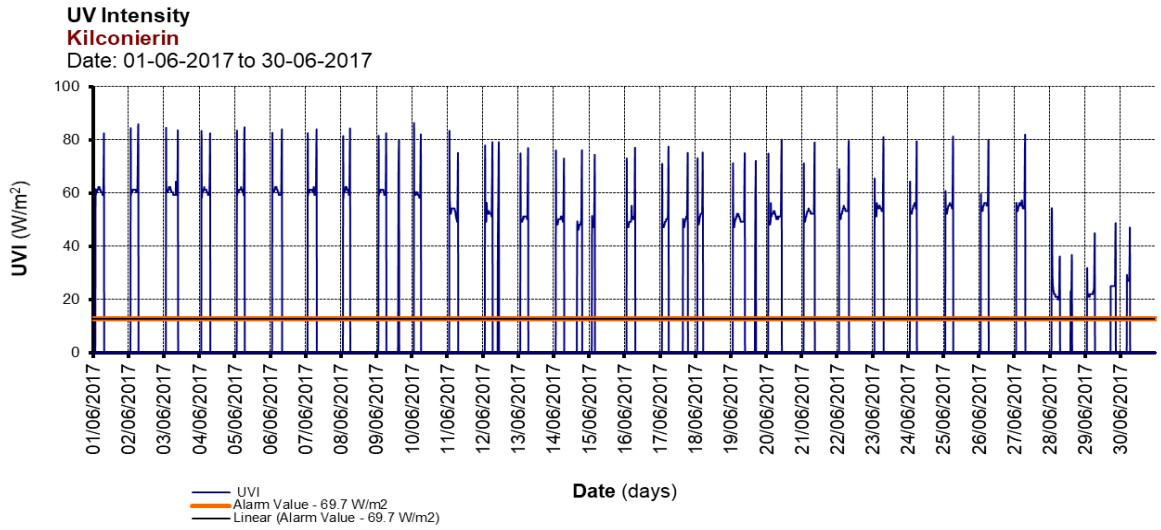

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analytical Results

Category	Report On	Comments
	Quality comparison to contract requirements	Fully compliant with S.I. 122 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 122
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting period	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary — 12/06/2017

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.25
TOC	mg/l	1.35
pH		7.02
Apparent Colour	mg/l PtCo	<5.00
Fe	ug/l	<10.0
Al	ug/l	5.6
Mn	ug/l	<1.0
Treated Water		
Aluminium	ug/l	11.4
TOC	mg/l	1.5
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	7.02
Fe	ug/l	<10.0
Mn	ug/l	<1.0
Coliform	MPN/100ml	<1
Clostridium Pefringens	cfu/100ml	<1
Turbidity	NTU	<0.25

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Health & Safety Issues ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

	John Fox	**Date:**	04/07/2017
For Period:	01/06/2017-30/06/2017		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**2**	*Exposure Hrs*	**08:05**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Sub Contractor

Sub Contractor	**0**	*Exposure Hrs*	**00:00**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Visitor

Number of Vistors	**0**	*Exposure Hrs*	**00:00**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 10: ***Operator: Stephen Costello***

Site Alarm /Incident Record

Date	Time	Type of Alarm/ Incident	Person Dealing with Alarm/Incident	Cause of Alarm/Incident
21/06/2017	12:55	Compressor Tripped	Shane O' Donnell	Possible Phase Loss

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
01/06/2017	Steve Costello	Glan Agua	09:05	09:20	Download Data
09/06/2017	Steve Costello	Glan Agua	13:05	13:45	Checks, Cal
12/06/2017	Steve Costello	Glan Agua	08:30	09:10	Sampling, Cal, Checks
14/06/2017	Steve Costello	Glan Agua	12:50	15:30	Maint, Adjust Chlorine
17/06/2017	Steve Costello	Glan Agua	14:30	15:00	Adjust Chlorine
19/06/2017	Steve Costello	Glan Agua	15:20	15:30	Calibrations
21/06/2017	Shane O' Donnell	Glan Agua	12:35	12:45	Alarm
22/06/2017	Steve Costello	Glan Agua	15:00	16:30	Checks, Cal, Maint
28/06/2017	Steve Costello	Glan Agua	12:25	13:30	Checks, Cal, Adjust
29/06/2017	Steve Costello	Glan Agua	16:05	16:30	Adjust Chlorine

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 12: ***Operator: Stephen Costello***

Equipment Calibration Record

Date	Equipment Description	Serial No.	Calibrated by (name &company)	Next Calib. Due	Calib. Cert Rec'd.	Comments
09/06/2017	Raw Ph		Steve Costello	Jul-17		Cleaned and Cal
09/06/2017	Plant Ph		Steve Costello	Jul-17		Passed Verification
09/06/2017	Res Ph		Steve Costello	Jul-17		Passed Verification
09/06/2017	Plant Chlorine		Steve Costello	Jul-17		Passed Verification
09/06/2017	Res Chlorine		Steve Costello	Jul-17		Passed Verification
12/06/2017	Res Chlorine		Steve Costello	Jul-17		Passed Verification
19/06/2017	Raw Turbidity		Steve Costello	Jul-17		Passed Verification
19/06/2017	Treated Turbidity		Steve Costello	Jul-17		Passed Verification
22/06/2017	Res Chlorine		Steve Costello	Jul-17		Passed Verification
28/06/2017	Colour		Steve Costello	Jul-17		Cleaned and Cal
28/06/2017	Res Chlorine		Steve Costello	Jul-17		Passed Verification

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	12/06/2017	***Sample No:***	361427
	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	<1	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 17: ***Operator: Stephen Costello***

Facility Maintenance Record

A = Excellent B = Acceptable C = Unacceptable

	A	B	C
1. LAWN MAINTENANCE			
a. Grass cut & collected		X	
b. Edging tidy		X	
2. SHRUB MAINTENACE			
a. Bushes prund		X	
b. Trees erect & staked where required		X	
c. Hedges cut		X	
3. HARD SURFACES			
a. All surfaces swept		X	
b. All surfaces free of algae, moss etc.		X	
c. Road surface clean & adequate		X	
d. All roofs free from algea, moss etc.		X	
4. EXTERIOR PAINTING			
a. All buildings painted/clean		X	
b. All gates & doors painted		X	
5. HOUSEKEEPING			
a. Litter removed from site		X	
b. Surface area around bins & skip clean		X	
c. Site free from spillages		X	
6. BUILDINGS			
a. Roof in waterproof conditions		X	
b. Glazing in good order		X	
7. INTERIOIR CONDITIONS			
a. All rooms clean		X	
8. WELFARE & SANITATION			
a. Toilet/washing facilities clean N/A			
b. Canteen clean N/A			

Checked by: **Steve Costello** Date: **14/06/2017**

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	12/06/2017	361426
City Analysts	Kilconierin Treated Water	12/06/2017	361427

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Certificate Of Analysis

Job Number: 17-30178
Issue Number: 1
Report Date: 19 June 2017

Site: Kilconierin
PO Number: GA-11-27-1352
Date Samples Received: 12/06/2017

Please find attached the results for the samples received at our laboratory on 12/06/2017.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our website at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Shane Wilmoth

Authorised Date: 19 June 2017

Shane Wilmoth
Chemistry Technical Manager

Notes:

Results relate only to the items tested.
Information on methods of analysis and performance characteristics is available on request.
Any opinions or interpretations indicated are outside the scope of our INAB accreditation.
This test report shall not be reproduced except in full or with written approval of City Analysts Limited.

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-30178

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Raw

Sample Type: Surface

Lab Reference Number: 361426

Date of Sampling: 12/06/2017

Date Sample Received: 12/06/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
D/D3001#	15/06/2017	Aluminium, Total	5.6	ug/l	-
S/S3010#	13/06/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	16/06/2017	Iron	< 10.0	ug/l	-
S/S3244#	16/06/2017	Manganese	< 1.0	ug/l	-
S/S1041#	12/06/2017	PH	7.02	pH Unit	-
S/S3224#	16/06/2017	Total Organic Carbon	1.350	mg/l	-
S/S3054#	13/06/2017	Turbidity	< 0.25	NTU	-

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-30178

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Treated

Sample Type: Treated

Lab Reference Number: 361427

Date of Sampling: 12/06/2017

Date Sample Received: 12/06/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
D/D3001#	15/06/2017	Aluminium, Total	11.4	ug/l	<= 200.0
S/S3010#	13/06/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	16/06/2017	Iron	< 10.0	ug/l	<= 200.0
S/S3244#	16/06/2017	Manganese	< 1.0	ug/l	<= 50.0
S/S1041#	12/06/2017	PH	7.02	pH Unit	6.50 - 9.50
S/S3224#	16/06/2017	Total Organic Carbon	1.500	mg/l	NAC & ATC
S/S3054#	13/06/2017	Turbidity	< 0.25	NTU	NAC & ATC
S/S1214#	12/06/2017	Clostridium perfringens	< 1	cfu/100ml	<= 0
S/S1201#	12/06/2017	Coliforms	< 1.0	MPN/100ml	<= 0.0
S/S1201#	12/06/2017	E.coli	< 1.0	MPN/100ml	<= 0.0

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited
Environmental Laboratories

Report Reference: 17-30178

Report Version: 1

Raw Data


Raw data has been provided with this Certificate of Analysis as it has been specifically requested by you. Please note that raw data results are Not Accredited. Raw data can be provided only for analysis carried out in-house.

Lab Reference Number:	Parameter	Result	Units	Site / Method Ref.
361426	Aluminium, Total	5.63535	ug/l	D/D3001
361426	Colour Apparent	1	Hazen	S/S3010
361426	Iron	3.3175	ug/l	S/S3244
361426	Manganese	0	ug/l	S/S3244
361426	PH	7.02	pH Unit	S/S1041
361426	Total Organic Carbon	1.35	mg/l	S/S3224
361426	Turbidity	0.05	NTU	S/S3054
361427	Aluminium, Total	11.4152	ug/l	D/D3001
361427	Colour Apparent	0	Hazen	S/S3010
361427	Iron	4.7844	ug/l	S/S3244
361427	Manganese	0	ug/l	S/S3244
361427	PH	7.02	pH Unit	S/S1041
361427	Total Organic Carbon	1.50	mg/l	S/S3224
361427	Turbidity	0.03	NTU	S/S3054
361427	Clostridium perfringens	0	cfu/100ml	S/S1214
361427	Coliforms	0	MPN/100ml	S/S1201
361427	E.coli	0	MPN/100ml	S/S1201

Railway House,
Station Road,
Loughrea,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

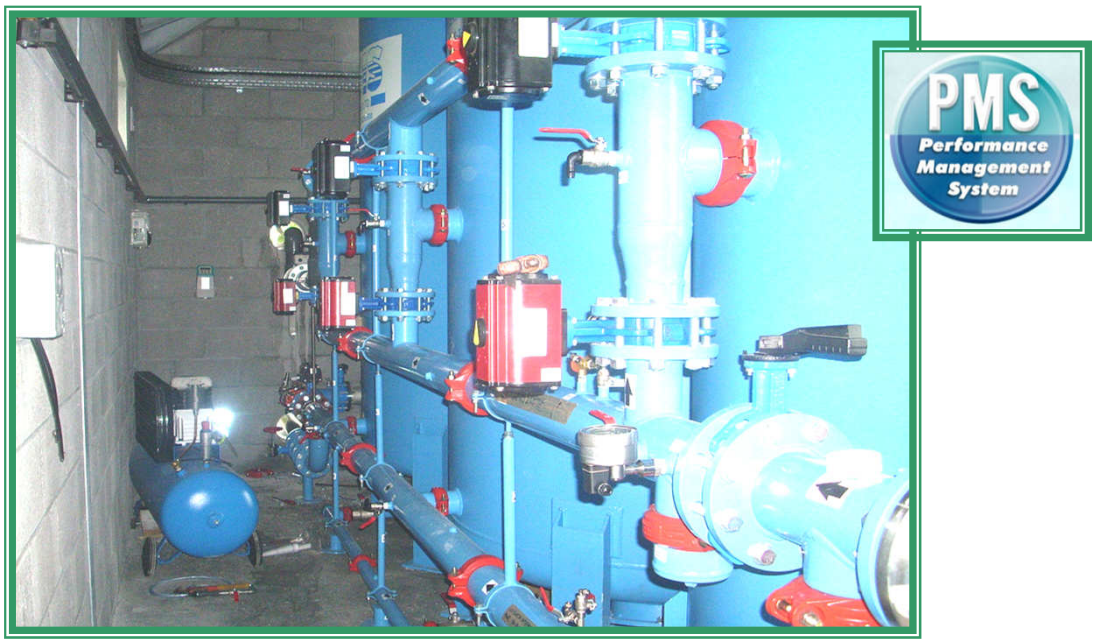

Glan Agua Ltd. is fully accredited to: ISO 9001 CERTIFICATION EUROPE, ISO 14001 CERTIFICATION EUROPE, OHSAS 18001 CERTIFICATION EUROPE

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**7-2017 70**
Operational Period:	**1 July 2017/31 July 2017**
Prepared by:	**Cathal Keighrey**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP NATIONAL DEVELOPMENT PLAN

wsntg

National Federation of Group Water Schemes

Printed:11/08/2017

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Summary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analytical Results**	
Section 6:	**Process Operational Changes Record**	
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	- Not Appicable
Section 9:	**Complaint Record**	- Not Appicable
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	
Section 13:	**Equipment Service Record**	- Not Appicable
Section 14:	**Plant Maintenance Schedule Report**	- Not Appicable
Section 15:	**Non-Sludge Waste Disposal Record**	- Not Appicable
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	-
Section 18:	**Emergency Event Record**	- Not Appicable
Section 19:	**Random Analysis by Employer**	- Not Appicable

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	Jul-17	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 122 of 2014 and Employer's Requirements.
Report No.:	7-2017	
Number of Reports To Date Including This One	70	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.7-2017 is for July 2017.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the Operational Period

- Treatment water met the required standards at all times.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Summary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	Changeable month with wet and windy conditions with days of good sunshine. Rainfall was below the Montly Long Term Average. Temperatures ranged between 10 - 26℃.
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Quantity of Water Treated and distributed to public	cubic meters	**1,931m^3**
Treated Water Flowmeter	28/06/2017	**195486m3**
Treated Water Flowmeter	24/07/2017	**197417m3**
Analytical Results	Results in or out of spec.	All on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	Recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	None recorded
Alarm Callouts	what they were	2 No. Callouts. See Section 10 for further details.
Heath & Safety Issues	what since last report or	None recorded
Equipment	taken off line and why or placed into service	None recorded
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present in water.
Electricity Disruption		None recorded

Notes:

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for July 2017.

Date	**Colour** (Pt Co)	**Turbidity** (NTU)	
	Treated	**Raw**	**Treated**
01/07/2017	2.37	0.14	0.12
02/07/2017	2.26	0.13	0.09
03/07/2017	1.95	0.11	0.07
04/07/2017	5.20	0.80	0.06
05/07/2017	1.74	0.10	0.05
06/07/2017	1.65	0.09	0.06
07/07/2017	1.61	0.09	0.04
08/07/2017	1.57	0.08	0.04
09/07/2017	1.52	0.07	0.04
10/07/2017	1.48	0.08	0.04
11/07/2017	1.45	0.07	0.04
12/07/2017	1.40	0.07	0.03
13/07/2017	1.40	0.07	0.03
14/07/2017	1.36	0.07	0.04
15/07/2017	1.35	0.07	0.03
16/07/2017	1.37	0.07	0.03
17/07/2017	1.40	0.07	0.03
18/07/2017	1.55	0.07	0.04
19/07/2017	1.59	0.07	0.05
20/07/2017	1.61	0.08	0.04
21/07/2017	1.56	0.07	0.05
22/07/2017	5.08	0.75	0.61
23/07/2017	3.32	0.18	0.15
24/07/2017	2.83	0.12	0.11
25/07/2017	2.69	0.10	0.09
26/07/2017	3.00	0.11	0.09
27/07/2017	2.65	0.09	0.08
28/07/2017	2.92	0.09	0.07
29/07/2017	3.20	0.09	0.07
30/07/2017	2.81	0.08	0.06
31/07/2017	4.64	0.09	0.07
Turbidity Limit (NTU):			1
Colour Limit (mg/l Pt Co) :			20

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS


Section 3: ***Operator: Stephen Costello***

Tabular Data Presentation


Daily averages of Free Chlorine in Final Water for July 2017.

Date	Chlorine ($mg/l\ Cl_2$)			
Day | Time	**06:00:00**	**12:00:00**	**18:00:00**	**23:59:59**
01/07/2017	0.31	0.26	0.27	0.26
02/07/2017	0.29	0.25	0.37	0.33
03/07/2017	0.26	0.32	0.27	0.26
04/07/2017	0.30	0.37	0.33	0.29
05/07/2017	0.31	0.37	0.32	0.28
06/07/2017	0.33	0.49	0.43	0.39
07/07/2017	0.43	0.53	0.48	0.44
08/07/2017	0.46	0.49	0.48	0.45
09/07/2017	0.44	0.49	0.47	0.44
10/07/2017	0.44	0.44	0.44	0.42
11/07/2017	0.43	0.43	0.39	0.37
12/07/2017	0.40	0.45	0.41	0.38
13/07/2017	0.41	0.50	0.45	0.42
14/07/2017	0.44	0.52	0.47	0.43
15/07/2017	0.46	0.52	0.47	0.43
16/07/2017	0.45	0.50	0.45	0.42
17/07/2017	0.44	0.50	0.45	0.42
18/07/2017	0.46	0.61	0.56	0.52
19/07/2017	0.50	0.53	0.59	0.54
20/07/2017	0.53	0.50	0.47	0.44
21/07/2017	0.46	0.50	0.46	0.44
22/07/2017	0.41	0.29	0.28	0.34
23/07/2017	0.32	0.28	0.29	0.35
24/07/2017	0.23	0.28	0.33	0.33
25/07/2017	0.28	0.45	0.28	0.26
26/07/2017	0.28	0.30	0.28	0.26
27/07/2017	0.31	0.34	0.33	0.28
28/07/2017	0.31	0.35	0.34	0.29
29/07/2017	0.31	0.37	0.34	0.29
30/07/2017	0.33	0.41	0.36	0.31
31/07/2017	0.34	0.40	0.36	0.32
Lower Limit:		**0.2**	mg/l Cl	
Upper Limit:		**0.7**	mg/l Cl	


Graph of Daily Treated Water

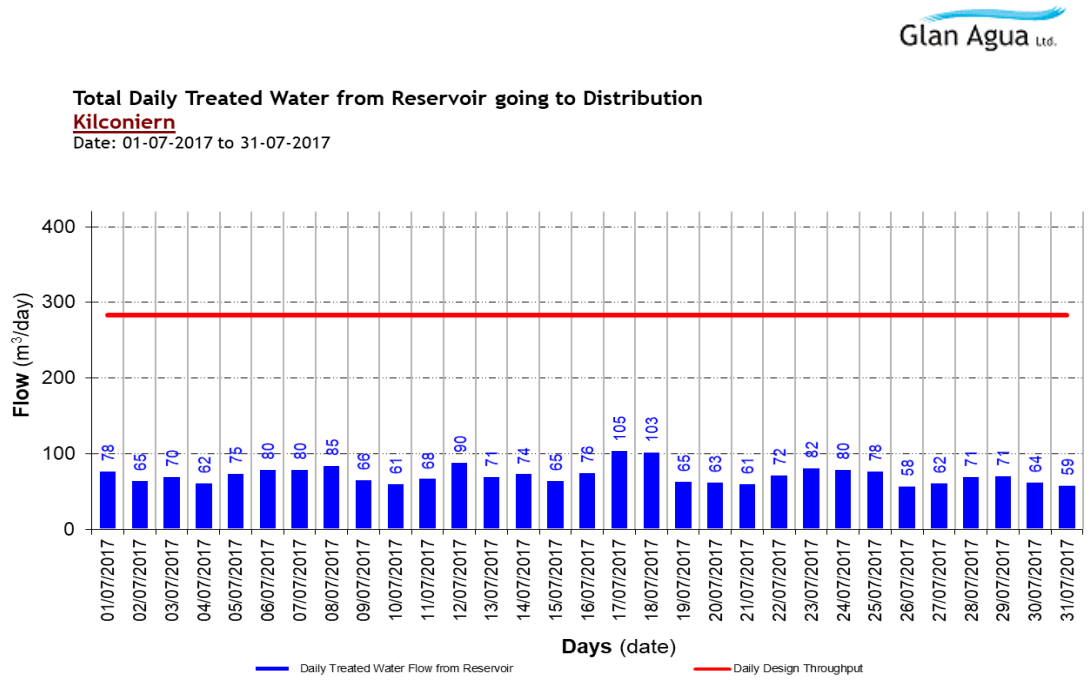

Graph of Reservoir Levels

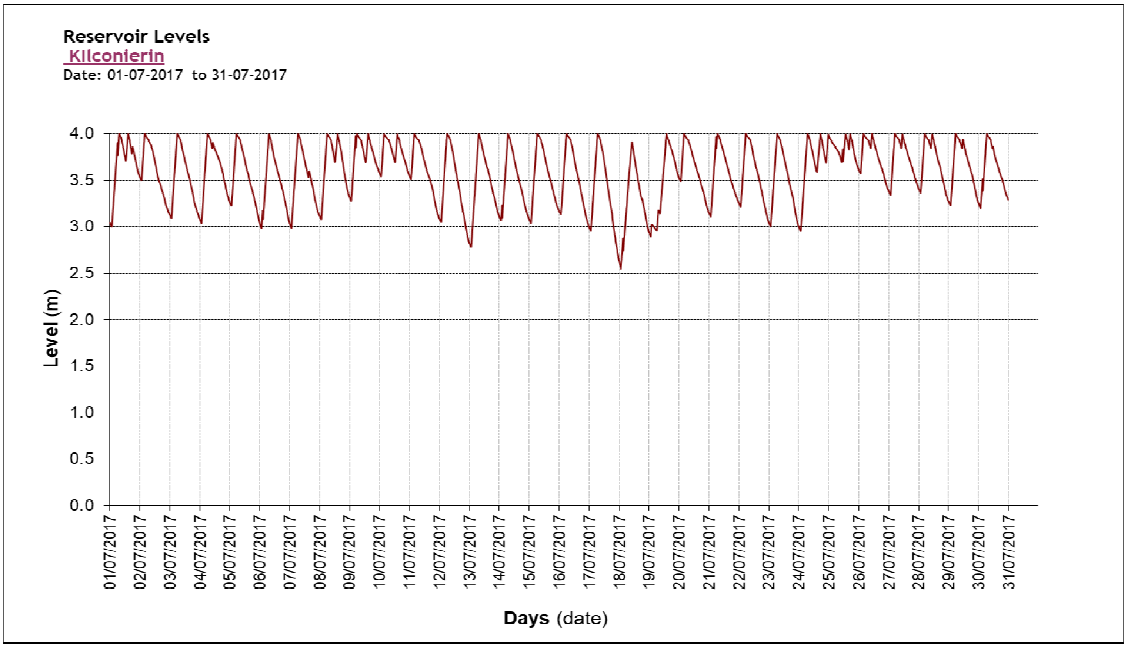

Graph of Daily Flows of Raw and Treated Water

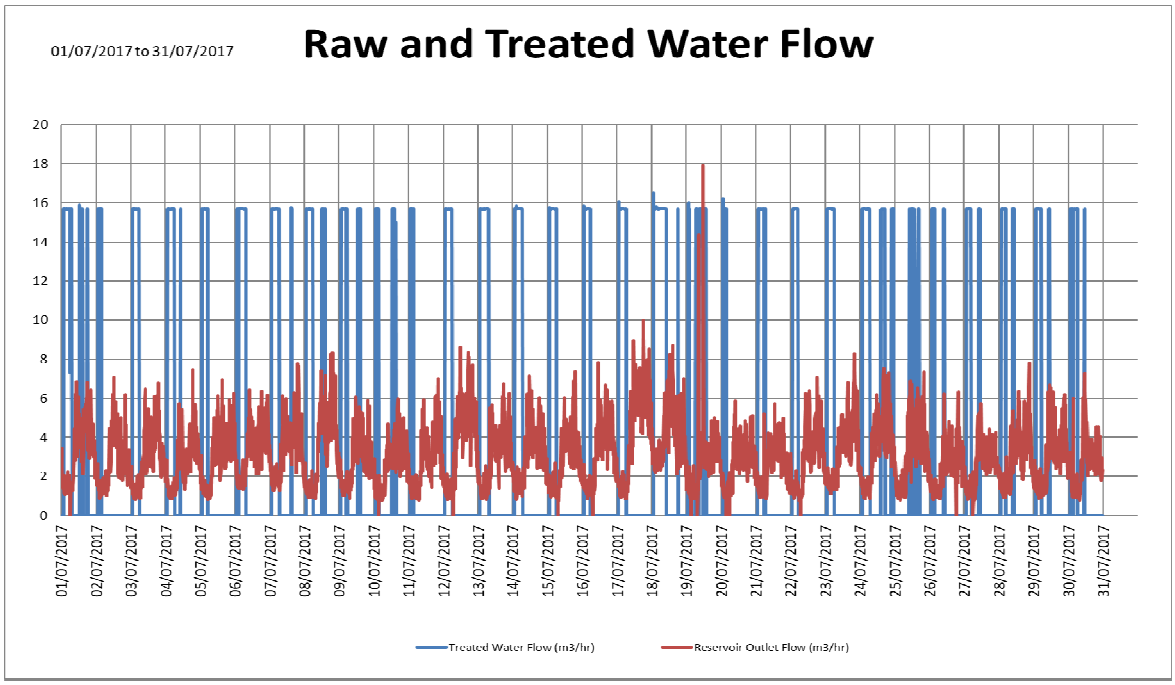

Monthly Status Report


Contract: Galway GWS DBO

Plant: Kilconierin GWS


Section 4: Graphical Presentation of Data

Operator: Stephen Costello


Average Daily Graph of Colour in Treated Water

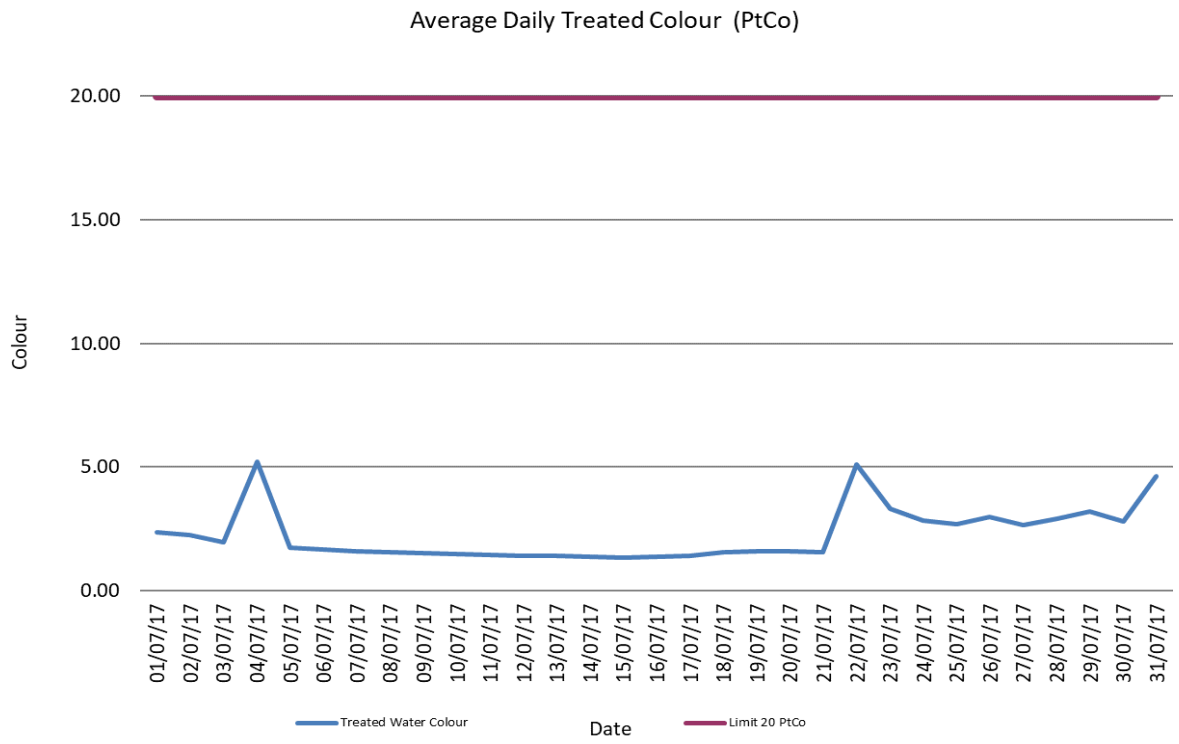


Average Daily Graph of Turbidity in Raw and Treated Water

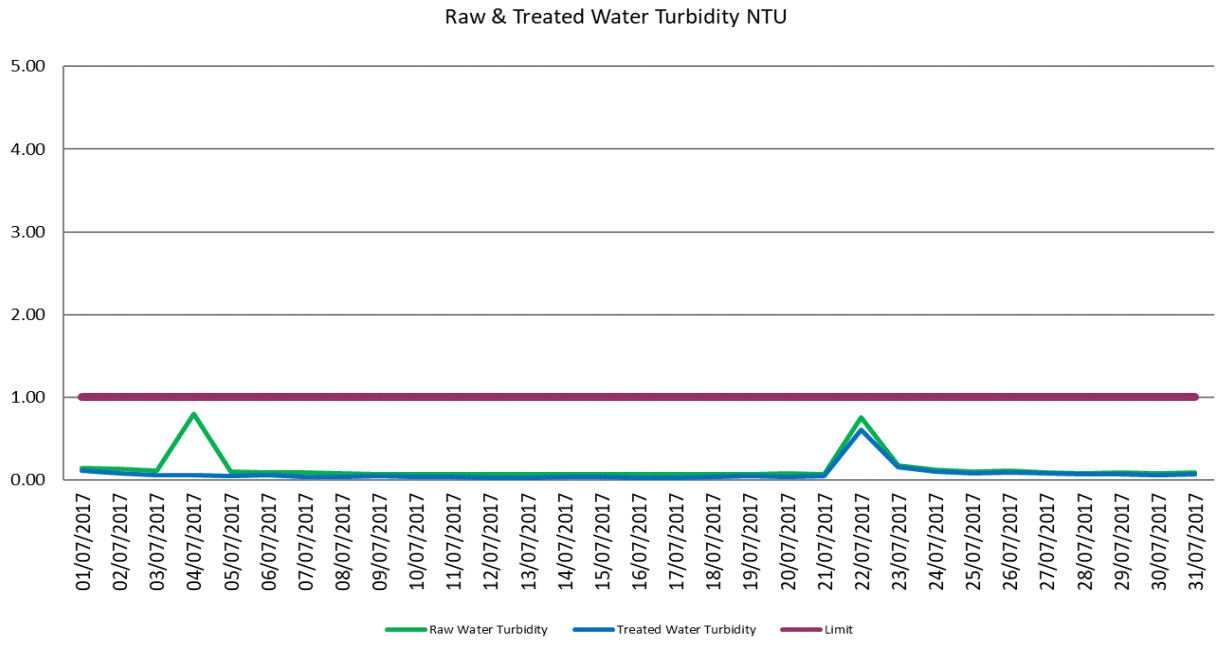

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution

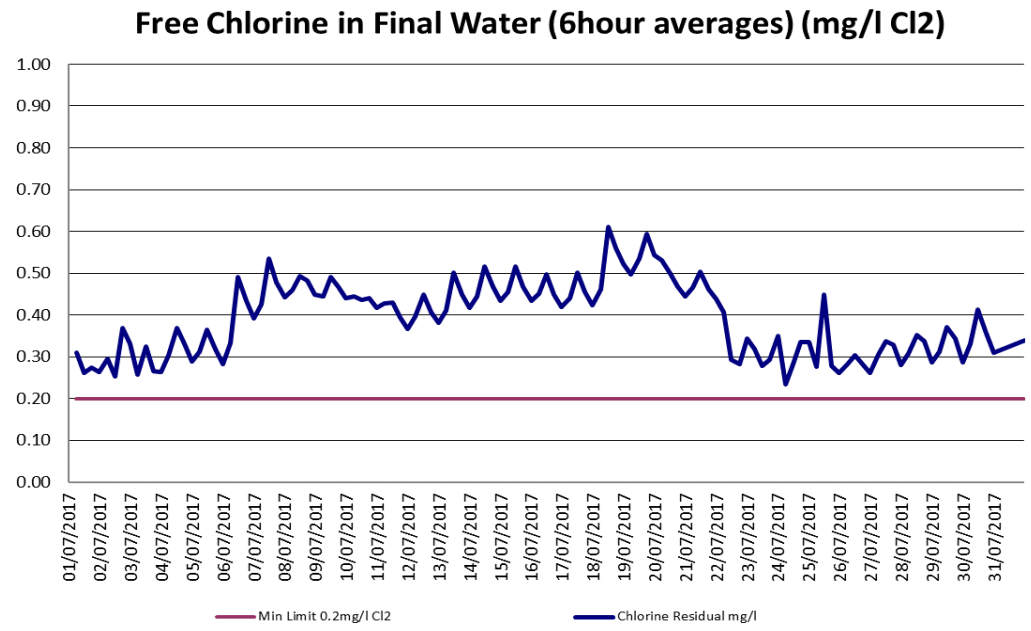

UV in Treated Water going to Distribution

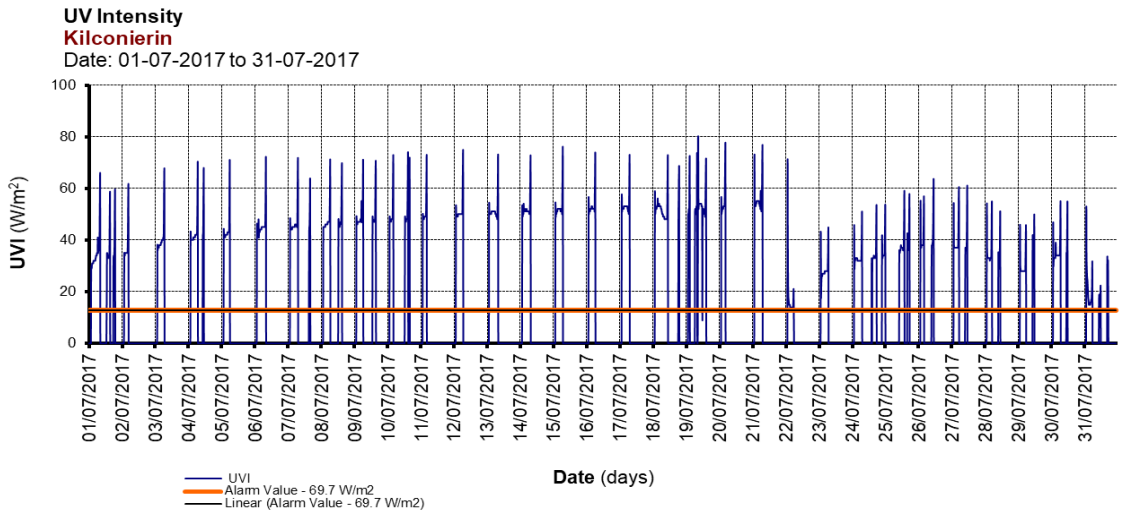

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analytical Results

Category	Report On	Comments
	Quality comparison to contract requirements	Fully compliant with S.I. 122 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 122
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting period	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary — 10/07/2017

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.25
TOC	mg/l	1.5
pH		7.01
Apparent Colour	mg/l PtCo	<5.00
Fe	ug/l	<10.0
Al	ug/l	<10.0
Mn	ug/l	<1.0
Treated Water		
Aluminium	ug/l	<10.0
TOC	mg/l	1.56
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	6.98
Fe	ug/l	<10.0
Mn	ug/l	<1.0
Coliform	MPN/100ml	<1
Clostridium Pefringens	cfu/100ml	<1
Turbidity	NTU	<0.25

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Health & Safety Issues ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

	John Fox	**Date:**	09/08/2017
For Period:	01/07/2017-31/07/2017		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**2**	*Exposure Hrs*	**09:45**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Sub Contractor

Sub Contractor	**2**	*Exposure Hrs*	**00:50**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Visitor

Number of Vistors	**0**	*Exposure Hrs*	**00:00**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 10: ***Operator: Stephen Costello***

Site Alarm /Incident Record

Date	Time	Type of Alarm/ Incident	Person Dealing with Alarm/Incident	Cause of Alarm/Incident
19/07/2017	05:10	Reset Plant after phase loss	Steve Costello	Phase Loss
19/07/2017	08:10	UV System Alarm	Steve Costello	Phase Loss

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
01/07/2017	Steve Costello	Glan Agua	12:00	12:10	Download Data
04/07/2017	Steve Costello	Glan Agua	09:00	10:00	Checks, Cal, Maint
07/07/2017	Steve Costello	Glan Agua	14:00	14:30	Adjust Chlorine
07/07/2017	Martin Egan	Glan Agua	14:00	14:30	Op Duties
10/07/2017	Steve Costello	Glan Agua	14:00	14:45	Sampling, Checks and Cal
18/07/2017	Martin Egan	Glan Agua	10:30	14:00	OP Duties
18/07/2017	Steve Costello	Glan Agua	17:25	17:45	Cal, Adjust Chlorine
19/07/2017	Steve Costello	Glan Agua	05:10	05:25	Alarm
19/07/2017	Steve Costello	Glan Agua	08:10	08:30	Alarm
19/07/2017	Steve Costello	Glan Agua	12:00	12:45	Calibrations
24/07/2017	Steve Costello	Glan Agua	12:40	13:45	Checks, Cal
24/07/2017	Michael Fox	KGWS	13:00	13:45	Sampling
24/07/2017	Robbie Doyle	IAS Labs	13:40	13:45	Sampling
25/07/2017	Steve Costello	Glan Agua	09:15	09:50	Adjust Chlorine
25/07/2017	Steve Costello	Glan Agua	16:00	16:30	Adjust Timeclock
31/07/2017	Steve Costello	Glan Agua	15:35	16:05	Process

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 12: ***Operator: Stephen Costello***

Equipment Calibration Record

Date	Equipment Description	Serial No.	Calibrated by (name &company)	Next Calib. Due	Calib. Cert Rec'd.	Comments
04/07/2017	Raw Turbidity		Steve Costello	Aug-17		Passed Verification
04/07/2017	Treated Turbidity		Steve Costello	Aug-17		Passed Verification
04/07/2017	Res Chlorine		Steve Costello	Aug-17		Passed Verification
04/07/2017	Plant Chlorine		Steve Costello	Aug-17		Calibrated
10/07/2017	Res Chlorine		Steve Costello	Aug-17		Passed Verification
18/07/2017	Res Chlorine		Steve Costello	Aug-17		Passed Verification
19/07/2017	Colour		Steve Costello	Aug-17		Passed Verification
19/07/2017	Raw Ph		Steve Costello	Aug-17		Passed Verification
19/07/2017	Plant Ph		Steve Costello	Aug-17		Passed Verification
19/07/2017	Res Ph		Steve Costello	Aug-17		Passed Verification
24/07/2017	Res Chlorine		Steve Costello	Aug-17		Passed Verification

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	10/07/2017	***Sample No:***	364909
	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	<1	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 17: ***Operator: Stephen Costello***

Facility Maintenance Record

A = Excellent B = Acceptable C = Unacceptable

	A	B	C
1. LAWN MAINTENANCE			
a. Grass cut & collected		X	
b. Edging tidy		X	
2. SHRUB MAINTENACE			
a. Bushes prund		X	
b. Trees erect & staked where required		X	
c. Hedges cut		X	
3. HARD SURFACES			
a. All surfaces swept		X	
b. All surfaces free of algae, moss etc.		X	
c. Road surface clean & adequate		X	
d. All roofs free from algea, moss etc.		X	
4. EXTERIOR PAINTING			
a. All buildings painted/clean		X	
b. All gates & doors painted		X	
5. HOUSEKEEPING			
a. Litter removed from site		X	
b. Surface area around bins & skip clean		X	
c. Site free from spillages		X	
6. BUILDINGS			
a. Roof in waterproof conditions		X	
b. Glazing in good order		X	
7. INTERIOIR CONDITIONS			
a. All rooms clean		X	
8. WELFARE & SANITATION			
a. Toilet/washing facilities clean N/A			
b. Canteen clean N/A			

Checked by: **Steve Costello** Date: **18/07/2017**

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	10/07/2017	17-31203
City Analysts	Kilconierin Treated Water	10/07/2017	17-31203

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Certificate Of Analysis

Job Number: 17-31203
Issue Number: 1
Report Date: 18 July 2017

Site: Kilconierin
PO Number: GA-11-27-1352
Date Samples Received: 10/07/2017

Please find attached the results for the samples received at our laboratory on 10/07/2017.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our website at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: 

Shane Reynolds
Laboratory Manager

Authorised Date: 18 July 2017

Notes:

Results relate only to the items tested.
Information on methods of analysis and performance characteristics is available on request.
Any opinions or interpretations indicated are outside the scope of our INAB accreditation.
This test report shall not be reproduced except in full or with written approval of City Analysts Limited.

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-31203

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Raw

Sample Type: Surface

Lab Reference Number: 364908

Date of Sampling: 10/07/2017

Date Sample Received: 10/07/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	10/07/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	11/07/2017	Iron	< 10.0	ug/l	-
S/S3244#	13/07/2017	Aluminium	< 10.0	ug/l	-
S/S3244#	11/07/2017	Manganese	< 1.0	ug/l	-
S/S1041#	10/07/2017	PH	7.01	pH Unit	-
S/S3224#	14/07/2017	Total Organic Carbon	1.500	mg/l	-
S/S3054#	11/07/2017	Turbidity	< 0.25	NTU	-

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-31203

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Treated

Sample Type: Treated

Lab Reference Number: 364909

Date of Sampling: 10/07/2017

Date Sample Received: 10/07/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	10/07/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	11/07/2017	Iron	< 10.0	ug/l	<= 200.0
S/S3244#	13/07/2017	Aluminium	< 10.0	ug/l	<= 200.0
S/S3244#	11/07/2017	Manganese	< 1.0	ug/l	<= 50.0
S/S1041#	10/07/2017	PH	6.98	pH Unit	6.50 - 9.50
S/S3224#	14/07/2017	Total Organic Carbon	1.560	mg/l	NAC & ATC
S/S3054#	11/07/2017	Turbidity	< 0.25	NTU	NAC & ATC
S/S1214#	10/07/2017	Clostridium perfringens	< 1	cfu/100ml	<= 0
S/S1201#	10/07/2017	Coliforms	< 1.0	MPN/100ml	<= 0.0
S/S1201#	10/07/2017	E.coli	< 1.0	MPN/100ml	<= 0.0

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited
Environmental Laboratories

Report Reference: 17-31203

Report Version: 1

Raw Data


Raw data has been provided with this Certificate of Analysis as it has been specifically requested by you. Please note that raw data results are Not Accredited. Raw data can be provided only for analysis carried out in-house.

Lab Reference Number:	Parameter	Result	Units	Site / Method Ref.
364908	Colour Apparent	0	Hazen	S/S3010
364908	Iron	9.5892	ug/l	S/S3244
364908	Aluminium	3.8572	ug/l	S/S3244
364908	Manganese	0.0478	ug/l	S/S3244
364908	PH	7.01	pH Unit	S/S1041
364908	Total Organic Carbon	1.50	mg/l	S/S3224
364908	Turbidity	0.02	NTU	S/S3054
364909	Colour Apparent	0	Hazen	S/S3010
364909	Iron	9.5745	ug/l	S/S3244
364909	Aluminium	9.6287	ug/l	S/S3244
364909	Manganese	0.3384	ug/l	S/S3244
364909	PH	6.98	pH Unit	S/S1041
364909	Total Organic Carbon	1.56	mg/l	S/S3224
364909	Turbidity	0.02	NTU	S/S3054
364909	Clostridium perfringens	0	cfu/100ml	S/S1214
364909	Coliforms	0	MPN/100ml	S/S1201
364909	E.coli	0	MPN/100ml	S/S1201

Railway House,
Station Road,
Loughrea,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

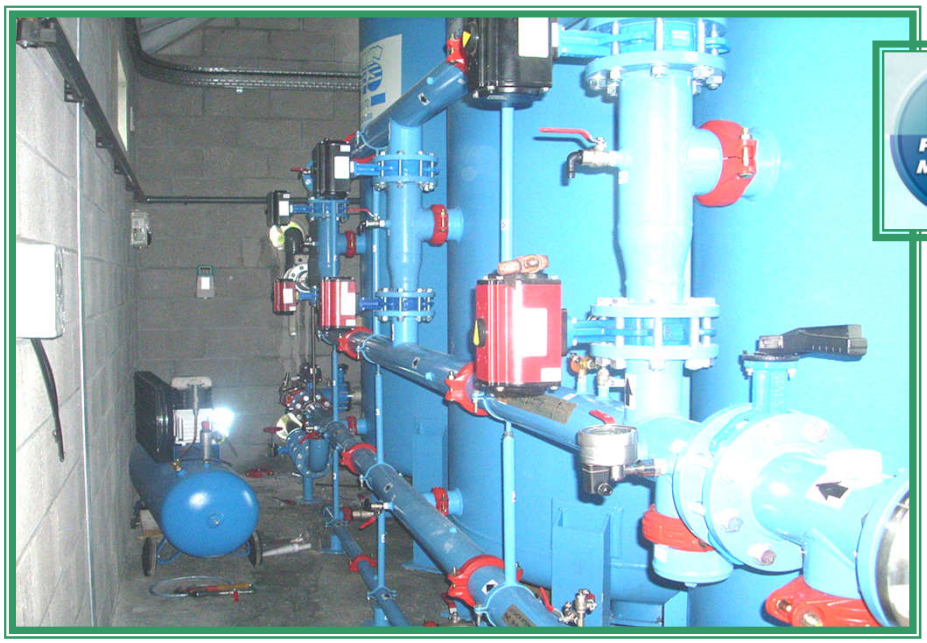

Glan Agua Ltd. is fully accredited to: ISO 9001 CERTIFICATION EUROPE, ISO 14001 CERTIFICATION EUROPE, OHSAS 18001 CERTIFICATION EUROPE

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**8-2017 71**
Operational Period:	**1 August 2017/31 August 2017**
Prepared by:	**Cathal Keighrey**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP NATIONAL DEVELOPMENT PLAN

wsntg

National Federation of Group Water Schemes

Printed:07/09/2017

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Summary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analytical Results**	
Section 6:	**Process Operational Changes Record**	
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	- Not Appicable
Section 9:	**Complaint Record**	- Not Appicable
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	
Section 13:	**Equipment Service Record**	- Not Appicable
Section 14:	**Plant Maintenance Schedule Report**	- Not Appicable
Section 15:	**Non-Sludge Waste Disposal Record**	- Not Appicable
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	-
Section 18:	**Emergency Event Record**	- Not Appicable
Section 19:	**Random Analysis by Employer**	- Not Appicable

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	Aug-17	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 122 of 2014 and Employer's Requirements.
Report No.:	8-2017	
Number of Reports To Date Including This One	70	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.8-2017 is for August 2017.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the Operational Period

- Treatment water met the required standards at all times.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Summary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	This month was an unsettled and changeable month. Rainfall was above the Monthly Long Term Average. Temperatures ranged between 12 - 23℃.
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Quantity of Water Treated and distributed to public	cubic meters	**2,479m^3**
Treated Water Flowmeter	24/07/2017	**197417m3**
Treated Water Flowmeter	30/08/2017	**199896m3**
Analytical Results	Results in or out of spec.	All on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	Recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	None recorded
Alarm Callouts	what they were	No. Callouts.
Heath & Safety Issues	what since last report or	None recorded
Equipment	taken off line and why or placed into service	None recorded
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present in water.
Electricity Disruption		None recorded

Notes:

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for August 2017.

Date	**Colour** (Pt Co)	**Turbidity** (NTU)	
	Treated	**Raw**	**Treated**
01/08/2017	3.42	0.28	0.07
02/08/2017	2.82	0.16	0.05
03/08/2017	3.28	0.15	0.08
04/08/2017	3.68	0.13	0.11
05/08/2017	4.03	0.14	0.13
06/08/2017	3.73	0.10	0.05
07/08/2017	3.43	0.09	0.09
08/08/2017	3.56	0.09	0.13
09/08/2017	4.24	0.09	0.19
10/08/2017	4.02	0.09	0.13
11/08/2017	3.85	0.09	0.13
12/08/2017	3.83	0.08	0.13
13/08/2017	3.57	0.08	0.04
14/08/2017	3.39	0.16	0.05
15/08/2017	3.32	0.08	0.05
16/08/2017	3.08	0.07	0.05
17/08/2017	2.68	0.08	0.05
18/08/2017	2.44	0.07	0.06
19/08/2017	3.11	0.15	0.11
20/08/2017	3.36	0.12	0.09
21/08/2017	3.55	0.10	0.08
22/08/2017	5.40	0.27	0.23
23/08/2017	4.52	0.12	0.10
24/08/2017	6.90	0.12	0.10
25/08/2017	7.18	0.10	0.09
26/08/2017	6.97	0.11	0.09
27/08/2017	6.72	0.08	0.08
28/08/2017	6.87	0.08	0.07
29/08/2017	6.71	0.07	0.07
30/08/2017	6.66	0.07	0.07
31/08/2017	6.48	0.09	0.07
Turbidity Limit (NTU):			1
Colour Limit (mg/l Pt Co) :			20

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 3: ***Operator: Stephen Costello***

Tabular Data Presentation


Daily averages of Free Chlorine in Final Water for August 2017.

Date	Chlorine (mg/l Cl_2)			
Day | Time	**06:00:00**	**12:00:00**	**18:00:00**	**23:59:59**
01/08/2017	0.27	0.35	0.29	0.25
02/08/2017	0.28	0.41	0.34	0.29
03/08/2017	0.33	0.43	0.36	0.31
04/08/2017	0.34	0.39	0.33	0.29
05/08/2017	0.30	0.36	0.29	0.25
06/08/2017	0.32	0.39	0.32	0.28
07/08/2017	0.34	0.41	0.35	0.31
08/08/2017	0.35	0.49	0.43	0.38
09/08/2017	0.41	0.48	0.41	0.38
10/08/2017	0.41	0.55	0.48	0.44
11/08/2017	0.49	0.58	0.51	0.47
12/08/2017	0.51	0.62	0.55	0.50
13/08/2017	0.50	0.54	0.48	0.45
14/08/2017	0.46	0.52	0.46	0.42
15/08/2017	0.43	0.48	0.43	0.39
16/08/2017	0.41	0.49	0.44	0.39
17/08/2017	0.41	0.46	0.41	0.37
18/08/2017	0.39	0.45	0.40	0.37
19/08/2017	0.38	0.37	0.33	0.30
20/08/2017	0.32	0.34	0.29	0.26
21/08/2017	0.29	0.32	0.27	0.26
22/08/2017	0.29	0.26	0.30	0.38
23/08/2017	0.31	0.26	0.28	0.31
24/08/2017	0.40	0.31	0.27	0.24
25/08/2017	0.34	0.35	0.30	0.26
26/08/2017	0.31	0.40	0.34	0.30
27/08/2017	0.34	0.48	0.41	0.36
28/08/2017	0.39	0.47	0.41	0.37
29/08/2017	0.41	0.48	0.43	0.39
30/08/2017	0.45	0.52	0.47	0.44
31/08/2017	0.34	0.40	0.36	0.32


Lower Limit: **0.2** mg/l Cl

Upper Limit: **0.7** mg/l Cl

Graph of Daily Treated Water

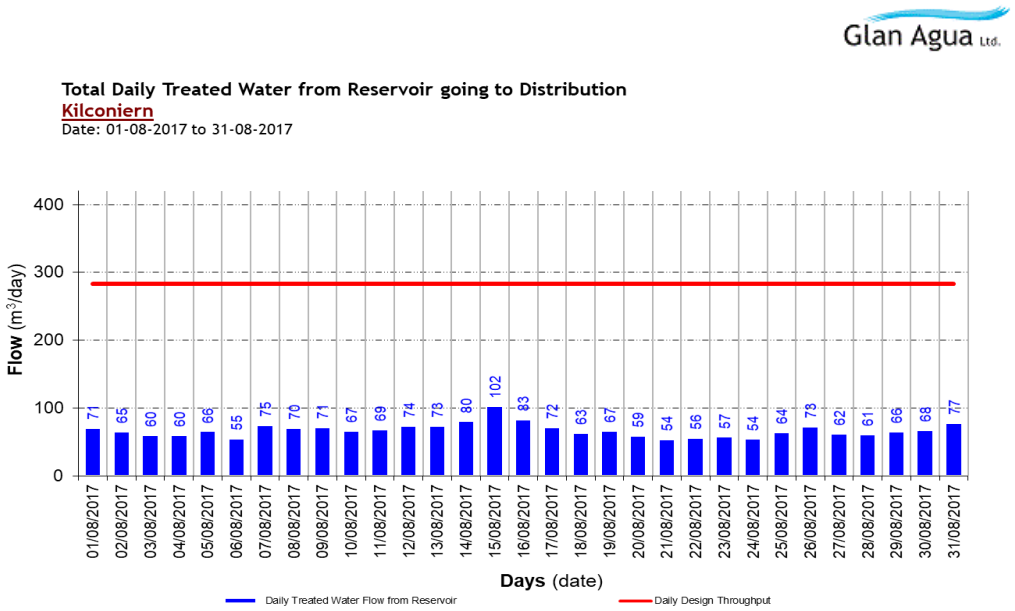

Graph of Reservoir Levels

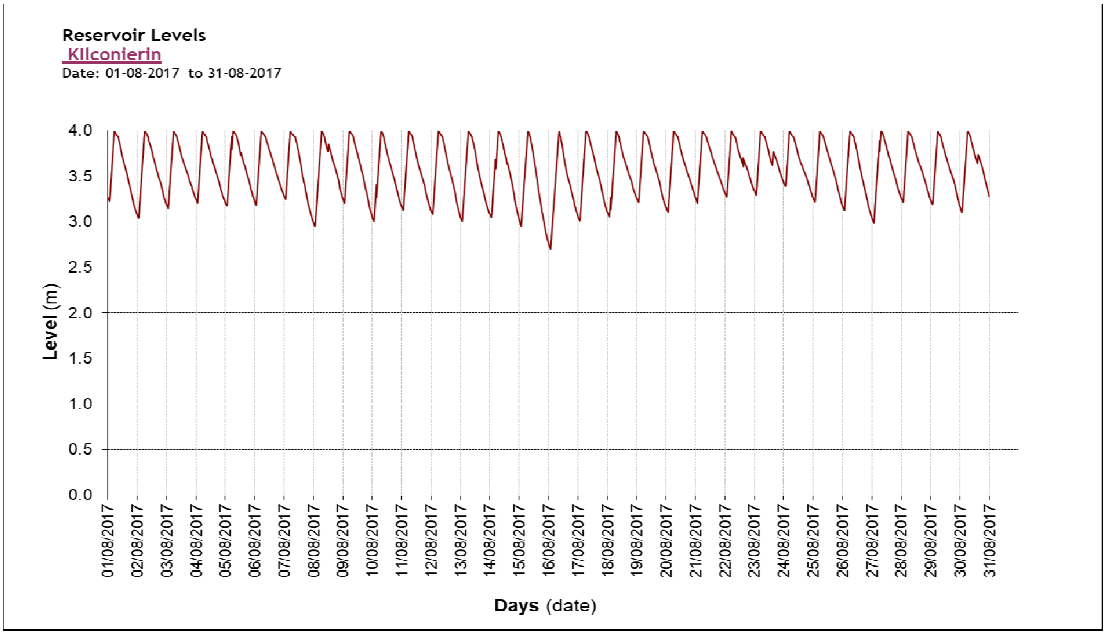

Monthly Status Report


Contract: Galway GWS DBO

Plant: Kilconierin GWS

Section 4: Graphical Presentation of Data

Operator: Stephen Costello

Graph of Daily Flows of Raw and Treated Water

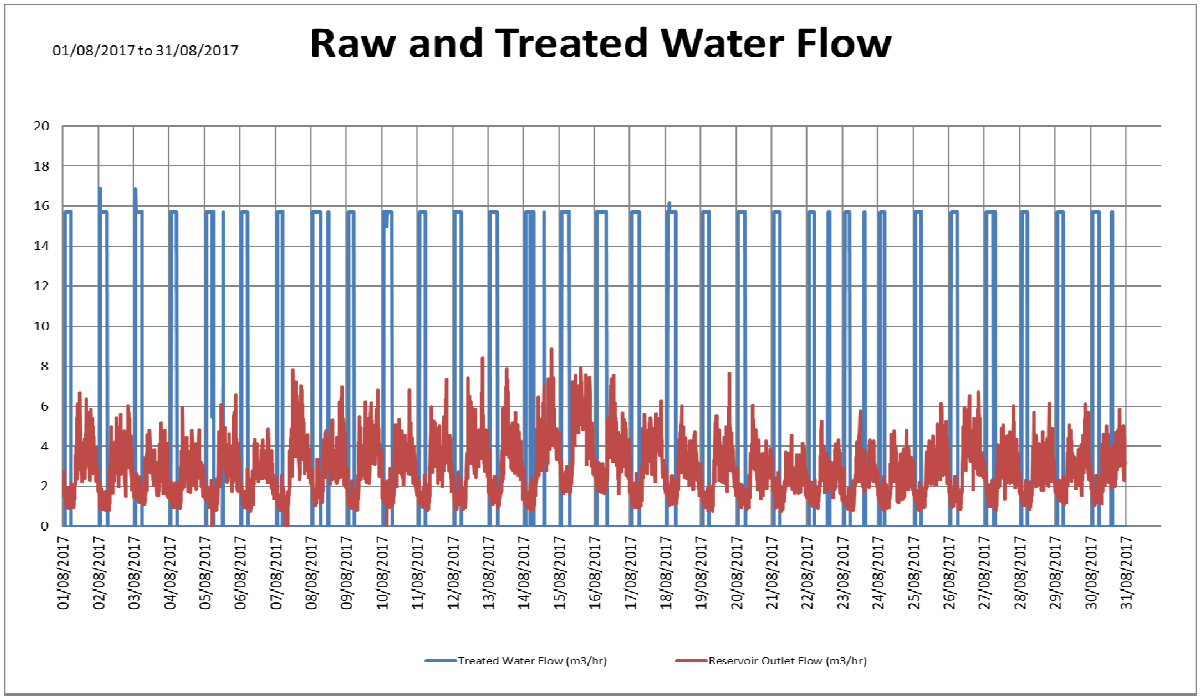


Monthly Status Report ***Contract: Galway GWS DBO***


Plant: Kilconierin GWS

Section 4: Graphical Presentation of Data ***Operator: Stephen Costello***


Average Daily Graph of Colour in Treated Water

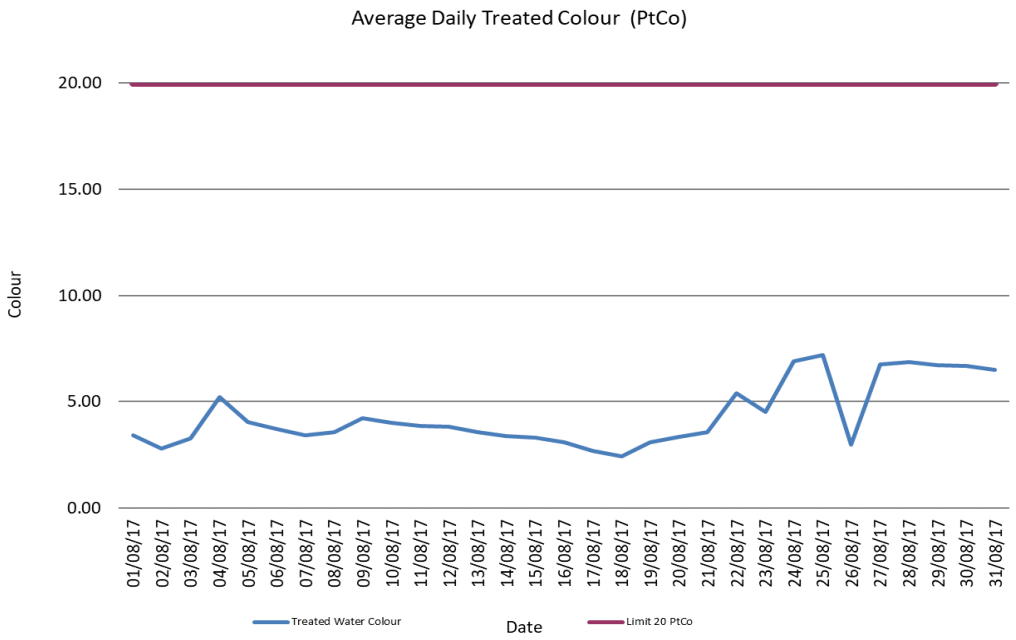


Average Daily Graph of Turbidity in Raw and Treated Water

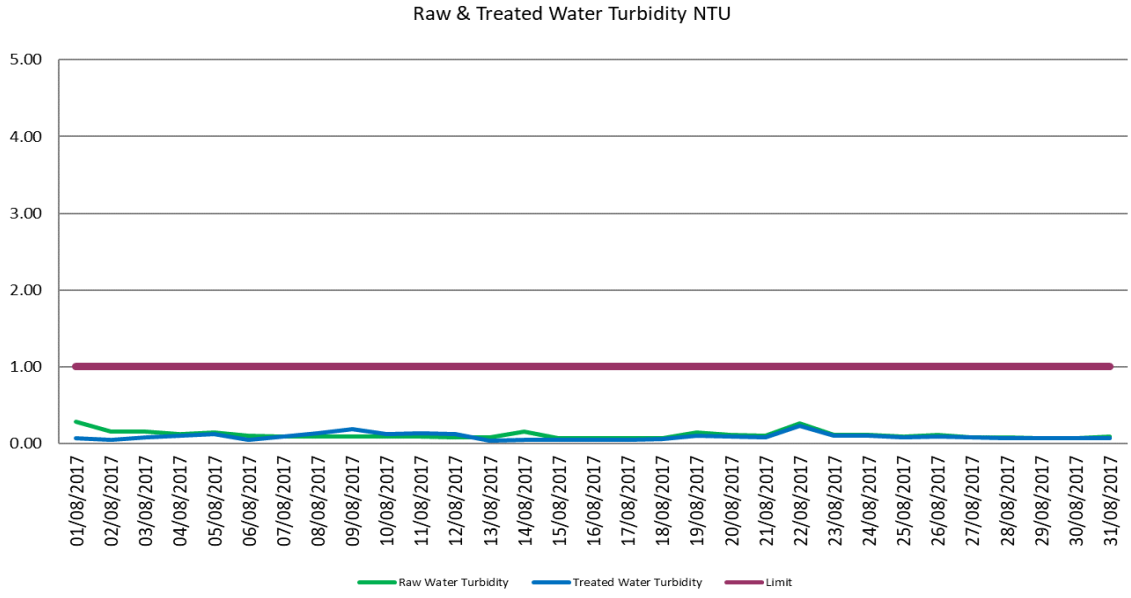

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution

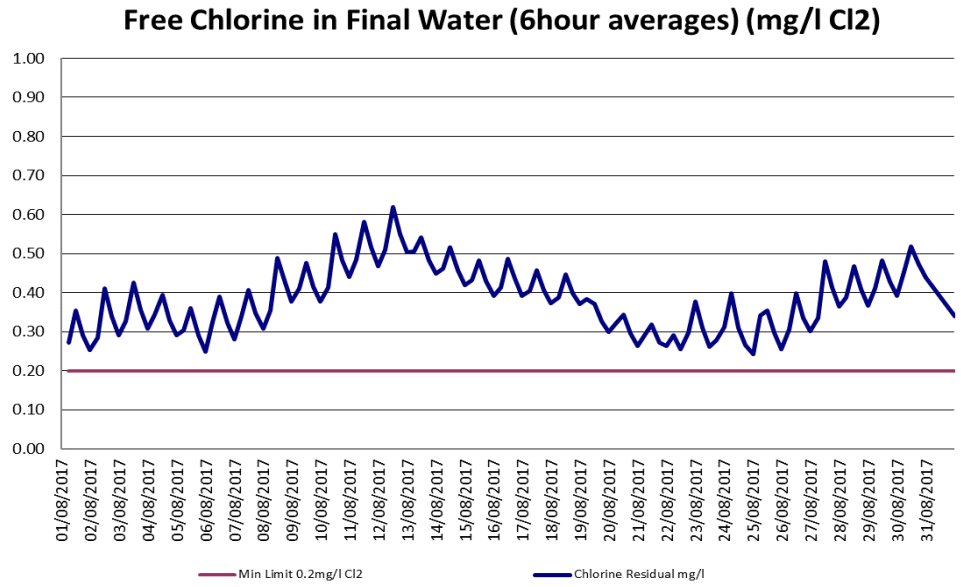

UV in Treated Water going to Distribution

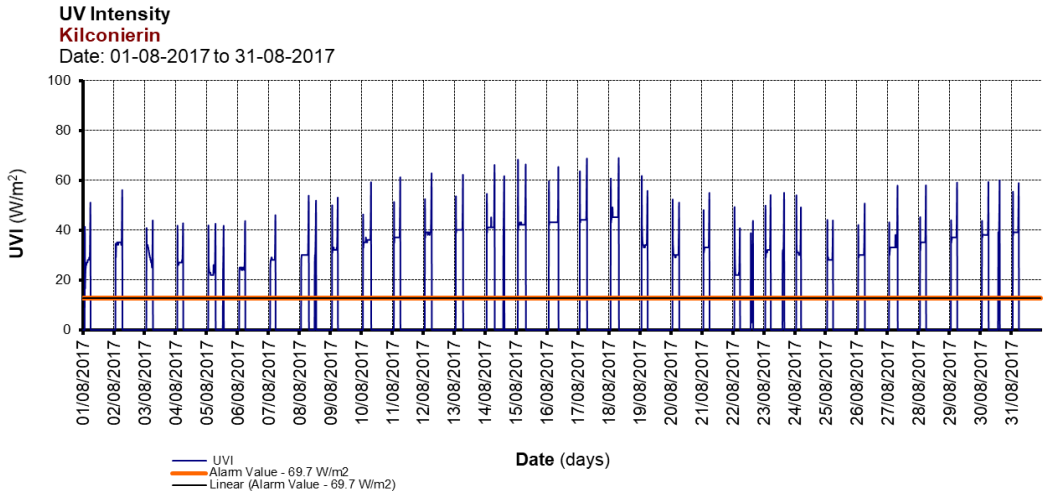

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analytical Results

Category	Report On	Comments
	Quality comparison to contract requirements	Fully compliant with S.I. 122 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 122
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting period	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary — 14/08/2017

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.10
TOC	mg/l	0.59
pH		6.94
Apparent Colour	mg/l PtCo	<5.00
Fe	ug/l	<10.0
Al	ug/l	<10.0
Mn	ug/l	<1.0
Treated Water		
Aluminium	ug/l	115
TOC	mg/l	0.6
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	6.93
Fe	ug/l	<10.0
Mn	ug/l	<1.0
Coliform	MPN/100ml	<1
Clostridium Pefringens	cfu/100ml	<1
Turbidity	NTU	<0.10

Monthly Status Report | ***Contract: Galway GWS DBO*** | ***Plant: Kilconierin GWS*** | **Health & Safety Issues** | ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

	John Fox	**Date:**	05/09/2017
For Period:	01/08/2017-31/08/2017		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**3**	*Exposure Hrs*	**09:50**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Sub Contractor

Sub Contractor	**2**	*Exposure Hrs*	**00:50**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Visitor

Number of Vistors	**0**	*Exposure Hrs*	**00:00**		
Visitor					
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
01/08/2017	Steve Costello	Glan Agua	10:45	11:15	Download Data, Checks, Cal
04/08/2017	Steve Costello	Glan Agua	10:30	10:50	CTU
05/08/2017	Steve Costello	Glan Agua	11:25	12:00	Adjust Chlorine
08/08/2017	Steve Costello	Glan Agua	10:50	11:50	Checks, Cal
09/08/2017	Steve Costello	Glan Agua	10:35	10:45	Collect Lawn Mower
11/08/2017	Martin Egan	Glan Agua	15:55	16:30	Top-up chemicals
12/08/2017	Steve Costello	Glan Agua	10:50	11:20	Adjust Chlorine
14/08/2017	Steve Costello	Glan Agua	12:50	13:15	Sampling/Cal
15/08/2017	Steve Costello	Glan Agua	16:10	17:00	Checks, Cal
17/08/2017	Steve Costello	Glan Agua	12:10	13:40	Maint
21/08/2017	Martin Egan	Glan Agua	10:15	10:40	Operational Duties
22/08/2017	Shane O'Donnell	Glan Agua	12:45	14:15	Adjust Chlorine
23/08/2017	Shane O'Donnell	Glan Agua	13:20	14:20	Adjust Chlorine
28/08/2017	Martin Egan	Glan Agua	15:30	16:00	Operational Duties
30/08/2017	Shane O'Donnell	Glan Agua	12:40	13:40	Adjust Chlorine

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 12: ***Operator: Stephen Costello***

Equipment Calibration Record

Date	Equipment Description	Serial No.	Calibrated by (name &company)	Next Calib. Due	Calib. Cert Rec'd.	Comments
01/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Plant Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Raw Ph		Steve Costello	Sep-17		Calibrated
08/08/2017	Plant Ph		Steve Costello	Sep-17		Passed Verification
08/08/2017	Res Ph		Steve Costello	Sep-17		Passed Verification
08/08/2017	Colour		Steve Costello	Sep-17		Passed Verification
14/08/2017	Raw Turbidity		Steve Costello	Sep-17		Passed Verification
14/08/2017	Treated Turbidity		Steve Costello	Sep-17		Passed Verification
15/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
23/08/2017	Res Chlorine		Shane O'Donnell	Sep-17		Passed Verification

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	14/08/2017	***Sample No:***	368901
	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	<1	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 17: ***Operator: Stephen Costello***

Facility Maintenance Record

A = Excellent B = Acceptable C = Unacceptable

	A	B	C
1. LAWN MAINTENANCE			
a. Grass cut & collected		X	
b. Edging tidy		X	
2. SHRUB MAINTENACE			
a. Bushes prund		X	
b. Trees erect & staked where required		X	
c. Hedges cut		X	
3. HARD SURFACES			
a. All surfaces swept		X	
b. All surfaces free of algae, moss etc.		X	
c. Road surface clean & adequate		X	
d. All roofs free from algea, moss etc.		X	
4. EXTERIOR PAINTING			
a. All buildings painted/clean		X	
b. All gates & doors painted		X	
5. HOUSEKEEPING			
a. Litter removed from site		X	
b. Surface area around bins & skip clean		X	
c. Site free from spillages		X	
6. BUILDINGS			
a. Roof in waterproof conditions		X	
b. Glazing in good order		X	
7. INTERIOIR CONDITIONS			
a. All rooms clean		X	
8. WELFARE & SANITATION			
a. Toilet/washing facilities clean N/A			
b. Canteen clean N/A			

Checked by: **Steve Costello** Date: **17/08/2017**

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	14/08/2017	17-32471
City Analysts	Kilconierin Treated Water	14/08/2017	17-32471

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Certificate Of Analysis

Job Number: 17-32468
Issue Number: 1
Report Date: 1 September 2017

Site: Kilconierin
PO Number: 5800036527
Date Samples Received: 14/08/2017

Please find attached the results for the samples received at our laboratory on 14/08/2017.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our website at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Shane Reynolds
Laboratory Manager

Authorised Date: 1 September 2017

Notes:

Results relate only to the items tested.
Information on methods of analysis and performance characteristics is available on request.
Any opinions or interpretations indicated are outside the scope of our INAB accreditation.
This test report shall not be reproduced except in full or with written approval of City Analysts Limited.

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-32468

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Raw

Sample Type: Surface

Lab Reference Number: 368900

Date of Sampling: 14/08/2017

Date Sample Received: 14/08/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	15/08/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	28/08/2017	Iron	< 10.0	ug/l	-
S/S3244#	15/08/2017	Aluminium	< 10.0	ug/l	-
S/S3244#	28/08/2017	Manganese	< 1.0	ug/l	-
S/S1041#	14/08/2017	PH	6.94	pH Unit	-
S/S3224#	30/08/2017	Total Organic Carbon	0.590	mg/l	-
S/S3054#	14/08/2017	Turbidity	< 0.10	NTU	-

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-32468

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Treated

Sample Type: Treated

Lab Reference Number: 368901

Date of Sampling: 14/08/2017

Date Sample Received: 14/08/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	15/08/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	28/08/2017	Iron	< 10.0	ug/l	<= 200.0
S/S3244#	15/08/2017	Aluminium	115	ug/l	<= 200.0
S/S3244#	28/08/2017	Manganese	< 1.0	ug/l	<= 50.0
S/S1041#	14/08/2017	PH	6.93	pH Unit	6.50 - 9.50
S/S3224#	30/08/2017	Total Organic Carbon	0.600	mg/l	NAC & ATC
S/S3054#	14/08/2017	Turbidity	< 0.10	NTU	NAC & ATC
S/S1214#	14/08/2017	Clostridium perfringens	< 1	cfu/100ml	<= 0
S/S1201#	14/08/2017	Coliforms	< 1.0	MPN/100ml	<= 0.0
S/S1201#	14/08/2017	E.coli	< 1.0	MPN/100ml	<= 0.0

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited
Environmental Laboratories

Report Reference: 17-32468

Report Version: 1

Raw Data

Raw data has been provided with this Certificate of Analysis as it has been specifically requested by you. Please note that raw data results are Not Accredited. Raw data can be provided only for analysis carried out in-house.


Lab Reference Number:	Parameter	Result	Units	Site / Method Ref.
368900	Colour Apparent	0	Hazen	S/S3010
368900	Iron	3.88782	ug/l	S/S3244
368900	Aluminium	7.8264	ug/l	S/S3244
368900	Manganese	0.810192	ug/l	S/S3244
368900	PH	6.94	pH Unit	S/S1041
368900	Total Organic Carbon	0.59	mg/l	S/S3224
368900	Turbidity	0.02	NTU	S/S3054
368901	Colour Apparent	0	Hazen	S/S3010
368901	Iron	7.54923	ug/l	S/S3244
368901	Aluminium	115.1017	ug/l	S/S3244
368901	Manganese	0.74565	ug/l	S/S3244
368901	PH	6.93	pH Unit	S/S1041
368901	Total Organic Carbon	0.6	mg/l	S/S3224
368901	Turbidity	0.07	NTU	S/S3054
368901	Clostridium perfringens	0	cfu/100ml	S/S1214
368901	Coliforms	0	MPN/100ml	S/S1201
368901	E.coli	0	MPN/100ml	S/S1201

Glan Agua Ltd.

Enterprise & Technology Centre
Creagh Road,
Ballinasloe,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

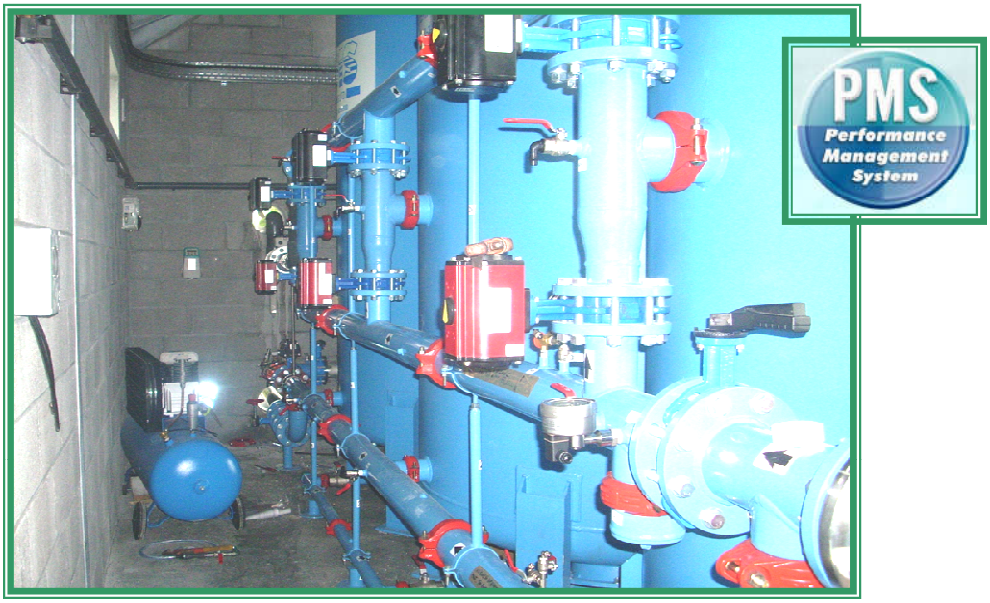

Glan Agua Ltd. is fully accredited to:

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**4-2012 (7)**
Operational Period:	**1 April 2012/30 April 2012**
Prepared by:	**Julian Drapiewski**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP
NATIONAL DEVELOPMENT PLAN

wsntg

National Federation of Group Water Schemes

Printed:14/05/2012

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Sumary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analythical Results**	
Section 6:	**Process Operational Changes Record**	- N/A
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	
Section 9:	**Complaint Record**	- N/A
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	- N/A
Section 13:	**Equipment Service Record**	- N/A
Section 14:	**Plant Maintenance Schedule Report**	- N/A
Section 15:	**Non-Sludge Waste Disposal Record**	- N/A
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	- N/A
Section 18:	**Emergency Event Record**	- N/A
Section 19:	**Random Analysis by Employer**	- N/A

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	April 2012	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 278 of 2007 and Employer's Requirements.
Report No.:	4-2012	
Number of Reports To Date Including This One	7	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.4-2012 is for April 2012.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the process proving period.

- Treatment plant provided treated water to the required standard at all times; no non-compliances recorded

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Sumary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	Generally dry, however there was periods of heavy rainfall particularly the 18th adn 30th of April. Temperature between 3℃ to 9°C
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Treated and distributed to public	cubic meters	**5900m^3**
Analyticall Results	results in or out of specs	all on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	none recorded
Alarm Callouts	what they were	1 no. callouts: See section 10 for more details
Heath & Safety Issues	what since last report or	none recorded
Equipment	taken off line and why or placed into service	none.
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present it water.
Other	Outstanding works	Outstanding civil finishing works were addressed. The outstanding M&E/process works as listed in Section 8 - *Outstanding Exceptions Report* to be addressed in the coming weeks.

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for April 2012.

Date	Colour	Turbidity (NTU)	
	treated	raw	treated
01/04/2012	4.05	0.27	0.12
02/04/2012	4.02	0.22	0.09
03/04/2012	4.04	0.20	0.08
04/04/2012	4.01	0.21	0.08
05/04/2012	3.95	0.21	0.08
06/04/2012	3.98	0.52	0.19
07/04/2012	4.26	1.04	0.40
08/04/2012	4.11	0.29	0.11
09/04/2012	4.04	0.23	0.09
10/04/2012	4.02	0.22	0.09
11/04/2012	4.02	0.22	0.10
12/04/2012	3.91	0.24	0.10
13/04/2012	4.05	0.37	0.17
14/04/2012	4.06	0.26	0.12
15/04/2012	4.03	0.20	0.09
16/04/2012	3.93	0.21	0.08
17/04/2012	3.88	0.21	0.09
18/04/2012	5.06	0.73	0.42
19/04/2012	6.71	0.85	0.63
20/04/2012	5.31	0.37	0.25
21/04/2012	4.79	0.28	0.16
22/04/2012	4.59	0.23	0.12
23/04/2012	3.92	0.19	0.09
24/04/2012	4.59	6.04	0.25
25/04/2012	4.35	6.41	0.14
26/04/2012	4.52	0.21	0.11
27/04/2012	4.57	0.25	0.12
28/04/2012	4.44	0.22	0.10
29/04/2012	4.26	0.21	0.11
30/04/2012	4.17	0.20	0.09

Turbidity Limit (NTU):	1
Colour Limit (mg/l Pt Co) :	20

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 3: ***Operator: Stephen Costello***


Tabular Data Presentation

Daily averages of Free Chlorine in Final Water for April 2012.


Day | Time	06:00:00	12:00:00	18:00:00	23:59:59
01/04/2012	0.35	0.35	0.38	0.40
02/04/2012	0.37	0.40	0.37	0.34
03/04/2012	0.38	0.45	0.42	0.40
04/04/2012	0.43	0.49	0.45	0.43
05/04/2012	0.43	0.46	0.42	0.39
06/04/2012	0.41	0.45	0.42	0.39
07/04/2012	0.41	0.45	0.41	0.38
08/04/2012	0.40	0.42	0.39	0.36
09/04/2012	0.39	0.42	0.39	0.36
10/04/2012	0.40	0.43	0.40	0.37
11/04/2012	0.41	0.45	0.42	0.39
12/04/2012	0.41	0.45	0.41	0.39
13/04/2012	0.41	0.43	0.39	0.37
14/04/2012	0.39	0.42	0.38	0.35
15/04/2012	0.38	0.41	0.38	0.35
16/04/2012	0.38	0.41	0.38	0.35
17/04/2012	0.37	0.36	0.33	0.31
18/04/2012	0.31	0.31	0.31	0.50
19/04/2012	0.43	0.37	0.34	0.37
20/04/2012	0.43	0.39	0.37	0.34
21/04/2012	0.41	0.44	0.42	0.45
22/04/2012	0.46	0.45	0.44	0.55
23/04/2012	0.40	0.51	0.45	0.53
24/04/2012	0.61	0.57	0.60	0.48
25/04/2012	0.57	0.45	0.26	0.26
26/04/2012	0.27	0.26	0.28	0.25
27/04/2012	0.24	0.30	0.27	0.24
28/04/2012	0.28	0.32	0.28	0.25
29/04/2012	0.30	0.35	0.32	0.28
30/04/2012	0.33	0.38	0.35	0.31

Lower Limit: **0.2** mg/l Cl


Upper Limit: **0.7** mg/l Cl

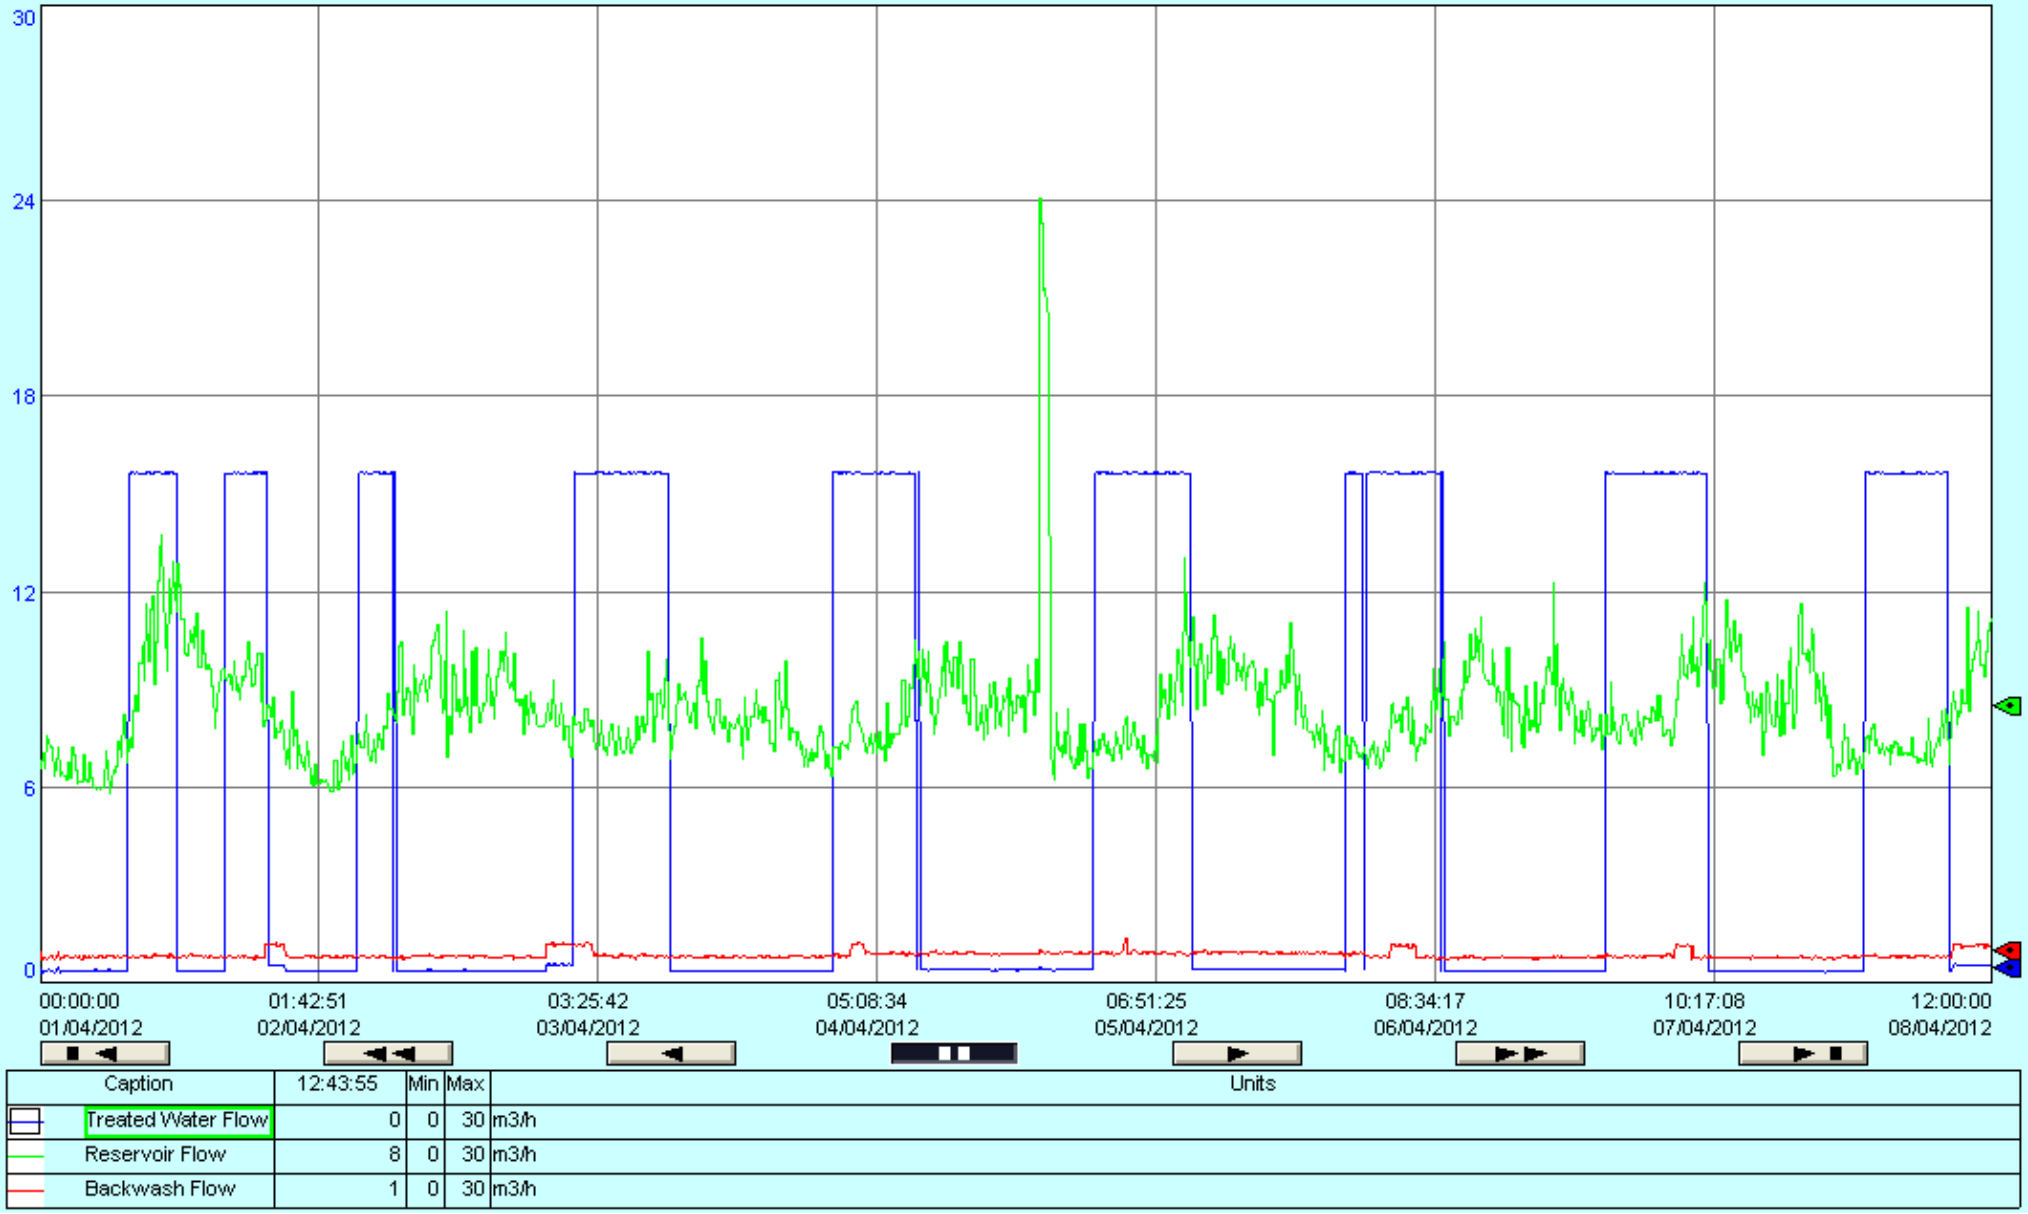


Caption	12:43:55	Min	Max	Units
Treated Water Flow	0	0	30	m3/h
Reservoir Flow	8	0	30	m3/h
Backwash Flow	1	0	30	m3/h

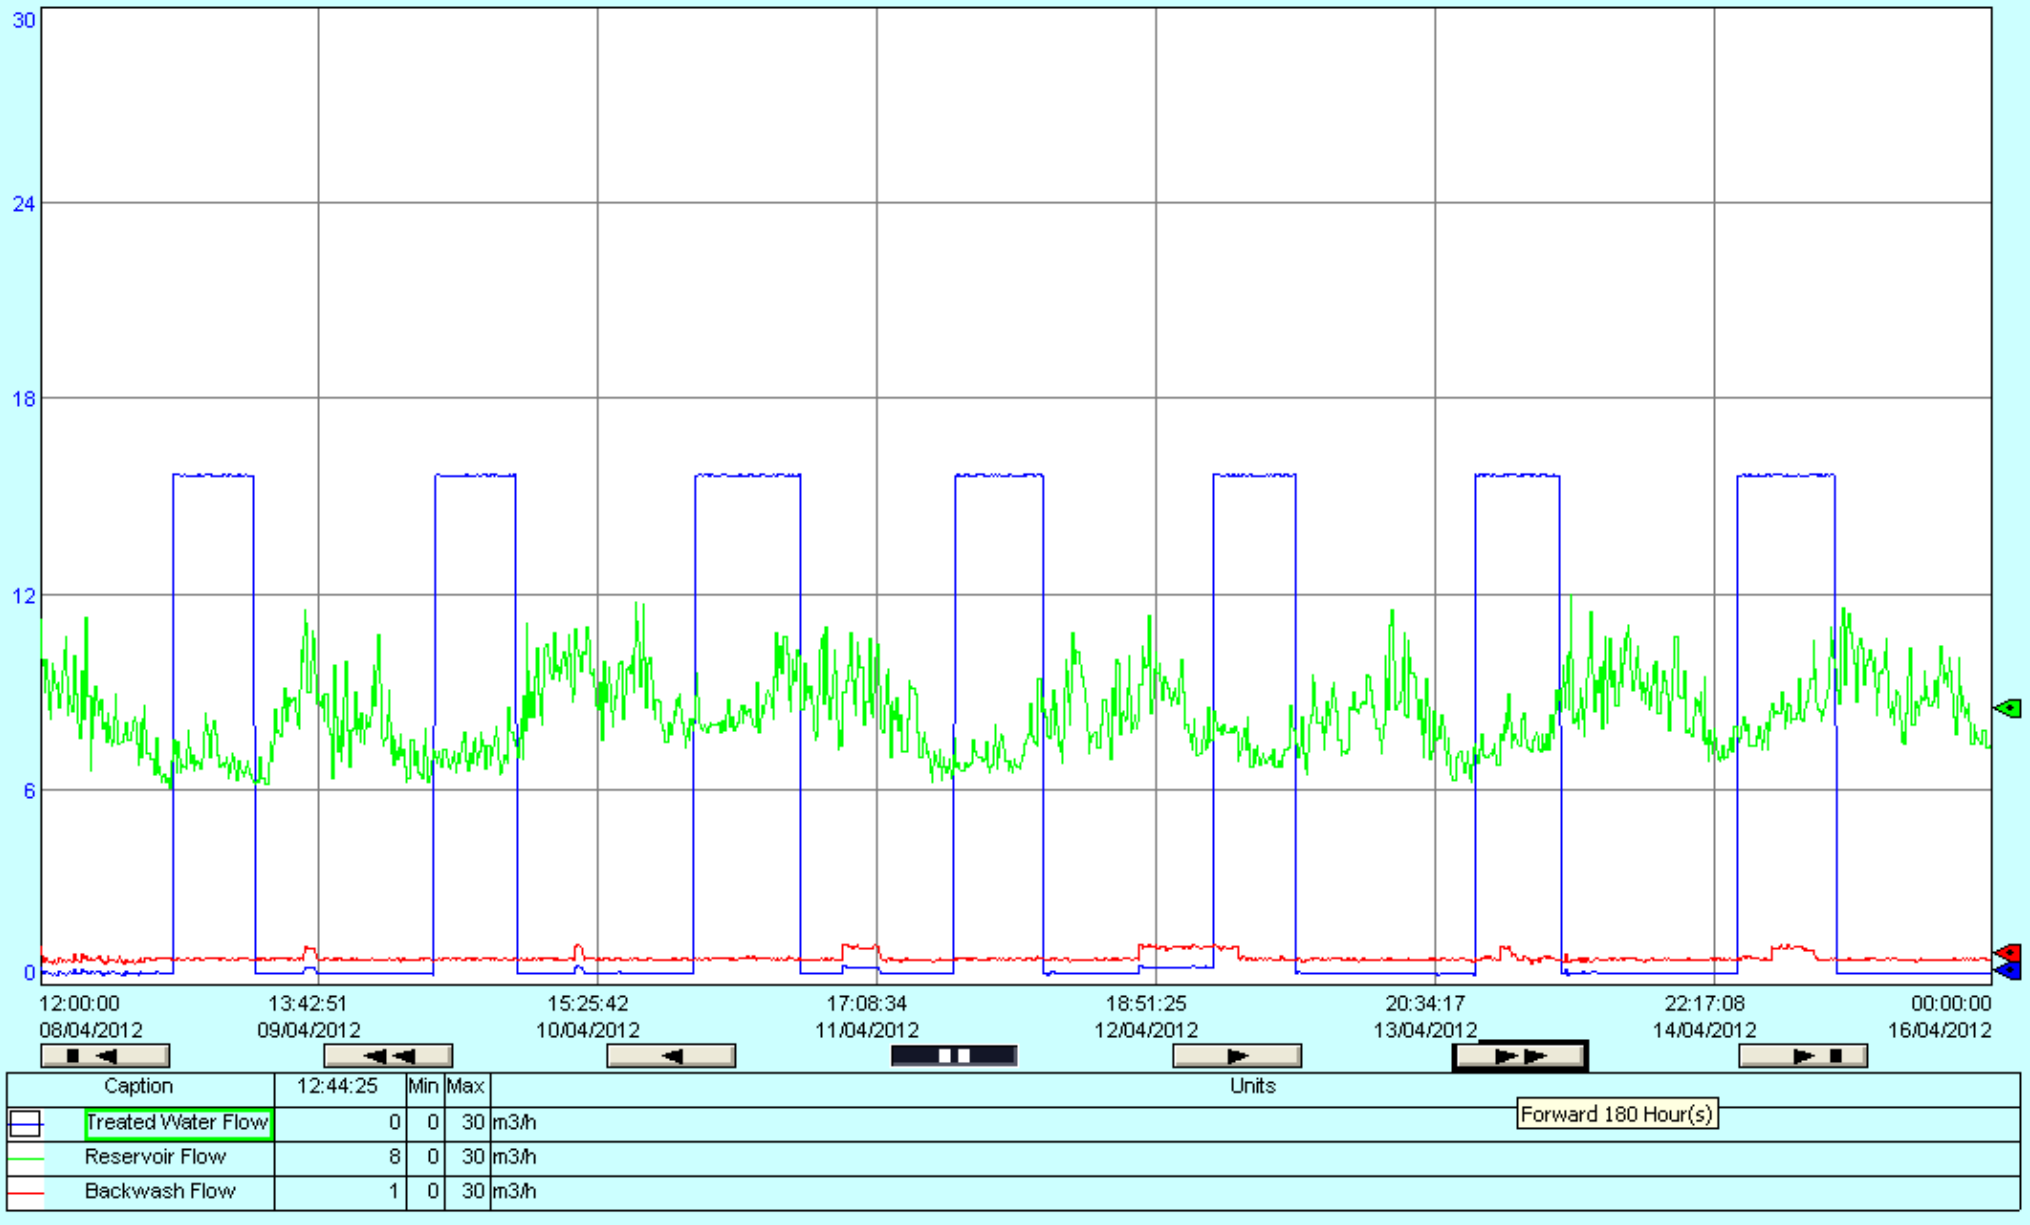


Caption	12:44:25	Min	Max	Units
Treated Water Flow	0	0	30	m3/h
Reservoir Flow	8	0	30	m3/h
Backwash Flow	1	0	30	m3/h

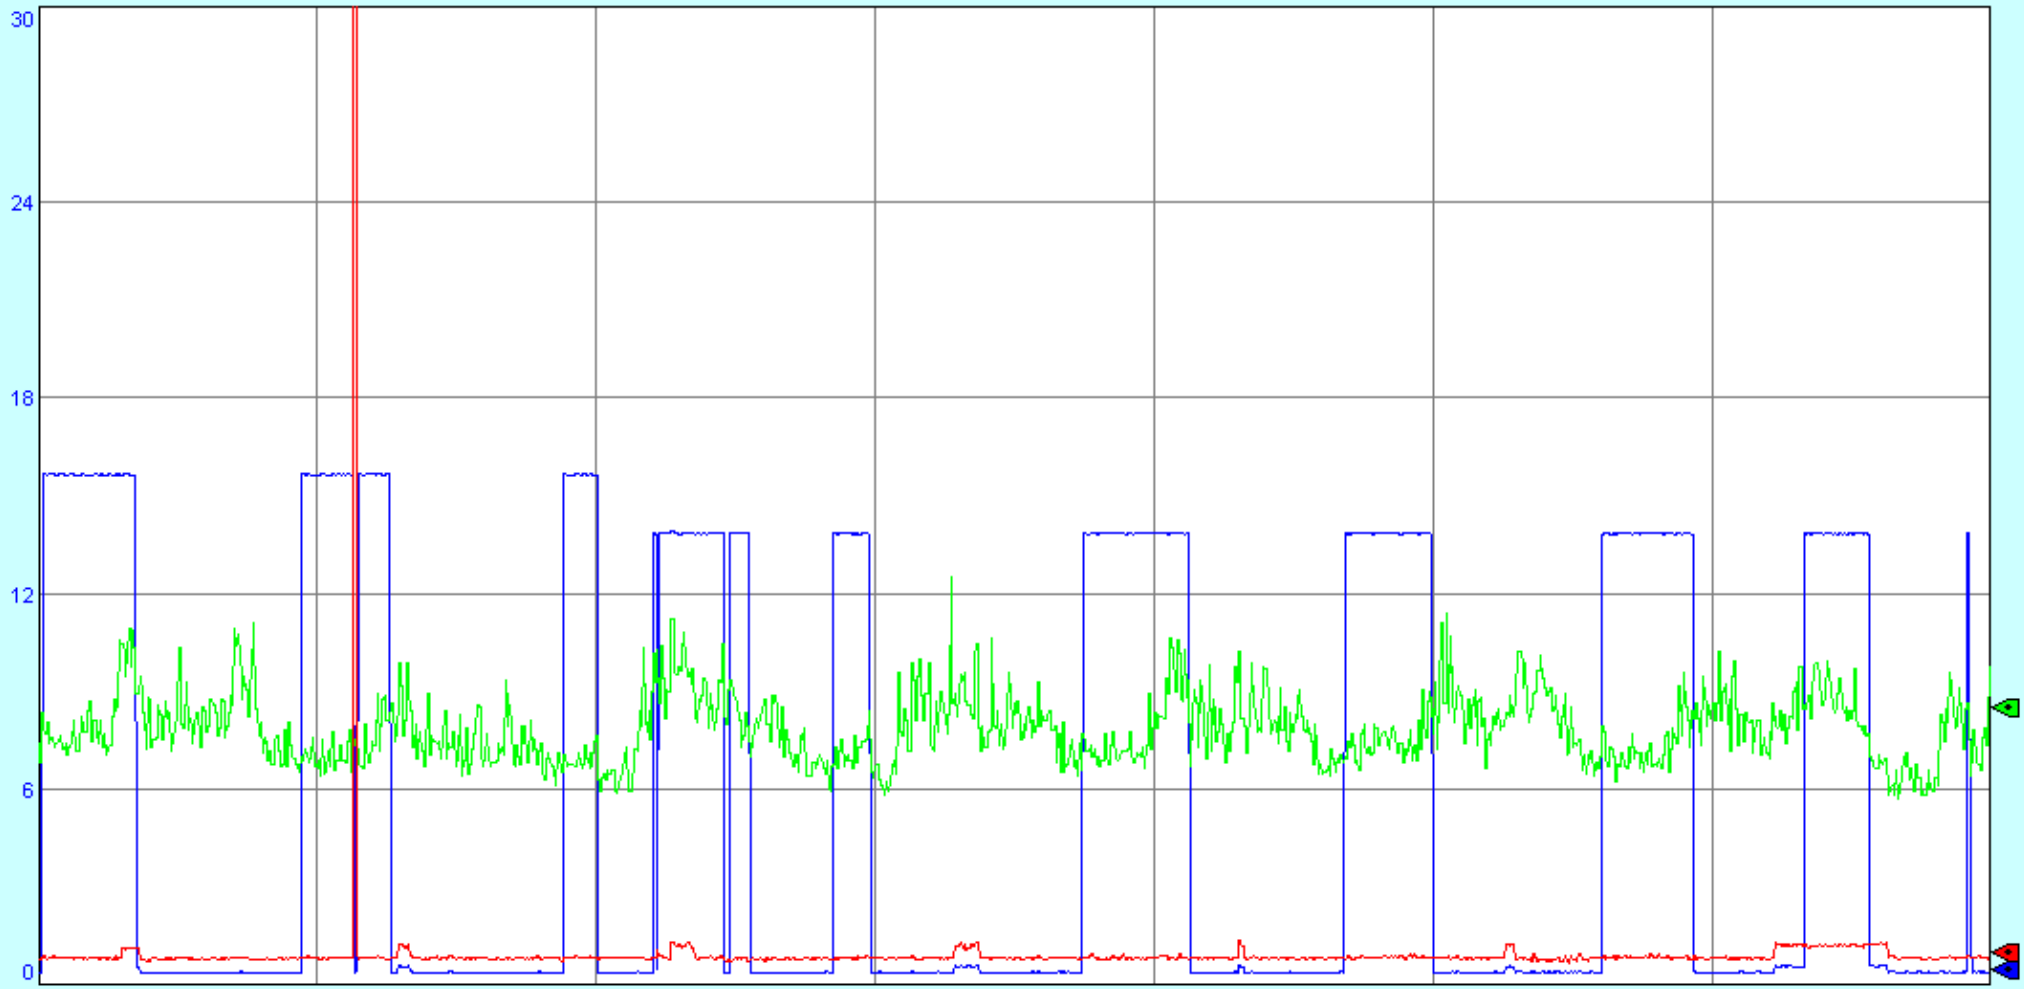


Caption	12:45:45	Min	Max	Units
Treated Water Flow	0	0	30	m3/h
Reservoir Flow	8	0	30	m3/h
Backwash Flow	1	0	30	m3/h

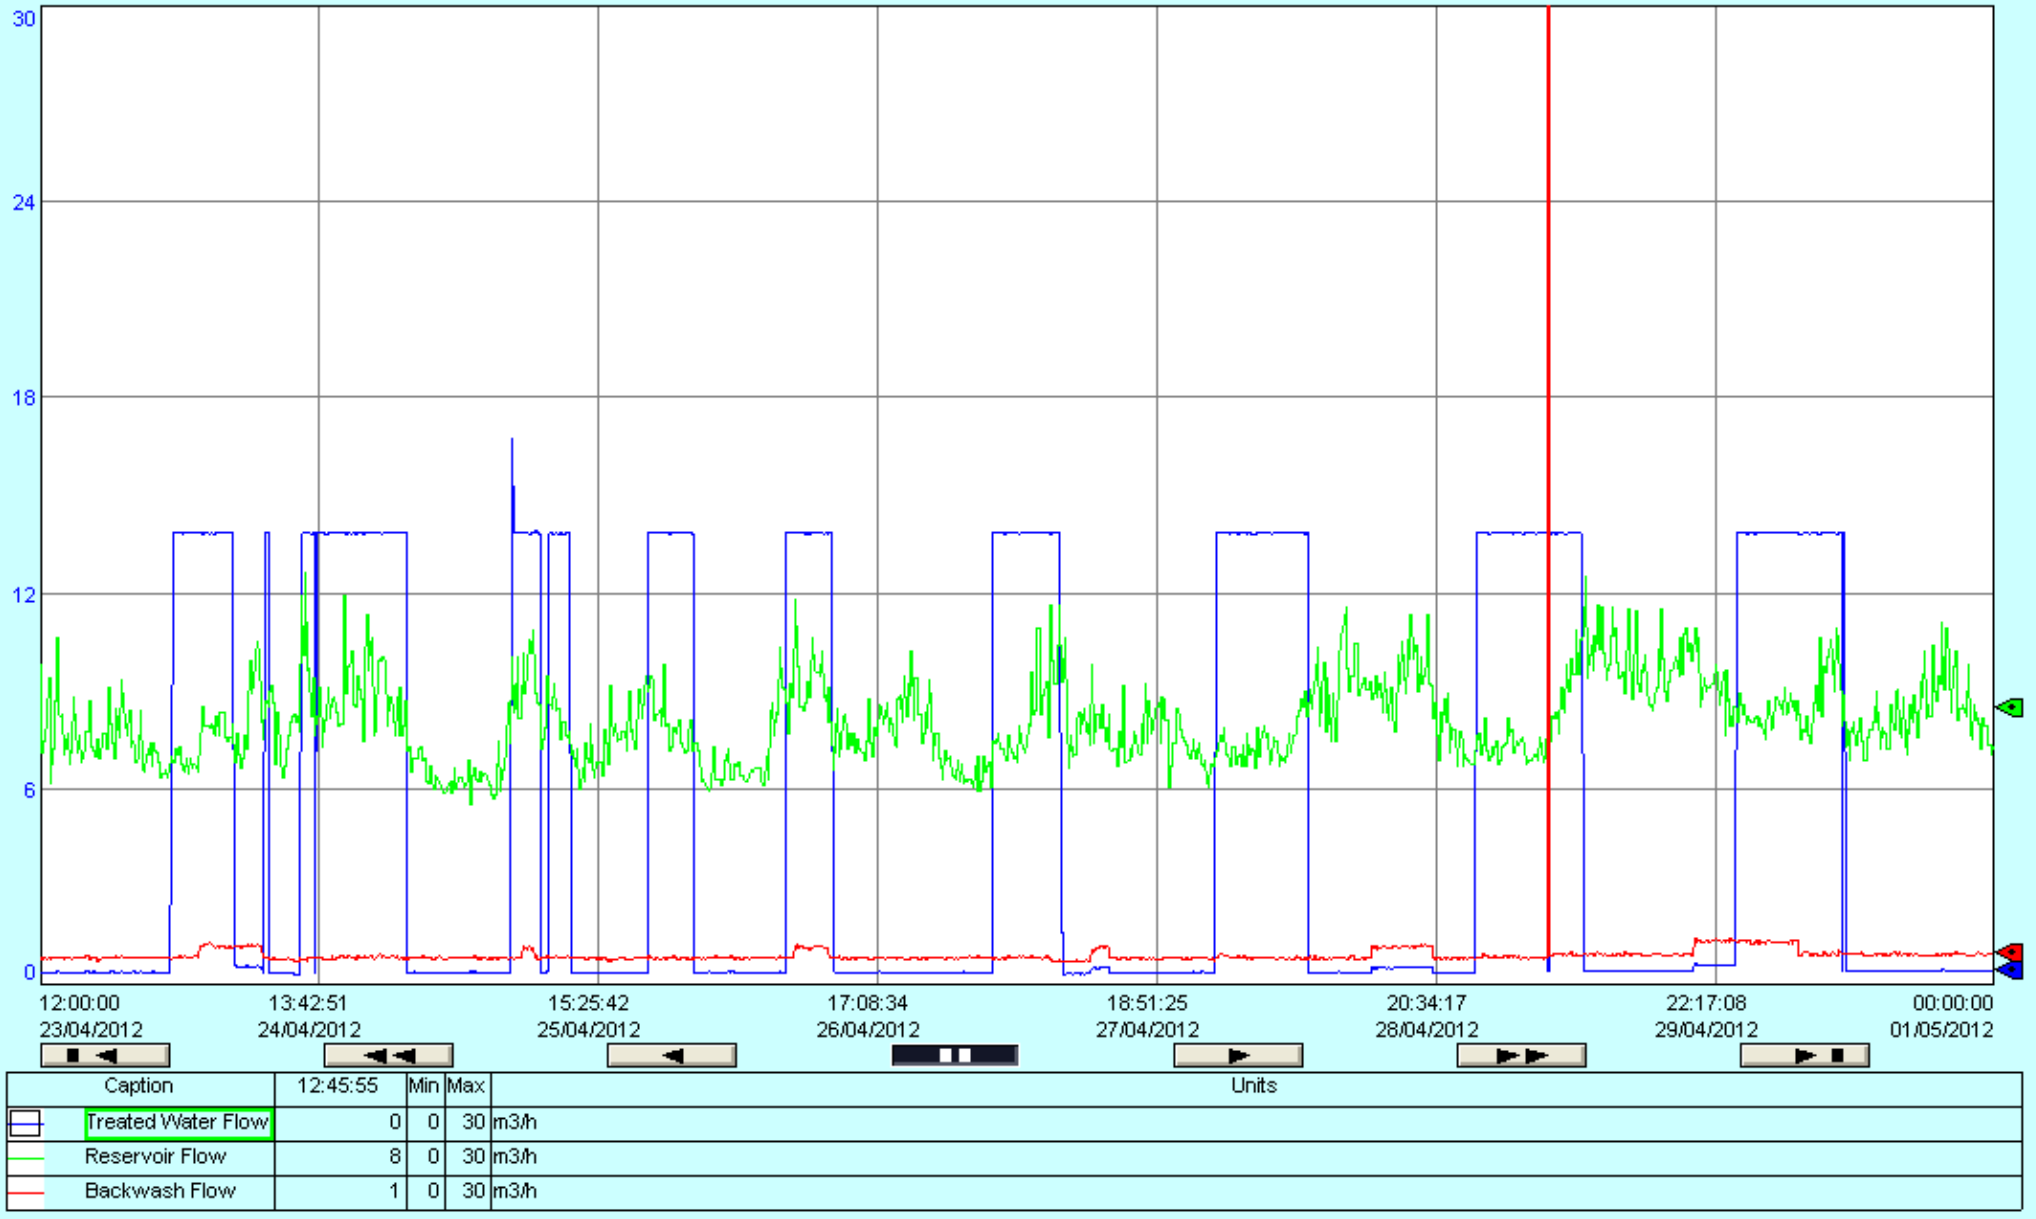



Caption	12:45:55	Min	Max	Units
Treated Water Flow	0	0	30	m3/h
Reservoir Flow	8	0	30	m3/h
Backwash Flow	1	0	30	m3/h

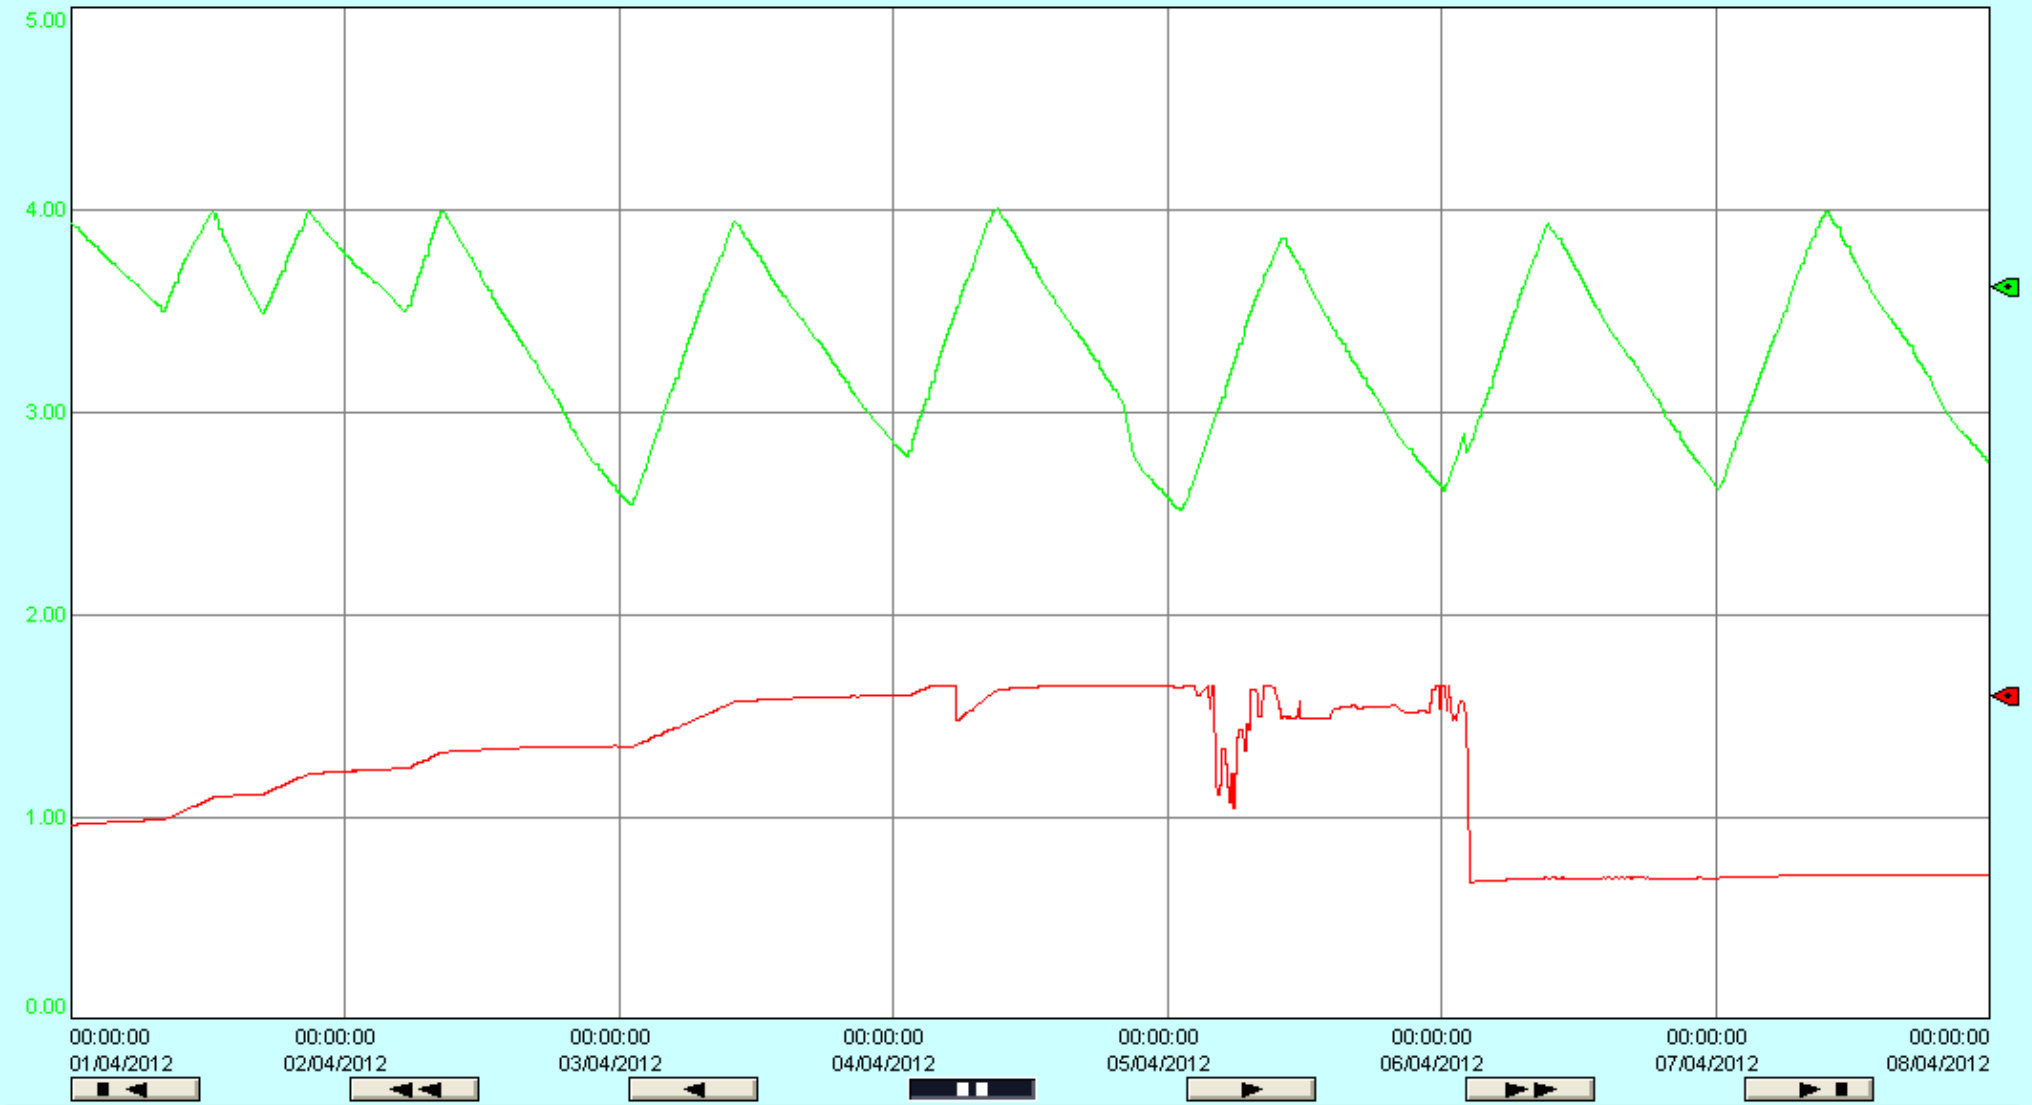

Caption	12:46:40	Min	Max	Units
Reservoir Level	3.63	0.00	5.00	m
Backwash Tank Level	1.60	0.00	5.00	m

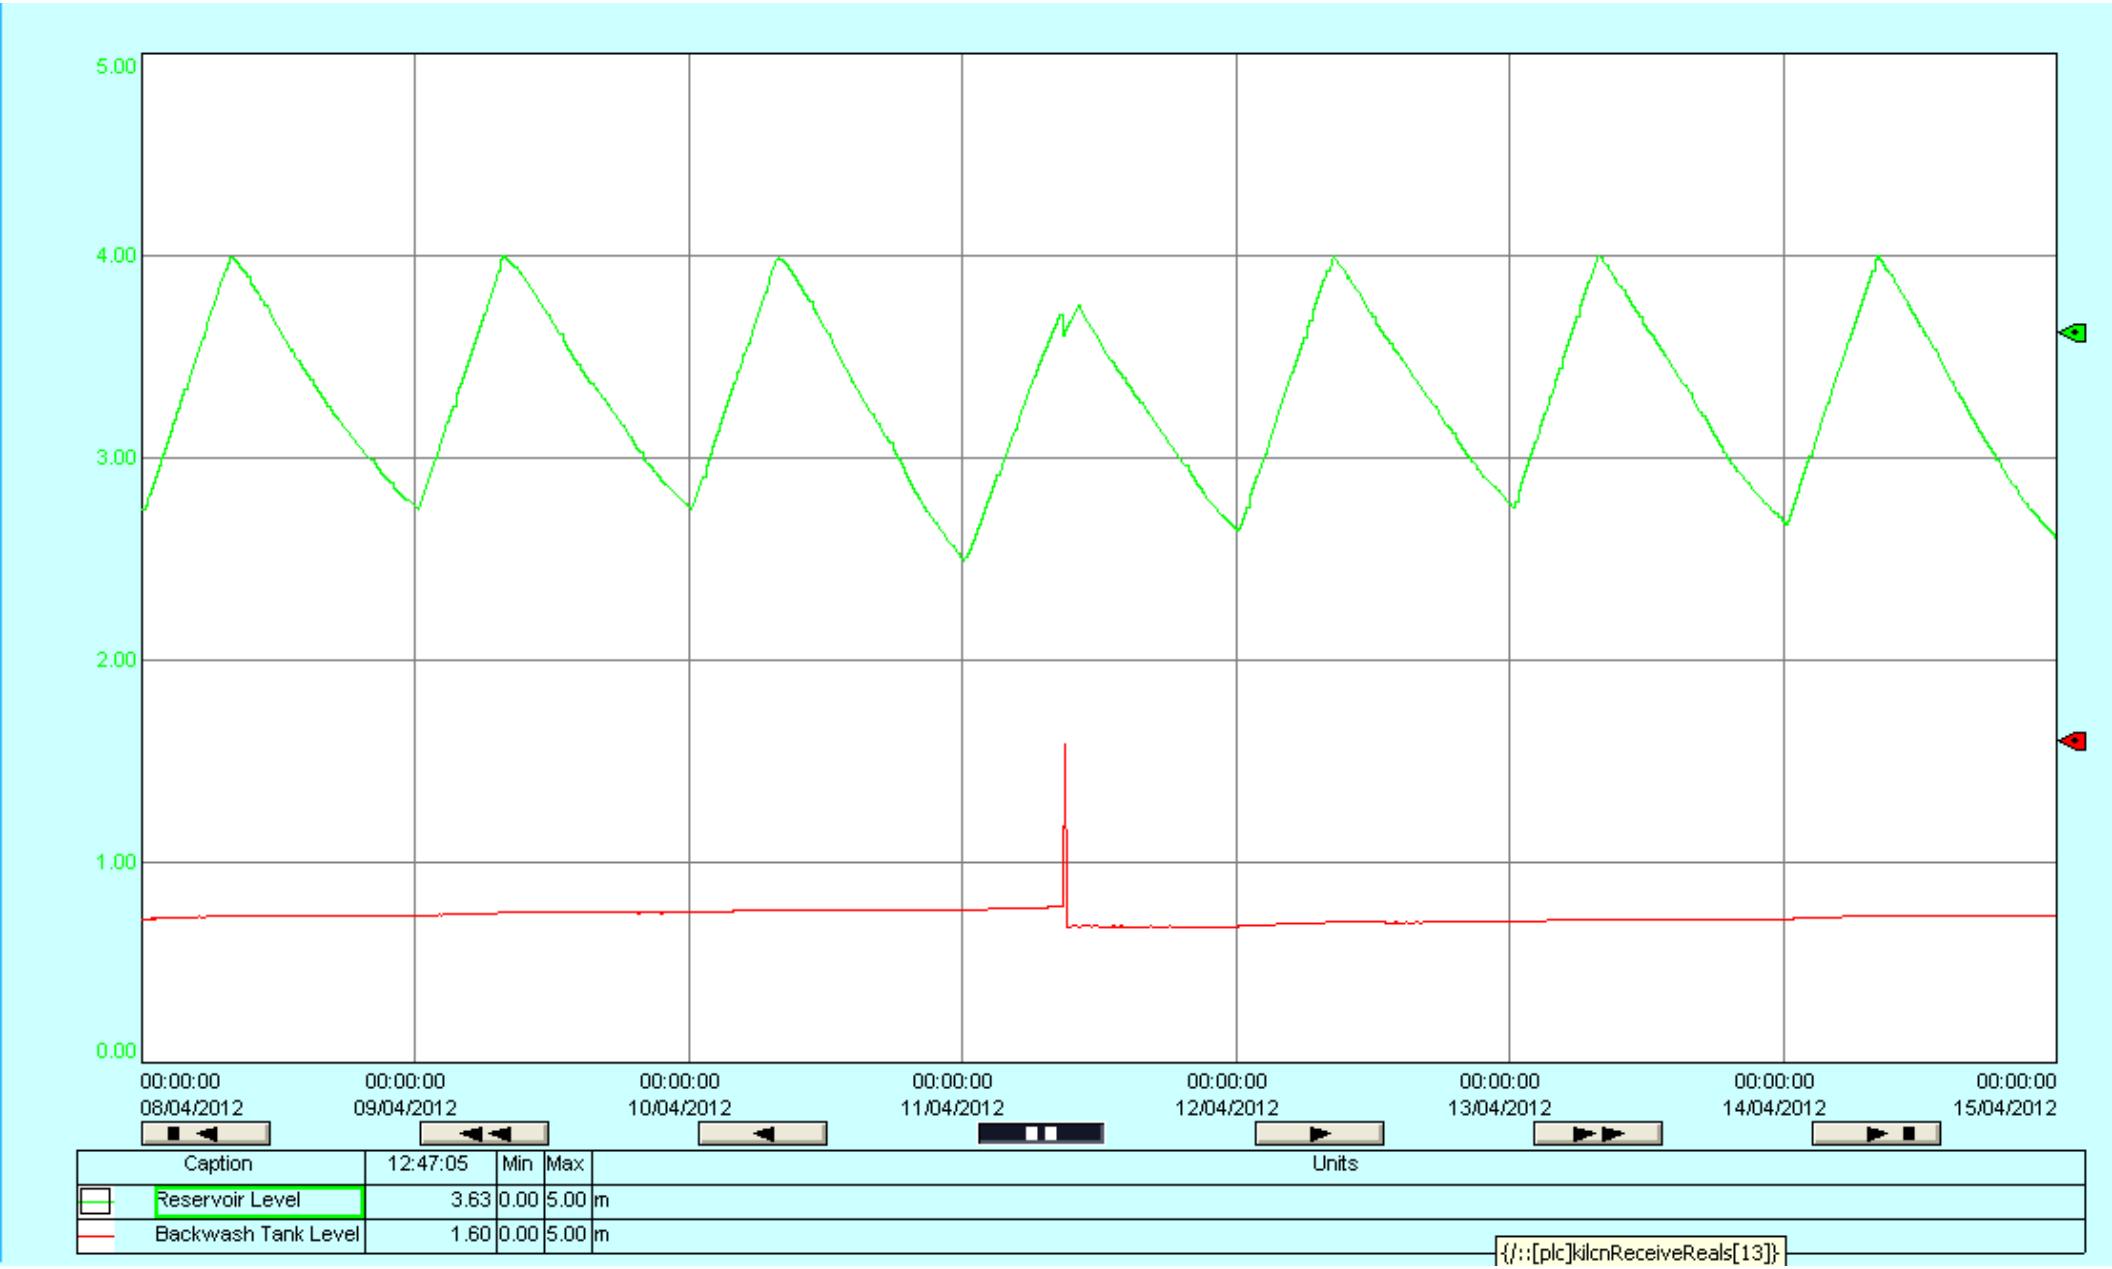

5.00
4.00
3.00
2.00
1.00
0.00
00:00:00 08/04/2012
00:00:00 09/04/2012
00:00:00 10/04/2012
00:00:00 11/04/2012
00:00:00 12/04/2012
00:00:00 13/04/2012
00:00:00 14/04/2012
00:00:00 15/04/2012
Caption | 12:47:05 | Min | Max | Units
Reservoir Level | 3.63 | 0.00 | 5.00 | m
Backwash Tank Level | 1.60 | 0.00 | 5.00 | m
{/::[plc]kilcnReceiveReals[13]}

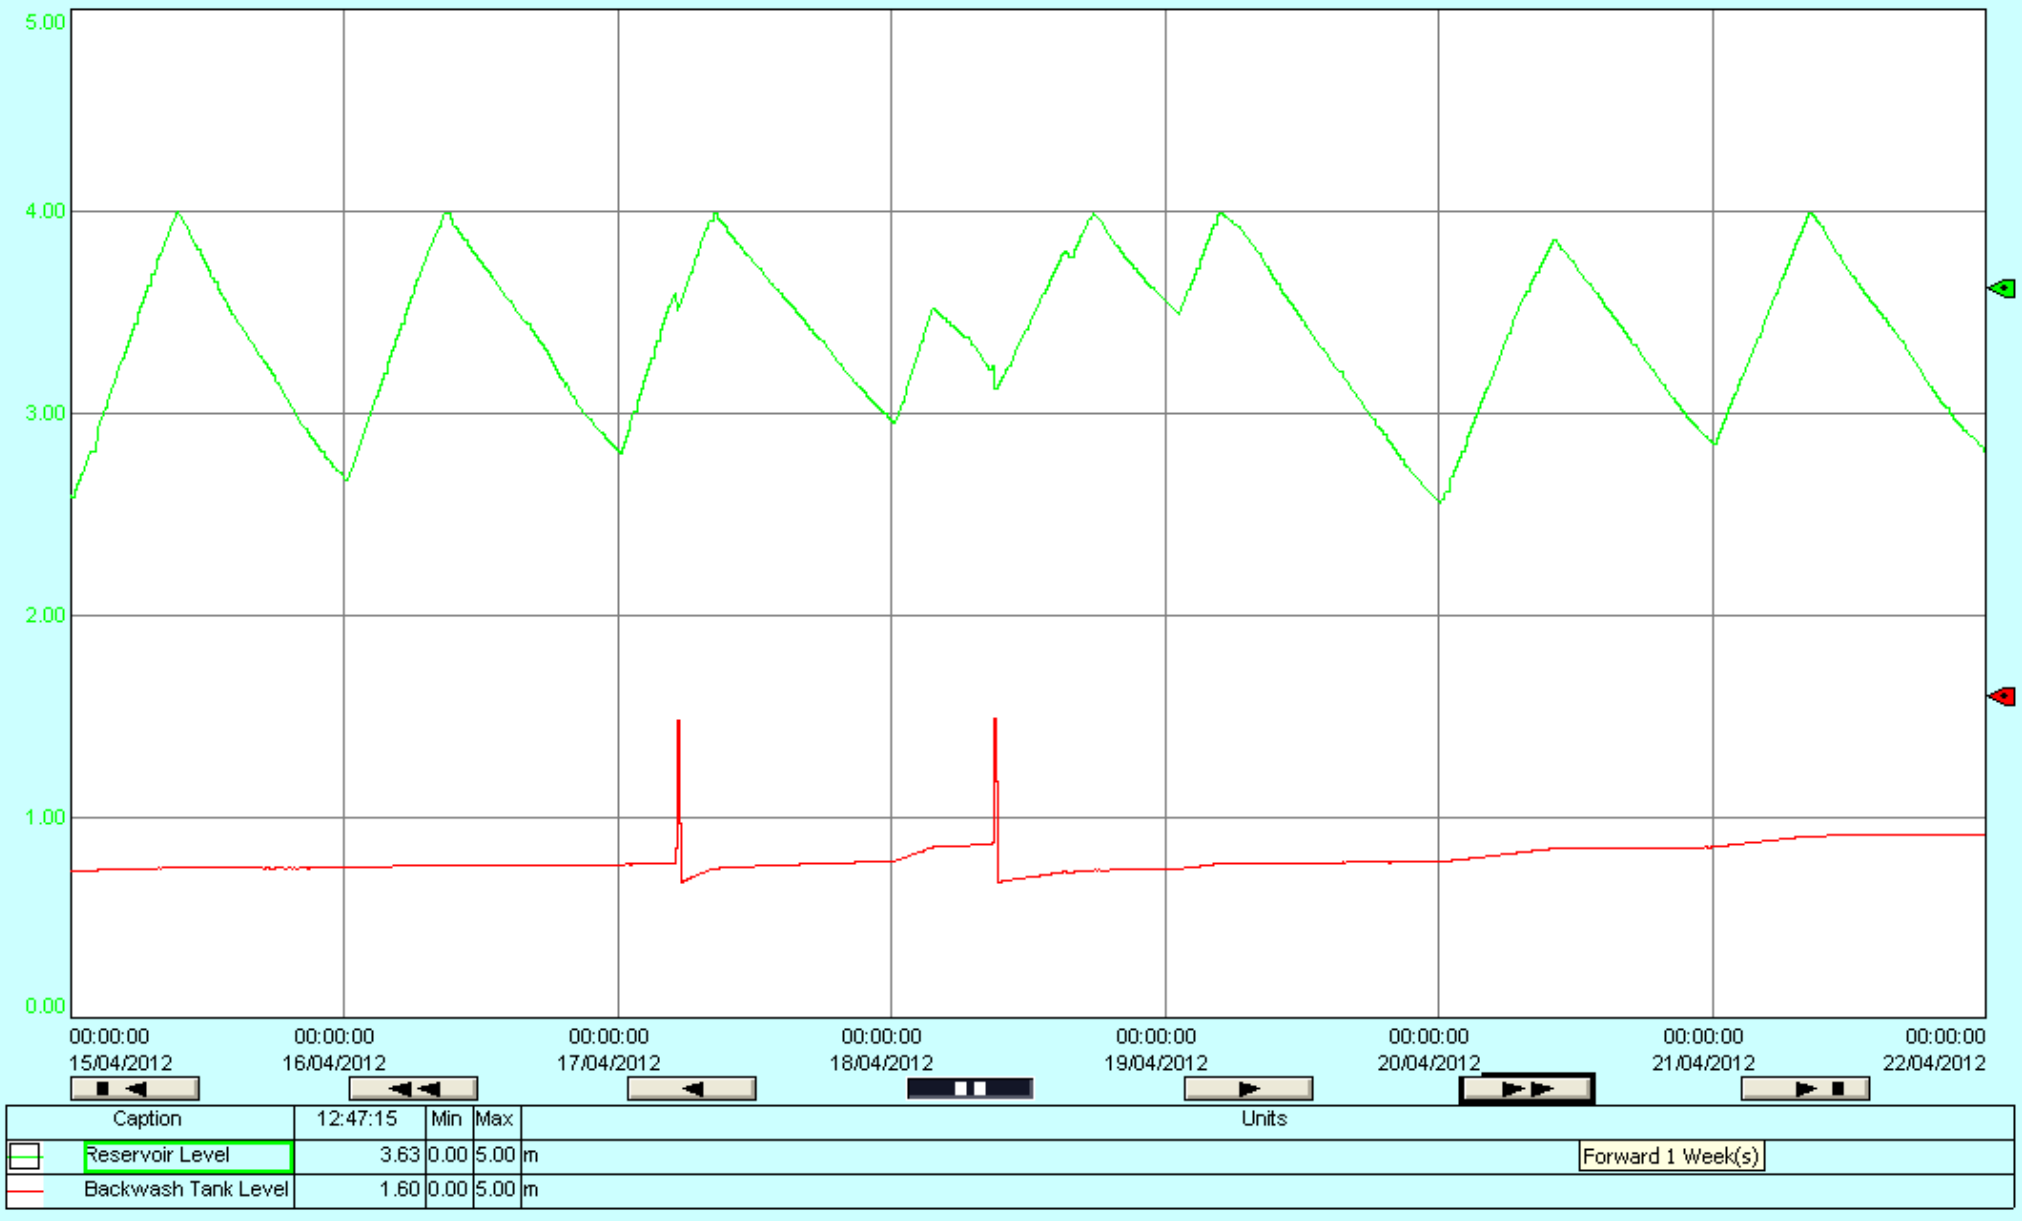
5.00
4.00
3.00
2.00
1.00
0.00
00:00:00 15/04/2012
00:00:00 16/04/2012
00:00:00 17/04/2012
00:00:00 18/04/2012
00:00:00 19/04/2012
00:00:00 20/04/2012
00:00:00 21/04/2012
00:00:00 22/04/2012
Caption
12:47:15
Min
Max
Units
Reservoir Level
3.63
0.00
5.00
m
Backwash Tank Level
1.60
0.00
5.00
m
Forward 1 Week(s)

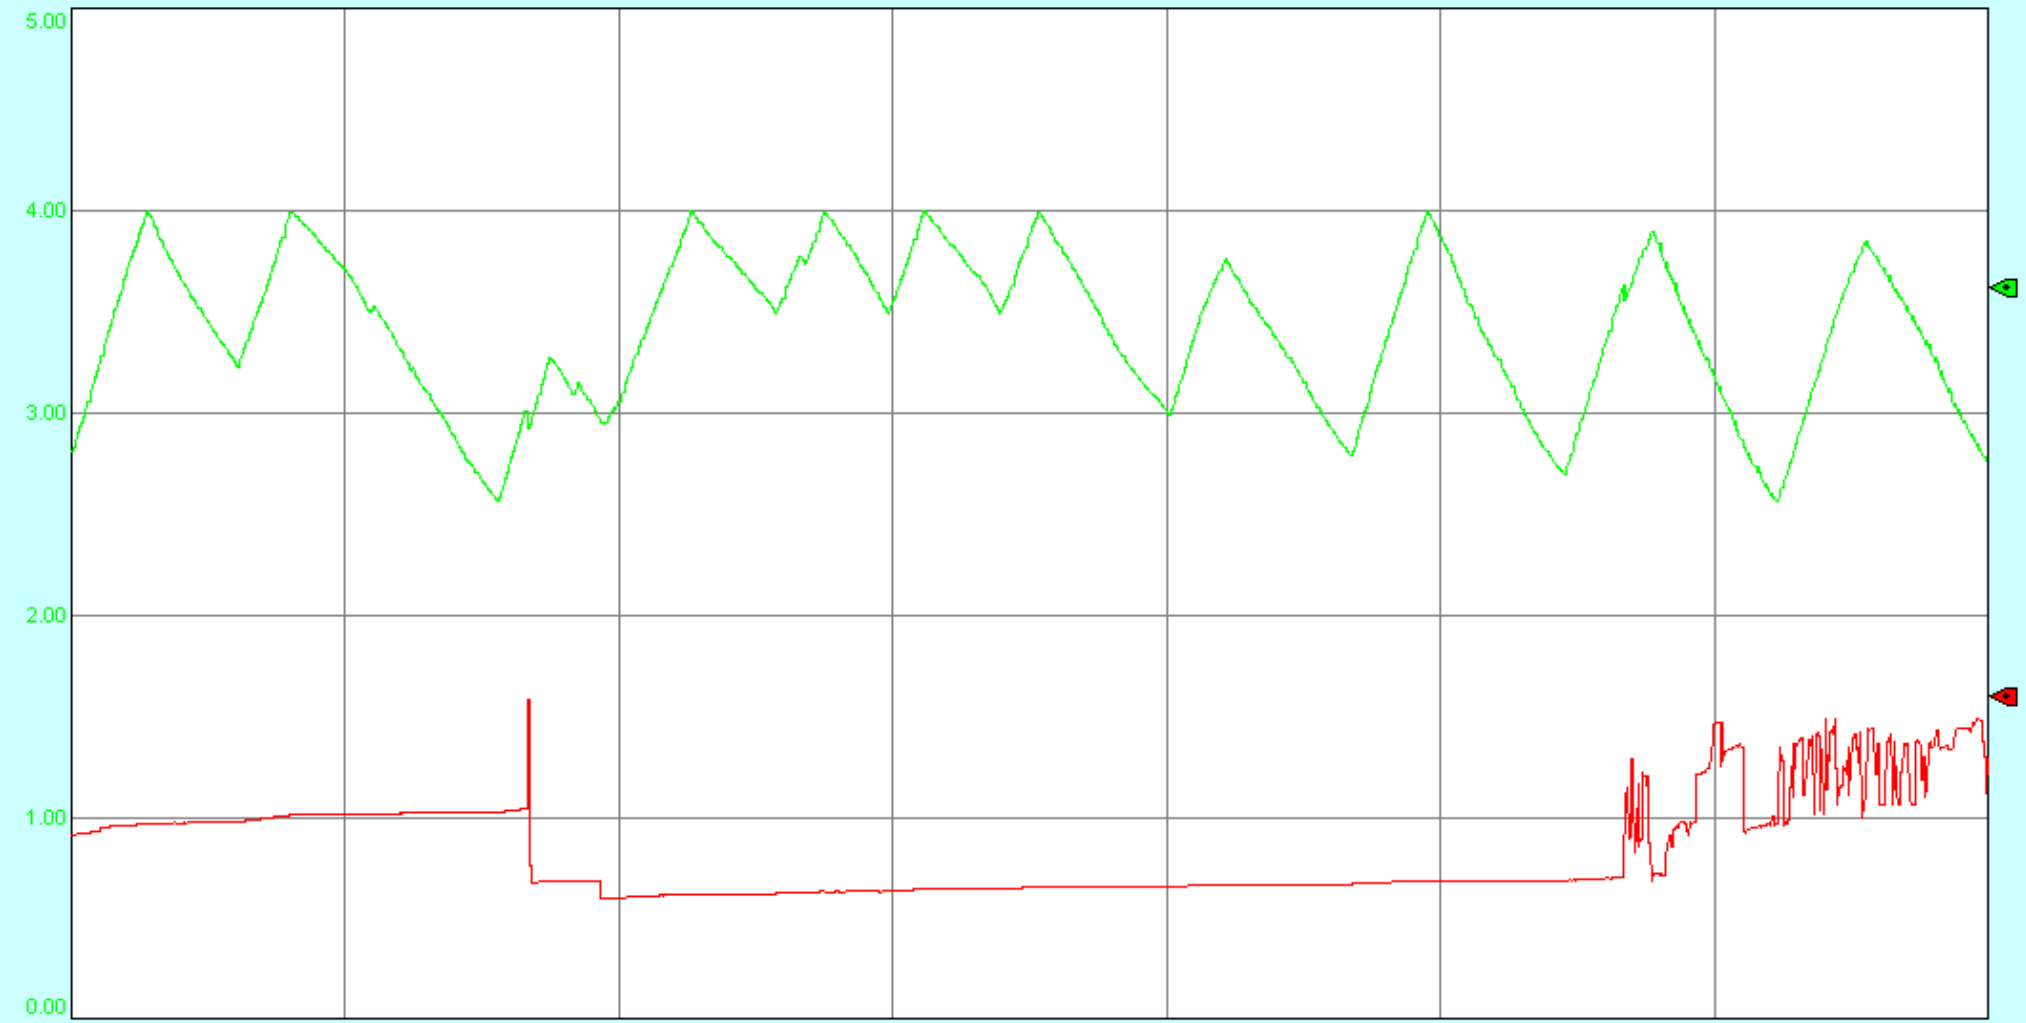


Caption	12:47:35	Min	Max	Units
Reservoir Level	3.63	0.00	5.00	m
Backwash Tank Level	1.60	0.00	5.00	m


Graph of Daily Flows of Raw and Treated Water for April 2012.

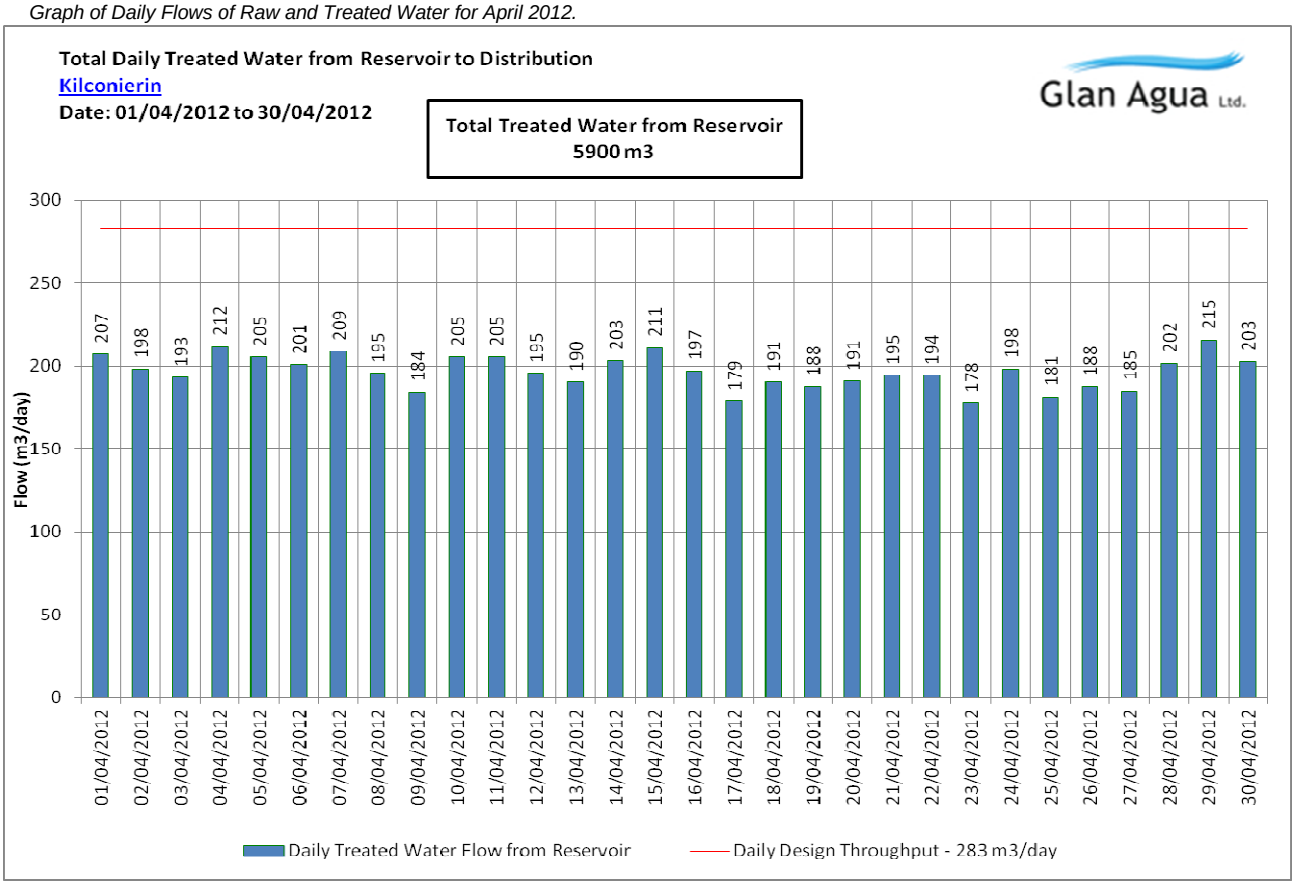


Average Daily Graph of Colour in Raw and Treated Water for April 2012.

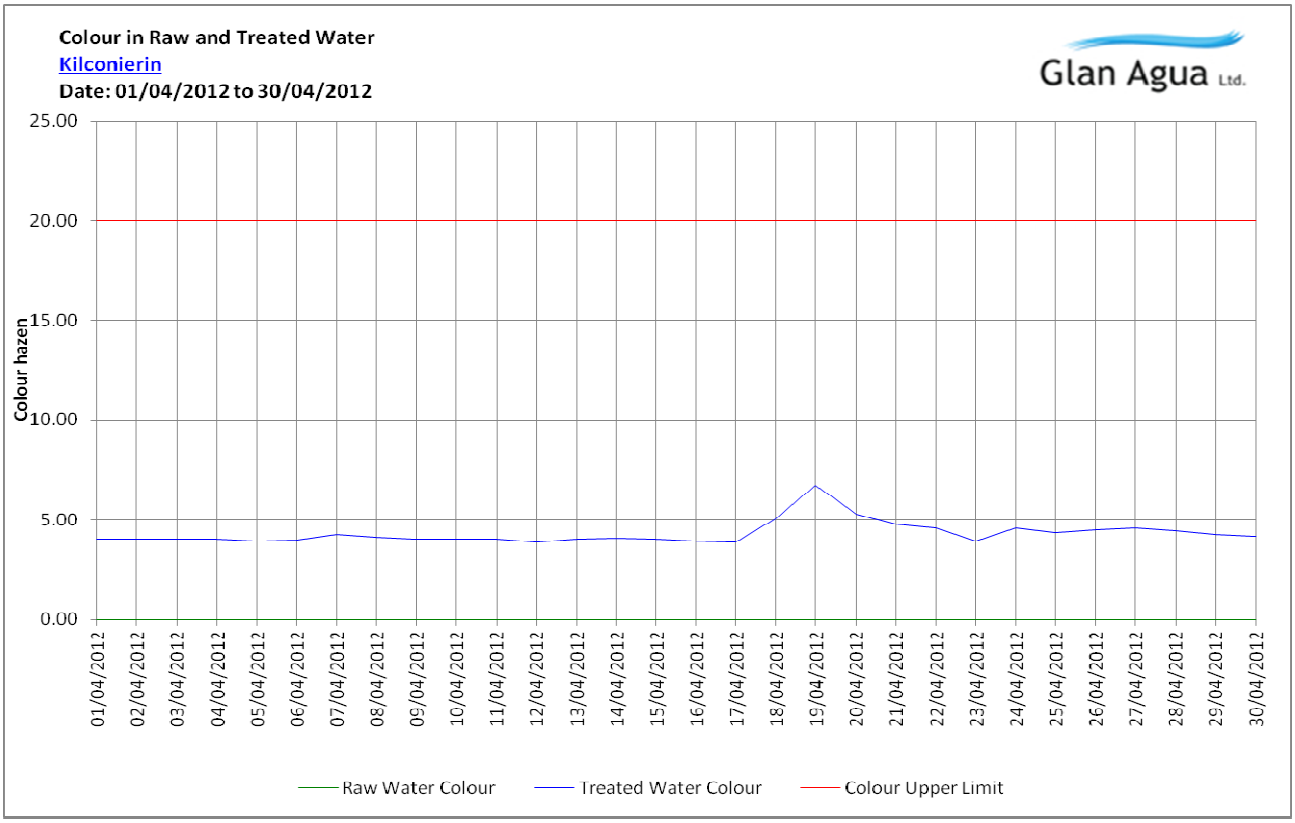


Average Daily Graph of Turbidity in Raw and Treated Water for April 2012.

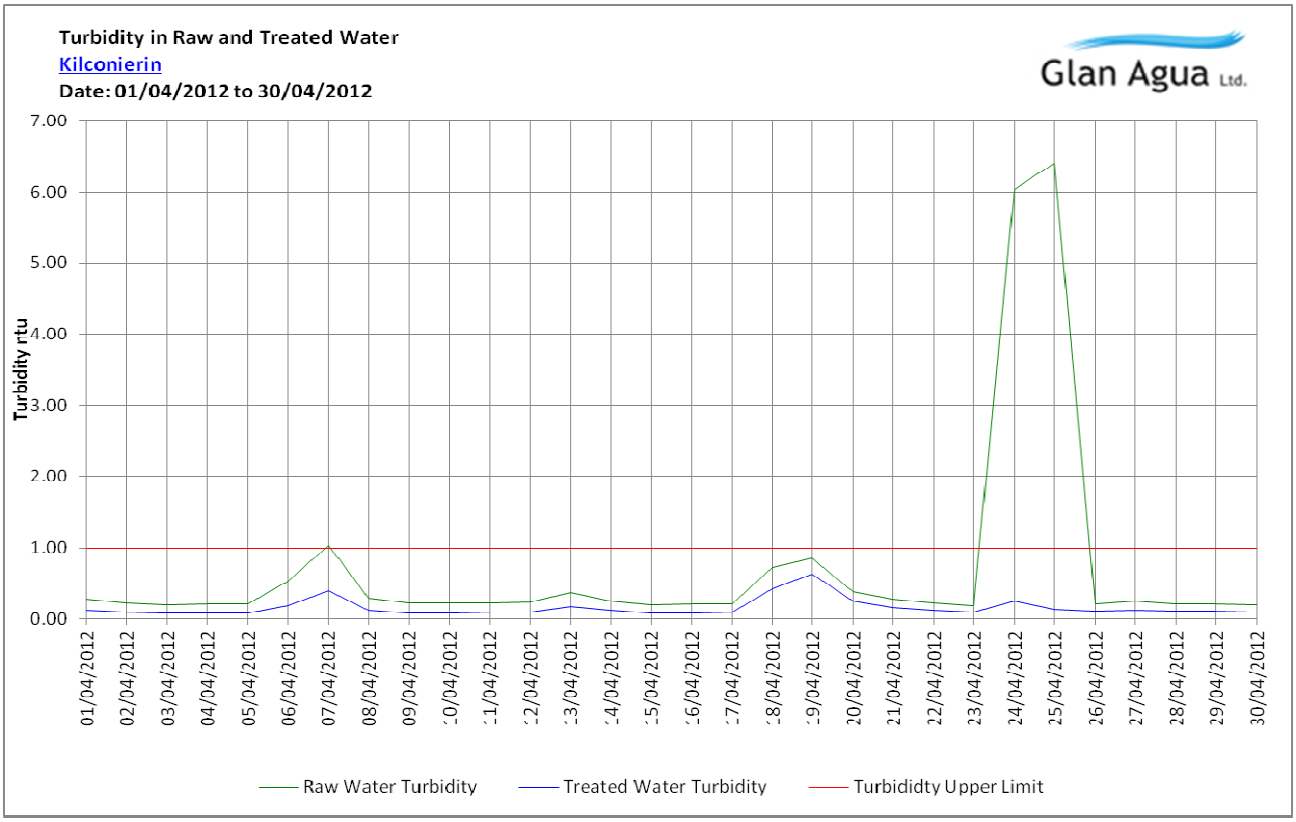

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution for April 2012.

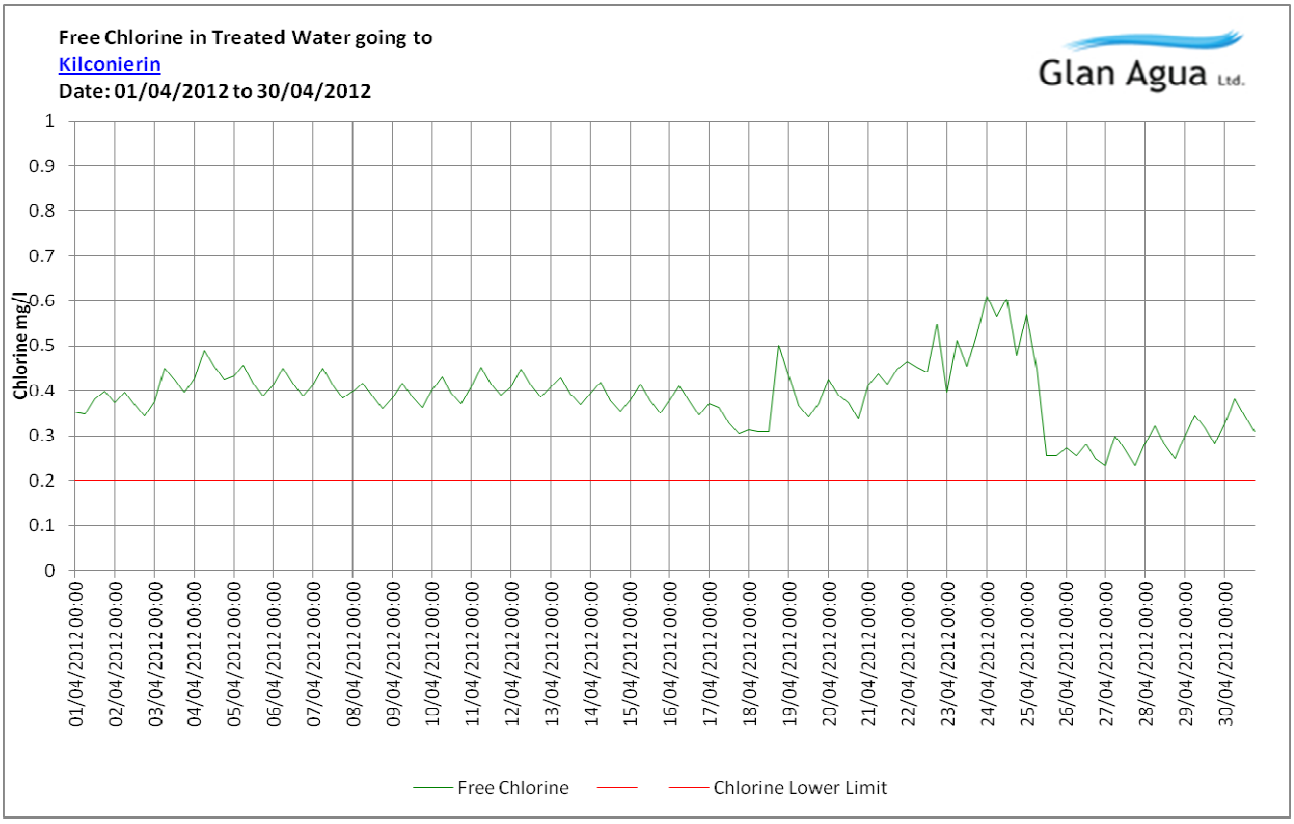

UV in Treated Water going to Distribution for April 2012.

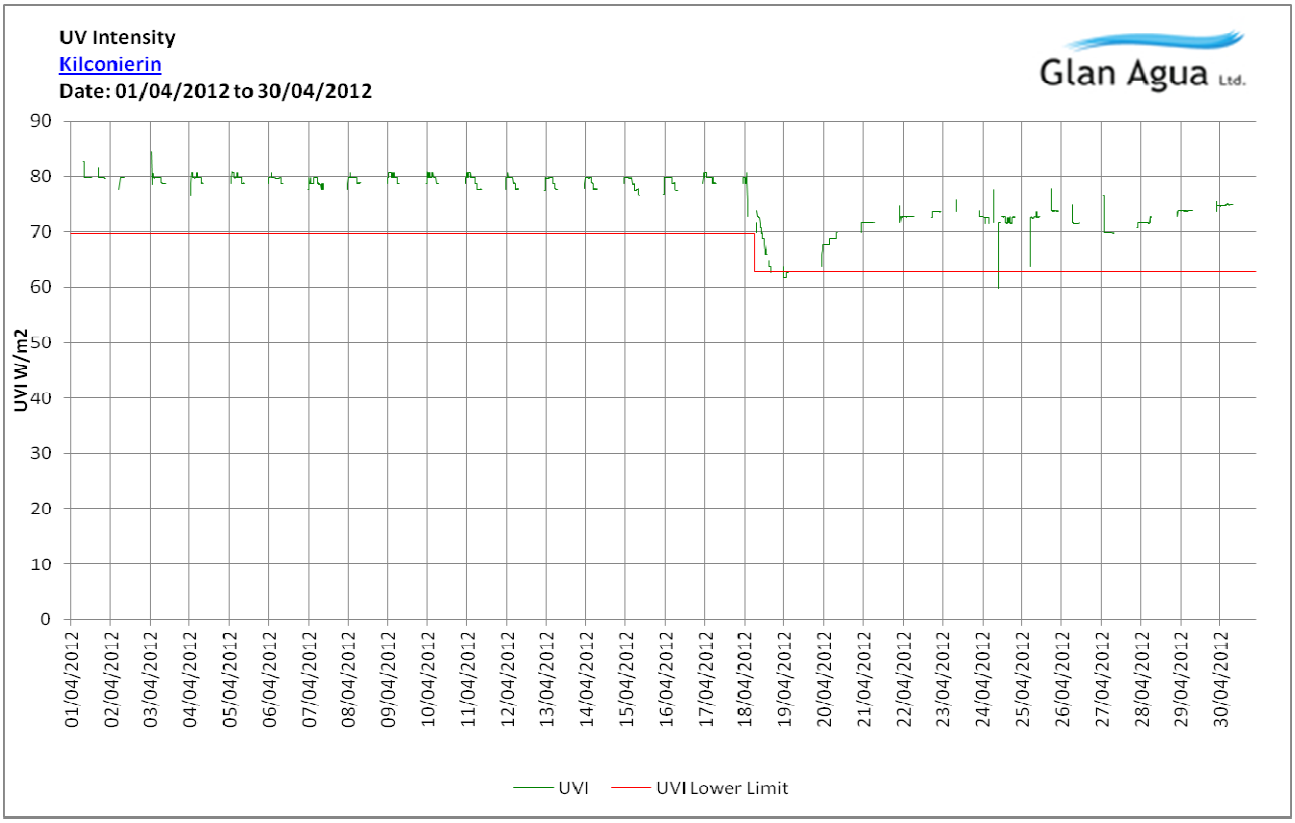

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analythical Results

Category	Report On	Comments
Final water	Quality comparison to contract requirements	Fully compliant with S.I. 278 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 278
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary Date:24/04/2012

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.5
TOC	mg/l	1.8
pH		7.02
Apparent Colour	mg/l PtCo	<5
Fe	ug/l	<7.2
Al	ug/l	<5
Mn	ug/l	<0.7
Treated Water		
Aluminium	ug/l	7
TOC	mg/l	1.6
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	7.04
Fe	ug/l	<7.2
Mn	ug/l	<0.7
Coliform	MPN/100ml	<1
Turbidity	NTU	<0.5

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 6: ***Operator: Stephen Costello***

Process Operational Changes Record

Date	Description of Process Operational Change	Purpose of Process Operatioinal Change	Implemented By
04/04/2012	Lowering plant chlorine	Reservoir cl starting to rise	Stephen Costello
18/04/2012	Increased flow to 15.7m3/hr	Water quality sending UV into fault	Stephen Costello
	.		

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Health & Safety Issues ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

Plant Manager:	Julian Drapiewski	**Date:**	10/05/2012
For Period:	01/04/2012-30/04/2012		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**2**	*Exposure Hours*	**10:35**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Subcontractors

Number of Emplyees	**1**	*Exposure Hours*	0.5		
Subcontractors on Site	City Analysts				
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents					
Days Lost					

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 10: ***Operator: Stephen Costello***

Site Alarm /Incident Record

18/04/2012	08:30	UV Alarm	Stephen Costello	Water quality

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
02/04/2012	Stephen Costello	GA Operator	08:45	09:15	Collecting Data/ Activating nights
04/04/2012	Stephen Costello	GA Operator	08:40	09:00	Process change
05/04/2012	Stephen Costello	GA Operator	15:10	15:15	Adjusting night regeime
18/04/2012	Stephen Costello	GA Operator	08:30	09:20	Callout
18/04/2012	Stephen Costello	GA Operator	14:55	16:10	Top up chlorine, 200 ltrs, 3:1 mix
20/04/2012	Stephen Costello	GA Operator	14:00	14:15	Checks
24/04/2012	Aidan O'Malley	GA Operator	12:55	13:15	Sampling
24/04/2012	Maurice Daffy	City Analysts	12:55	13:15	Sampling
24/04/2012	Stephen Costello	GA Operator	11:00	17:00	Cleaning and Maintanance
30/04/2012	Stephen Costello	GA Operator	13:15	13:55	Ckecks + Calibration

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	24/04/2012	***Sample No:***	125493
Analyst	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	0	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	24/04/2012	125492
City Analysts	Kilconierin Treated Water	24/04/2012	125493

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

ISO 17025 INAB ACCREDITED TESTING DETAILED IN SCOPE REG NO. 138T

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-02345-GAL
Report Version: 1

Report Date: 08/05/2012

Customer PO No.: GA11-27-0011
Chain of Custody No.:

Certificate Of Analysis

Analysis of 1 sample(s) submitted on 08/05/2012 is now complete.
We have the pleasure of enclosing your certificate of analysis.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our web site at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Melissa Brady

Date: 08/05/2012

Authorised Signatories:
Dublin : Miriam Byrne, Melissa Brady, Maria Nevin, Leann Hession,
Slawek Gryczewski, Ewa Krol, Dariusz Bartoszewicz, Stephen Crampton.
Limerick: Hugh O'Donnell, Maurice Daffy, Sylwia Wojtowicz.
Note: Information on methods of analysis and performance characteristics is available on request.

Note: Results relate only to the items tested.

Test report shall not be reproduced except in full or with written approval of City Analysts Ltd.

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-02345-GAL
Report Version: 1
Date Received: 24/04/2012

Sample Description: Raw Kilconierin Water
Sample Type: Raw Water
Date Sampled: 24/04/2012
Lab Reference Number: 125492

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3001	26/04/2012	Aluminium, Total	<5	ug/l	-	INAB
D/3000	30/04/2012	Ammonia as N	<0.01	mg/l	-	INAB
D/3000	30/04/2012	Chloride	15.28	mg/l	-	INAB
D/1220	24/04/2012	Clostridium perfringens	0	cfu/100ml	-	NON
D/3010	30/04/2012	Colour,Apparent	<5	Hazen	-	NON
D/1201	24/04/2012	Coliforms	920.8	MPN/100ml	-	INAB
SUBC		Dissolved Organic Carbon	2.10	mg/l	-	UKAS
D/1201	24/04/2012	E.coli	46.0	MPN/100ml	-	INAB
D/3001	26/04/2012	Iron, Total	<7.2	ug/l	-	INAB
D/3001	26/04/2012	Manganese, Total	<0.7	ug/l	-	INAB
D/3000	30/04/2012	Nitrite as N	<0.005	mg/l	-	INAB
D/3000	30/04/2012	Nitrate as N	<2	mg/l	-	INAB
D/1041	24/04/2012	pH	7.02	pH Units	-	INAB
D/3001	26/04/2012	Potassium	2.2	mg/l	-	INAB
D/3001	26/04/2012	Sodium	7.500	mg/l	-	INAB
SUB C		Total organic carbon	1.80	mg/l	-	UKAS
D/3054	30/04/2012	Turbidity	<0.5	NTU	-	INAB

Note:
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

ISO 17025 INAB ACCREDITED TESTING DETAILED IN SCOPE REG NO. 138T

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-02346-GAL
Report Version: 1

Report Date: 08/05/2012

Customer PO No.: GA11-27-0011
Chain of Custody No.:

Certificate Of Analysis

Analysis of 1 sample(s) submitted on 08/05/2012 is now complete.
We have the pleasure of enclosing your certificate of analysis.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our web site at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Melissa Brady

Date: 08/05/2012

Authorised Signatories:
Dublin : Miriam Byrne, Melissa Brady, Maria Nevin, Leann Hession,
Slawek Gryczewski, Ewa Krol, Dariusz Bartoszewicz, Stephen Crampton.
Limerick: Hugh O'Donnell, Maurice Daffy, Sylwia Wojtowicz.
Note: Information on methods of analysis and performance characteristics is available on request.
Note: Results relate only to the items tested.

Test report shall not be reproduced except in full or with written approval of City Analysts Ltd.

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-02346-GAL
Report Version: 1
Date Received: 24/04/2012

Sample Description: Treated Kilconierin Water
Sample Type: Treated Water
Date Sampled: 24/04/2012
Lab Reference Number: 125493

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3001	26/04/2012	Aluminium, Total	7	ug/l	200 µg/l	INAB
D/1220	24/04/2012	Clostridium perfringens	0	cfu/100ml	0/100mls	NON
D/3010	30/04/2012	Colour,Apparent	<5	Hazen	NAC & ATC	NON
D/1201	24/04/2012	Coliforms	<1.0	MPN/100ml	0/100mls	INAB
SUBC		Dissolved Organic Carbon	2.10	mg/l		UKAS
D/1201	24/04/2012	E.coli	<1.0	MPN/100ml	0/100mls	INAB
D/3001	26/04/2012	Iron, Total	<7.2	ug/l	200 µg/l	INAB
D/3001	26/04/2012	Manganese, Total	<0.7	ug/l	50 µg/l	INAB
D/1041	24/04/2012	pH	7.04	pH Units	6.5 - 9.5	INAB
L/1016	03/05/2012	Chloroform	2.95	ug/l		INAB
L/1016	03/05/2012	Bromodichloromethane	6.041	ug/l		INAB
L/1016	03/05/2012	Chlorodibromomethane	9.534	ug/l		INAB
L/1016	03/05/2012	Bromoform	3.711	ug/l		INAB
L/1016	03/05/2012	Total THM	22.236	ug/l	100 µg/l	INAB
SUB C		Total organic carbon	1.60	mg/l		UKAS
D/3054	30/04/2012	Turbidity	<0.5	NTU	NAC & ATC	INAB
		UV Transmissivity	76.2	%		NON


Note:
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

Glan Agua Ltd.

Enterprise & Technology Centre
Creagh Road,
Ballinasloe,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

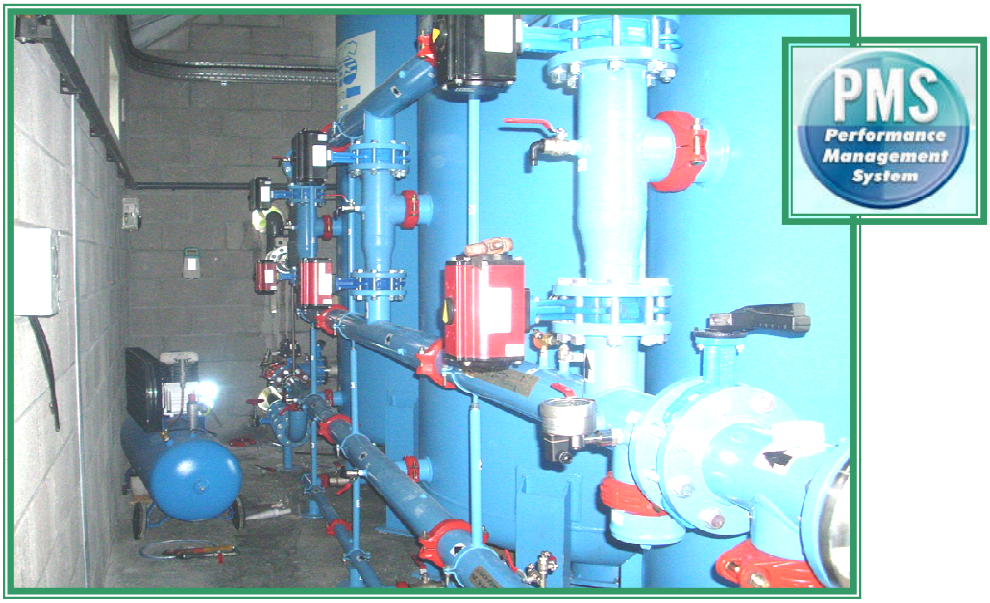

Glan Agua Ltd. is fully accredited to:

Contract:	**Galway GWS DBO**
Plant:	**Kilconierin GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**8-2012 (11)**
Operational Period:	**1 August 2012/31 August 2012**
Prepared by:	**Julian Drapiewski**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP
NATIONAL DEVELOPMENT PLAN

wsntg

National Federation of Group Water Schemes

Printed:12/09/2012

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Sumary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analythical Results**	
Section 6:	**Process Operational Changes Record**	- N/A
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	
Section 9:	**Complaint Record**	- N/A
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	- N/A
Section 13:	**Equipment Service Record**	- N/A
Section 14:	**Plant Maintenance Schedule Report**	- N/A
Section 15:	**Non-Sludge Waste Disposal Record**	- N/A
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	- N/A
Section 18:	**Emergency Event Record**	- N/A
Section 19:	**Random Analysis by Employer**	- N/A

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	August 2012	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 278 of 2007 and Employer's Requirements.
Report No.:	8-2012	
Number of Reports To Date Including This One	11	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.7-2012 is for August 2012.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the Operational Period

- Treatment plant provided treated water to the required standard at all times; no non-compliances recorded

- Presistant heavy rainfall over the duration of the month resulted in a significant drop in UV Intensity. The flow through the plant was reduced in order to maintain validation. However due to excess poor water quality on occasions it was not possible to maintain validation. On these occasions the Employees Repersentative was contacted.

- The UV reactor in Kilconierin Water Treatment Plant is too small to comply with UV validation conditions. Glan Agua has requested instruction from the Employers Represenative on how to proceed in this regard.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Sumary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	Generally dry, however there was periods of heavy rainfall. Temperature between 9℃ to 14 °C
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Treated and distributed to public	cubic meters	**3378m^3**
Analyticall Results	results in or out of specs	all on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	none recorded
Alarm Callouts	what they were	1 no. callouts: See section 10 for more details
Heath & Safety Issues	what since last report or	none recorded
Equipment	taken off line and why or placed into service	none.
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present it water.
Other	Outstanding works	Outstanding civil finishing works were addressed. The outstanding M&E/process works as listed in Section 8 - *Outstanding Exceptions Report* to be addressed in the coming weeks.

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for August 2012.

Date	Colour	Turbidity (NTU)	
	treated	raw	treated
01/08/2012	3.16	0.31	0.17
02/08/2012	3.59	0.21	0.10
03/08/2012	3.53	0.20	0.09
04/08/2012	3.45	0.20	0.09
05/08/2012	3.85	0.29	0.18
06/08/2012	5.29	0.72	0.57
07/08/2012	4.08	0.28	0.17
08/08/2012	3.70	0.22	0.11
09/08/2012	3.65	0.22	0.10
10/08/2012	3.67	0.22	0.10
11/08/2012	3.64	0.22	0.10
12/08/2012	3.62	0.23	0.10
13/08/2012	4.79	0.48	0.35
14/08/2012	7.78	1.15	0.98
15/08/2012	3.82	0.49	0.36
16/08/2012	4.79	0.61	0.46
17/08/2012	3.60	0.34	0.21
18/08/2012	3.16	0.29	0.17
19/08/2012	2.85	0.25	0.12
20/08/2012	2.62	0.22	0.11
21/08/2012	2.55	0.24	0.11
22/08/2012	2.45	0.22	0.09
23/08/2012	2.42	0.21	0.08
24/08/2012	2.51	0.22	0.08
25/08/2012	2.52	0.22	0.09
26/08/2012	2.70	0.24	0.11
27/08/2012	2.67	0.21	0.09
28/08/2012	2.57	0.22	0.08
29/08/2012	2.51	0.21	0.08
30/08/2012	2.44	0.21	0.09
31/08/2012	2.49	0.33	0.16

Turbidity Limit (NTU):	1
Colour Limit (mg/l Pt Co) :	20

Monthly Status Report *Contract: Galway GWS DBO*


Plant: Kilconierin GWS

Section 3: *Operator: Stephen Costello*


Tabular Data Presentation

Daily averages of Free Chlorine in Final Water for August 2012.


Day | Time	06:00:00	12:00:00	18:00:00	23:59:59
01/08/2012	0.44	0.43	0.38	0.35
02/08/2012	0.41	0.48	0.43	0.39
03/08/2012	0.41	0.44	0.39	0.41
04/08/2012	0.37	0.38	0.34	0.31
05/08/2012	0.35	0.40	0.34	0.31
06/08/2012	0.32	0.30	0.31	0.31
07/08/2012	0.45	0.31	0.32	0.29
08/08/2012	0.24	0.24	0.32	0.35
09/08/2012	0.33	0.35	0.30	0.26
10/08/2012	0.32	0.42	0.37	0.33
11/08/2012	0.39	0.48	0.43	0.38
12/08/2012	0.43	0.50	0.44	0.41
13/08/2012	0.43	0.44	0.37	0.33
14/08/2012	0.30	0.23	0.32	0.47
15/08/2012	0.57	0.57	0.55	0.32
16/08/2012	0.37	0.31	0.29	0.28
17/08/2012	0.33	0.26	0.29	0.30
18/08/2012	0.33	0.31	0.42	0.27
19/08/2012	0.67	0.40	0.28	0.65
20/08/2012	0.69	0.45	0.40	0.33
21/08/2012	0.41	0.56	0.49	0.44
22/08/2012	0.46	0.50	0.44	0.39
23/08/2012	0.43	0.45	0.39	0.35
24/08/2012	0.38	0.43	0.38	0.34
25/08/2012	0.40	0.47	0.41	0.37
26/08/2012	0.40	0.44	0.38	0.34
27/08/2012	0.38	0.46	0.42	0.35
28/08/2012	0.39	0.39	0.33	0.30
29/08/2012	0.31	0.34	0.31	0.26
30/08/2012	0.27	0.33	0.28	0.24
31/08/2012	0.25	0.27	0.25	0.54
Lower Limit:		**0.2** mg/l Cl		
Upper Limit:		**0.7** mg/l Cl		

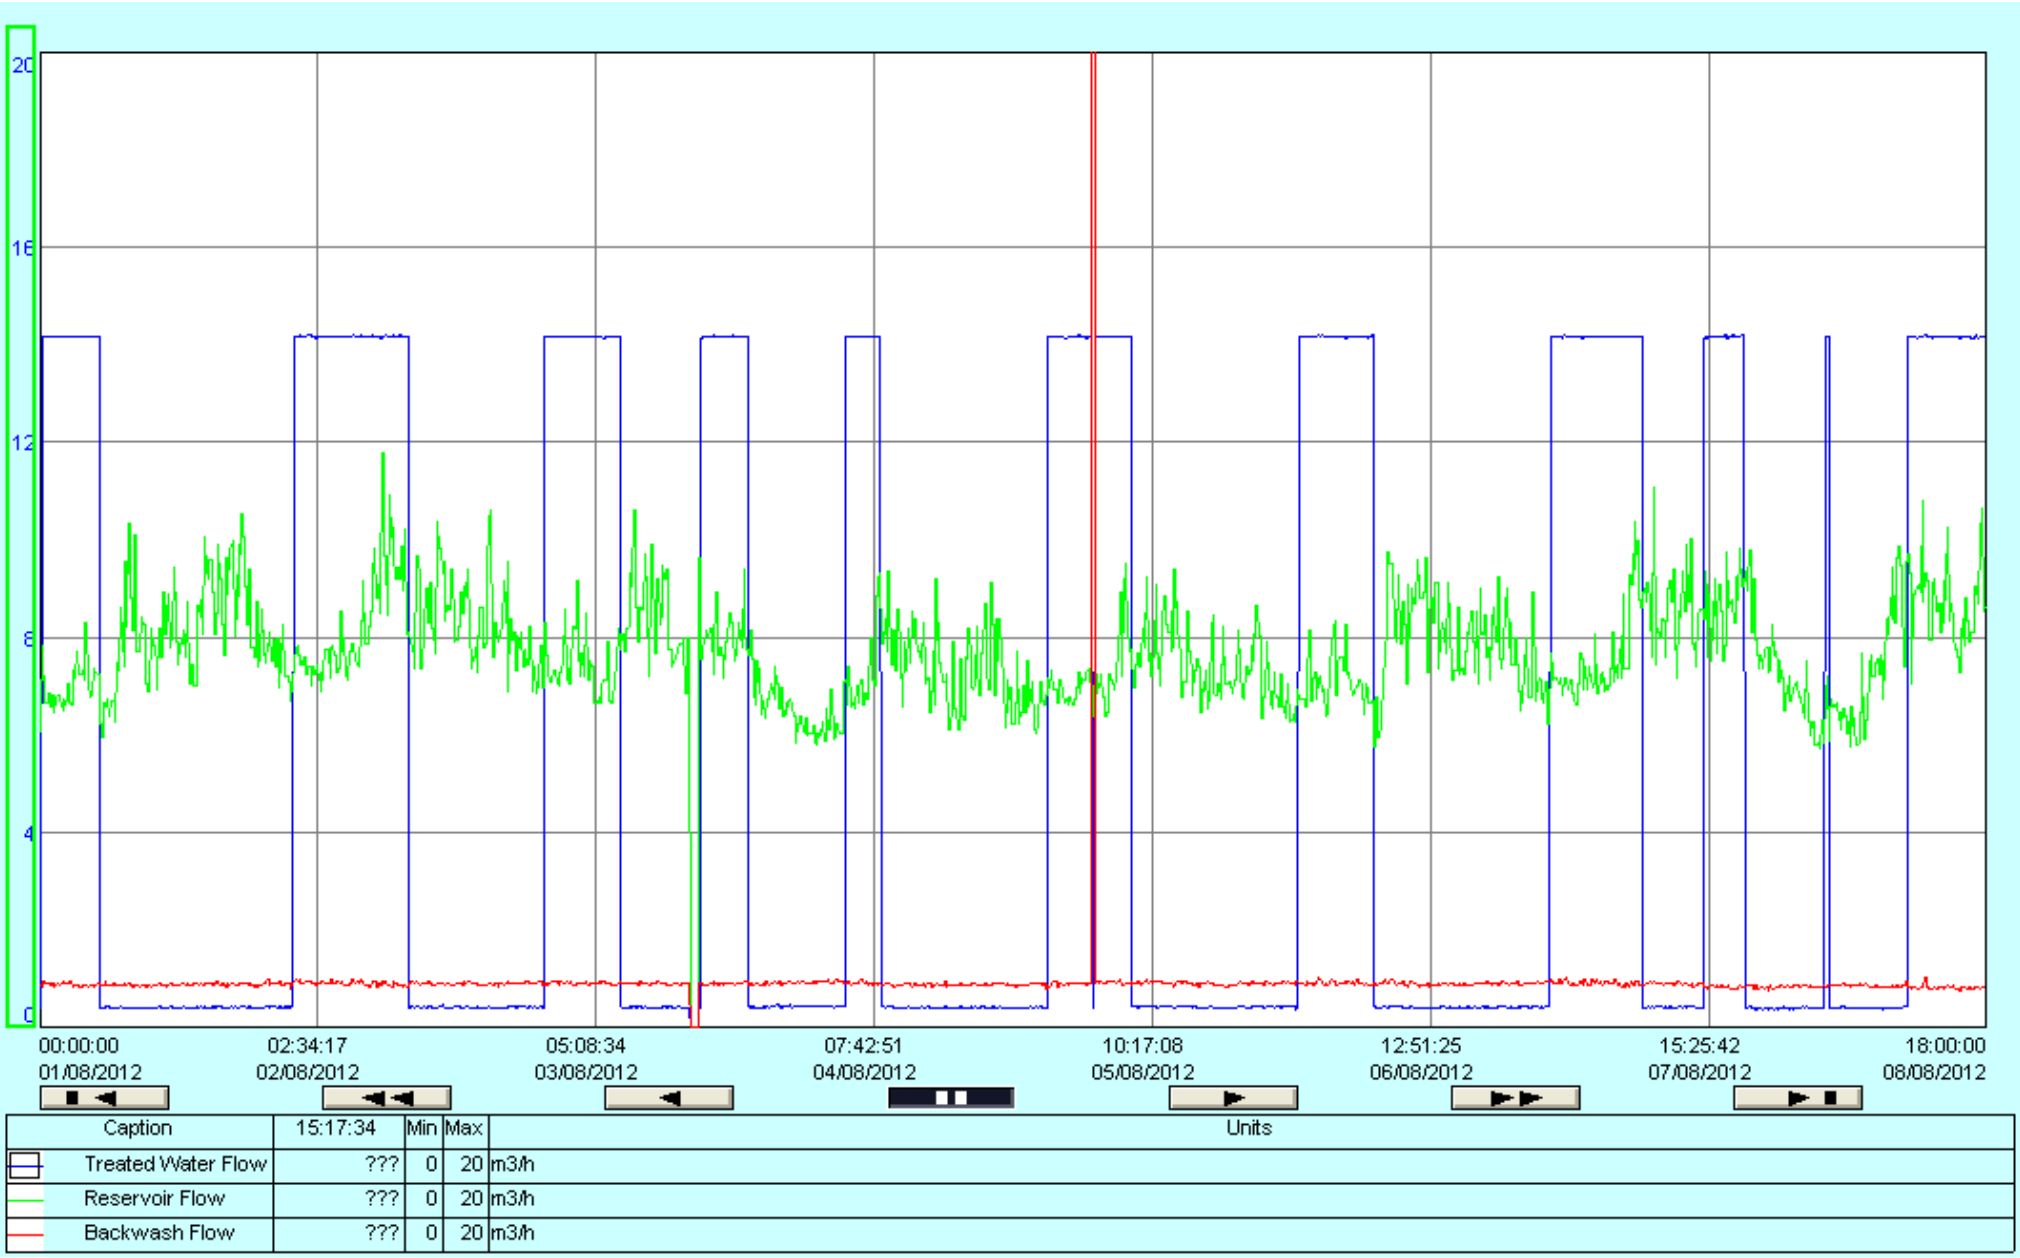


Caption	15:17:34	Min	Max	Units
Treated Water Flow	???	0	20	m3/h
Reservoir Flow	???	0	20	m3/h
Backwash Flow	???	0	20	m3/h

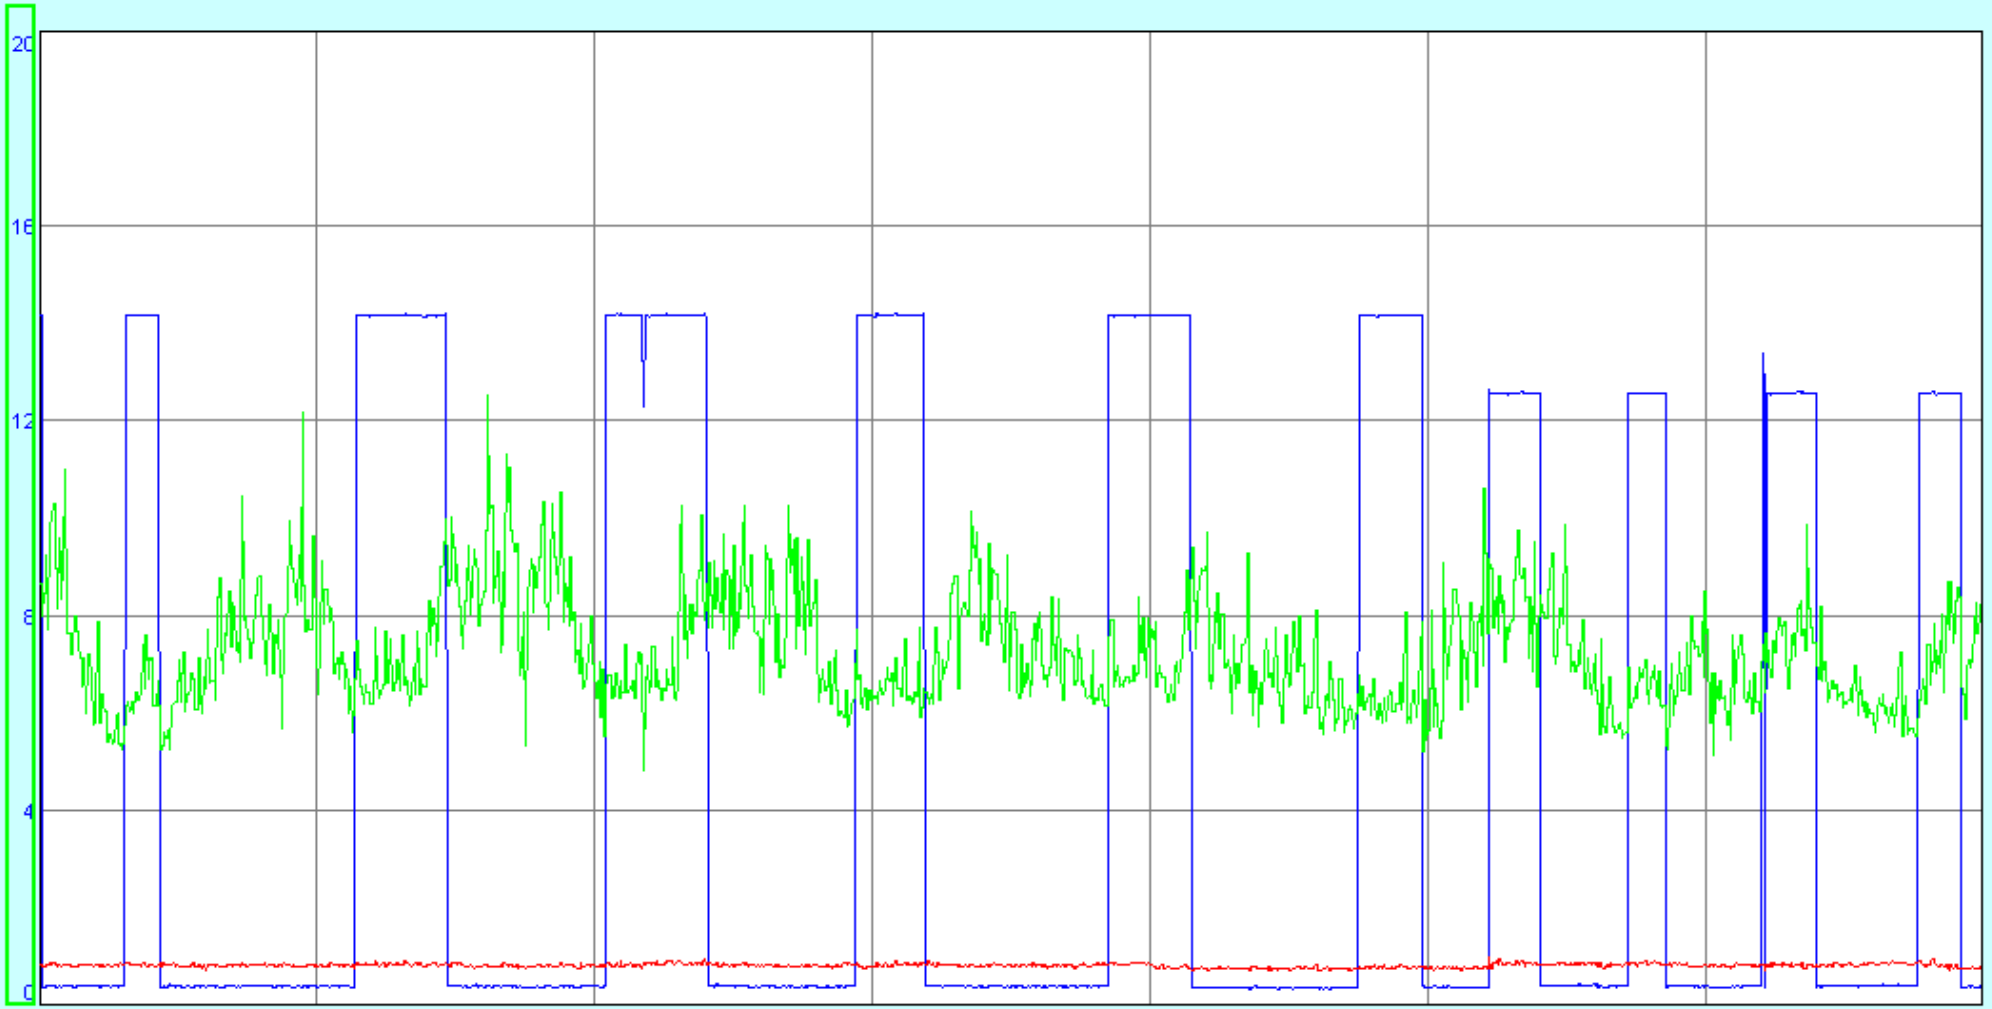


Caption	15:18:54	Min	Max	Units
Treated Water Flow	???	0	20	m3/h
Reservoir Flow	???	0	20	m3/h
Backwash Flow	???	0	20	m3/h

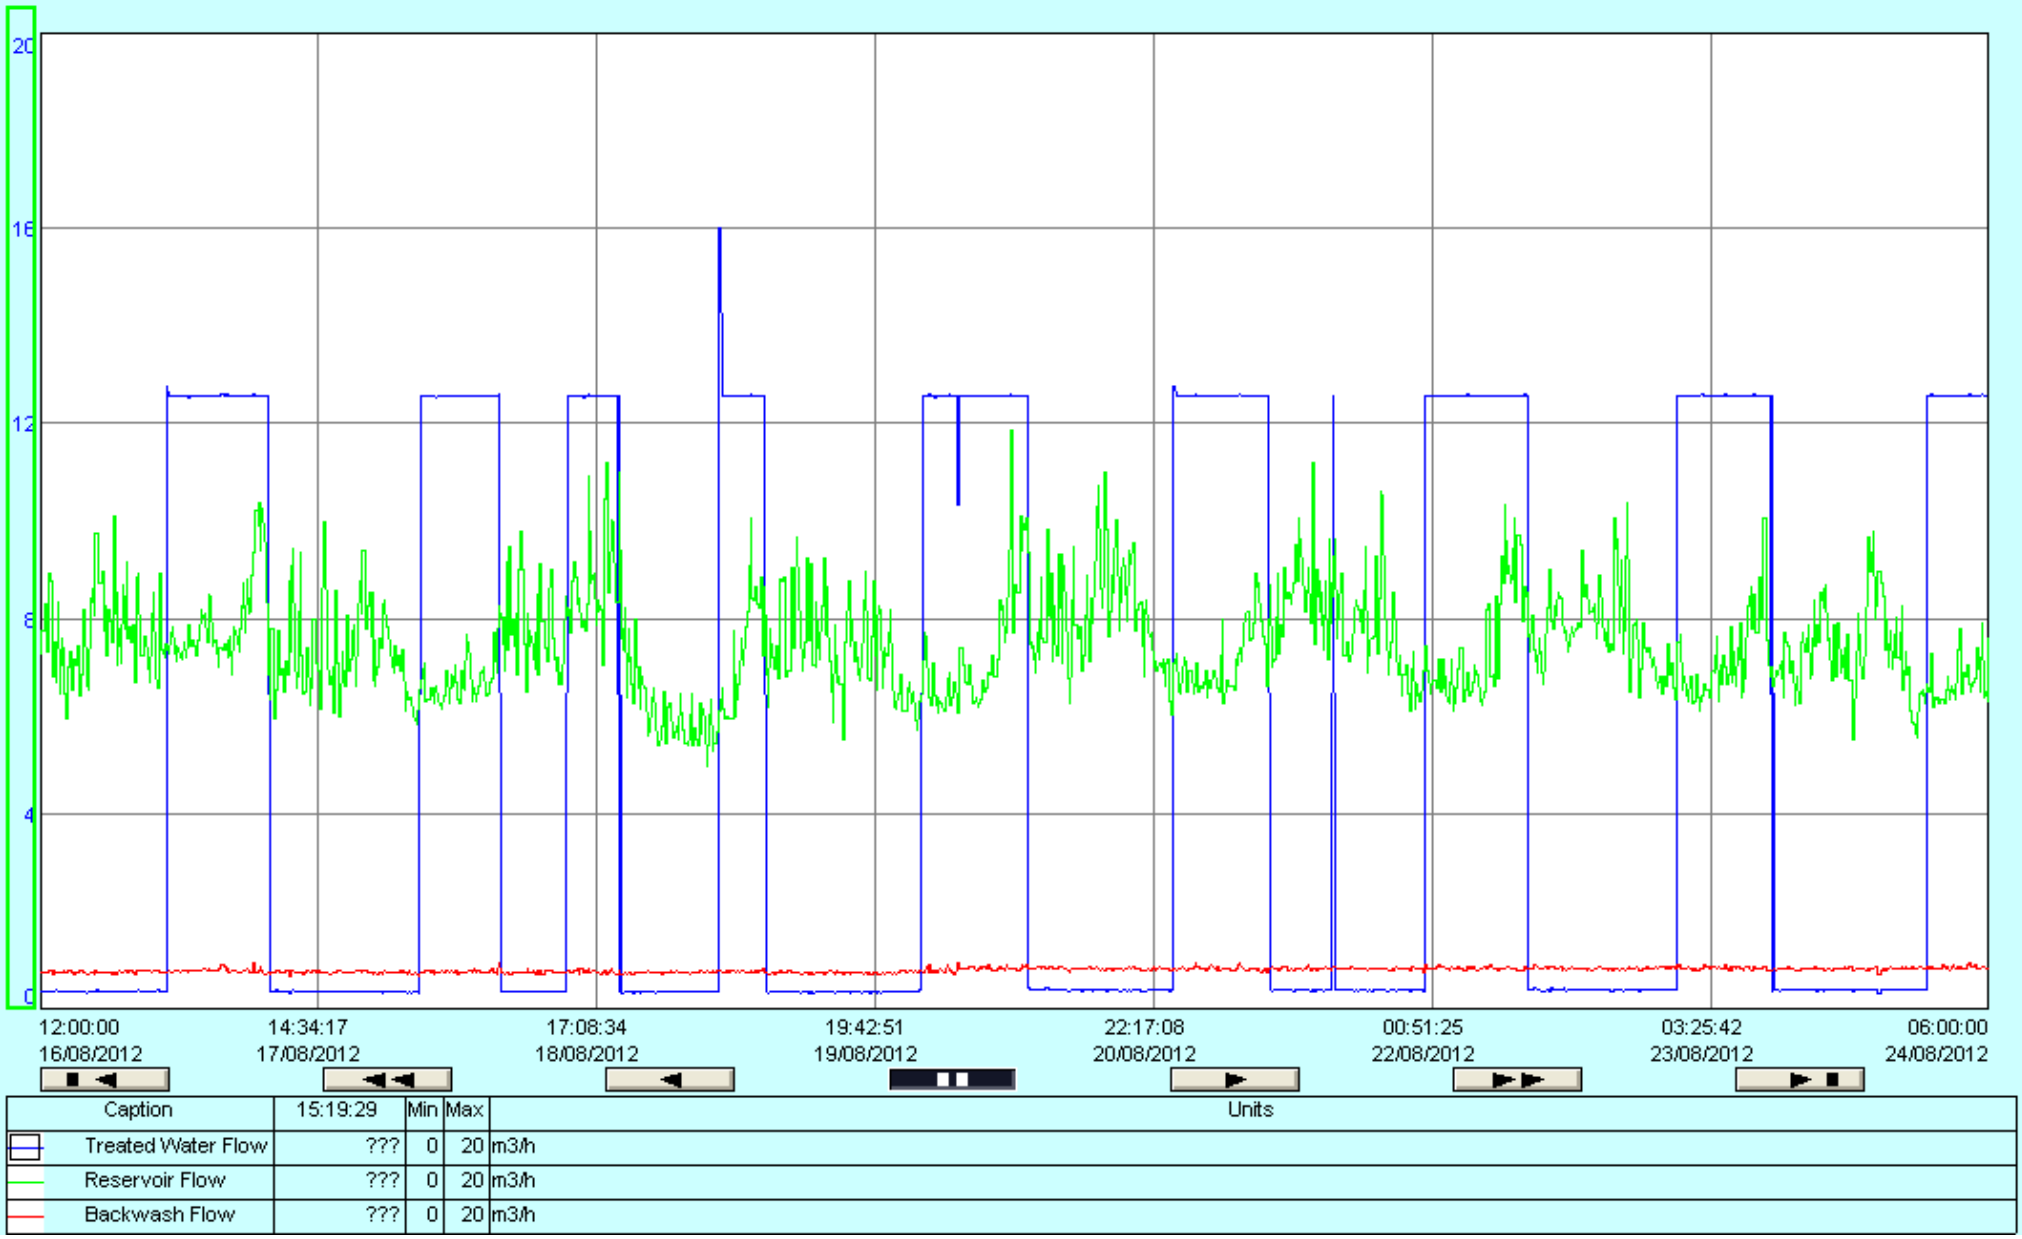


Caption	15:19:29	Min	Max	Units
Treated Water Flow	???	0	20	m3/h
Reservoir Flow	???	0	20	m3/h
Backwash Flow	???	0	20	m3/h

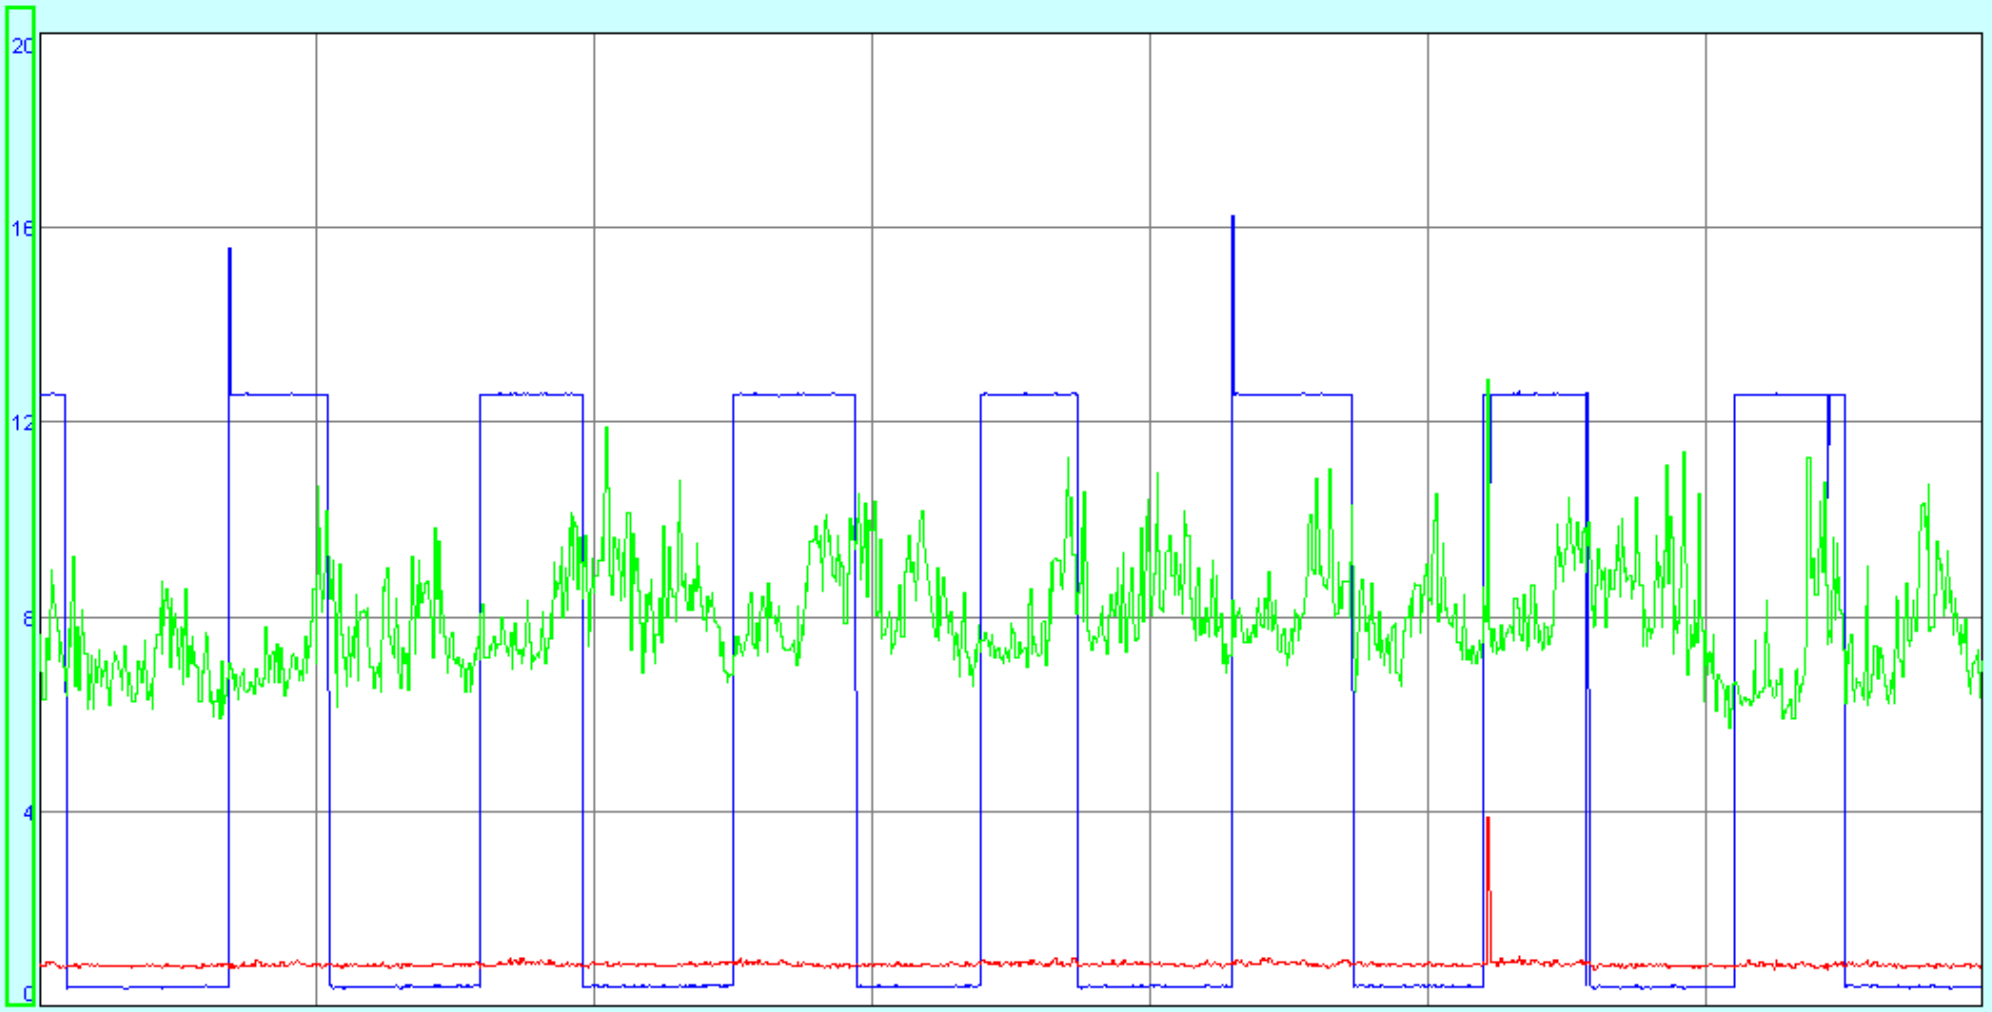


Caption	15:20:04	Min	Max	Units
Treated Water Flow	???	0	20	m3/h
Reservoir Flow	???	0	20	m3/h
Backwash Flow	???	0	20	m3/h

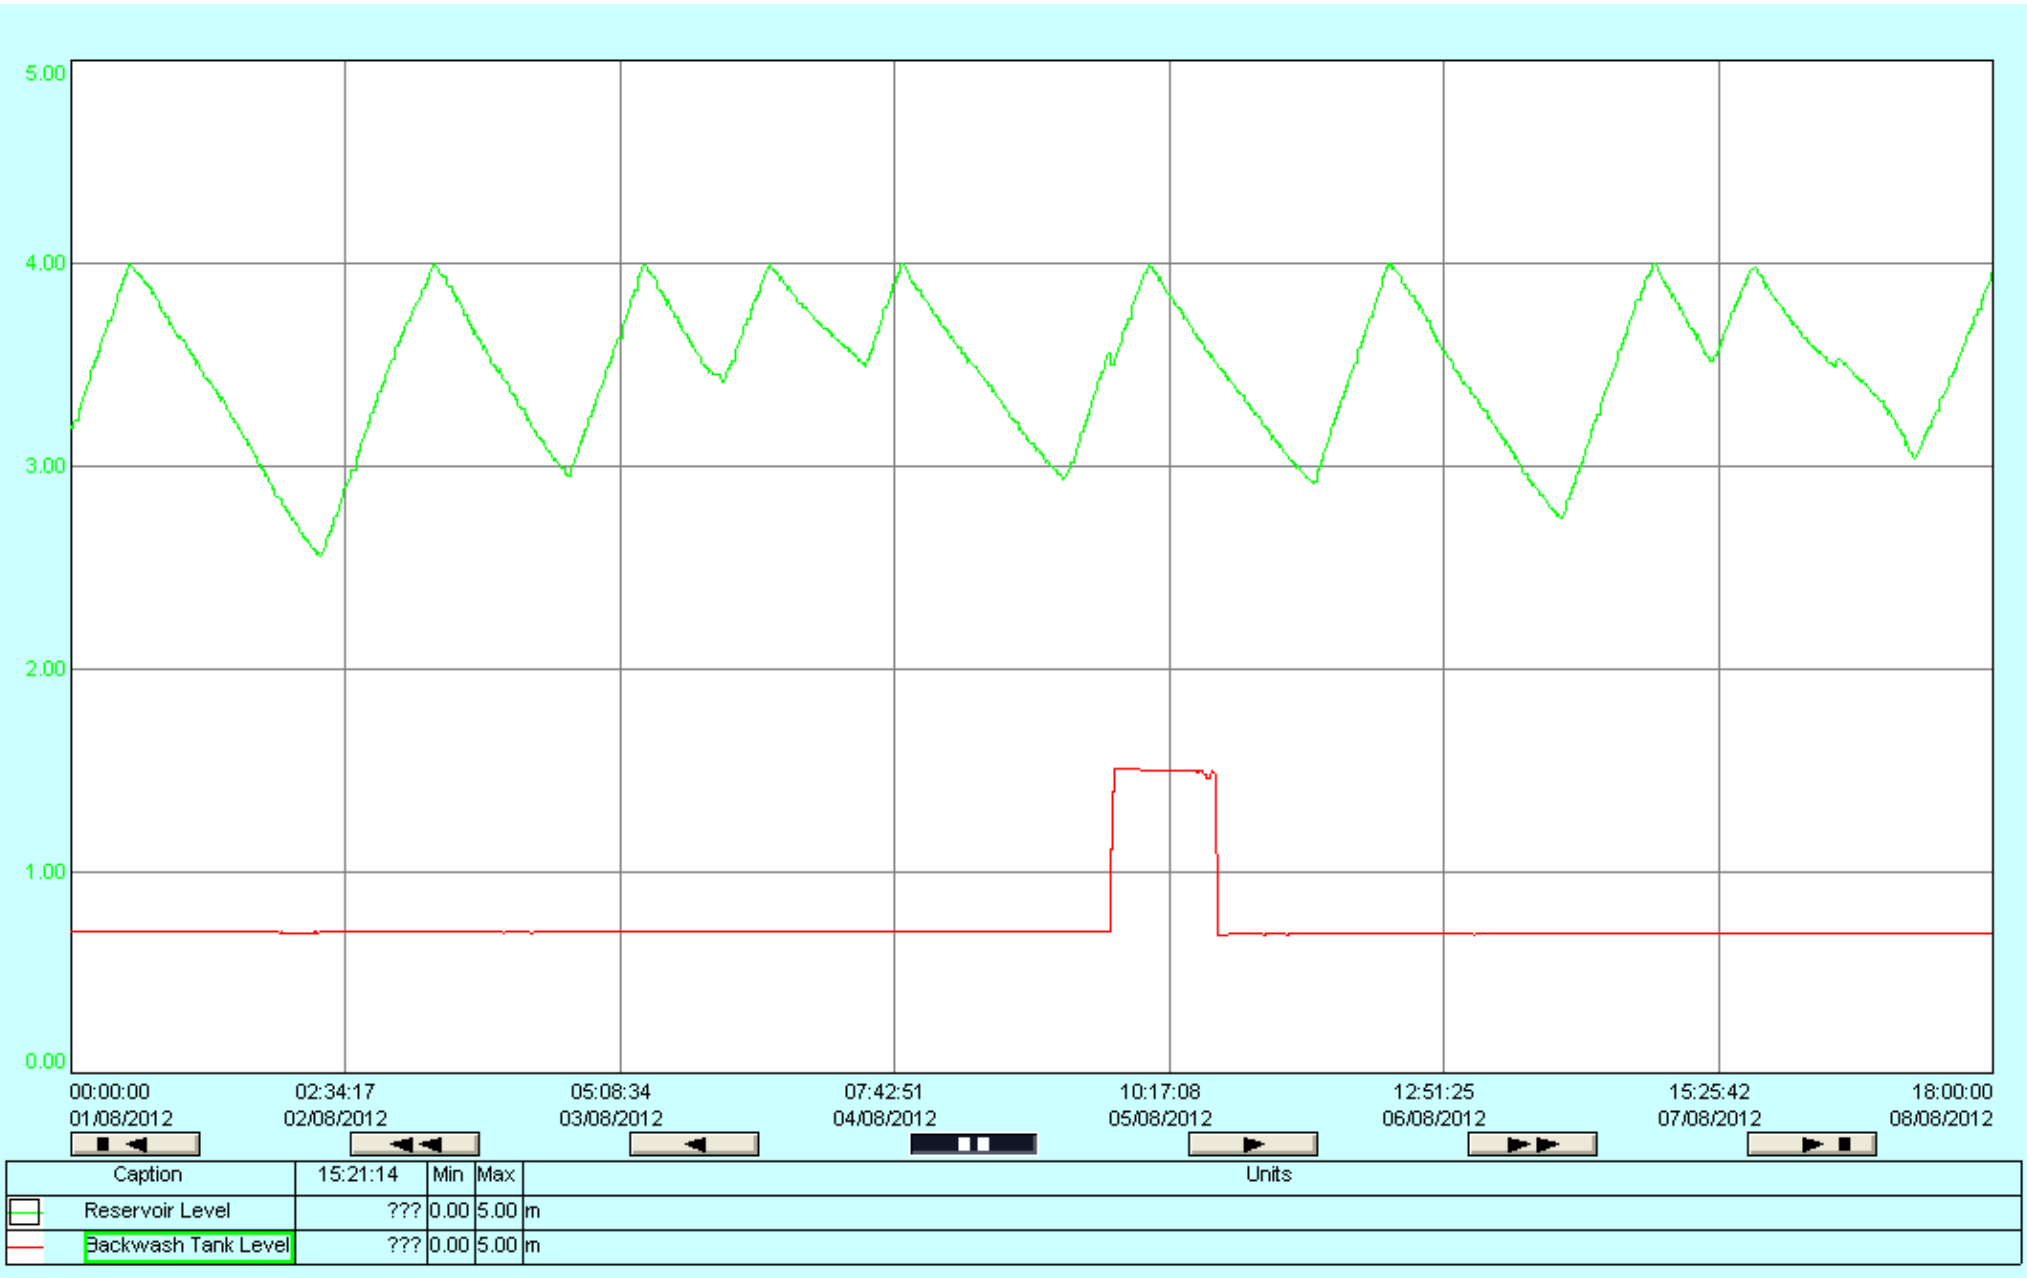


Caption	15:21:14	Min	Max	Units
Reservoir Level	???	0.00	5.00	m
Backwash Tank Level	???	0.00	5.00	m

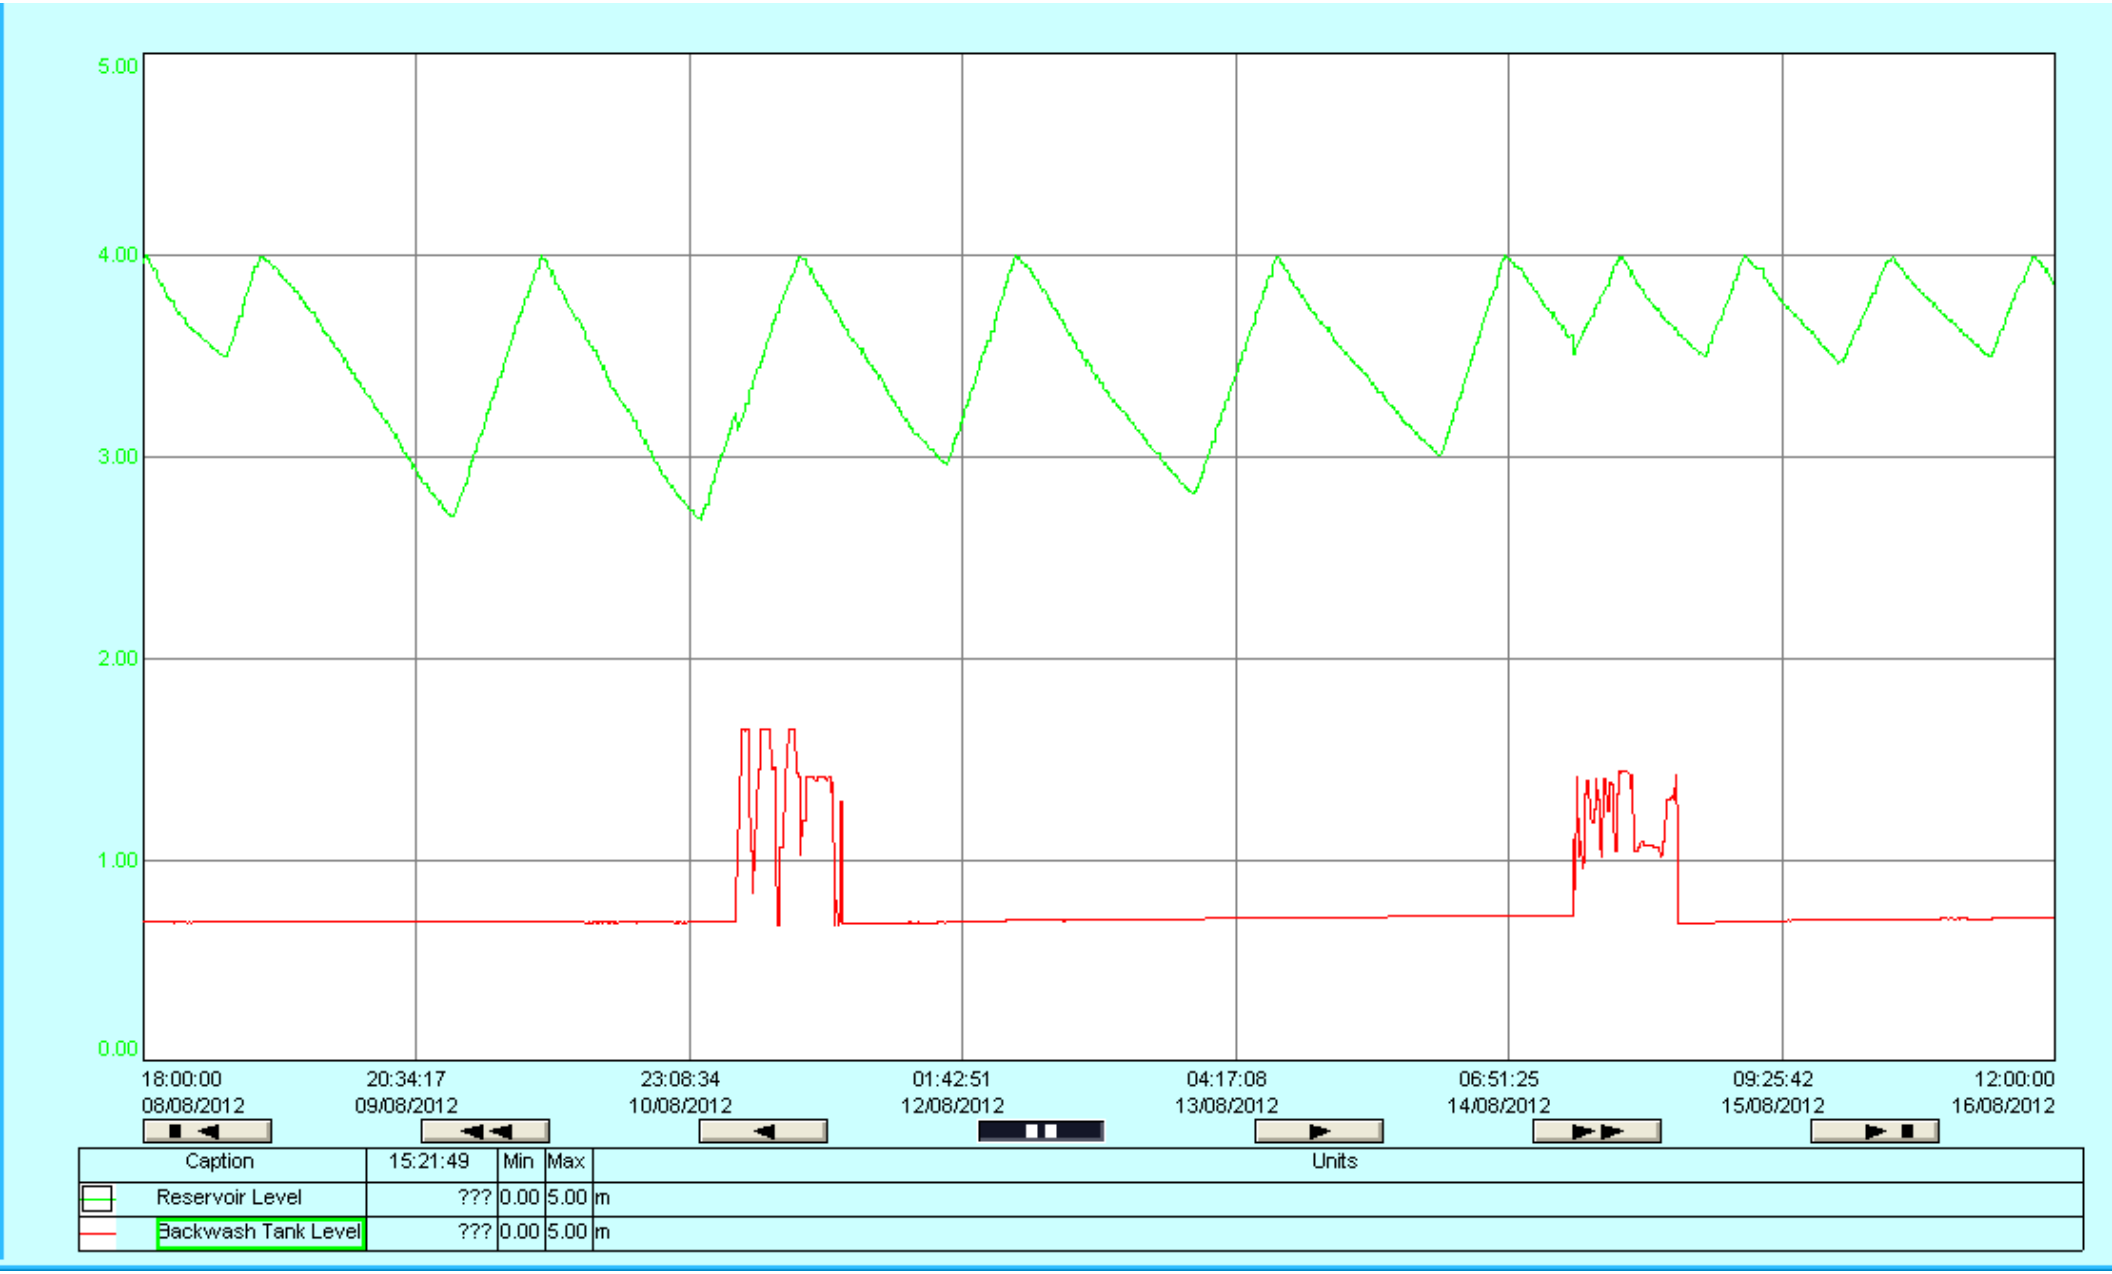

Caption	15:21:49	Min	Max	Units
Reservoir Level	???	0.00	5.00	m
Backwash Tank Level	???	0.00	5.00	m

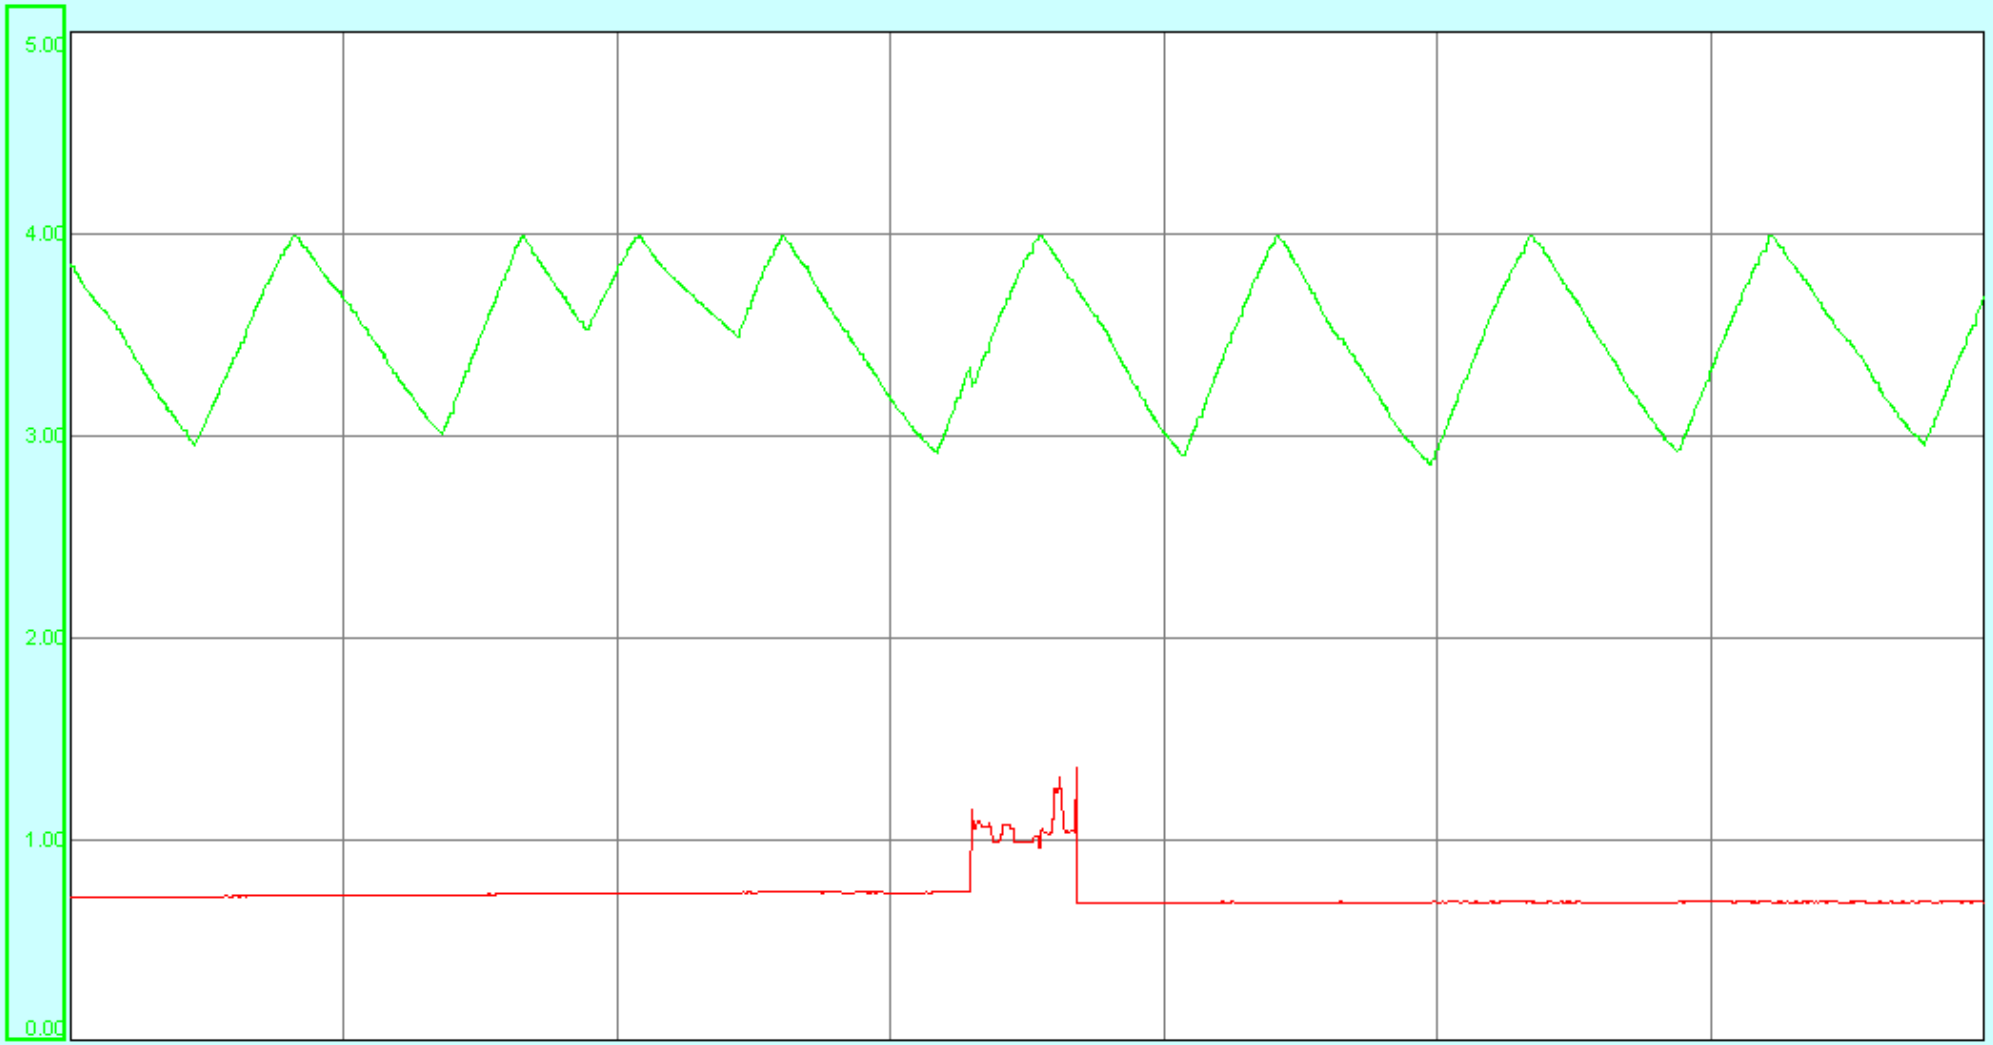


Caption	15:22:19	Min	Max	Units
Reservoir Level	???	0.00	5.00	m
Backwash Tank Level	???	0.00	5.00	m

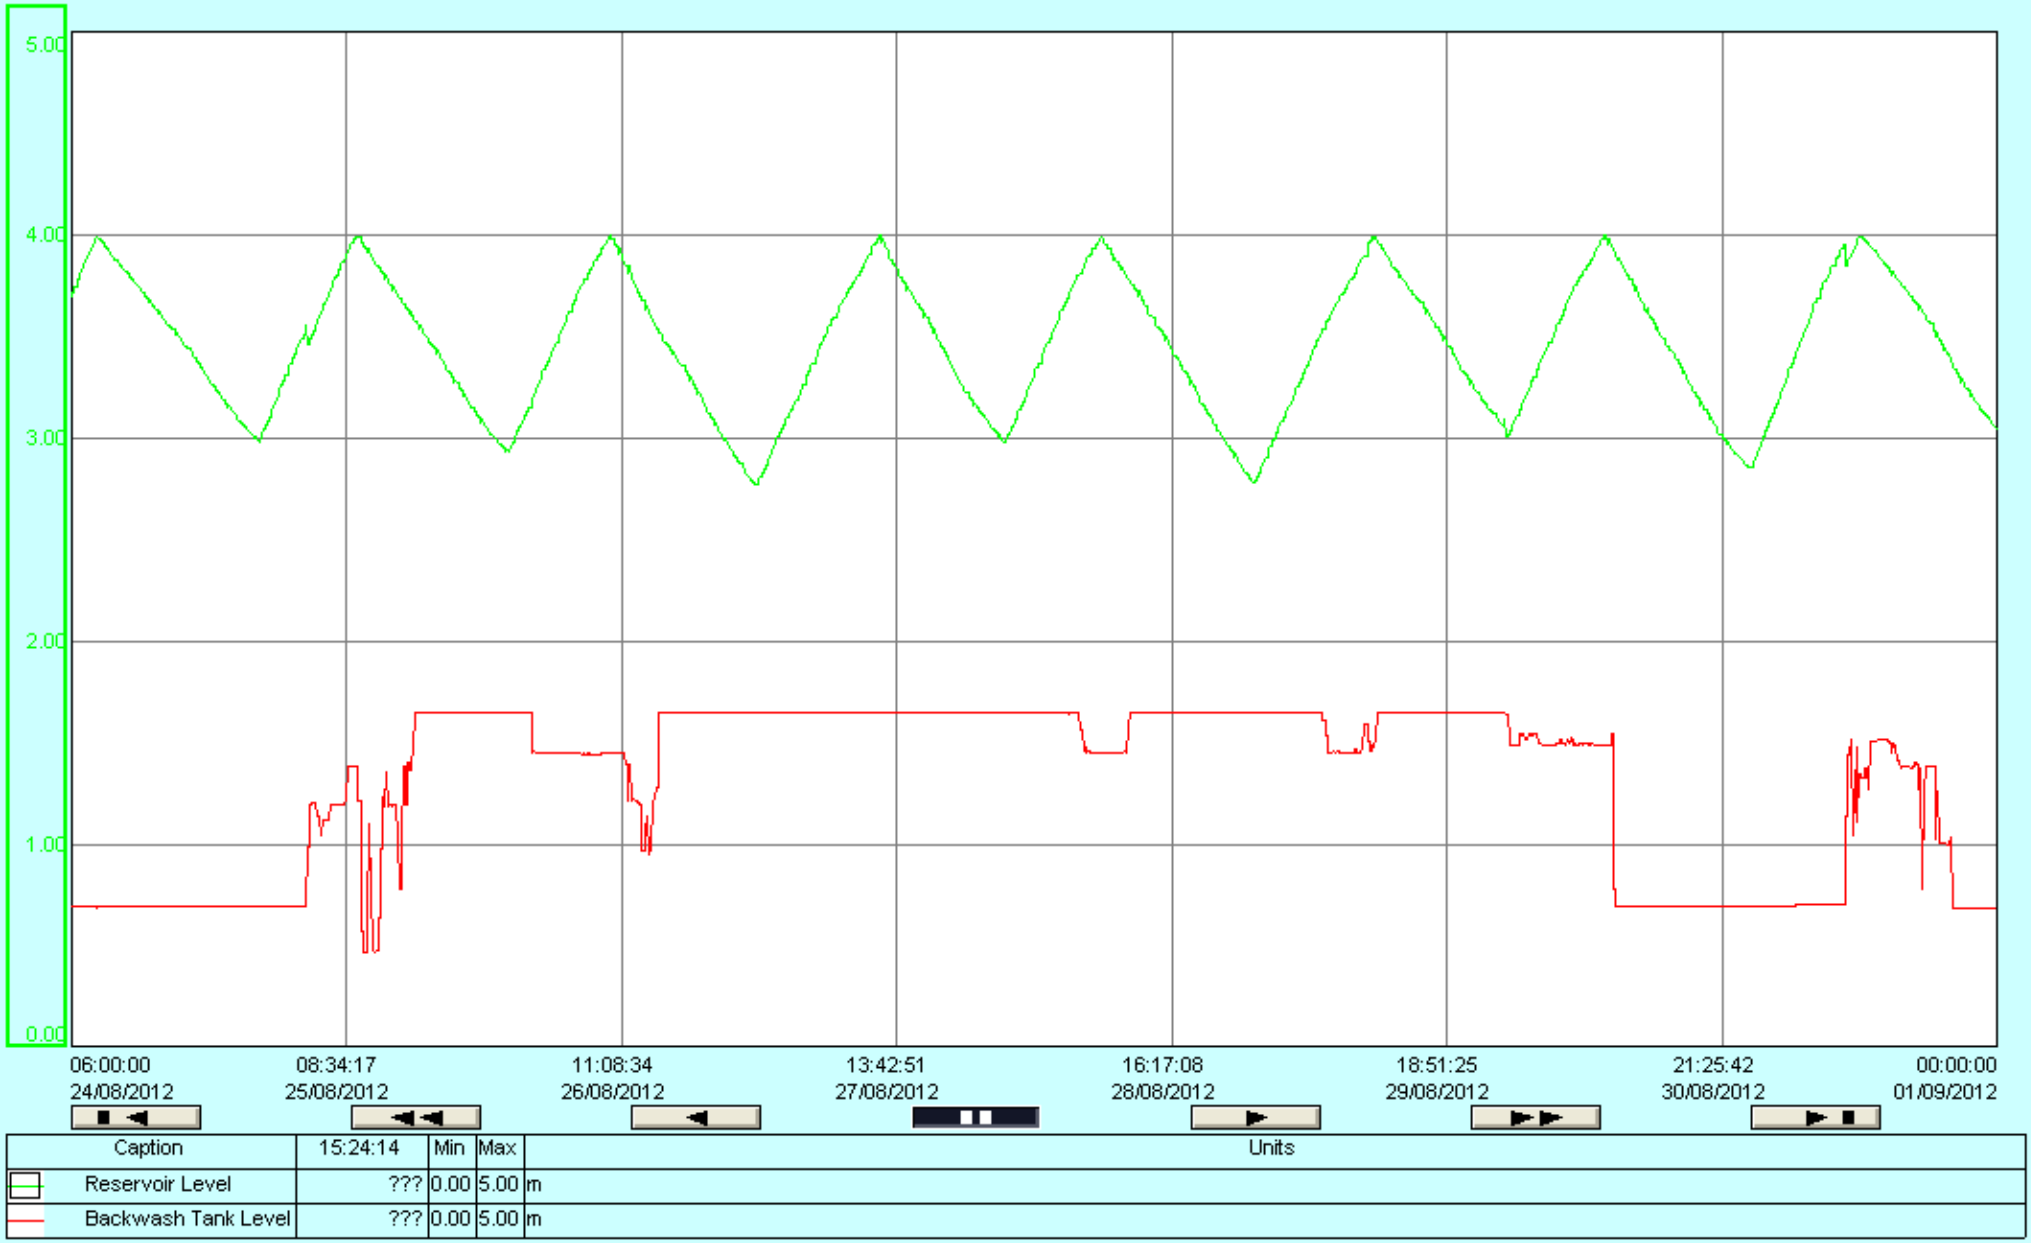


Caption	15:24:14	Min	Max	Units
Reservoir Level	???	0.00	5.00	m
Backwash Tank Level	???	0.00	5.00	m


Graph of Daily Flows of Raw and Treated Water for August 2012.

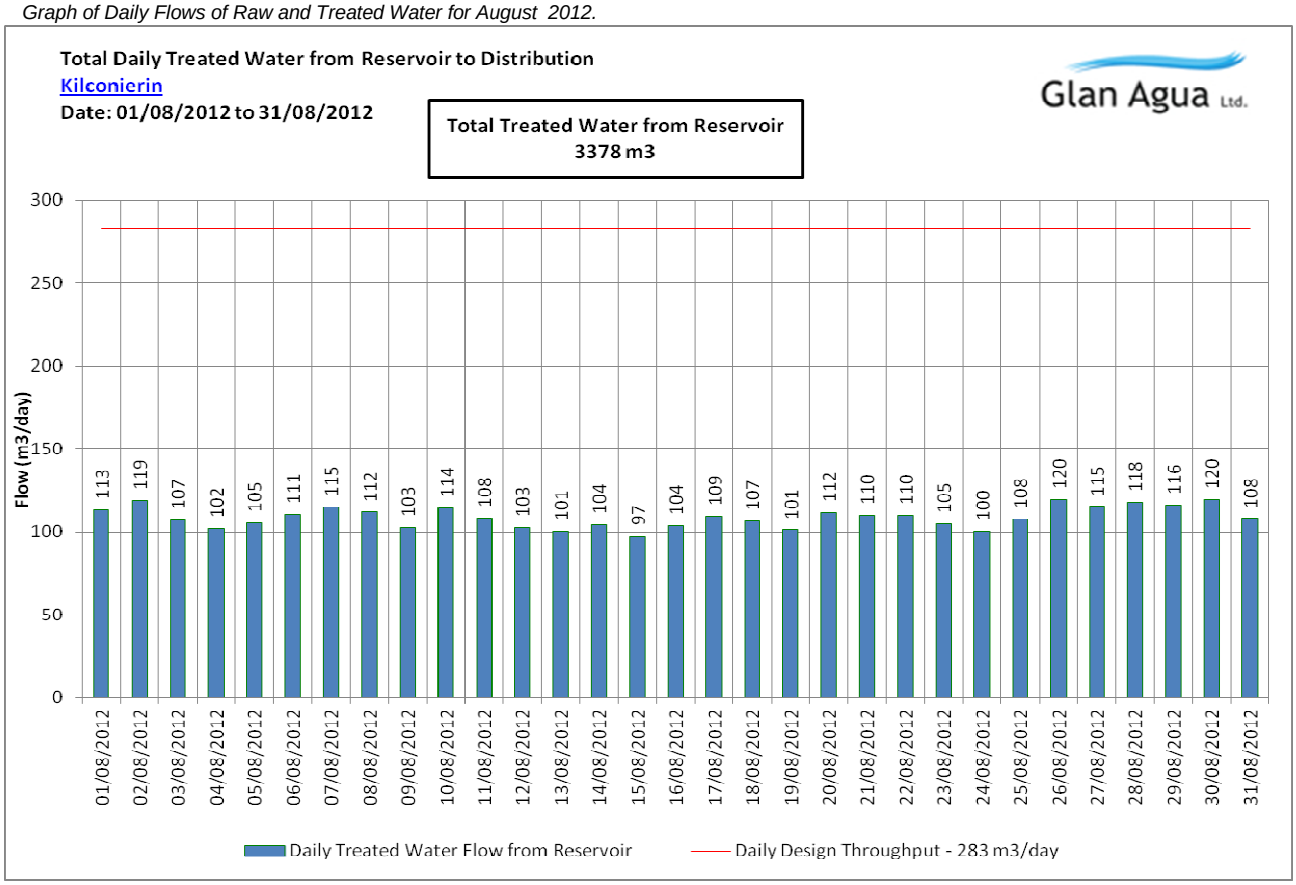


Average Daily Graph of Colour in Raw and Treated Water for August 2012.

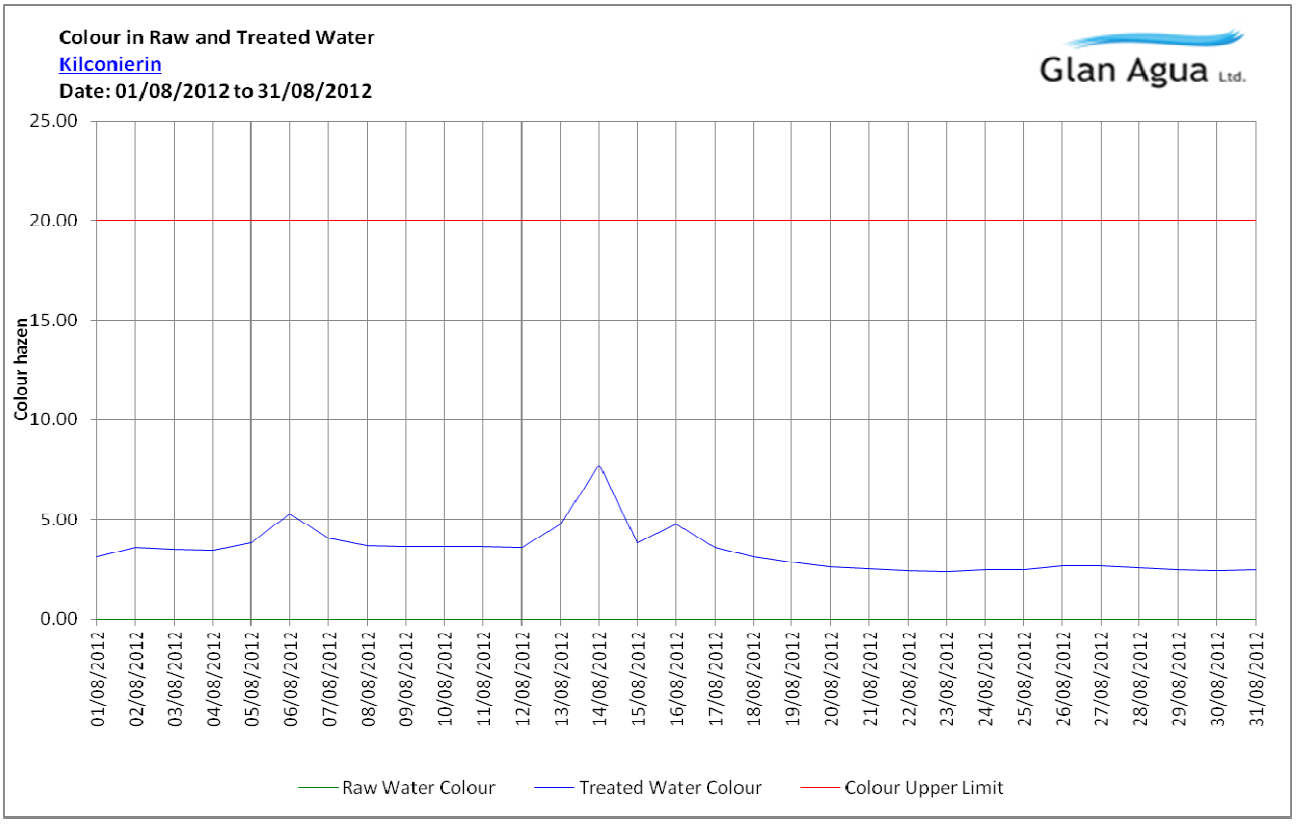


Average Daily Graph of Turbidity in Raw and Treated Water for August 2012.

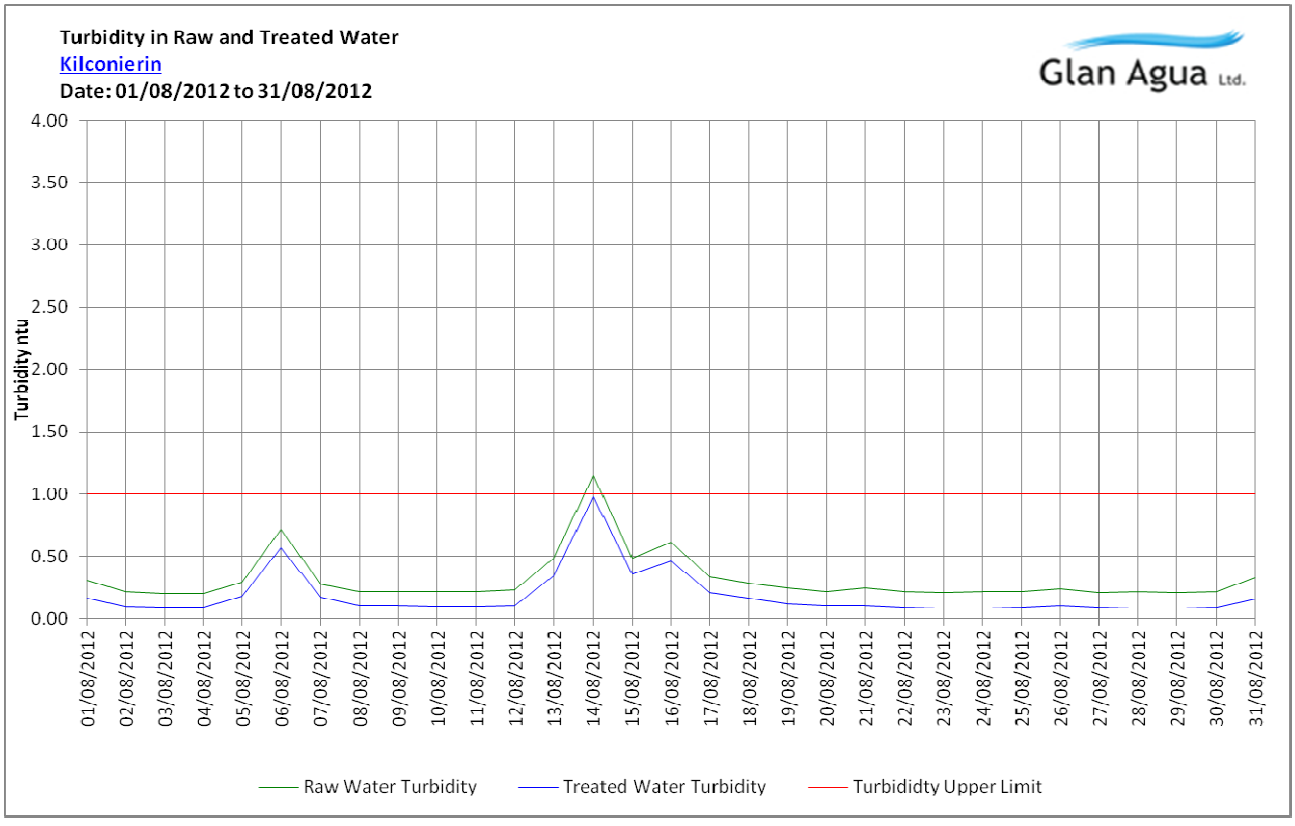

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution for August 2012.

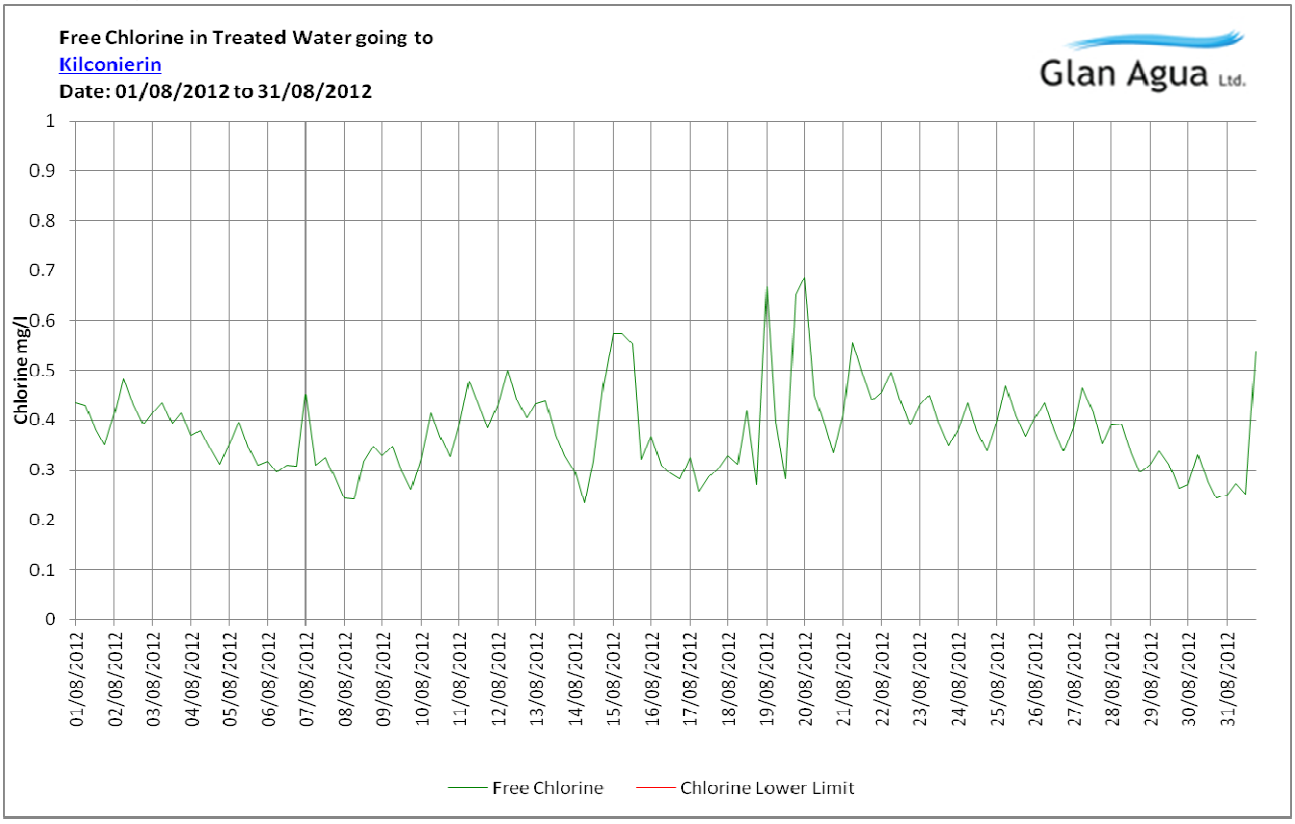

UV in Treated Water going to Distribution for August 2012.

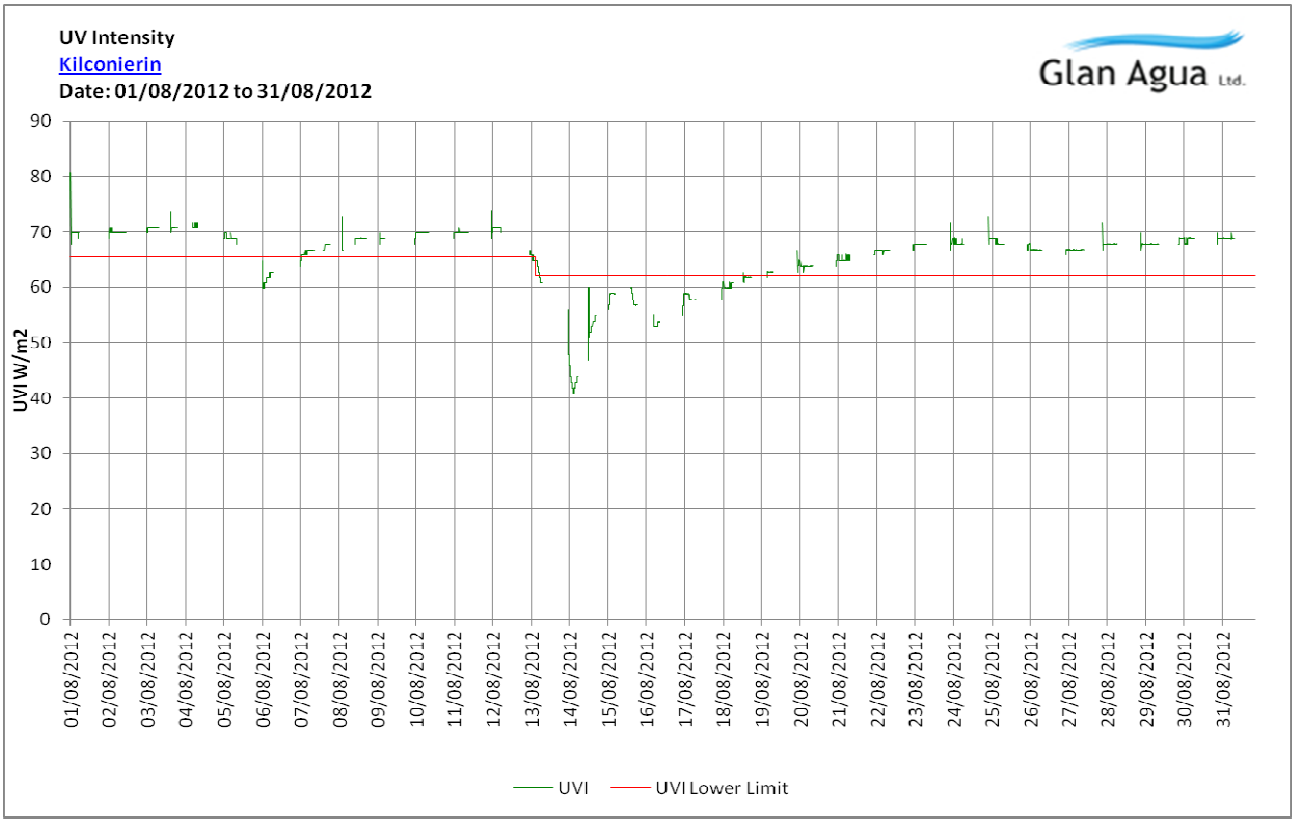

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analythical Results

Category	Report On	Comments
Final water	Quality comparison to contract requirements	Fully compliant with S.I. 278 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 278
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary Date:21/08/2012

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.5
TOC	mg/l	2.3
pH		6.8
Apparent Colour	mg/l PtCo	<5
Fe	ug/l	<7.2
Al	ug/l	<5
Mn	ug/l	<0.7
Treated Water		
Aluminium	ug/l	<5
TOC	mg/l	2.7
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	6.84
Fe	ug/l	<7.2
Mn	ug/l	<0.7
Coliform	MPN/100ml	<1
THMS	ug/l	29.263
Turbidity	NTU	<0.5

Monthly Status Report

Contract: Galway GWS DBO
Plant: Kilconierin GWS

Section 6:

Operator: Stephen Costello

Process Operational Changes Record

Date	Description of Process Operational Change	Purpose of Process Operatioinal Change	Implemented By
02/08/2012	Reduced plant chlorine from 0.85ppm to 0.7ppm	Reservoir chlorine starting to rise	S. Costello
14/08/2012	Reduced flow from 14.2m3/hr to 12.6m3/hr	UV intensity decreased	S. Costello
15/08/2012	Increasing plant chlorine to 1.2ppm	To eliminate top up pumps	S. Costello

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Health & Safety Issues ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

Plant Manager:	Julian Drapiewski	**Date:**	06/09/2012
For Period:	01/08/2012-31/08/2012		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**1**	*Exposure Hours*	**08:10**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Subcontractors

Number of Emplyees	**1**	*Exposure Hours*	0.5		
Subcontractors on Site	City Analysts				
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents					
Days Lost					

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 10: ***Operator: Stephen Costello***

Site Alarm /Incident Record

08/08/2012	10:15	ODIS low chlorine	S. Costello	Failed on start up
14/08/2012	12:40	Low chlorine at Res	S. Costello	Top up pump needed primming
18/08/2012	14:00	Low chlorine at reservoir	S. Costello	Top up pump needed primming
29/08/2012	08:30	Low chlorine at plant	S. Costello	Pump Cutting in and out

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
02/08/2012	Stephen Costello	GA Operator	08:30	08:45	Process Change
08/08/2012	Stephen Costello	GA Operator	10:15	10:50	Alarm and WTP Inspection
08/08/2012	Stephen Costello	GA Operator	11:50	13:00	WTP Inspection
09/08/2012	Stephen Costello	GA Operator	12:25	12:40	WTP Inspection
14/0815/08	Stephen Costello	GA Operator	12:35	14:00	Process Change
15/08/2012	Stephen Costello	GA Operator	14:30	15:45	Process Change
17/08/2012	Stephen Costello	GA Operator	16:30	16:40	WTP Inspection
18/08/2012	Stephen Costello	GA Operator	14:00	14:45	Alarm and WTP Inspection
21/08/2012	Richard Byrne	City Analysts	15:10	15:30	Sampling
21/08/2012	Stephen Costello	GA Operator	15:10	15:30	Sampling
27/08/2012	Stephen Costello	GA Operator	13:50	14:20	WTP Inspection
29/08/2012	Stephen Costello	GA Operator	08:30	09:10	Alarm and WTP Inspection
31/08/2012	Stephen Costello	GA Operator	08:50	09:20	WTP Inspection

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	21/08/2012	***Sample No:***	133855
Analyst	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	0	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	21/08/2012	133867
City Analysts	Kilconierin Treated Water	21/08/2012	133855

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Customer Contact: Anne-Marie Rooney
Customer: Glan Aqua Ltd
Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-04473-GAL
Report Version: 1

Report Date: 29/08/2012
Customer PO No.: GA-11-27-0011
Chain of Custody No.:

Certificate Of Analysis

Analysis of 1 sample(s) submitted on 20/08/2012 is now complete.
We have the pleasure of enclosing your certificate of analysis.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our web site at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Maria Nevin **Date:** 29/08/2012

Authorised Signatories:
Dublin : Miriam Byrne, Melissa Brady, Maria Nevin, Leann Hession, Slawek Gryczewski, Ewa Krol, Dariusz Bartoszewicz, Stephen Crampton.
Limerick: Hugh O'Donnell, Maurice Daffy, Sylwia Wojtowicz.
Note: Information on methods of analysis and performance characteristics is available on request.

Note: Results relate only to the items tested.
Test report shall not be reproduced except in full or with written approval of City Analysts Ltd.

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Anne-Marie Rooney

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-04473-GAL
Report Version: 1
Date Received: 20/08/2012

Sample Description: Kilconierin raw
Sample Type: Raw Water
Date Sampled: 21/08/2012
Lab Reference Number: 133867

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3001	22/08/2012	Aluminium, Total	<5	ug/l	-	INAB
D/3010	23/08/2012	Colour,Apparent	<5	Hazen	-	NON
D/3001	22/08/2012	Iron, Total	<7.2	ug/l	-	INAB
D/3001	22/08/2012	Manganese, Total	<0.7	ug/l	-	INAB
D/1041	21/08/2012	pH	6.80	pH Units	-	INAB
L/1016	27/08/2012	Chloroform	<1.0	ug/l	-	INAB
L/1016	27/08/2012	Bromodichloromethane	<2.0	ug/l	-	INAB
L/1016	27/08/2012	Chlorodibromomethane	<1.0	ug/l	-	INAB
L/1016	27/08/2012	Bromoform	<0.5	ug/l	-	INAB
L/1016	27/08/2012	Total THM	<2	ug/l	-	INAB
SUB C		Total organic carbon	2.30	mg/l	-	UKAS
D/3054	22/08/2012	Turbidity	<0.5	NTU	-	INAB

Note:

NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Customer Contact: Anne-Marie Rooney

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-04462-GAL
Report Version: 1

Report Date: 29/08/2012

Customer PO No.: GA-11-27-0011
Chain of Custody No.:

Certificate Of Analysis

Analysis of 1 sample(s) submitted on 20/08/2012 is now complete.
We have the pleasure of enclosing your certificate of analysis.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our web site at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Melissa Brady

Date: 29/08/2012

Authorised Signatories:
Dublin : Miriam Byrne, Melissa Brady, Maria Nevin, Leann Hession,
Slawek Gryczewski, Ewa Krol, Dariusz Bartoszewicz, Stephen Crampton.
Limerick: Hugh O'Donnell, Maurice Daffy, Sylwia Wojtowicz.
Note: Information on methods of analysis and performance characteristics is available on request.

Note: Results relate only to the items tested.

Test report shall not be reproduced except in full or with written approval of City Analysts Ltd.

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Anne-Marie Rooney

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-04462-GAL
Report Version: 1
Date Received: 20/08/2012

Sample Description: Kilconierin Treated
Sample Type: Drinking Water
Date Sampled: 21/08/2012
Lab Reference Number: 133855

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3001	22/08/2012	Aluminium, Total	<5	ug/l	200 µg/l	INAB
D/1220	21/08/2012	Clostridium perfringens	<1	cfu/100ml	0/100mls	NON
D/3010	23/08/2012	Colour,Apparent	<5	Hazen	NAC & ATC	NON
D/1201	21/08/2012	Coliforms	<1	MPN/100ml	0/100mls	INAB
D/1201	21/08/2012	E.coli	<1	MPN/100ml	0/100mls	INAB
D/3001	22/08/2012	Iron, Total	<7.2	ug/l	200 µg/l	INAB
D/3001	22/08/2012	Manganese, Total	<0.7	ug/l	50 µg/l	INAB
D/1041	21/08/2012	pH	6.84	pH Units	6.5 - 9.5	INAB
L/1016	27/08/2012	Chloroform	8.681	ug/l		INAB
L/1016	27/08/2012	Bromodichloromethane	10.081	ug/l		INAB
L/1016	27/08/2012	Chlorodibromomethane	8.829	ug/l		INAB
L/1016	27/08/2012	Bromoform	1.672	ug/l		INAB
L/1016	27/08/2012	Total THM	29.263	ug/l	100 µg/l	INAB
SUB C		Total organic carbon	2.70	mg/l		UKAS
D/3054	22/08/2012	Turbidity	<0.5	NTU	NAC & ATC	INAB


Note:
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

Glan Agua Ltd.

Enterprise & Technology Centre
Creagh Road,
Ballinasloe,
Co. Galway,
IRELAND

Tel: +353 909630301
Fax: +353 909630300
web: www.glanagua.com
e-mail: info@glanagua.com

MONTHLY STATUS REPORT

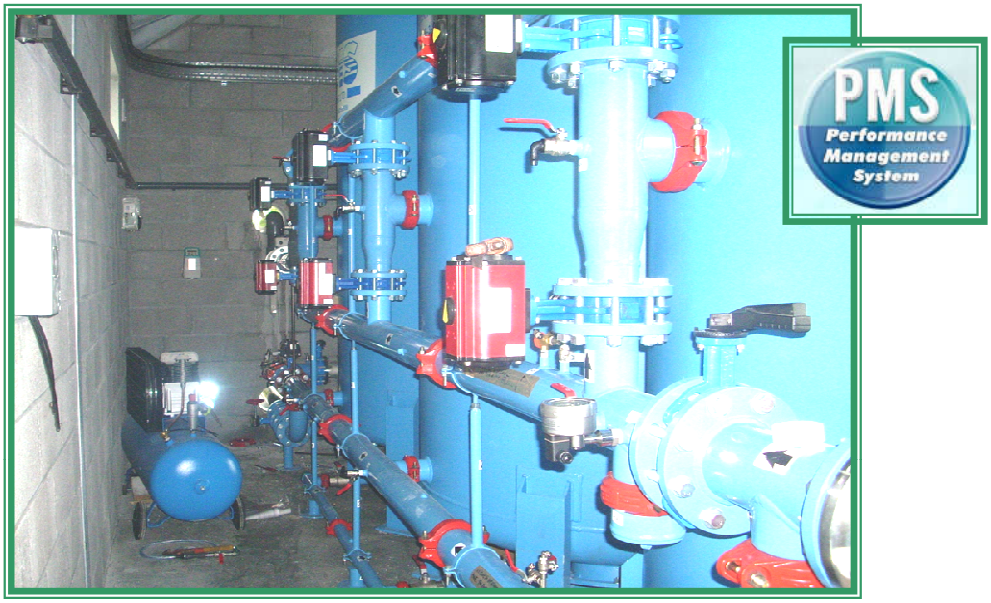

Glan Agua Ltd. is fully accredited to:

Contract:	**Galway GWS DBO**
Plant:	**Kiltiernan GWS**
Form No.	F-10-139.GA.0
Report Number / Period:	**3-2012 (6)**
Operational Period:	**1 March 2012/31 March 2012**
Prepared by:	**Julian Drapiewski**
Scheme Operator in Charge:	**Stephen Costello**

Comhshaol, Oidhreacht agus Rialtas Áitiúil
Environment, Heritage and Local Government

NDP
NATIONAL DEVELOPMENT PLAN

wsntg

Printed:04/04/2012

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Sumary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analythical Results**	
Section 6:	**Process Operational Changes Record**	- not applicable
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	- not applicable
Section 9:	**Complaint Record**	- not applicable
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	- not applicable
Section 13:	**Equipment Service Record**	- not applicable
Section 14:	**Plant Maintenance Schedule Report**	- not applicable
Section 15:	**Non-Sludge Waste Disposal Record**	- not applicable
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	not applicable
Section 18:	**Emergency Event Record**	- not applicable
Section 19:	**Random Analysis by Employer**	- not applicable

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	March 2012	**Short process description:** Kiltiernan WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I 278 of 2007 and Employer's Requirements.
Report No.:	3-2012	
Number of Reports To Date Including This One	6	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.3-2012 (6) for March 2012.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good throughout the operational period

-Treated water of the required standard was provided at all times during the operational period

- The chlorine residual was kept on the higher end of the scale over the month due to the risk to water quality as the adjacent turlough drained down in the dry weather. This mitigation measure was agreed with the Employers Representative.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 2: ***Operator: Stephen Costello***

Executive Sumary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	Generally dry, however there was periods of heavy rainfall particularly the 6th of March. Temperature between 4℃ to 13 °C
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Treated and distributed to public	cubic meters	**10751m^3**
Analyticall Results	results in or out of specs	all on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	recommendations to improve	Raw water quality is of good with ocassional spikes of ammonia and manganase (outside Table 9.2)
Complaints	what and solution	none recorded
Alarm Callouts	what they were	6no. callouts: See section 10 for detail.
Heath & Safety Issues	what since last report or	none recorded
Equipment	taken off line and why or placed into service	None Reported
Treated Water Quality	Phis-Chem and Bio	Good Quality
Other	Outstanding works	Outstanding civil finishing works were addressed. The outstanding M&E/process works as listed in Section 8 - *Outstanding Exceptions Report* to be addressed in the coming weeks.

Monthly Status Report

Contract: Galway GWS DBO

Plant: Kiltiernan GWS

Section 3:

Operator: Stephen Costello

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for March 2012.*

Date	Colour		Turbidity	
	Raw	Treated	Raw	Treated
01/03/2012	5.79	0.89	0.18	0.51
02/03/2012	No Flow	No Flow	No Flow	No Flow
03/03/2012	6.98	0.70	0.14	0.04
04/03/2012	6.96	0.67	0.13	0.04
05/03/2012	7.11	0.65	0.12	0.04
06/03/2012	7.31	0.70	0.14	0.05
07/03/2012	7.38	0.77	0.14	0.03
08/03/2012	7.64	0.77	0.15	0.03
09/03/2012	6.48	0.77	0.12	0.05
10/03/2012	5.61	0.80	0.13	0.03
11/03/2012	5.63	0.69	0.13	0.02
12/03/2012	5.56	0.79	0.10	0.02
13/03/2012	5.78	0.79	0.09	0.02
14/03/2012	5.75	0.83	0.10	0.02
15/03/2012	6.08	0.78	0.10	0.02
16/03/2012	5.98	0.73	0.08	0.02
17/03/2012	6.44	0.82	0.09	0.02
18/03/2012	6.93	0.82	0.08	0.02
19/03/2012	7.37	0.86	0.08	0.02
20/03/2012	8.04	0.78	0.16	0.02
21/03/2012	7.66	0.75	0.08	0.02
22/03/2012	7.54	0.79	0.08	0.05
23/03/2012	7.78	0.80	0.07	0.05
24/03/2012	7.21	0.77	0.07	0.03
25/03/2012	6.66	0.77	0.11	0.03
26/03/2012	6.54	0.79	0.13	0.08
27/03/2012	5.91	0.79	0.11	0.02
28/03/2012	5.30	0.78	0.11	0.02
29/03/2012	5.98	0.81	0.12	0.02
30/03/2012	6.03	0.80	0.10	0.03
31/03/2012	6.01	0.78	0.11	0.02

Turbidity Limit (NTU):	1	NTU
Colour Limit (mg/l Pt Co) :	20	mg/l PtCo

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS


Section 3: ***Operator: Stephen Costello***

Tabular Data Presentation


Daily averages of Free Chlorine in Final Water for March 2012.

Day | Time	06:00:00	12:00:00	18:00:00	23:59:59
01/03/2012	0.45	0.48	0.42	0.47
02/03/2012	0.41	0.36	0.32	0.29
03/03/2012	0.39	0.48	0.41	0.36
04/03/2012	0.43	0.44	0.37	0.33
05/03/2012	0.42	0.44	0.38	0.34
06/03/2012	0.36	0.34	0.30	0.26
07/03/2012	0.39	0.40	0.35	0.31
08/03/2012	0.41	0.43	0.36	0.32
09/03/2012	0.43	0.49	0.42	0.38
10/03/2012	0.44	0.43	0.37	0.33
11/03/2012	0.44	0.52	0.45	0.41
12/03/2012	0.49	0.56	0.49	0.45
13/03/2012	0.53	0.58	0.45	0.39
14/03/2012	0.44	0.46	0.42	0.39
15/03/2012	0.44	0.48	0.45	0.42
16/03/2012	0.42	0.39	0.36	0.33
17/03/2012	0.35	0.35	0.32	0.29
18/03/2012	0.34	0.35	0.32	0.29
19/03/2012	0.35	0.36	0.32	0.30
20/03/2012	0.36	0.38	0.34	0.32
21/03/2012	0.37	0.38	0.35	0.33
22/03/2012	0.38	0.40	0.36	0.34
23/03/2012	0.39	0.42	0.38	0.35
24/03/2012	0.40	0.41	0.38	0.35
25/03/2012	0.39	0.44	0.40	0.37
26/03/2012	0.39	0.44	0.39	0.37
27/03/2012	0.39	0.42	0.38	0.35
28/03/2012	0.40	0.42	0.38	0.35
29/03/2012	0.40	0.42	0.37	0.34
30/03/2012	0.37	0.41	0.37	0.34
31/03/2012	0.35	0.39	0.35	0.32


Lower Limit: **0.2** mg/l Cl

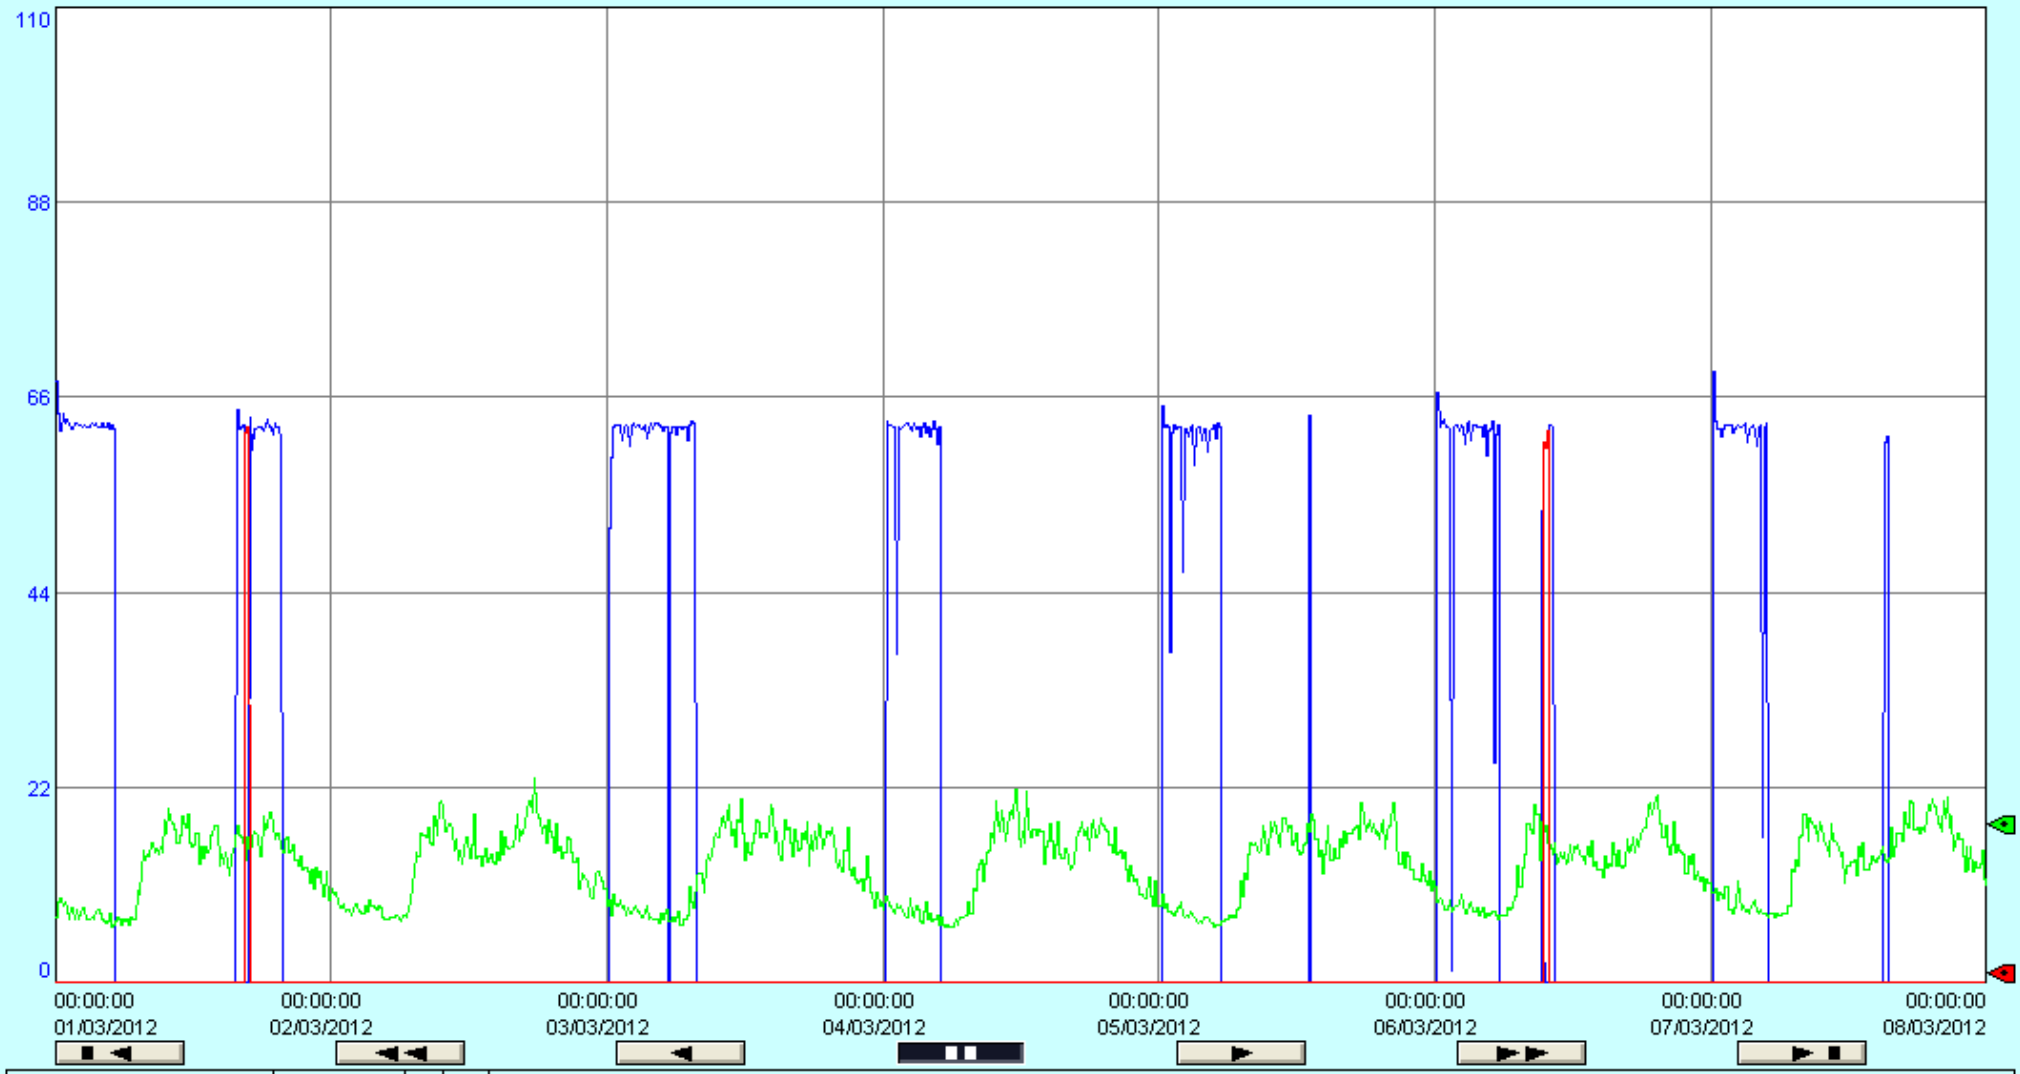


Caption	11:04:18	Min	Max	Units
Treated Water Flow	0	0	110	m3/h
Reservoir Flow	17	0	110	m3/h
Backwash Flow	0	0	110	m3/h

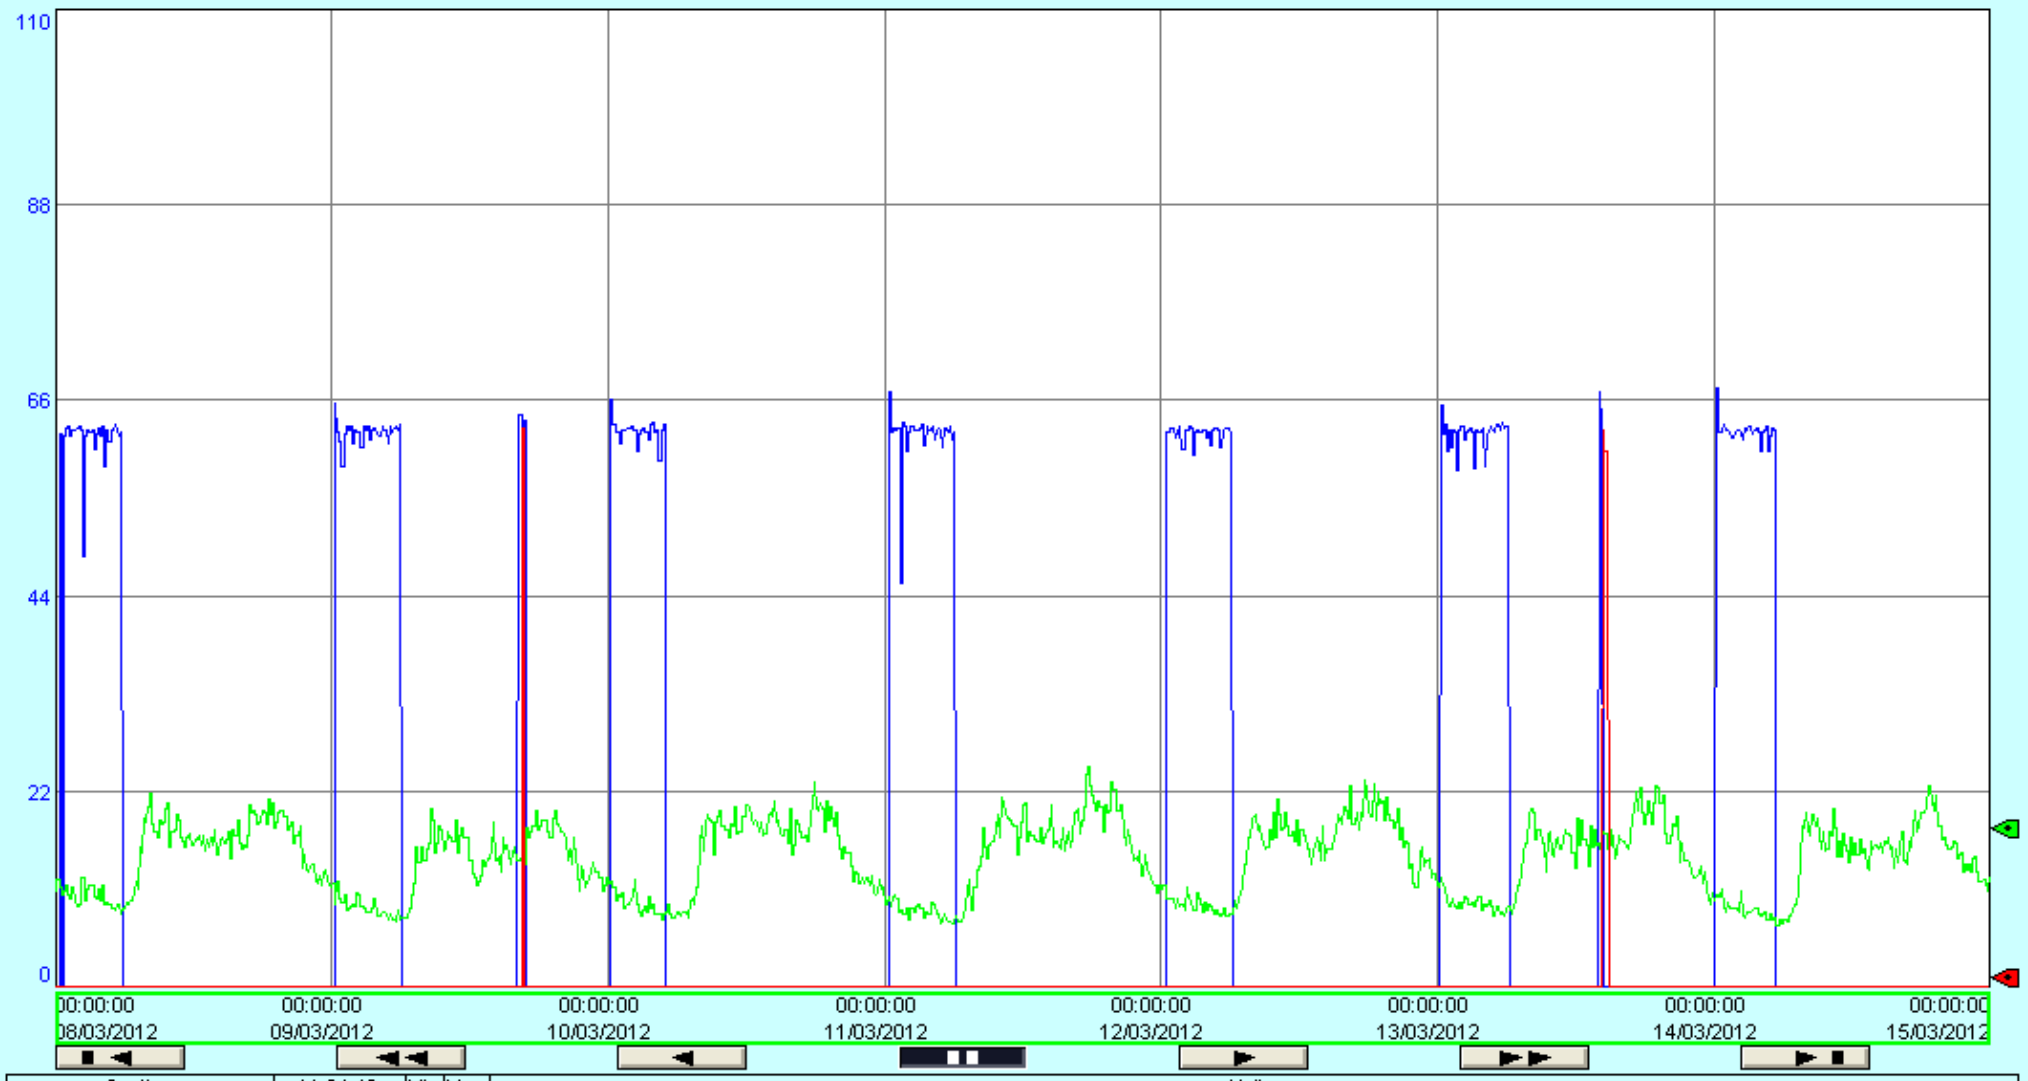


Caption	11:04:48	Min	Max	Units
Treated Water Flow	0	0	110	m3/h
Reservoir Flow	17	0	110	m3/h
Backwash Flow	0	0	110	m3/h

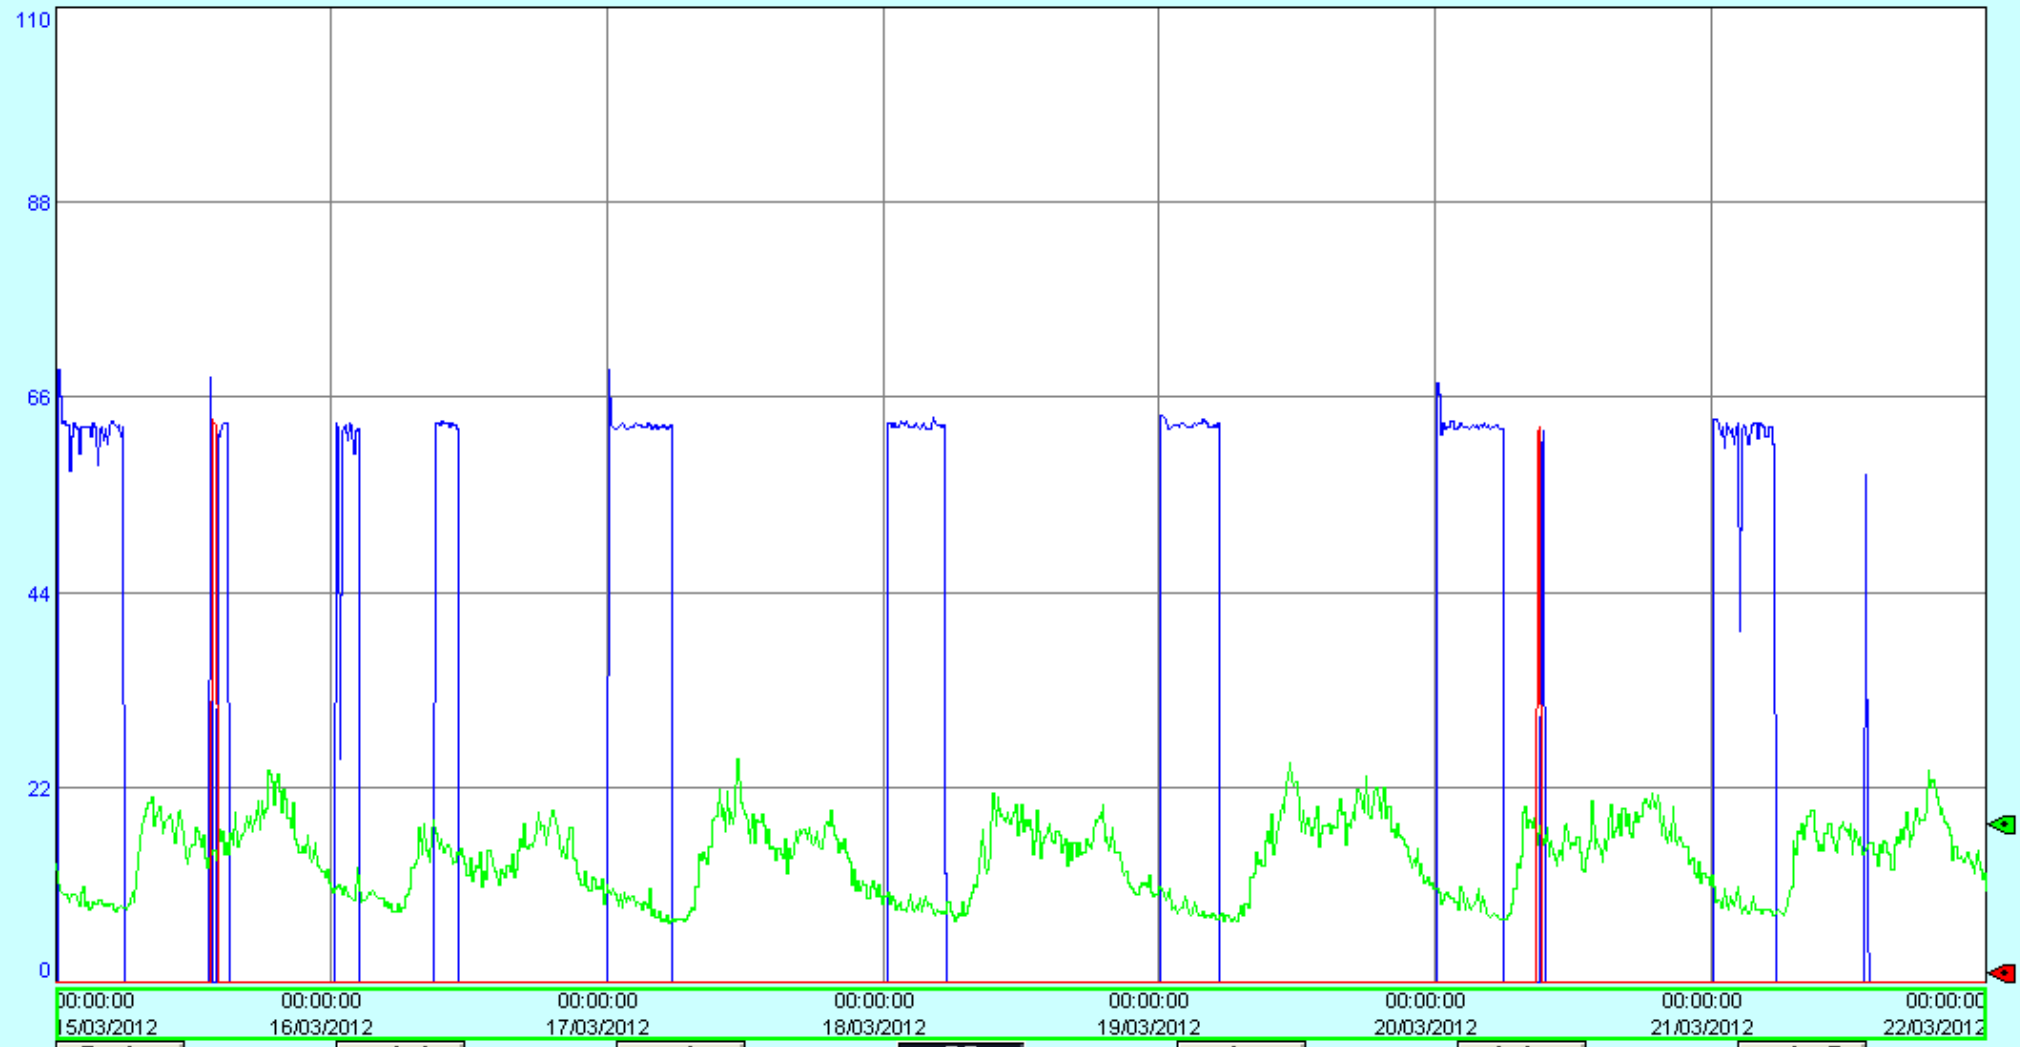


Caption	11:05:03	Min	Max	Units
Treated Water Flow	0	0	110	m3/h
Reservoir Flow	17	0	110	m3/h
Backwash Flow	0	0	110	m3/h

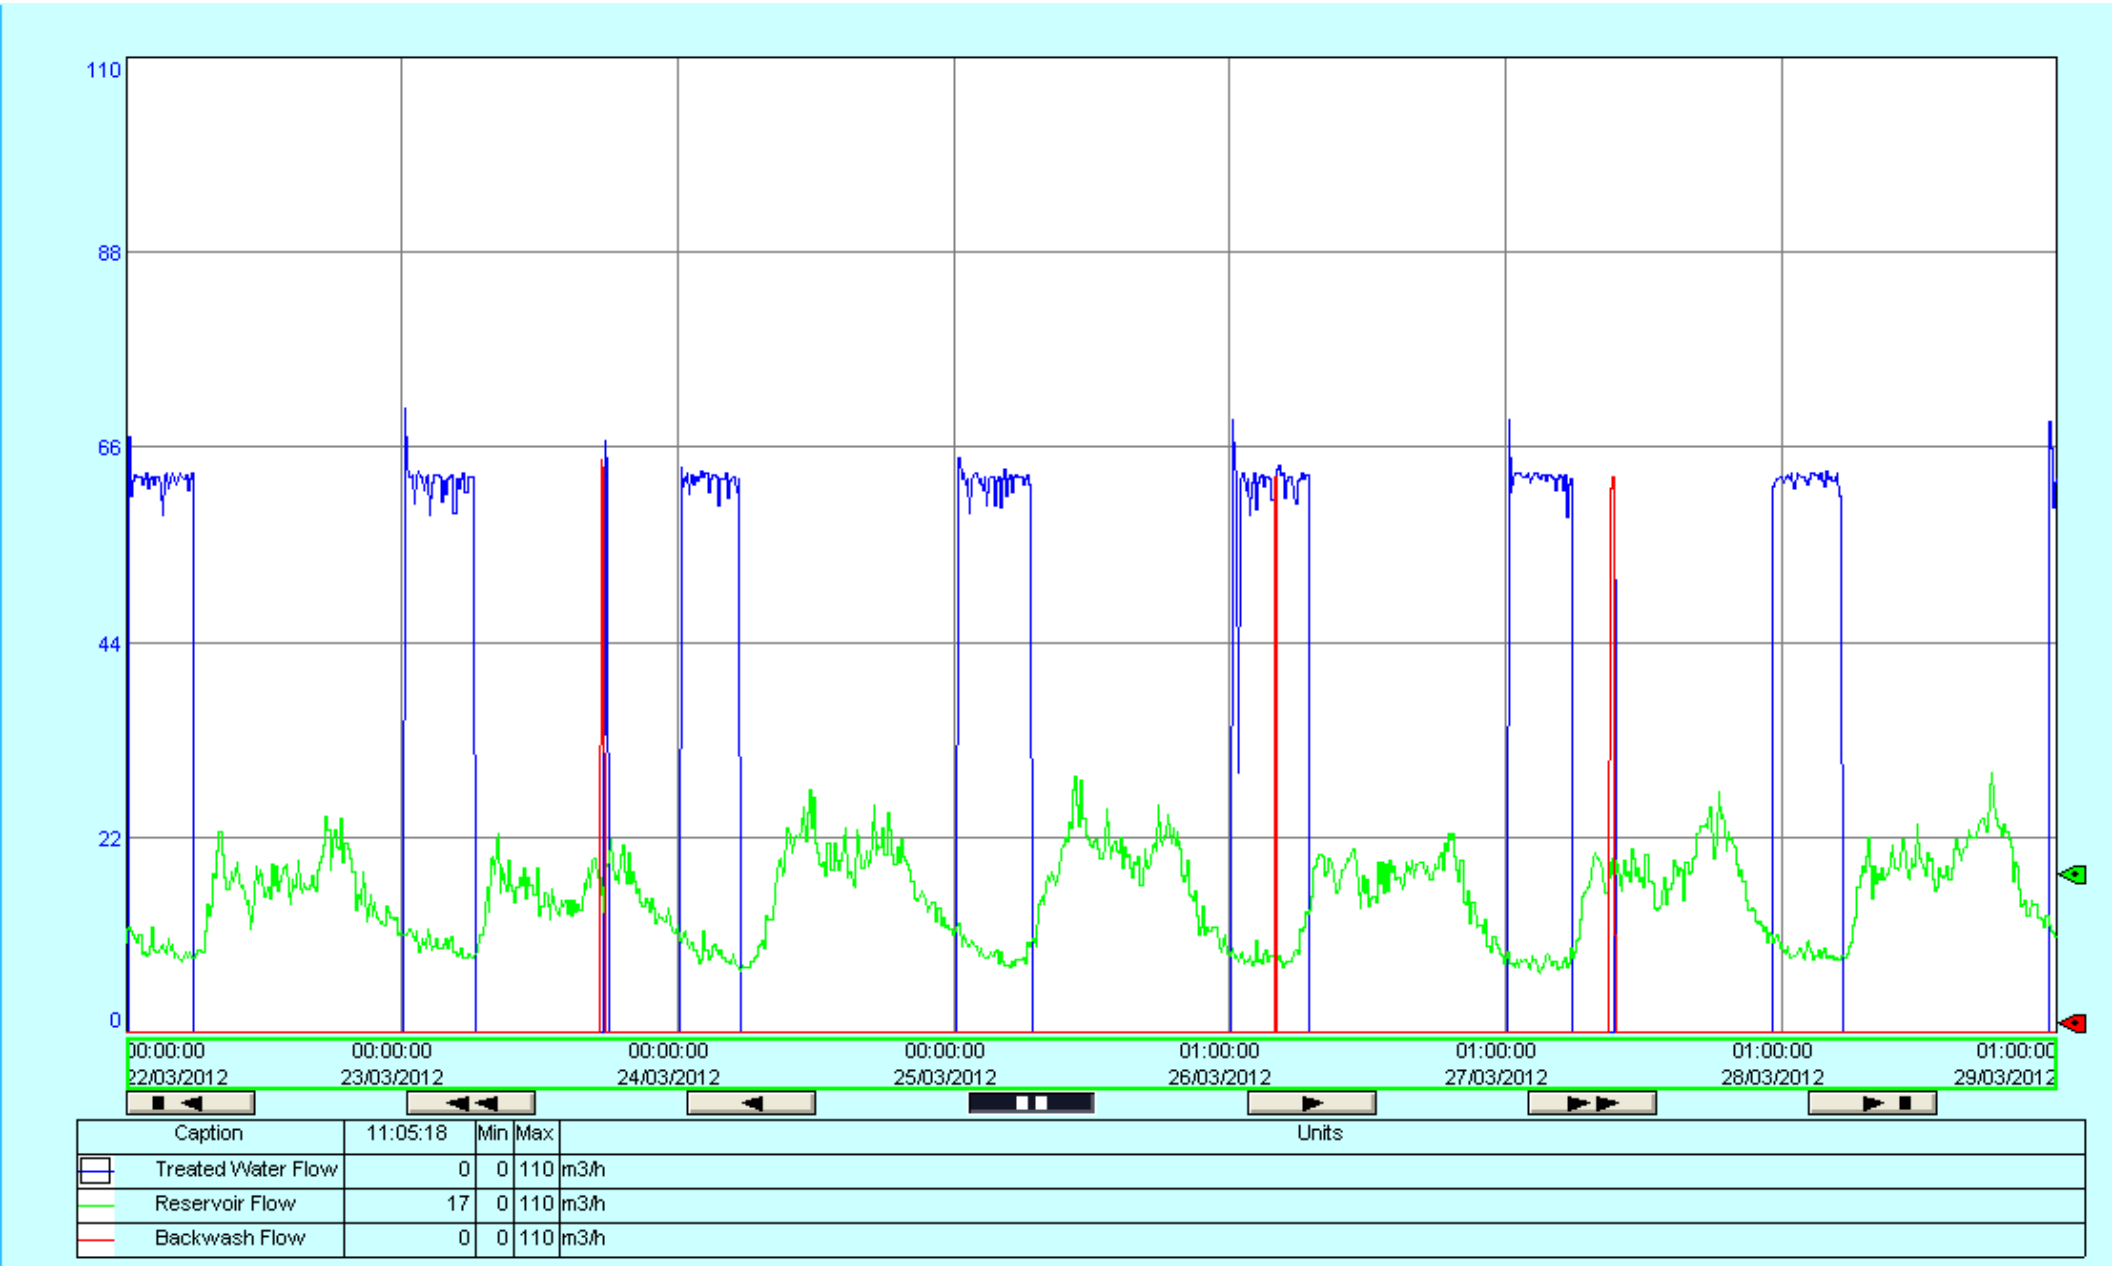


Caption	11:05:18	Min	Max	Units
Treated Water Flow	0	0	110	m3/h
Reservoir Flow	17	0	110	m3/h
Backwash Flow	0	0	110	m3/h

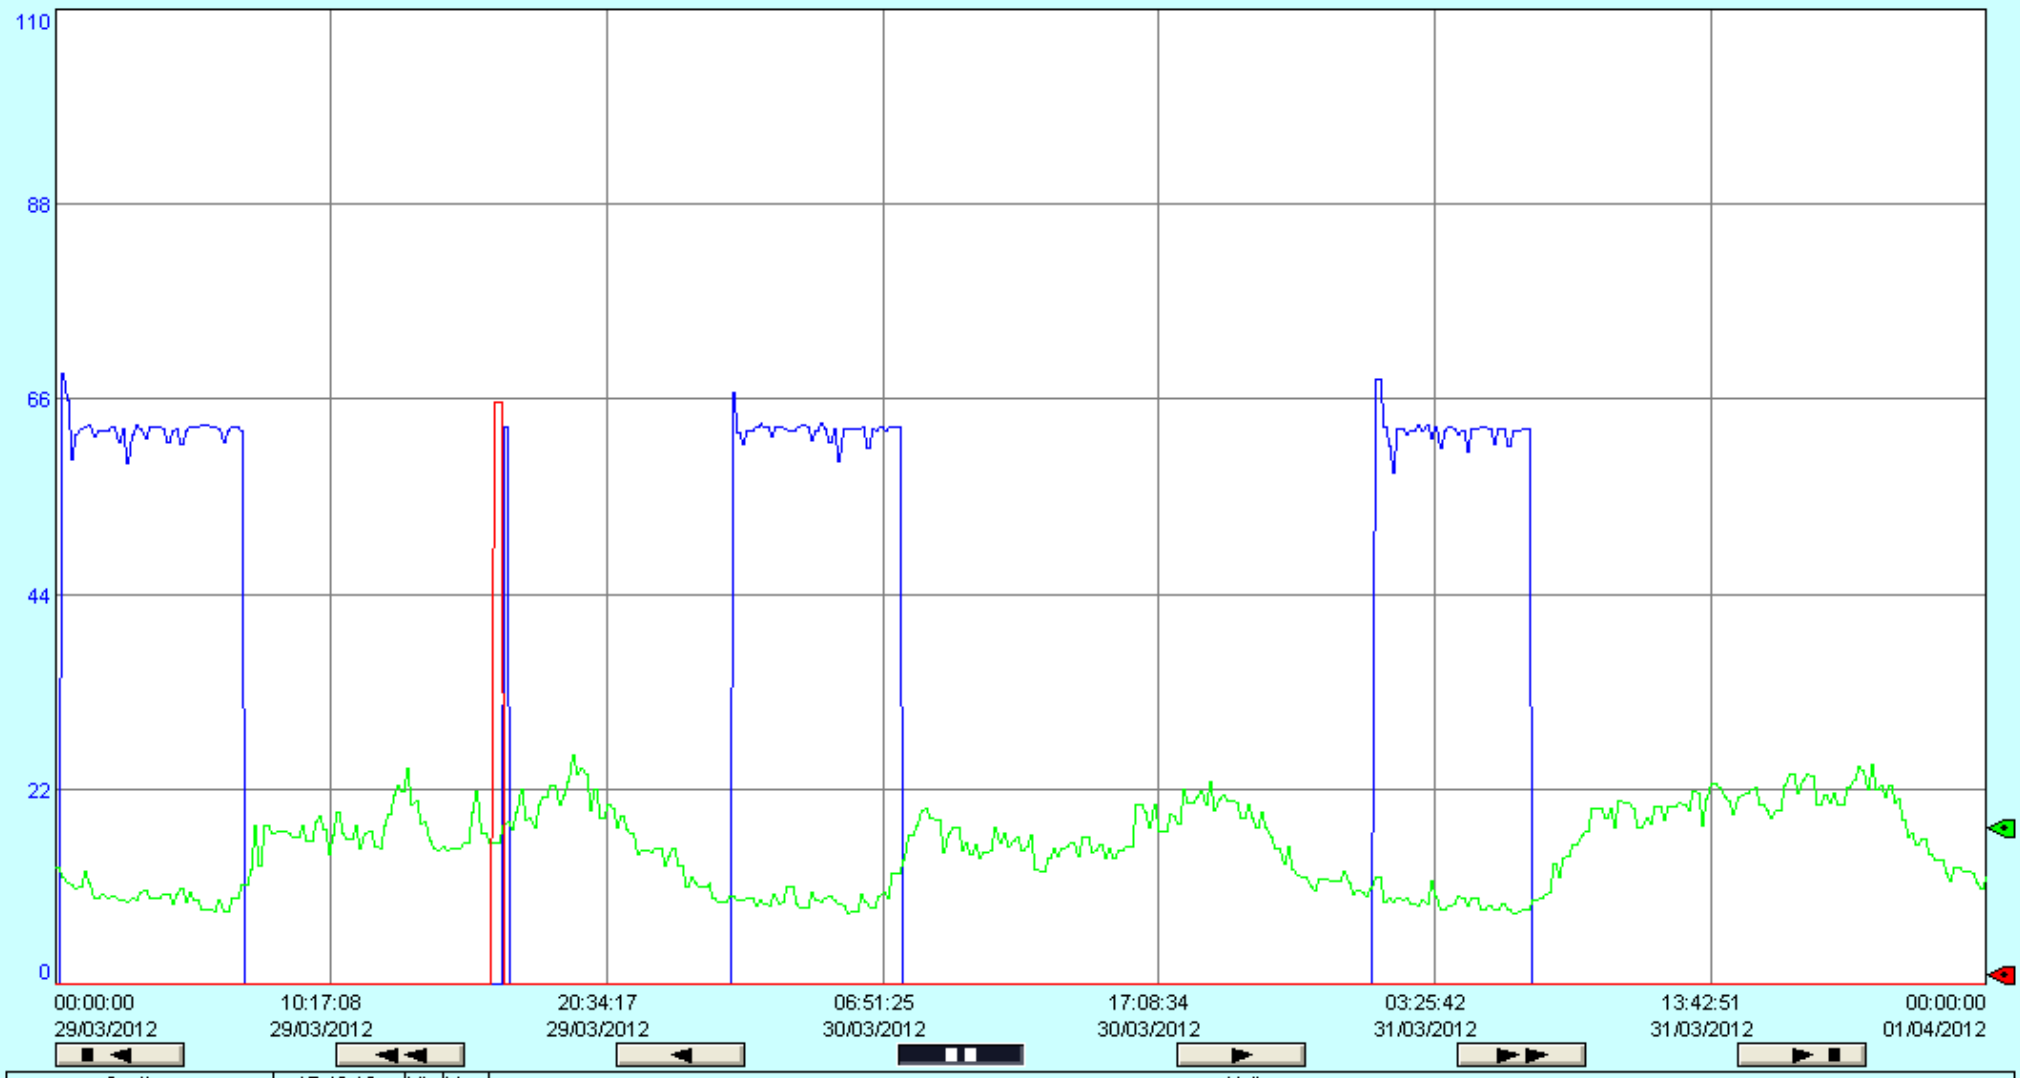


Caption	17:49:18	Min	Max	Units
Treated Water Flow	0	0	110	m3/h
Reservoir Flow	17	0	110	m3/h
Backwash Flow	0	0	110	m3/h

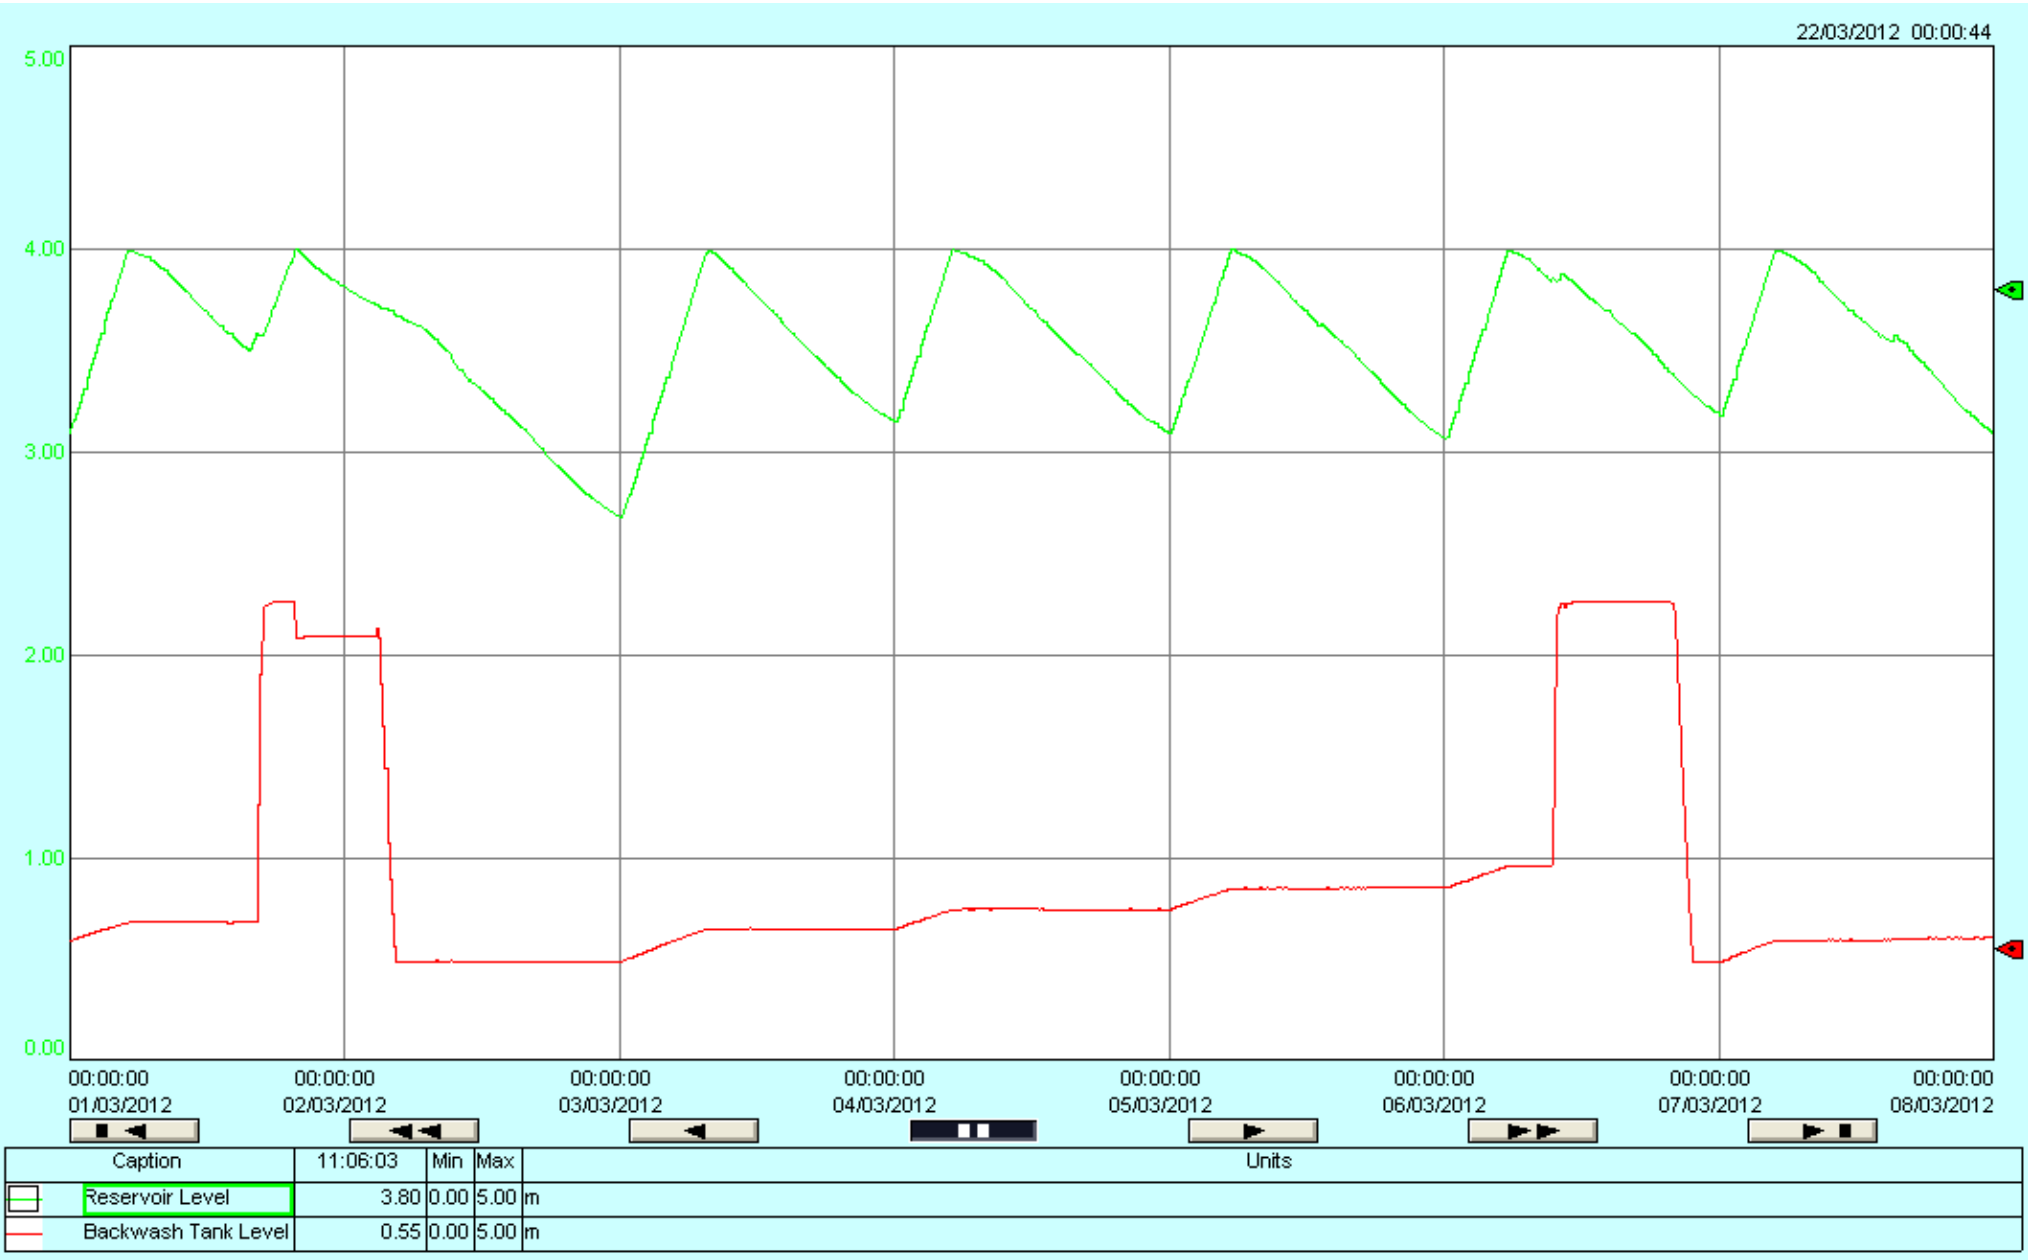


Caption	11:06:03	Min	Max	Units
Reservoir Level	3.80	0.00	5.00	m
Backwash Tank Level	0.55	0.00	5.00	m

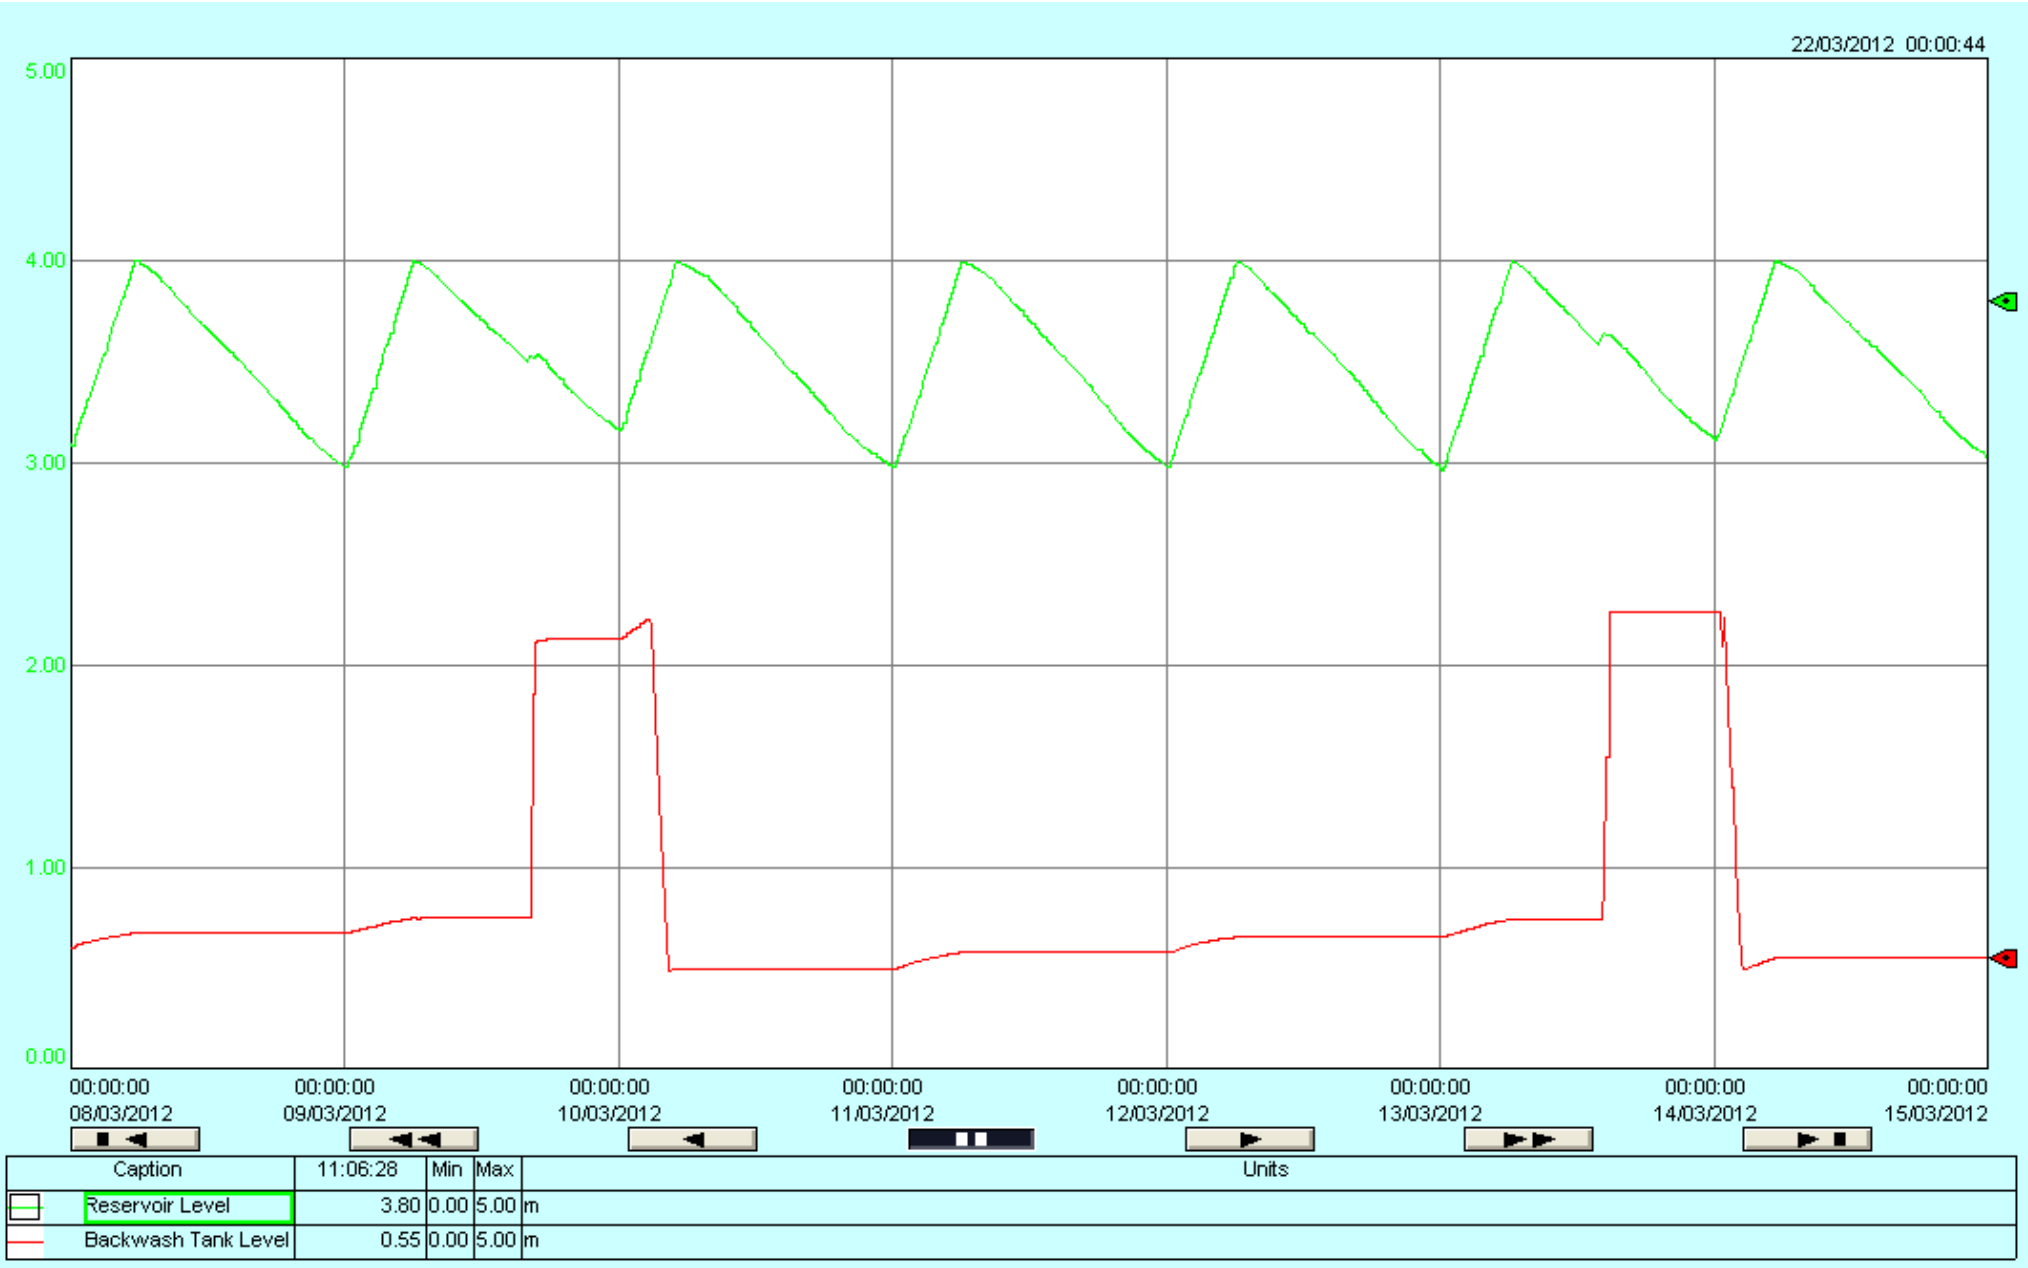

Caption	11:06:28	Min	Max	Units
Reservoir Level	3.80	0.00	5.00	m
Backwash Tank Level	0.55	0.00	5.00	m

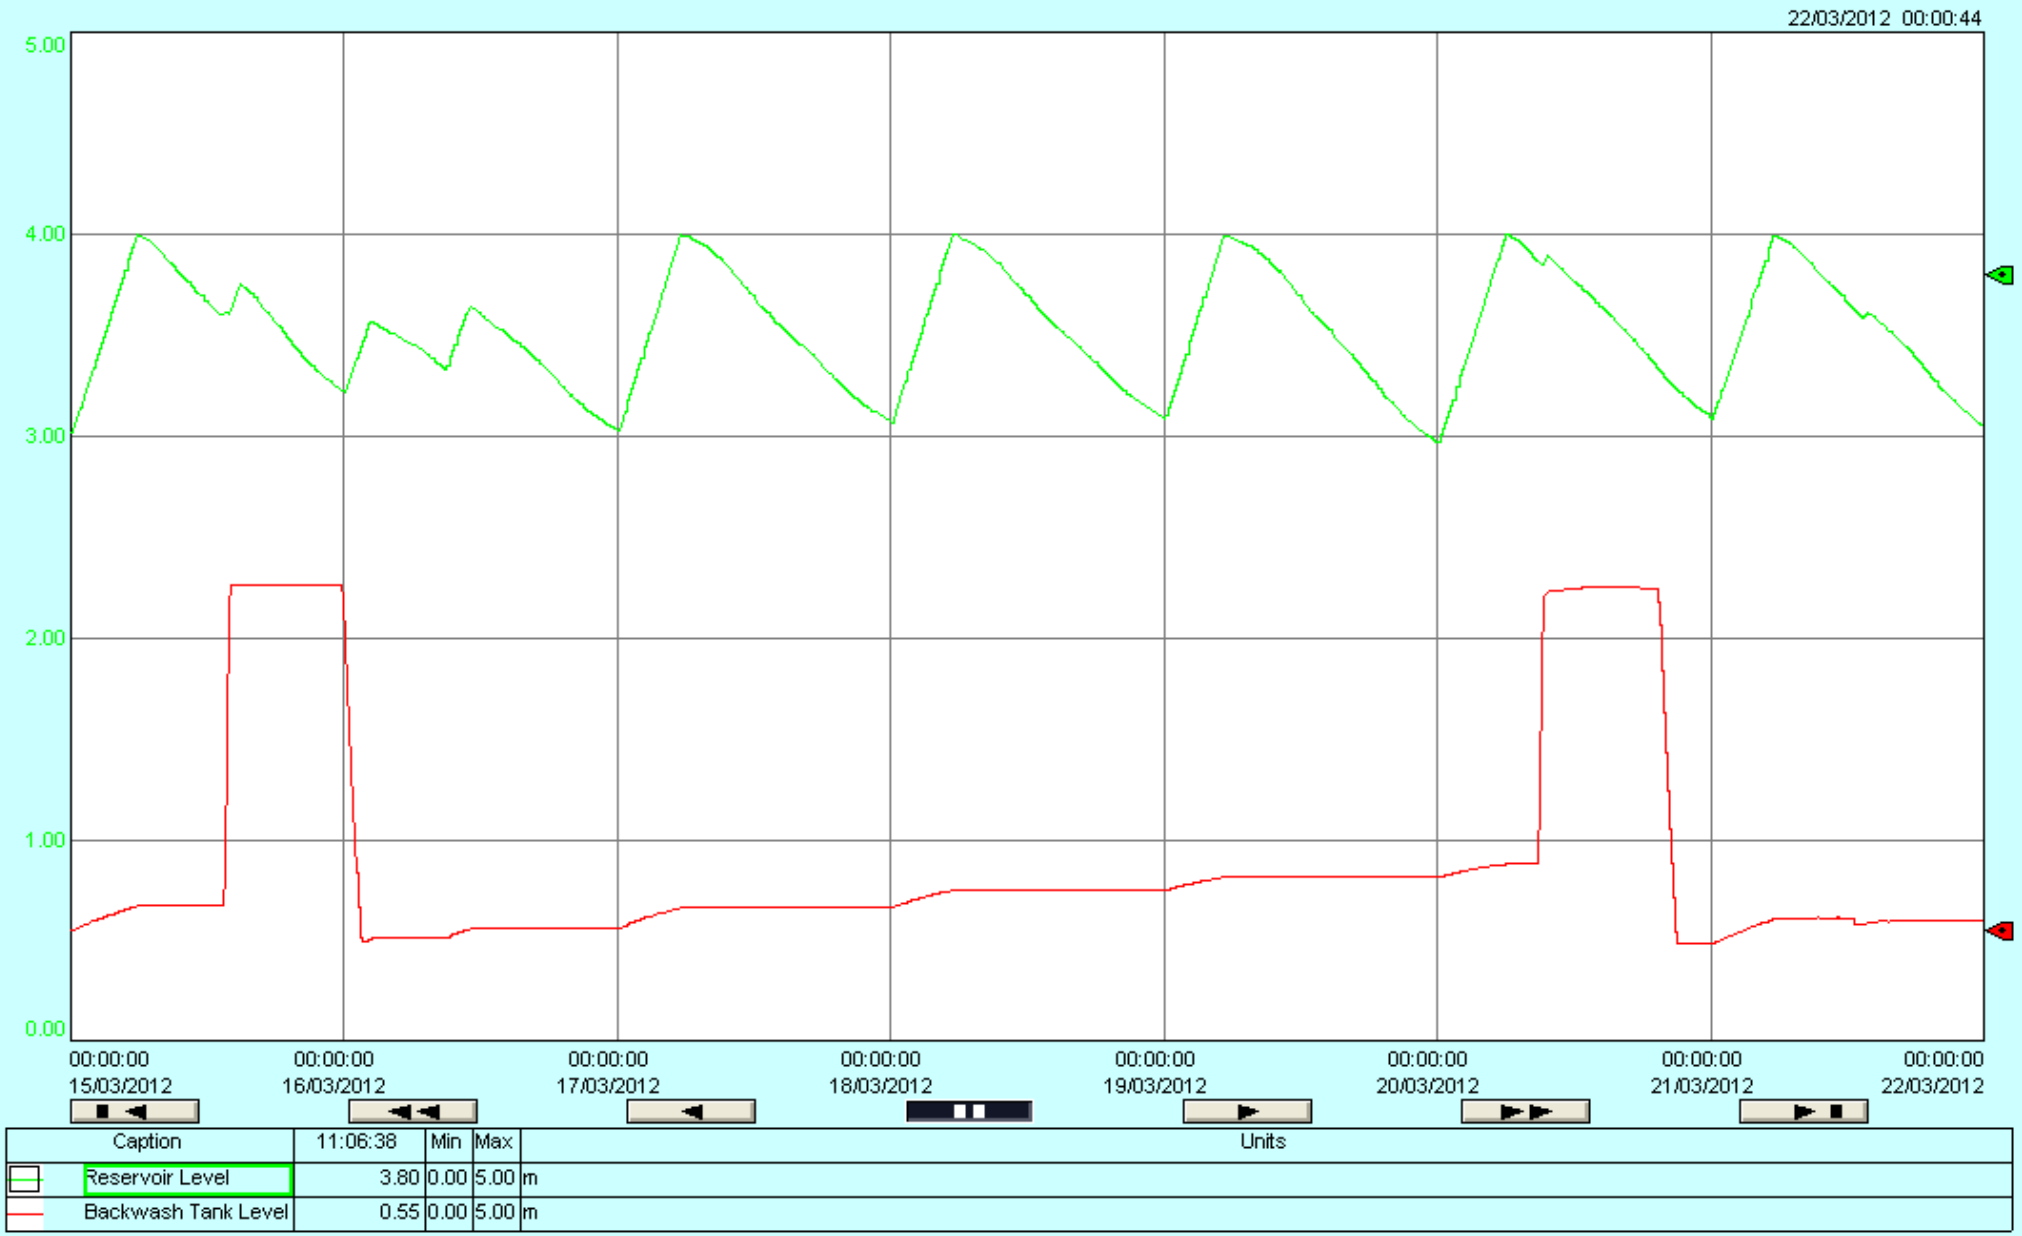

Caption	11:06:38	Min	Max	Units
Reservoir Level	3.80	0.00	5.00	m
Backwash Tank Level	0.55	0.00	5.00	m

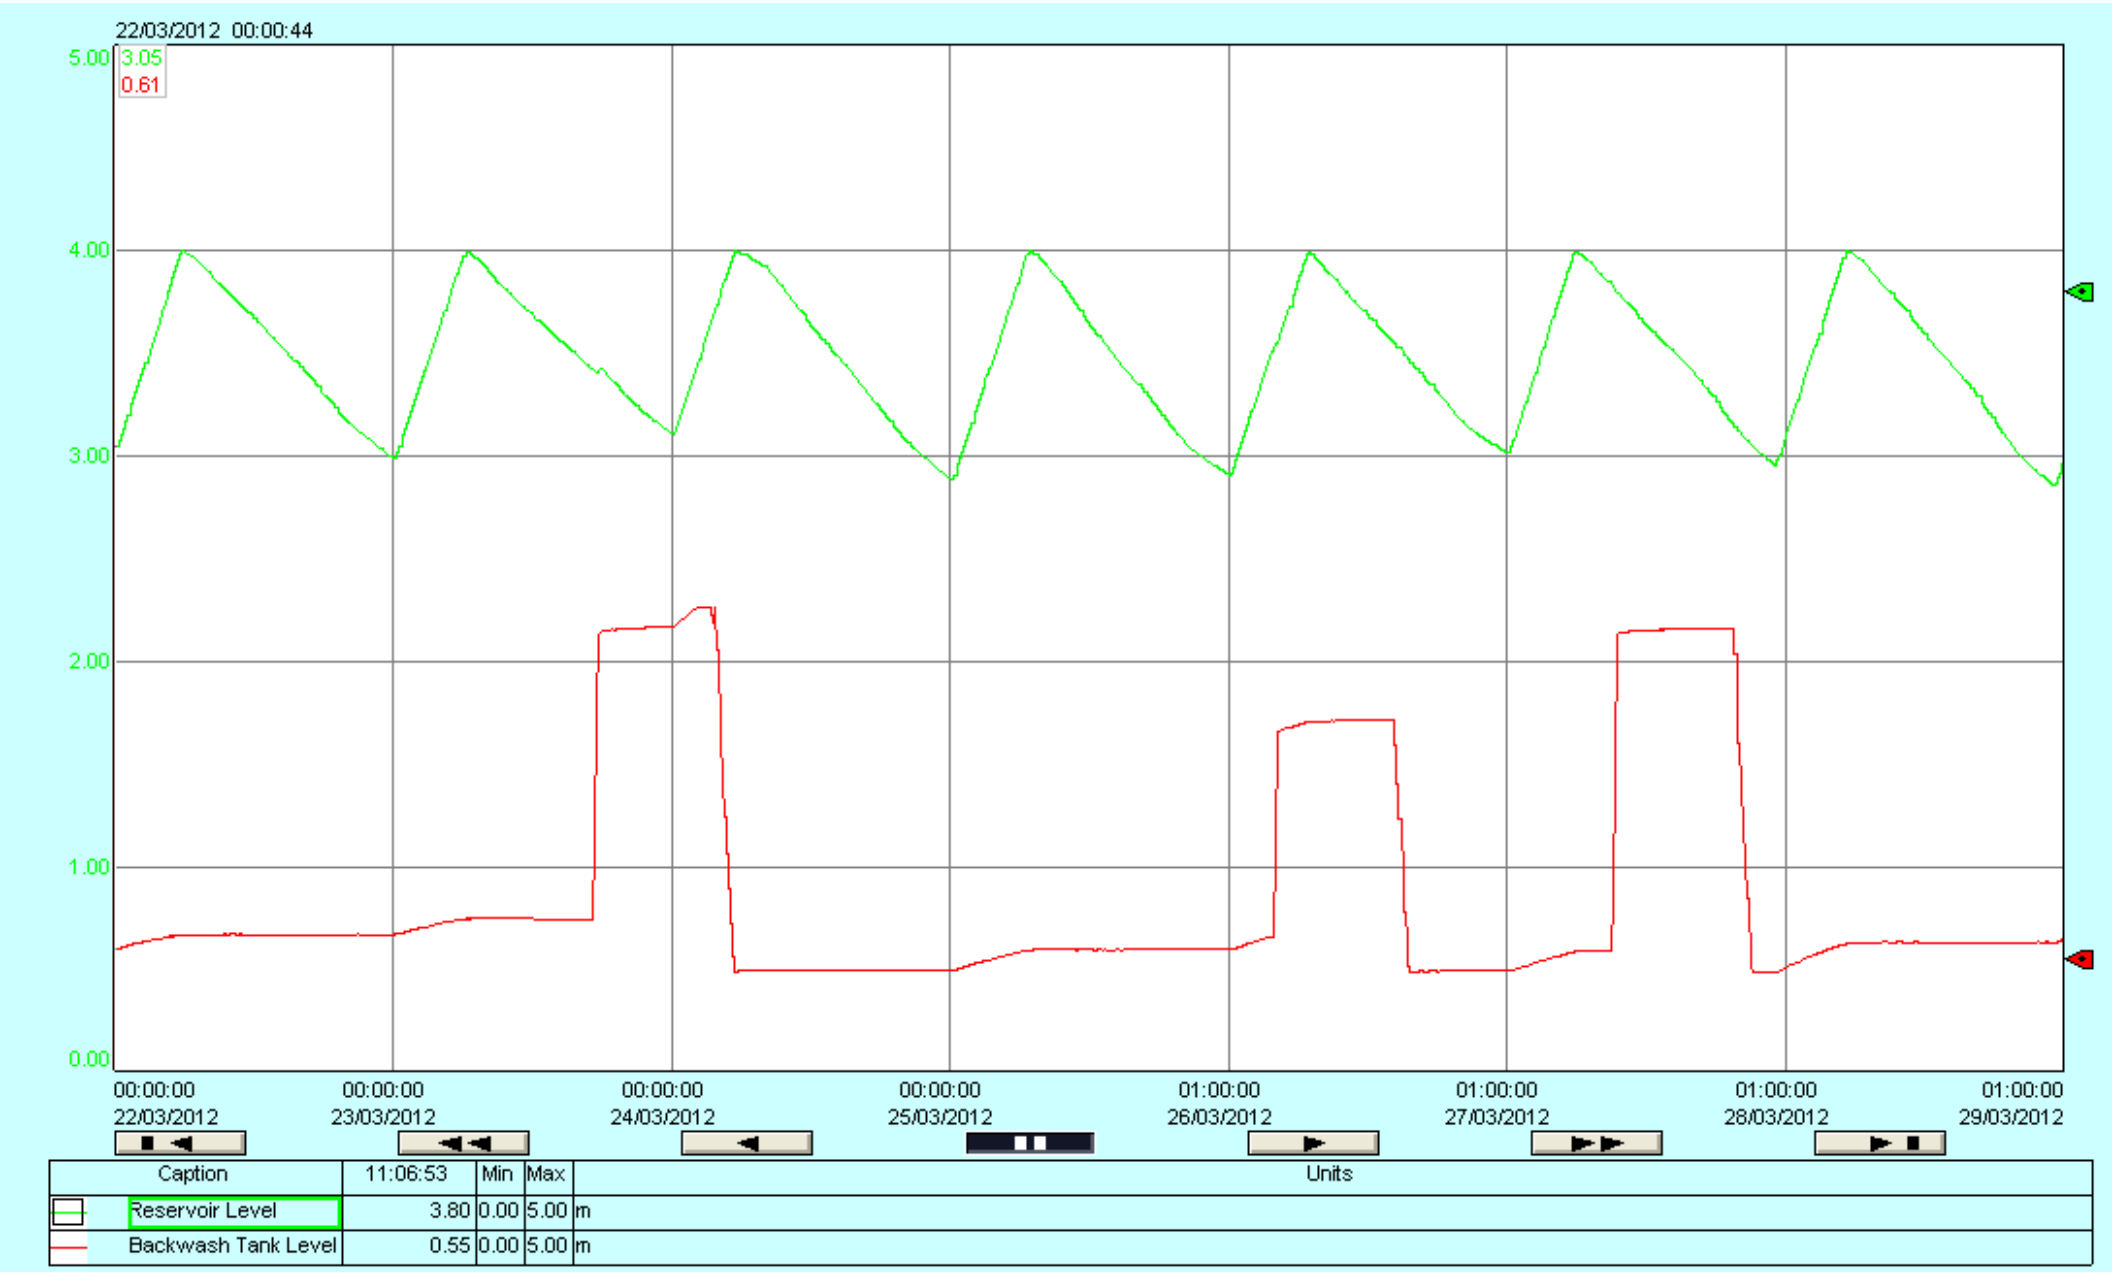


Caption	11:06:53	Min	Max	Units
Reservoir Level	3.80	0.00	5.00	m
Backwash Tank Level	0.55	0.00	5.00	m




Caption	17:49:48	Min	Max	Units
Reservoir Level	3.43	0.00	5.00	m
Backwash Tank Level	1.99	0.00	5.00	m


Graph of Daily Flows of Raw and Treated Water for March 2012.

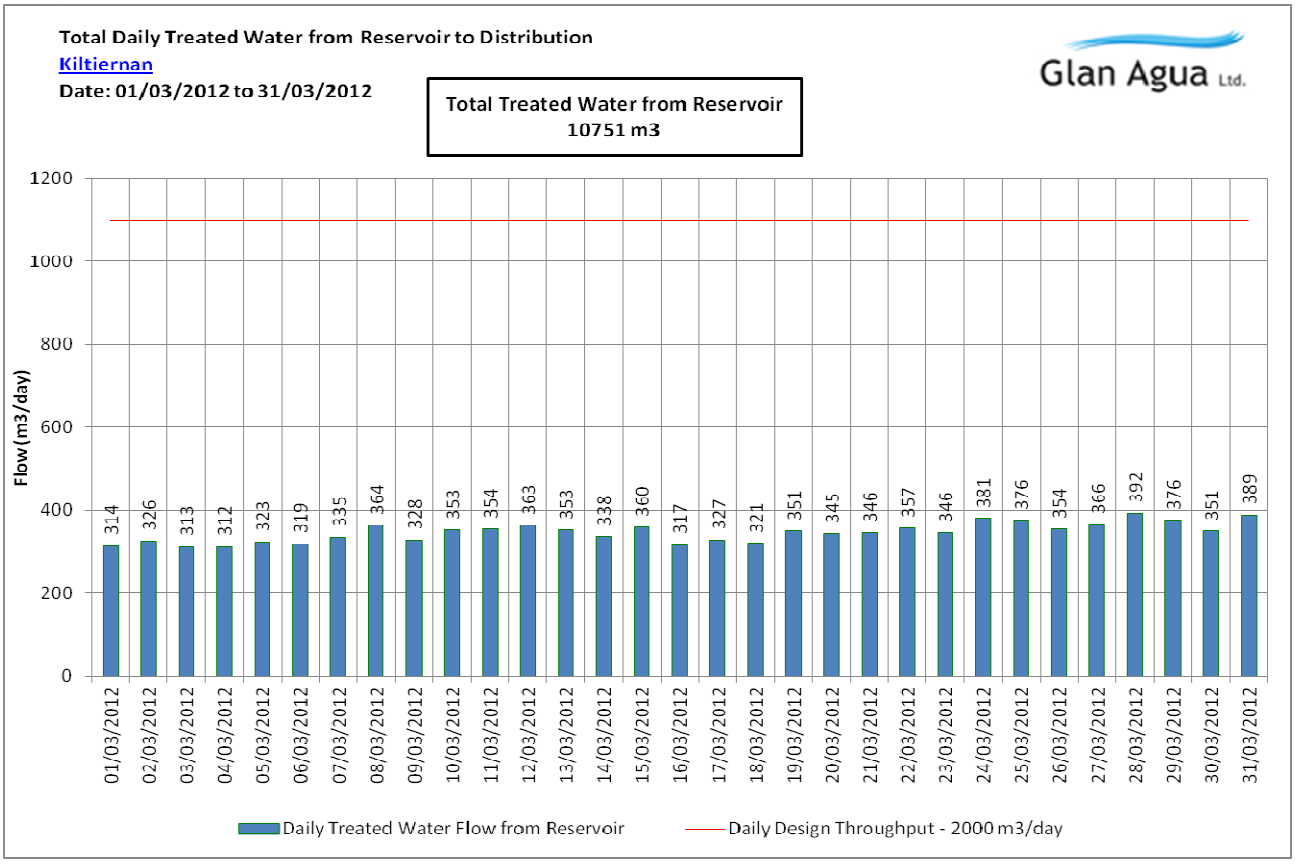


Average Daily Graph of Colour in Raw and Treated Water for March 2012.

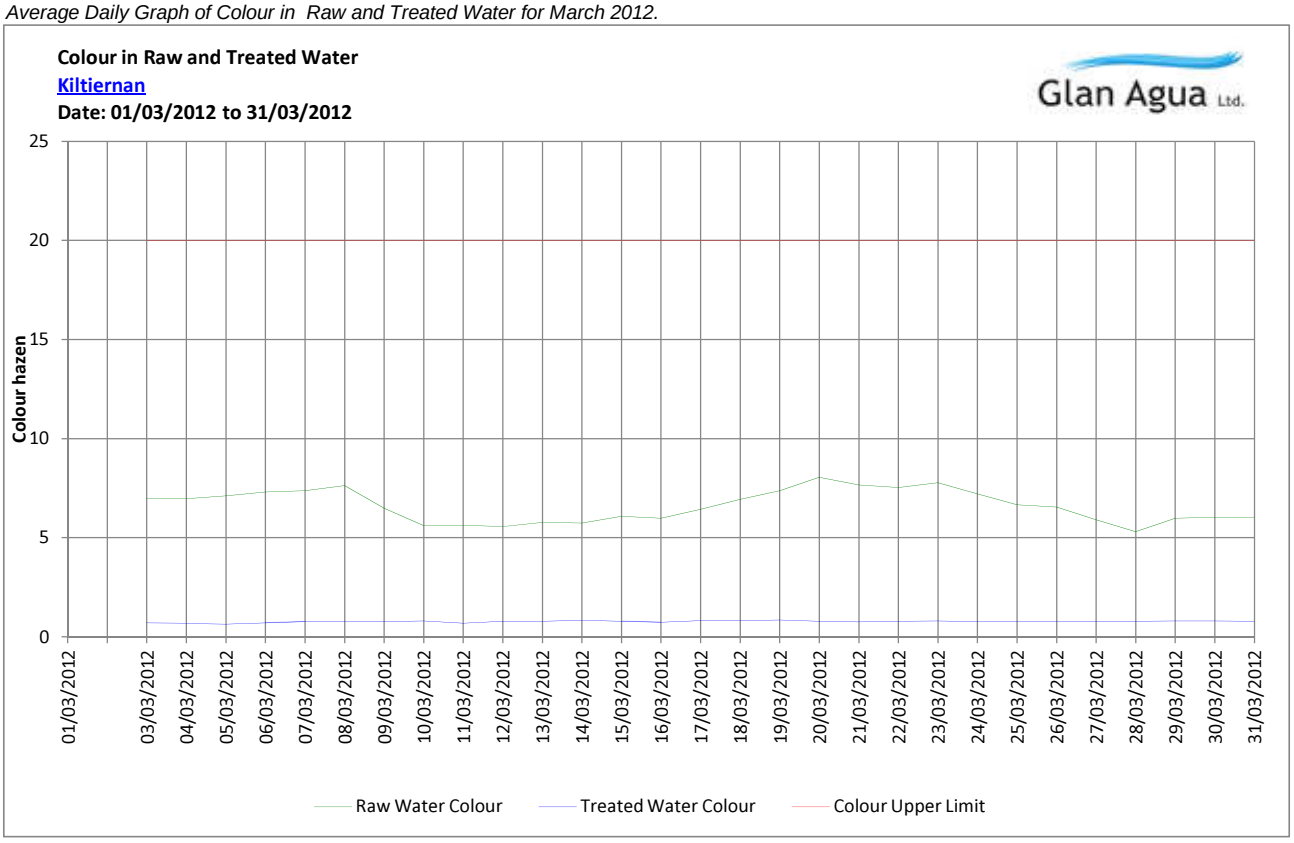


Average Daily Graph of Turbidity in Raw and Treated Water for March 2012.

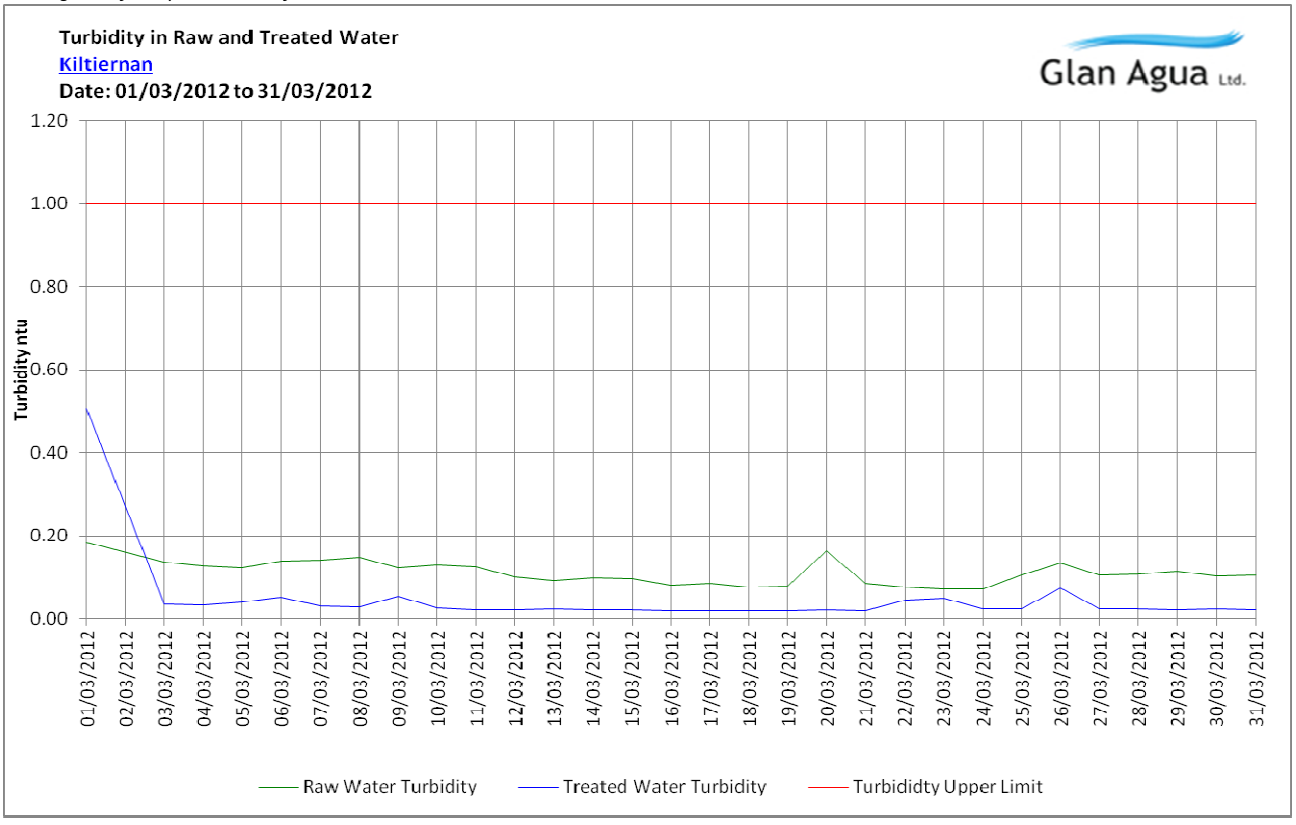

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution for March 2012.

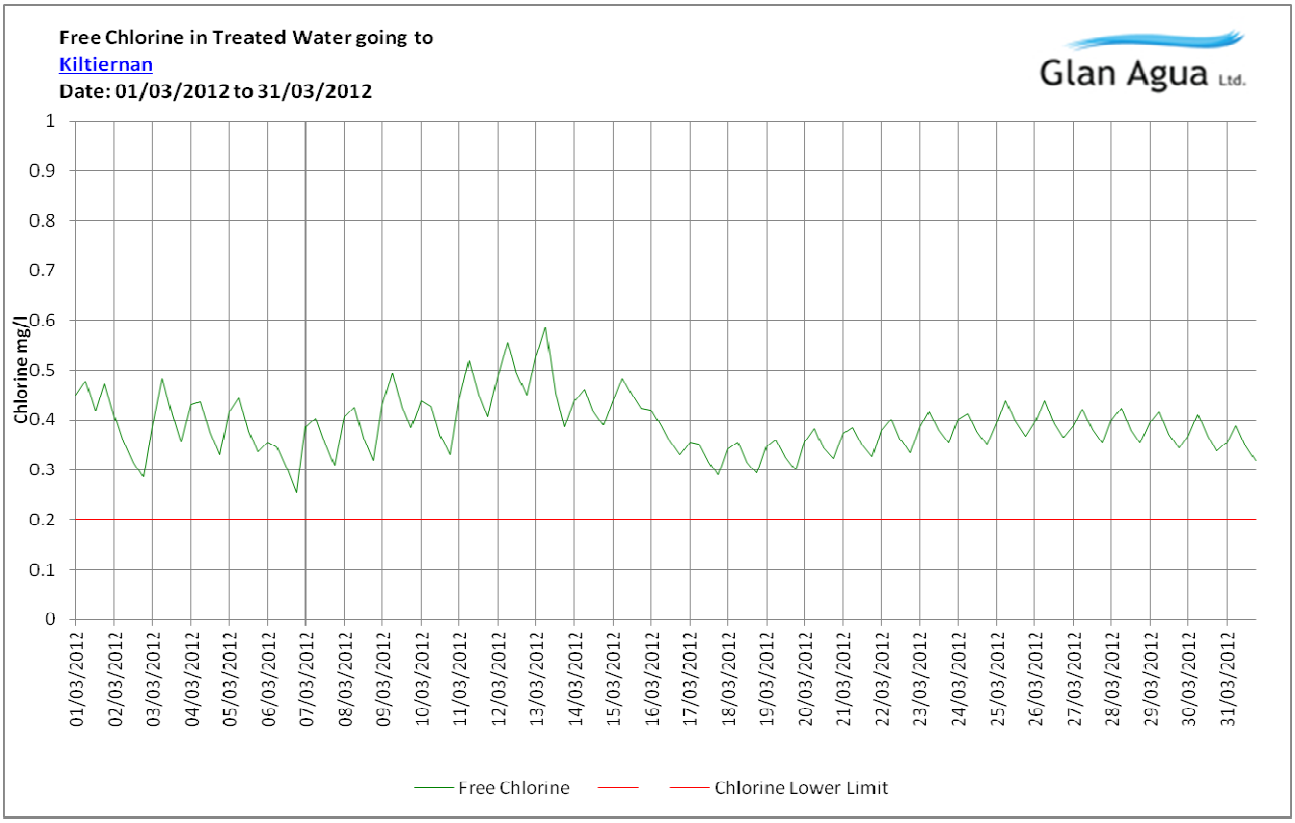

UV in Treated Water going to Distribution from for March 2012.

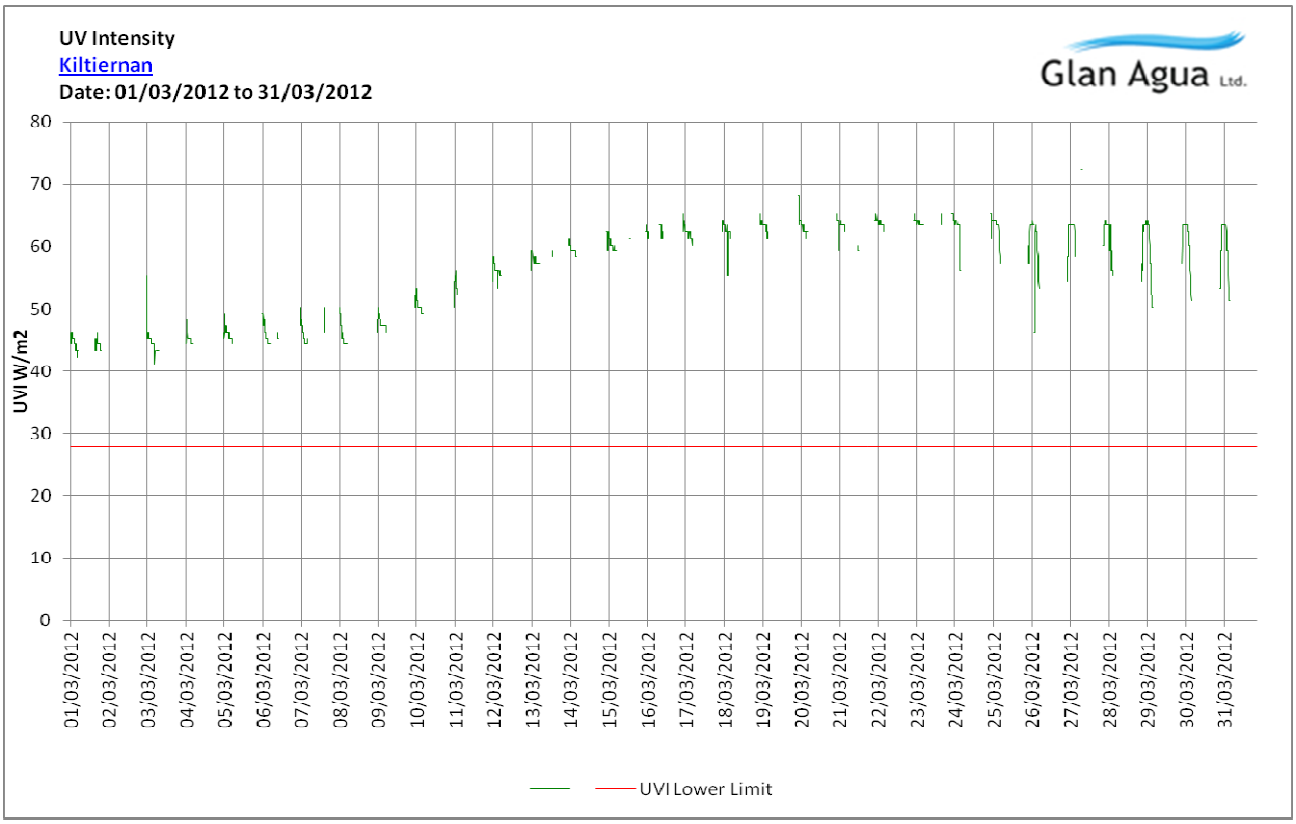

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analythical Results

Category	Report On	Comments
Final water	Quality comparison to contract requirements	Fully compliant with S.I. 278 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 278
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary 07/03/2012

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.5
TOC	mg/l	2.5
pH		7.2
Apparent Colour	mg/l PtCo	5
Fe	ug/l	<20
Al	ug/l	20
Mn	ug/l	<5
Nitrate NO2	mg/l	<0.07
Nitrate NO3	mg/l	9.21
Ammonia	mg/l	<0.01
Treated Water		
Aluminium	ug/l	<20
Ammonium	mg/l	<0.01
Apparent Colour	mg/l PtCo	<5
TOC	mg/l	2.1
E.coli	MPN/100ml	<1
pH	pH units	7.3
Fe	ug/l	<20
Mn	ug/l	<5
Coliform	MPN/100ml	<1
Turbidity	NTU	<0.5
Clostridium Perfringens	cfu/100ml	<1
Nitrate NO3	mg/l	9.21
Nitrites NO2	mg/l	<0.07

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Health & Safety Issues ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

Plant Manager:	Julian Drapiewski	**Date:**	04/04/2012
For Period:	01/03/2012-31/03/2012		
Site Involved:	Kiltiernan WTP		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**2**	*Exposure Hours*	**11:15**		
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Subcontractors

Number of Emplyees	**1**	*Exposure Hours*	0.2		
Subcontractors on Site	City Analsyts				
	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents					
Days Lost					

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 10: ***Operator: Stephen Costello***

Site Alarm /Incident Record

Date	Time	Type of Alarm/ Incident	Person Dealing with	Cause of Alarm/ Incident
16/03/2012	08:50	ODIS Low Chlorine	Aidan O' Malley	Injection point needed cleaning

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
02/03/2012	A. O'Malley	GA Operator	16:00	17:00	WTP Inspection
05/03/2012	S. Costello	GA Operator	13:00	13:15	WTP Inspection
06/03/2012	S. Costello	GA Operator	09:10	10:15	WTP Inspection
07/03/2012	S. Costello	GA Operator	14:55	15:20	WTP Inspection
07/03/2012	A. O'Malley	GA Operator	15:30	15:45	Sampling
07/03/2012	Maurice Daffy	City Analysis	15:30	15:45	Sampling
09/03/2012	S. Costello	GA Operator	16:00	16:15	WTP Inspection
13/03/2012	A. O'Malley	GA Operator	13:45	15:05	WTP Inspection
15/03/2012	S. Costello	GA Operator	13:20	13:25	WTP Inspection
15/03/2012	S. Costello	GA Operator	14:50	15:00	WTP Inspection
16/03/2012	A. O'Malley	GA Operator	08:50	10:00	Alarm and WTP Inspection
20/03/2012	A. O'Malley	GA Operator	08:30	09:40	WTP Inspection
21/03/2012	J. Drapiewski	GA O&M Manager	11:55	14:00	WTP Inspection
23/03/2012	E. Galligan	EMCA	17:10	17:50	WTP Inspection
27/03/2012	P O'Hare	EMCA	09:55	10:35	WTP Inspection
29/03/2012	A. O'Malley	GA Operator	16:10	16:50	WTP Inspection

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kiltiernan GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	07/03/2012	***Sample No:***	122248
Analyst	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	<1	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Raw Water	07/03/2012	122247
City Analysts	Treated Water	07/03/2012	122248

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

ISO 17025 INAB ACCREDITED TESTING DETAILED IN SCOPE REG NO. 138T

Customer Contact: Julian Drapiewski
Customer: Glan Aqua Ltd
Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-00469-GAL
Report Version: 1
Reason for report re-issue: Report re-issued due to result entry typo on original report.

Report Date: 16/03/2012

Customer PO No.: GA 11-27-0011
Chain of Custody No.:

Certificate Of Analysis

Analysis of 2 sample(s) submitted on 07/03/2012 is now complete.
We have the pleasure of enclosing your certificate of analysis.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our web site at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Melissa Brady **Date:** 16/03/2012

Authorised Signatories:
Dublin : Miriam Byrne, Melissa Brady, Maria Nevin, Leann Hession, Slawek Gryczewski, Ewa Krol, Dariusz Bartoszewicz, Stephen Crampton.
Limerick: Hugh O'Donnell, Maurice Daffy, Sylwia Wojtowicz.
Note: Information on methods of analysis and performance characteristics is available on request.

Note: Results relate only to the items tested.
Test report shall not be reproduced except in full or with written approval of City Analysts Ltd.

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-00469-GAL
Report Version: 1
Date Received: 07/03/2012

Sample Description: KILTIERNAN RAW WATER
Sample Type: Raw Water
Date Sampled: 07/03/2012
Lab Reference Number: 122247

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3000	14/03/2012	Nitrate as NO3	9.21	mg/l	-	INAB
D/3000	14/03/2012	Nitrite as NO2	<0.07	mg/l	-	INAB
SUB C		Total organic carbon	2.50	mg/l	-	UKAS
D/3000	14/03/2012	Ammonia as N	<0.01	mg/l	-	INAB
D/3001	12/03/2012	Manganese, Total	<5	ug/l	-	INAB
D/3001	12/03/2012	Iron, Total	<20	ug/l	-	INAB
D/3001	12/03/2012	Aluminium, Total	20	ug/l	-	INAB
L/3010	09/03/2012	Colour. Apparent	5	Hazen	-	NON
D/3054	09/03/2012	Turbidity	<0.5	NTU	-	INAB
L/1041	08/03/2012	pH	7.20	pH Units	-	INAB

Note:

NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

City Analysts Limited
Environmental Laboratories

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel:(01) 613 6003 /6 /9
Fax:(01) 613 6008
Email:info@cityanalysts.ie

www.cityanalysts.ie

Certificate of Analysis

Customer Contact: Julian Drapiewski

Customer: Glan Aqua Ltd

Customer Address: Enterprise Centre
Creagh Road
Ballinasloe
Co Galway

Report Reference: 12-00469-GAL
Report Version: 1
Date Received: 07/03/2012

Sample Description: KILTIERNAN TREATED WATER
Sample Type: Treated Water
Date Sampled: 07/03/2012
Lab Reference Number: 122248

Site/Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value	Accreditation Status
D/3000	14/03/2012	Nitrate as NO3	9.21	mg/l	50 mg/L	INAB
D/3000	14/03/2012	Nitrite as NO2	<0.07	mg/l	0.50 mg/L	INAB
D/3000	14/03/2012	Ammonia as N	<0.01	mg/l	0.23 mg/l	INAB
L/1201	07/03/2012	Total Coliforms	<1.00	MPN/100ml	0 / 100mls	INAB
L/1201	07/03/2012	E.coli	<1.00	MPN/100ml	0/100mls	INAB
SUB C		Total organic carbon	2.10	mg/l		UKAS
L/1214	07/03/2012	Clostridium perfringens	<1	cfu/100ml	0 / 100mls	INAB
D/3001	12/03/2012	Manganese, Total	<5	ug/l	50 µg/l	INAB
D/3001	12/03/2012	Iron, Total	<20	ug/l	200 µg/l	INAB
D/3001	12/03/2012	Aluminium, Total	<20	ug/l	200 µg/l	INAB
D/3054	09/03/2012	Turbidity	<0.5	NTU	NAC & ATC	INAB
L/3010	09/03/2012	Colour. Apparent	<5	Hazen	NAC + ATC	NON
L/1041	08/03/2012	pH	7.30	pH Units	6.5 - 9.5	INAB

Note:

NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total Viable Count
PV Value is the parametric value, taken from European Communities, (Drinking Water) (No. 2) Regulations, 2007. S.I. No. 278 of 2007, and relates only to drinking water samples.
Site D = Analysed at City Analysts Dublin. Site L = Analysed at City Analysts Limerick

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilconierin	24/07/2017	Raw	Alkalinity	No abnormal change	-	689.91
BushyPark	06/02/2012	Treated	Aluminium	200	µg/l	214
Glinsk/Creggs	02/03/2012	Treated	Aluminium	200	µg/l	597
Milltown Co-Op	13/03/2012	Treated	Aluminium	200	µg/l	297
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Aluminium	200	µg/l	725
Moanbaun	04/10/2012	Treated	Aluminium	200	µg/l	2620
Criminagh/Lettermore	12/11/2012	Treated	Aluminium	200	µg/l	229
Kilconierin	24/07/2017	Raw	Aluminium	200	µg/l	0
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Aluminium	200	µg/l	25
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Aluminium	200	µg/l	12
Gallagh/Brownsgrove	16/01/2012	Treated	Aluminium	200	µg/l	8.2
Glinsk/Creggs	16/01/2012	Treated	Aluminium	200	µg/l	48.6
Newbridge Group Water Scheme	17/01/2012	Treated	Aluminium	200	µg/l	7.1
Corofin/Ballintubber	23/01/2012	Treated	Aluminium	200	µg/l	52
Corrandulla	23/01/2012	Treated	Aluminium	200	µg/l	38
Coole GWS	23/01/2012	Treated	Aluminium	200	µg/l	15.7
Cloon	23/01/2012	Treated	Aluminium	200	µg/l	32
Ardrahan, GWS	23/01/2012	Treated	Aluminium	200	µg/l	5
Clontuskert	24/01/2012	Treated	Aluminium	200	µg/l	99
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Aluminium	200	µg/l	2
Cuillagh	26/01/2012	Treated	Aluminium	200	µg/l	5
Doughiska No. 2	30/01/2012	Treated	Aluminium	200	µg/l	35
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	Aluminium	200	µg/l	43
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	Aluminium	200	µg/l	39
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	Aluminium	200	µg/l	40
Caherfinisker	30/01/2012	Treated	Aluminium	200	µg/l	35
Tubber	02/02/2012	Treated	Aluminium	200	µg/l	5
Seehan, Gort	02/02/2012	Treated	Aluminium	200	µg/l	3
Tierneevin	02/02/2012	Treated	Aluminium	200	µg/l	7
Roo	02/02/2012	Treated	Aluminium	200	µg/l	4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisheenavalla	06/02/2012	Treated	Aluminium	200	µg/l	34
Ballyfruit, Headford	08/02/2012	Treated	Aluminium	200	µg/l	30
Coolarne	08/02/2012	Treated	Aluminium	200	µg/l	24
Gurteen/Cloonmore	09/02/2012	Treated	Aluminium	200	µg/l	3
Garrafrauns	09/02/2012	Treated	Aluminium	200	µg/l	9
Carranurlaur	09/02/2012	Treated	Aluminium	200	µg/l	6
Annaghdown	10/02/2012	Treated	Aluminium	200	µg/l	33
Belclare	10/02/2012	Treated	Aluminium	200	µg/l	6
Rusheens	10/02/2012	Treated	Aluminium	200	µg/l	11
Anbally & District GWS	10/02/2012	Treated	Aluminium	200	µg/l	5
Bullaun, Tuam	10/02/2012	Treated	Aluminium	200	µg/l	28
Esker/ Eyrecourt	13/02/2012	Treated	Aluminium	200	µg/l	2
Newcastle (Aughrim)	13/02/2012	Treated	Aluminium	200	µg/l	3
Moyglass, Loughrea.	13/02/2012	Treated	Aluminium	200	µg/l	3
Feigh East & West	14/02/2012	Treated	Aluminium	200	µg/l	3
Abbert No 2	14/02/2012	Treated	Aluminium	200	µg/l	7
Abbert Public Group Water Scheme	14/02/2012	Treated	Aluminium	200	µg/l	8
Ballintleva GWS Spiddal	14/02/2012	Treated	Aluminium	200	µg/l	10
Keelogue	14/02/2012	Treated	Aluminium	200	µg/l	2
Ballymanagh, Craughwell	16/02/2012	Treated	Aluminium	200	µg/l	3
Gortnaglassa	16/02/2012	Treated	Aluminium	200	µg/l	15
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Aluminium	200	µg/l	35
Inismeain	23/02/2012	Treated	Aluminium	200	µg/l	6
Ardrahan, GWS	01/03/2012	Treated	Aluminium	200	µg/l	7
Caherdine/Caherdevan	01/03/2012	Treated	Aluminium	200	µg/l	3
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Aluminium	200	µg/l	6
Ballyglass/Fiddane	01/03/2012	Treated	Aluminium	200	µg/l	5
Toberowen	02/03/2012	Treated	Aluminium	200	µg/l	2
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Aluminium	200	µg/l	4
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	Aluminium	200	µg/l	91
Ballinakill, Moyard GWS	06/03/2012	Treated	Aluminium	200	µg/l	26

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
New Inn GWS	07/03/2012	Treated	Aluminium	200	µg/l	6
Menlough	07/03/2012	Treated	Aluminium	200	µg/l	3
Killough GWS	08/03/2012	Treated	Aluminium	200	µg/l	167
Glann, Oughterard	08/03/2012	Treated	Aluminium	200	µg/l	44
Glengowla (Gibbons)	08/03/2012	Treated	Aluminium	200	µg/l	44
Lisananey/Liskeavy	12/03/2012	Treated	Aluminium	200	µg/l	6.7
Bullaun, Loughrea	12/03/2012	Treated	Aluminium	200	µg/l	18
Milltown Co-Op	12/03/2012	Treated	Aluminium	200	µg/l	114.4
Kilcooley (Gurtymadden)	12/03/2012	Treated	Aluminium	200	µg/l	3
Corohan Group Water Scheme	12/03/2012	Treated	Aluminium	200	µg/l	13.7
Newtowndaly	12/03/2012	Treated	Aluminium	200	µg/l	4
Belmont (Kilconly)	12/03/2012	Treated	Aluminium	200	µg/l	10.5
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Aluminium	200	µg/l	42.9
Rhynn/Killeeneen	12/03/2012	Treated	Aluminium	200	µg/l	5
Belmont (Kilconly)	13/03/2012	Treated	Aluminium	200	µg/l	2
Looscaun	13/03/2012	Treated	Aluminium	200	µg/l	6.1
Lisananey/Liskeavy	13/03/2012	Treated	Aluminium	200	µg/l	3
Killeen / Poulatoon	13/03/2012	Treated	Aluminium	200	µg/l	6.2
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	Aluminium	200	µg/l	44
Kylemore Abbey	13/03/2012	Treated	Aluminium	200	µg/l	6.5
Ballynahinch Hotel	13/03/2012	Treated	Aluminium	200	µg/l	55
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Aluminium	200	µg/l	70
Gallagh/Brownsgrove	13/03/2012	Treated	Aluminium	200	µg/l	9
Kilchreest	13/03/2012	Treated	Aluminium	200	µg/l	6.6
Moyglass, Loughrea.	13/03/2012	Treated	Aluminium	200	µg/l	7
Bullaun, Loughrea	13/03/2012	Treated	Aluminium	200	µg/l	15.7
Anbally & District GWS	14/03/2012	Treated	Aluminium	200	µg/l	12.2
Killeen / Poulatoon	14/03/2012	Treated	Aluminium	200	µg/l	4
Clough/Cummer	14/03/2012	Treated	Aluminium	200	µg/l	8.8
Curry, Pollinmore GWS	14/03/2012	Treated	Aluminium	200	µg/l	45.8
Rusheens	14/03/2012	Treated	Aluminium	200	µg/l	6.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Caherlea / Gurrane	14/03/2012	Treated	Aluminium	200	µg/l	10.8
Kilconly	14/03/2012	Treated	Aluminium	200	µg/l	46.9
Claren/knocklehard	20/03/2012	Treated	Aluminium	200	µg/l	8
Cahermorris, Corrandulla.	20/03/2012	Treated	Aluminium	200	µg/l	7
Kilconly	20/03/2012	Treated	Aluminium	200	µg/l	44
Kilbannon	20/03/2012	Treated	Aluminium	200	µg/l	45
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	Aluminium	200	µg/l	67
Moy	02/04/2012	Treated	Aluminium	200	µg/l	26
Currenrue, Kinvara.	02/04/2012	Treated	Aluminium	200	µg/l	22
Toureen/Tarrea	02/04/2012	Treated	Aluminium	200	µg/l	32
Mulrock	02/04/2012	Treated	Aluminium	200	µg/l	16
Carraghbrown	03/04/2012	Treated	Aluminium	200	µg/l	77
Derrydonnell	03/04/2012	Treated	Aluminium	200	µg/l	54
Doughiska No. 1.	03/04/2012	Treated	Aluminium	200	µg/l	40
Loughwell (Leamhcoill)	03/04/2012	Treated	Aluminium	200	µg/l	45
Corofin/Ballintubber	04/04/2012	Treated	Aluminium	200	µg/l	154
Corrandulla	04/04/2012	Treated	Aluminium	200	µg/l	51
Carraghy (Claregalway)	04/04/2012	Treated	Aluminium	200	µg/l	56
Kiniska, Claregalway.	04/04/2012	Treated	Aluminium	200	µg/l	65
Claregalway No 2	04/04/2012	Treated	Aluminium	200	µg/l	122
Cloon	04/04/2012	Treated	Aluminium	200	µg/l	53
Cloonacauneen	04/04/2012	Treated	Aluminium	200	µg/l	63
Carhereenlea, Athenry.	05/04/2012	Treated	Aluminium	200	µg/l	3
Kiltevna	05/04/2012	Treated	Aluminium	200	µg/l	3
Knockauns	05/04/2012	Treated	Aluminium	200	µg/l	3
Killasmuggaun	05/04/2012	Treated	Aluminium	200	µg/l	3
Cloonkeen/Toomard	05/04/2012	Treated	Aluminium	200	µg/l	3
Tully, Thornfield	10/04/2012	Treated	Aluminium	200	µg/l	6
Clooncun, Glenamaddy	10/04/2012	Treated	Aluminium	200	µg/l	4
Knockmascahill	10/04/2012	Treated	Aluminium	200	µg/l	4
Lettergesh/Mullaghgloss	11/04/2012	Treated	Aluminium	200	µg/l	22

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Aluminium	200	µg/l	8
Castlegar/Lissyegan	12/04/2012	Treated	Aluminium	200	µg/l	4
Cornamucklagh	12/04/2012	Treated	Aluminium	200	µg/l	3
Emlough	16/04/2012	Treated	Aluminium	200	µg/l	122
Claregalway No.1.	16/04/2012	Treated	Aluminium	200	µg/l	71
Killeen/Bruckey	16/04/2012	Treated	Aluminium	200	µg/l	56
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	Aluminium	200	µg/l	74
Cashla No. 1	16/04/2012	Treated	Aluminium	200	µg/l	68
Castlelambert, Knocknacreva.	16/04/2012	Treated	Aluminium	200	µg/l	71
Moanbaun	16/04/2012	Treated	Aluminium	200	µg/l	64
Caherfinisker	16/04/2012	Treated	Aluminium	200	µg/l	57
Lowville No.1	19/04/2012	Treated	Aluminium	200	µg/l	10
Cloonigney	19/04/2012	Treated	Aluminium	200	µg/l	2
Carramore-Knock.	19/04/2012	Treated	Aluminium	200	µg/l	4
Lisheenkyle	23/04/2012	Treated	Aluminium	200	µg/l	60
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	Aluminium	200	µg/l	67
Cregannamore/Moneymore GWS	23/04/2012	Treated	Aluminium	200	µg/l	64
Lavally No. 3 (Higgins)	23/04/2012	Treated	Aluminium	200	µg/l	47
Tarramuid No 2, Oranmore	23/04/2012	Treated	Aluminium	200	µg/l	58
Killeely/Kilcolgan	23/04/2012	Treated	Aluminium	200	µg/l	41
Tyrone	23/04/2012	Treated	Aluminium	200	µg/l	31
Tonroe	23/04/2012	Treated	Aluminium	200	µg/l	52
Clontuskert	25/04/2012	Treated	Aluminium	200	µg/l	178
Moher	25/04/2012	Treated	Aluminium	200	µg/l	163
Kiltomer No. 3	25/04/2012	Treated	Aluminium	200	µg/l	155
Perssepark (Ballinasloe)	25/04/2012	Treated	Aluminium	200	µg/l	94
Cloonatleva	25/04/2012	Treated	Aluminium	200	µg/l	4
Gortanumera	26/04/2012	Treated	Aluminium	200	µg/l	71
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Aluminium	200	µg/l	2
Cloonluane (Renvyle)	30/04/2012	Treated	Aluminium	200	µg/l	17
Coole GWS	01/05/2012	Treated	Aluminium	200	µg/l	6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Carrigan, Craughwell.	01/05/2012	Treated	Aluminium	200	µg/l	4
Lisheenavalla	01/05/2012	Treated	Aluminium	200	µg/l	61
Dunloughan, Ballyconneely.	03/05/2012	Treated	Aluminium	200	µg/l	11
Aillebrack GWS	03/05/2012	Treated	Aluminium	200	µg/l	11
Murvey/Dolan	03/05/2012	Treated	Aluminium	200	µg/l	12
Lettermullen No.2	10/05/2012	Treated	Aluminium	200	µg/l	29
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Aluminium	200	µg/l	47
Criminagh/Lettermore	10/05/2012	Treated	Aluminium	200	µg/l	30
Clough/Cummer	14/05/2012	Treated	Aluminium	200	µg/l	6
Curry, Pollinmore GWS	14/05/2012	Treated	Aluminium	200	µg/l	70
Caherlea / Gurrane	14/05/2012	Treated	Aluminium	200	µg/l	15
Ballymanagh, Craughwell	14/05/2012	Treated	Aluminium	200	µg/l	6.1
Carrigan, Craughwell.	14/05/2012	Treated	Aluminium	200	µg/l	7.3
Lisheenavalla	14/05/2012	Treated	Aluminium	200	µg/l	83
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	Aluminium	200	µg/l	91
Menlough	31/05/2012	Treated	Aluminium	200	µg/l	3
Glinsk/Creggs	31/05/2012	Treated	Aluminium	200	µg/l	42
Toberowen	31/05/2012	Treated	Aluminium	200	µg/l	3
Gallagh/Brownsgrove	31/05/2012	Treated	Aluminium	200	µg/l	14
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Aluminium	200	µg/l	4
Ardrahan, GWS	05/06/2012	Treated	Aluminium	200	µg/l	5
Ballyglass/Fiddane	05/06/2012	Treated	Aluminium	200	µg/l	3
Rhynn/Killeeneen	05/06/2012	Treated	Aluminium	200	µg/l	5
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Aluminium	200	µg/l	6
Annaghdown	07/06/2012	Treated	Aluminium	200	µg/l	113
Claren/knocklehard	07/06/2012	Treated	Aluminium	200	µg/l	7
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Aluminium	200	µg/l	31
Newbridge Group Water Scheme	07/06/2012	Treated	Aluminium	200	µg/l	4
Carramore-Knock.	11/06/2012	Treated	Aluminium	200	µg/l	6.5
Ballinakill, Moyard GWS	11/06/2012	Treated	Aluminium	200	µg/l	20.9
Bullaun, Loughrea	12/06/2012	Treated	Aluminium	200	µg/l	9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kylemore Abbey	14/06/2012	Treated	Aluminium	200	µg/l	4
Ballinakill, Moyard GWS	14/06/2012	Treated	Aluminium	200	µg/l	16
Milltown Co-Op	18/06/2012	Treated	Aluminium	200	µg/l	34
Kings Shop, Lettergesh	20/06/2012	Treated	Aluminium	200	µg/l	26
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Aluminium	200	µg/l	23
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	Aluminium	200	µg/l	137
Kilbannon	03/07/2012	Treated	Aluminium	200	µg/l	96
Kilconly	03/07/2012	Treated	Aluminium	200	µg/l	79
Menlough	04/07/2012	Treated	Aluminium	200	µg/l	3
Glinsk/Creggs	04/07/2012	Treated	Aluminium	200	µg/l	38
Toberowen	04/07/2012	Treated	Aluminium	200	µg/l	3
Gallagh/Brownsgrove	04/07/2012	Treated	Aluminium	200	µg/l	21
Kilcoona Caherlistrane GWS	04/07/2012	Treated	Aluminium	200	µg/l	3
Clontuskert	05/07/2012	Treated	Aluminium	200	µg/l	103
Annaghdown	09/07/2012	Treated	Aluminium	200	µg/l	95.2
Emlough	10/07/2012	Treated	Aluminium	200	µg/l	83.7
K2, Leenane	11/07/2012	Treated	Aluminium	200	µg/l	28
Sleepzone Connemara, Leenane	11/07/2012	Treated	Aluminium	200	µg/l	26
Corrandulla	16/07/2012	Treated	Aluminium	200	µg/l	83
Gortnaglassa	16/07/2012	Treated	Aluminium	200	µg/l	28.2
Corofin/Ballintubber	16/07/2012	Treated	Aluminium	200	µg/l	86
Cloon	16/07/2012	Treated	Aluminium	200	µg/l	84
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Aluminium	200	µg/l	83
Caherfinisker	16/07/2012	Treated	Aluminium	200	µg/l	91
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Aluminium	200	µg/l	47
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Aluminium	200	µg/l	3
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Aluminium	200	µg/l	42
Peacocks Hotel	18/07/2012	Treated	Aluminium	200	µg/l	45
Lettergesh/Mullaghgloss	31/07/2012	Treated	Aluminium	200	µg/l	22.5
Cloonluane (Renvyle)	31/07/2012	Treated	Aluminium	200	µg/l	10.5
Knockauns	09/08/2012	Treated	Aluminium	200	µg/l	8.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gurteen/Cloonmore	09/08/2012	Treated	Aluminium	200	µg/l	5
Gurteen/Cloonmore	09/08/2012	Treated	Aluminium	200	µg/l	11
Newbridge Group Water Scheme	09/08/2012	Treated	Aluminium	200	µg/l	8
Corofin/Ballintubber	09/08/2012	Treated	Aluminium	200	µg/l	103.4
Bullaun, Tuam	09/08/2012	Treated	Aluminium	200	µg/l	103.6
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Aluminium	200	µg/l	102.2
Esker/ Eyrecourt	13/08/2012	Treated	Aluminium	200	µg/l	4
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Aluminium	200	µg/l	148
Connemara Lady - Stream water	21/08/2012	Treated	Aluminium	200	µg/l	33
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Aluminium	200	µg/l	58
Dunloughan, Ballyconneely.	22/08/2012	Treated	Aluminium	200	µg/l	9
Aillebrack GWS	22/08/2012	Treated	Aluminium	200	µg/l	7
Murvey/Dolan	22/08/2012	Treated	Aluminium	200	µg/l	9
Gortnaglassa	23/08/2012	Treated	Aluminium	200	µg/l	14
Feigh East & West	30/08/2012	Treated	Aluminium	200	µg/l	4
New Inn GWS	30/08/2012	Treated	Aluminium	200	µg/l	4
Rhynn/Killeeneen	30/08/2012	Treated	Aluminium	200	µg/l	5
Lisheenavalla	30/08/2012	Treated	Aluminium	200	µg/l	115
Carraghy (Claregalway)	03/09/2012	Treated	Aluminium	200	µg/l	109
Claregalway No 2	03/09/2012	Treated	Aluminium	200	µg/l	110
Claregalway No.1.	03/09/2012	Treated	Aluminium	200	µg/l	110
Cloonacauneen	03/09/2012	Treated	Aluminium	200	µg/l	119
Cashla No. 1	03/09/2012	Treated	Aluminium	200	µg/l	106
Castlelambert, Knocknacreva.	03/09/2012	Treated	Aluminium	200	µg/l	101
Tubber	04/09/2012	Treated	Aluminium	200	µg/l	6
Ardrahan, GWS	04/09/2012	Treated	Aluminium	200	µg/l	4
Ballyglass/Fiddane	04/09/2012	Treated	Aluminium	200	µg/l	3
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	Aluminium	200	µg/l	8
Derrydonnell	04/09/2012	Treated	Aluminium	200	µg/l	106
Doughiska No. 1.	04/09/2012	Treated	Aluminium	200	µg/l	41
Carraghbrown	04/09/2012	Treated	Aluminium	200	µg/l	128

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killough GWS	05/09/2012	Treated	Aluminium	200	µg/l	28
Glengowla (Gibbons)	05/09/2012	Treated	Aluminium	200	µg/l	31
Ballinakill, Moyard GWS	05/09/2012	Treated	Aluminium	200	µg/l	25
Annaghdown	10/09/2012	Treated	Aluminium	200	µg/l	115
Cahermorris, Corrandulla.	10/09/2012	Treated	Aluminium	200	µg/l	5
Clontuskert	10/09/2012	Treated	Aluminium	200	µg/l	149.7
Belclare	10/09/2012	Treated	Aluminium	200	µg/l	8
Rusheens	10/09/2012	Treated	Aluminium	200	µg/l	4
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Aluminium	200	µg/l	132
Belmont (Kilconly)	10/09/2012	Treated	Aluminium	200	µg/l	5
Bullaun, Tuam	10/09/2012	Treated	Aluminium	200	µg/l	118
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Aluminium	200	µg/l	3
Brierfield No1, Ballinasloe	11/09/2012	Treated	Aluminium	200	µg/l	4
Masonbrook, Loughrea	12/09/2012	Treated	Aluminium	200	µg/l	2
Newtowndaly	12/09/2012	Treated	Aluminium	200	µg/l	3
Kylemore Abbey	12/09/2012	Treated	Aluminium	200	µg/l	2
Bullaun, Loughrea	12/09/2012	Treated	Aluminium	200	µg/l	5
Kilcooley (Gurtymadden)	13/09/2012	Treated	Aluminium	200	µg/l	3
Caherdine/Caherdevan	13/09/2012	Treated	Aluminium	200	µg/l	2
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Aluminium	200	µg/l	6
Balroebuckbeg	17/09/2012	Treated	Aluminium	200	µg/l	5
Claren/knocklehard	17/09/2012	Treated	Aluminium	200	µg/l	6
Milltown Co-Op	17/09/2012	Treated	Aluminium	200	µg/l	109
Anbally & District GWS	17/09/2012	Treated	Aluminium	200	µg/l	8
Ballymanagh, Craughwell	17/09/2012	Treated	Aluminium	200	µg/l	3
Inismeain	24/09/2012	Treated	Aluminium	200	µg/l	6
Cloonigney	03/10/2012	Treated	Aluminium	200	µg/l	3
Corrandulla	04/10/2012	Treated	Aluminium	200	µg/l	134
Kilconly	04/10/2012	Treated	Aluminium	200	µg/l	122
Kilbannon	04/10/2012	Treated	Aluminium	200	µg/l	108
Corofin/Ballintubber	04/10/2012	Treated	Aluminium	200	µg/l	106

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Seehan, Gort	08/10/2012	Treated	Aluminium	200	µg/l	4
Roo	08/10/2012	Treated	Aluminium	200	µg/l	9
Currenrue, Kinvara.	08/10/2012	Treated	Aluminium	200	µg/l	50
Moy	08/10/2012	Treated	Aluminium	200	µg/l	57
Toureen/Tarrea	08/10/2012	Treated	Aluminium	200	µg/l	73
Mulrock	08/10/2012	Treated	Aluminium	200	µg/l	64
Moher	09/10/2012	Treated	Aluminium	200	µg/l	100
Clontuskert	09/10/2012	Treated	Aluminium	200	µg/l	87
Kiltomer No. 3	09/10/2012	Treated	Aluminium	200	µg/l	68
Perssepark (Ballinasloe)	09/10/2012	Treated	Aluminium	200	µg/l	51
Lowville No.2	09/10/2012	Treated	Aluminium	200	µg/l	4
Castlegar/Lissyegan	09/10/2012	Treated	Aluminium	200	µg/l	4
Cornamucklagh	09/10/2012	Treated	Aluminium	200	µg/l	5
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Aluminium	200	µg/l	121
Kiniska, Claregalway.	11/10/2012	Treated	Aluminium	200	µg/l	125
Cloon	11/10/2012	Treated	Aluminium	200	µg/l	112
Killeen/Bruckey	11/10/2012	Treated	Aluminium	200	µg/l	41
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Aluminium	200	µg/l	187
Lisheenkyle	11/10/2012	Treated	Aluminium	200	µg/l	111
Cregannamore/Moneymore GWS	11/10/2012	Treated	Aluminium	200	µg/l	118
Tarramuid No 2, Oranmore	11/10/2012	Treated	Aluminium	200	µg/l	111
Lavally No. 3 (Higgins)	11/10/2012	Treated	Aluminium	200	µg/l	84
Killeen / Poulatoon	15/10/2012	Treated	Aluminium	200	µg/l	3
Gortanumera	15/10/2012	Treated	Aluminium	200	µg/l	145
Kylemore Abbey	15/10/2012	Treated	Aluminium	200	µg/l	4
Moyglass, Loughrea.	15/10/2012	Treated	Aluminium	200	µg/l	5
Loughwell (Leamhcoill)	15/10/2012	Treated	Aluminium	200	µg/l	31
Cuillagh	16/10/2012	Treated	Aluminium	200	µg/l	6
New Inn GWS	16/10/2012	Treated	Aluminium	200	µg/l	3
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Aluminium	200	µg/l	3
Rhynn/Killeeneen	16/10/2012	Treated	Aluminium	200	µg/l	4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Menlough	18/10/2012	Treated	Aluminium	200	µg/l	3
Cloonkeen/Toomard	18/10/2012	Treated	Aluminium	200	µg/l	3
Glinsk/Creggs	18/10/2012	Treated	Aluminium	200	µg/l	160
Toberowen	18/10/2012	Treated	Aluminium	200	µg/l	3
Gallagh/Brownsgrove	18/10/2012	Treated	Aluminium	200	µg/l	31
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Aluminium	200	µg/l	4
Clough/Cummer	18/10/2012	Treated	Aluminium	200	µg/l	56
Caherlea / Gurrane	18/10/2012	Treated	Aluminium	200	µg/l	17
Carramore-Knock.	18/10/2012	Treated	Aluminium	200	µg/l	4
Caherfinisker	22/10/2012	Treated	Aluminium	200	µg/l	109
Killeely/Kilcolgan	22/10/2012	Treated	Aluminium	200	µg/l	82
Tyrone	22/10/2012	Treated	Aluminium	200	µg/l	78
Tonroe	22/10/2012	Treated	Aluminium	200	µg/l	94
Doughiska No. 2	22/10/2012	Treated	Aluminium	200	µg/l	100
Knockmascahill	23/10/2012	Treated	Aluminium	200	µg/l	5
Clooncun, Glenamaddy	23/10/2012	Treated	Aluminium	200	µg/l	13
Tully, Thornfield	23/10/2012	Treated	Aluminium	200	µg/l	12
Killasolan	23/10/2012	Treated	Aluminium	200	µg/l	20
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	Aluminium	200	µg/l	54
Carhereenlea, Athenry.	25/10/2012	Treated	Aluminium	200	µg/l	8
Carrigan, Craughwell.	25/10/2012	Treated	Aluminium	200	µg/l	8
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	Aluminium	200	µg/l	11
Glann, Oughterard	30/10/2012	Treated	Aluminium	200	µg/l	25
Corrandulla	31/10/2012	Treated	Aluminium	200	µg/l	24.3
Annaghdown	01/11/2012	Treated	Aluminium	200	µg/l	91
Ballyfruit, Headford	01/11/2012	Treated	Aluminium	200	µg/l	90
Coolarne	01/11/2012	Treated	Aluminium	200	µg/l	92
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	Aluminium	200	µg/l	84
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Aluminium	200	µg/l	49
Ardrahan, GWS	05/11/2012	Treated	Aluminium	200	µg/l	5
Ballyglass/Fiddane	05/11/2012	Treated	Aluminium	200	µg/l	28

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisheenavalla	05/11/2012	Treated	Aluminium	200	µg/l	99
BushyPark	05/11/2012	Treated	Aluminium	200	µg/l	34
Brackloon, Dunmore	06/11/2012	Treated	Aluminium	200	µg/l	5
Garrafrauns	06/11/2012	Treated	Aluminium	200	µg/l	6
Killasmuggaun	06/11/2012	Treated	Aluminium	200	µg/l	3
Knockauns	06/11/2012	Treated	Aluminium	200	µg/l	3
Newbridge Group Water Scheme	06/11/2012	Treated	Aluminium	200	µg/l	17
Abbert No 2	07/11/2012	Treated	Aluminium	200	µg/l	10
Abbert Public Group Water Scheme	07/11/2012	Treated	Aluminium	200	µg/l	9
Milltown Co-Op	07/11/2012	Treated	Aluminium	200	µg/l	116
Corohan Group Water Scheme	07/11/2012	Treated	Aluminium	200	µg/l	4
Lisananey/Liskeavy	07/11/2012	Treated	Aluminium	200	µg/l	2
Lettermullen No.2	12/11/2012	Treated	Aluminium	200	µg/l	102
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Aluminium	200	µg/l	62
Claren/knocklehard	14/11/2012	Treated	Aluminium	200	µg/l	6
Carranurlaur	14/11/2012	Treated	Aluminium	200	µg/l	10
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Aluminium	200	µg/l	69
Curry, Pollinmore GWS	14/11/2012	Treated	Aluminium	200	µg/l	103
Looscaun	15/11/2012	Treated	Aluminium	200	µg/l	3
Bullaun, Loughrea	15/11/2012	Treated	Aluminium	200	µg/l	13
Ballintleva GWS Spiddal	15/11/2012	Treated	Aluminium	200	µg/l	13
Lowville No.1	19/11/2012	Treated	Aluminium	200	µg/l	7
Ballinakill, Moyard GWS	20/11/2012	Treated	Aluminium	200	µg/l	39
Cloonluane (Renvyle)	20/11/2012	Treated	Aluminium	200	µg/l	23
Lettergesh/Mullaghgloss	20/11/2012	Treated	Aluminium	200	µg/l	51
Emlough	21/11/2012	Treated	Aluminium	200	µg/l	101
Hazel House B & B, Rusheens	21/11/2012	Treated	Aluminium	200	µg/l	20
Tubber	21/11/2012	Treated	Aluminium	200	µg/l	15.2
Cloon	21/11/2012	Treated	Aluminium	200	µg/l	70
Kiltevna	22/11/2012	Treated	Aluminium	200	µg/l	3
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Aluminium	200	µg/l	23

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cluide, Cahermorris.	22/11/2012	Treated	Aluminium	200	µg/l	7
Coole GWS	26/11/2012	Treated	Aluminium	200	µg/l	5
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Aluminium	200	µg/l	30
Kilbannon	03/12/2012	Treated	Aluminium	200	µg/l	104
Kilconly	03/12/2012	Treated	Aluminium	200	µg/l	43
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Aluminium	200	µg/l	28
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Aluminium	200	µg/l	176
Kilbannon	11/12/2012	Treated	Aluminium	200	µg/l	64
Caherfinisker	11/12/2012	Treated	Aluminium	200	µg/l	47.8
Carhereenlea, Athenry.	11/12/2012	Treated	Aluminium	200	µg/l	64.6
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Aluminium	200	µg/l	20.9
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Aluminium	200	µg/l	37.9
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Ammonium	0.3	mg/l	0.54
Gallagh/Brownsgrove	16/01/2012	Treated	Ammonium	0.3	mg/l	0.049
Kiltevna	16/01/2012	Treated	Ammonium	0.3	mg/l	0.052
Toberowen	16/01/2012	Treated	Ammonium	0.3	mg/l	0.051
Glinsk/Creggs	16/01/2012	Treated	Ammonium	0.3	mg/l	0.056
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Ammonium	0.3	mg/l	0.3
Keelogue	16/01/2012	Treated	Ammonium	0.3	mg/l	0.054
Cloonkeen/Toomard	16/01/2012	Treated	Ammonium	0.3	mg/l	0.057
Newbridge Group Water Scheme	17/01/2012	Treated	Ammonium	0.3	mg/l	0.047
Cloonigney	17/01/2012	Treated	Ammonium	0.3	mg/l	0.056
Corofin/Ballintubber	23/01/2012	Treated	Ammonium	0.3	mg/l	0.032
Ardrahan, GWS	23/01/2012	Treated	Ammonium	0.3	mg/l	0.009
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Ammonium	0.3	mg/l	0.015
Cuillagh	26/01/2012	Treated	Ammonium	0.3	mg/l	0.022
Doughiska No. 2	30/01/2012	Treated	Ammonium	0.3	mg/l	0.075
Caherfinisker	30/01/2012	Treated	Ammonium	0.3	mg/l	0.036
Roo	02/02/2012	Treated	Ammonium	0.3	mg/l	0.011
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Ammonium	0.3	mg/l	0.093
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Ammonium	0.3	mg/l	0.06

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Inismeain	23/02/2012	Treated	Ammonium	0.3	mg/l	0.017
Ardrahan, GWS	01/03/2012	Treated	Ammonium	0.3	mg/l	0.091
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Ammonium	0.3	mg/l	0.08
Ballyglass/Fiddane	01/03/2012	Treated	Ammonium	0.3	mg/l	0.074
Brierfield No1, Ballinasloe	07/03/2012	Treated	Ammonium	0.3	mg/l	0.028
Bullaun, Loughrea	12/03/2012	Treated	Ammonium	0.3	mg/l	0.188
Milltown Co-Op	12/03/2012	Treated	Ammonium	0.3	mg/l	0.01
Corohan Group Water Scheme	12/03/2012	Treated	Ammonium	0.3	mg/l	0.013
Kilcooley (Gurtymadden)	12/03/2012	Treated	Ammonium	0.3	mg/l	0.092
Newtowndaly	12/03/2012	Treated	Ammonium	0.3	mg/l	0.032
Belmont (Kilconly)	12/03/2012	Treated	Ammonium	0.3	mg/l	0.011
Rhynn/Killeeneen	12/03/2012	Treated	Ammonium	0.3	mg/l	0.085
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Ammonium	0.3	mg/l	0.03
Corohan Group Water Scheme	13/03/2012	Treated	Ammonium	0.3	mg/l	0.016
Looscaun	13/03/2012	Treated	Ammonium	0.3	mg/l	0.101
Lisananey/Liskeavy	13/03/2012	Treated	Ammonium	0.3	mg/l	0.019
Killeen / Poulatoon	13/03/2012	Treated	Ammonium	0.3	mg/l	0.083
Kylemore Abbey	13/03/2012	Treated	Ammonium	0.3	mg/l	0.027
Ballynahinch Hotel	13/03/2012	Treated	Ammonium	0.3	mg/l	0.06
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Ammonium	0.3	mg/l	0.038
Kilchreest	13/03/2012	Treated	Ammonium	0.3	mg/l	0.04
Moyglass, Loughrea.	13/03/2012	Treated	Ammonium	0.3	mg/l	0.105
Anbally & District GWS	14/03/2012	Treated	Ammonium	0.3	mg/l	0.011
Killeen / Poulatoon	14/03/2012	Treated	Ammonium	0.3	mg/l	0.049
Curry, Pollinmore GWS	14/03/2012	Treated	Ammonium	0.3	mg/l	0.042
Caherlea / Gurrane	14/03/2012	Treated	Ammonium	0.3	mg/l	0.011
Claren/knocklehard	20/03/2012	Treated	Ammonium	0.3	mg/l	0.043
Cahermorris, Corrandulla.	20/03/2012	Treated	Ammonium	0.3	mg/l	0.017
Kilconly	20/03/2012	Treated	Ammonium	0.3	mg/l	0.017
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	Ammonium	0.3	mg/l	0.04
Corrandulla	04/04/2012	Treated	Ammonium	0.3	mg/l	0.064

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cornamucklagh	12/04/2012	Treated	Ammonium	0.3	mg/l	0.037
Emlough	16/04/2012	Treated	Ammonium	0.3	mg/l	0.045
Killeen/Bruckey	16/04/2012	Treated	Ammonium	0.3	mg/l	0.011
Castlelambert, Knocknacreva.	16/04/2012	Treated	Ammonium	0.3	mg/l	0.011
Tarramuid No 2, Oranmore	23/04/2012	Treated	Ammonium	0.3	mg/l	0.015
Perssepark (Ballinasloe)	25/04/2012	Treated	Ammonium	0.3	mg/l	0.042
Gortanumera	26/04/2012	Treated	Ammonium	0.3	mg/l	0.043
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Ammonium	0.3	mg/l	0.03
Looscaun	26/04/2012	Treated	Ammonium	0.3	mg/l	0.036
Kylemore Abbey	26/04/2012	Treated	Ammonium	0.3	mg/l	0.069
Kilchreest	26/04/2012	Treated	Ammonium	0.3	mg/l	0.072
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Ammonium	0.3	mg/l	0.04
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Ammonium	0.3	mg/l	0.08
Cloonluane (Renvyle)	30/04/2012	Treated	Ammonium	0.3	mg/l	0.034
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Ammonium	0.3	mg/l	0.033
Glinsk/Creggs	31/05/2012	Treated	Ammonium	0.3	mg/l	0.011
Gallagh/Brownsgrove	31/05/2012	Treated	Ammonium	0.3	mg/l	0.013
Ardrahan, GWS	05/06/2012	Treated	Ammonium	0.3	mg/l	0.019
Ballyglass/Fiddane	05/06/2012	Treated	Ammonium	0.3	mg/l	0.011
Rhynn/Killeeneen	05/06/2012	Treated	Ammonium	0.3	mg/l	0.027
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Ammonium	0.3	mg/l	0.039
Claren/knocklehard	07/06/2012	Treated	Ammonium	0.3	mg/l	0.083
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Ammonium	0.3	mg/l	0.04
Carramore-Knock.	11/06/2012	Treated	Ammonium	0.3	mg/l	0.01
Ballinakill, Moyard GWS	11/06/2012	Treated	Ammonium	0.3	mg/l	0.022
Ballinakill, Moyard GWS	14/06/2012	Treated	Ammonium	0.3	mg/l	0.013
Kilbannon	03/07/2012	Treated	Ammonium	0.3	mg/l	0.02
Kilconly	03/07/2012	Treated	Ammonium	0.3	mg/l	0.031
Annaghdown	09/07/2012	Treated	Ammonium	0.3	mg/l	0.016
Balroebuckbeg	09/07/2012	Treated	Ammonium	0.3	mg/l	0.01
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Ammonium	0.3	mg/l	0.02

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Belclare	09/07/2012	Treated	Ammonium	0.3	mg/l	0.016
Claren/knocklehard	09/07/2012	Treated	Ammonium	0.3	mg/l	0.029
Emlough	10/07/2012	Treated	Ammonium	0.3	mg/l	0.03
Gortnaglassa	16/07/2012	Treated	Ammonium	0.3	mg/l	0.02
Cloon	16/07/2012	Treated	Ammonium	0.3	mg/l	0.028
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Ammonium	0.3	mg/l	0.079
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Ammonium	0.3	mg/l	0.068
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Ammonium	0.3	mg/l	0.037
Peacocks Hotel	18/07/2012	Treated	Ammonium	0.3	mg/l	0.05
Inismeain	30/07/2012	Treated	Ammonium	0.3	mg/l	0.039
Lettergesh/Mullaghgloss	31/07/2012	Treated	Ammonium	0.3	mg/l	0.015
Cloonluane (Renvyle)	31/07/2012	Treated	Ammonium	0.3	mg/l	0.038
Knockauns	09/08/2012	Treated	Ammonium	0.3	mg/l	0.065
Gurteen/Cloonmore	09/08/2012	Treated	Ammonium	0.3	mg/l	0.013
Gurteen/Cloonmore	09/08/2012	Treated	Ammonium	0.3	mg/l	0.034
Corofin/Ballintubber	09/08/2012	Treated	Ammonium	0.3	mg/l	0.041
Bullaun, Tuam	09/08/2012	Treated	Ammonium	0.3	mg/l	0.029
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Ammonium	0.3	mg/l	0.048
Esker/ Eyrecourt	13/08/2012	Treated	Ammonium	0.3	mg/l	0.013
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Ammonium	0.3	mg/l	0.03
Gordans Bar, Tynagh - Well	18/08/2012	Treated	Ammonium	0.3	mg/l	0.03
Pallas Karting - Well	19/08/2012	Treated	Ammonium	0.3	mg/l	0.04
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Ammonium	0.3	mg/l	0.072
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Ammonium	0.3	mg/l	0.04
Dunloughan, Ballyconneely.	22/08/2012	Treated	Ammonium	0.3	mg/l	0.026
Aillebrack GWS	22/08/2012	Treated	Ammonium	0.3	mg/l	0.033
Murvey/Dolan	22/08/2012	Treated	Ammonium	0.3	mg/l	0.051
Carraghy (Claregalway)	03/09/2012	Treated	Ammonium	0.3	mg/l	0.018
Claregalway No 2	03/09/2012	Treated	Ammonium	0.3	mg/l	0.015
Claregalway No.1.	03/09/2012	Treated	Ammonium	0.3	mg/l	0.011
Cloonacauneen	03/09/2012	Treated	Ammonium	0.3	mg/l	0.015

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cashla No. 1	03/09/2012	Treated	Ammonium	0.3	mg/l	0.012
Castlelambert, Knocknacreva.	03/09/2012	Treated	Ammonium	0.3	mg/l	0.021
Glengowla (Gibbons)	05/09/2012	Treated	Ammonium	0.3	mg/l	0.011
Annaghdown	10/09/2012	Treated	Ammonium	0.3	mg/l	0.019
Cahermorris, Corrandulla.	10/09/2012	Treated	Ammonium	0.3	mg/l	0.01
Clontuskert	10/09/2012	Treated	Ammonium	0.3	mg/l	0.023
Rusheens	10/09/2012	Treated	Ammonium	0.3	mg/l	0.018
Lowville No.1	10/09/2012	Treated	Ammonium	0.3	mg/l	0.014
Belmont (Kilconly)	10/09/2012	Treated	Ammonium	0.3	mg/l	0.011
Menlough	10/09/2012	Treated	Ammonium	0.3	mg/l	0.01
Bullaun, Tuam	10/09/2012	Treated	Ammonium	0.3	mg/l	0.018
Killasmuggaun	10/09/2012	Treated	Ammonium	0.3	mg/l	0.009
Brierfield No1, Ballinasloe	10/09/2012	Treated	Ammonium	0.3	mg/l	0.022
Feigh East & West	10/09/2012	Treated	Ammonium	0.3	mg/l	0.021
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Ammonium	0.3	mg/l	0.05
Brierfield No1, Ballinasloe	11/09/2012	Treated	Ammonium	0.3	mg/l	0.033
Masonbrook, Loughrea	12/09/2012	Treated	Ammonium	0.3	mg/l	0.012
Tynagh GWS	12/09/2012	Treated	Ammonium	0.3	mg/l	0.014
Kilcooley (Gurtymadden)	13/09/2012	Treated	Ammonium	0.3	mg/l	0.02
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Ammonium	0.3	mg/l	0.01
Balroebuckbeg	17/09/2012	Treated	Ammonium	0.3	mg/l	0.018
Claren/knocklehard	17/09/2012	Treated	Ammonium	0.3	mg/l	0.014
Milltown Co-Op	17/09/2012	Treated	Ammonium	0.3	mg/l	0.021
Anbally & District GWS	17/09/2012	Treated	Ammonium	0.3	mg/l	0.01
Ballymanagh, Craughwell	17/09/2012	Treated	Ammonium	0.3	mg/l	0.021
Inismeain	24/09/2012	Treated	Ammonium	0.3	mg/l	0.044
Cloonigney	03/10/2012	Treated	Ammonium	0.3	mg/l	0.022
Cloonatleva	03/10/2012	Treated	Ammonium	0.3	mg/l	0.02
Seehan, Gort	08/10/2012	Treated	Ammonium	0.3	mg/l	0.053
Roo	08/10/2012	Treated	Ammonium	0.3	mg/l	0.09
Currenrue, Kinvara.	08/10/2012	Treated	Ammonium	0.3	mg/l	0.021

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Moy	08/10/2012	Treated	Ammonium	0.3	mg/l	0.033
Toureen/Tarrea	08/10/2012	Treated	Ammonium	0.3	mg/l	0.018
Mulrock	08/10/2012	Treated	Ammonium	0.3	mg/l	0.024
Moher	09/10/2012	Treated	Ammonium	0.3	mg/l	0.065
Clontuskert	09/10/2012	Treated	Ammonium	0.3	mg/l	0.037
Kiltomer No. 3	09/10/2012	Treated	Ammonium	0.3	mg/l	0.031
Perssepark (Ballinasloe)	09/10/2012	Treated	Ammonium	0.3	mg/l	0.111
Lowville No.2	09/10/2012	Treated	Ammonium	0.3	mg/l	0.022
Castlegar/Lissyegan	09/10/2012	Treated	Ammonium	0.3	mg/l	0.033
Cornamucklagh	09/10/2012	Treated	Ammonium	0.3	mg/l	0.032
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Ammonium	0.3	mg/l	0.019
Kiniska, Claregalway.	11/10/2012	Treated	Ammonium	0.3	mg/l	0.023
Cloon	11/10/2012	Treated	Ammonium	0.3	mg/l	0.036
Killeen/Bruckey	11/10/2012	Treated	Ammonium	0.3	mg/l	0.034
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Ammonium	0.3	mg/l	0.025
Lisheenkyle	11/10/2012	Treated	Ammonium	0.3	mg/l	0.018
Cregannamore/Moneymore GWS	11/10/2012	Treated	Ammonium	0.3	mg/l	0.032
Tarramuid No 2, Oranmore	11/10/2012	Treated	Ammonium	0.3	mg/l	0.019
Lavally No. 3 (Higgins)	11/10/2012	Treated	Ammonium	0.3	mg/l	0.051
Killeen / Poulatoon	15/10/2012	Treated	Ammonium	0.3	mg/l	0.056
Gortanumera	15/10/2012	Treated	Ammonium	0.3	mg/l	0.031
Kylemore Abbey	15/10/2012	Treated	Ammonium	0.3	mg/l	0.015
Moyglass, Loughrea.	15/10/2012	Treated	Ammonium	0.3	mg/l	0.049
Loughwell (Leamhcoill)	15/10/2012	Treated	Ammonium	0.3	mg/l	0.03
Cuillagh	16/10/2012	Treated	Ammonium	0.3	mg/l	0.024
New Inn GWS	16/10/2012	Treated	Ammonium	0.3	mg/l	0.021
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Ammonium	0.3	mg/l	0.026
Rhynn/Killeeneen	16/10/2012	Treated	Ammonium	0.3	mg/l	0.024
Menlough	18/10/2012	Treated	Ammonium	0.3	mg/l	0.035
Cloonkeen/Toomard	18/10/2012	Treated	Ammonium	0.3	mg/l	0.036
Glinsk/Creggs	18/10/2012	Treated	Ammonium	0.3	mg/l	0.045

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gallagh/Brownsgrove	18/10/2012	Treated	Ammonium	0.3	mg/l	0.031
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Ammonium	0.3	mg/l	0.017
Caherlea / Gurrane	18/10/2012	Treated	Ammonium	0.3	mg/l	0.018
Carramore-Knock.	18/10/2012	Treated	Ammonium	0.3	mg/l	0.025
Caherfinisker	22/10/2012	Treated	Ammonium	0.3	mg/l	0.01
Tonroe	22/10/2012	Treated	Ammonium	0.3	mg/l	0.011
Doughiska No. 2	22/10/2012	Treated	Ammonium	0.3	mg/l	0.011
Knockmascahill	23/10/2012	Treated	Ammonium	0.3	mg/l	0.052
Clooncun, Glenamaddy	23/10/2012	Treated	Ammonium	0.3	mg/l	0.045
Tully, Thornfield	23/10/2012	Treated	Ammonium	0.3	mg/l	0.057
Killasolan	23/10/2012	Treated	Ammonium	0.3	mg/l	0.027
Cluide, Cahermorris.	31/10/2012	Treated	Ammonium	0.3	mg/l	0.057
Cahermorris, Corrandulla.	31/10/2012	Treated	Ammonium	0.3	mg/l	0.063
Corrandulla	31/10/2012	Treated	Ammonium	0.3	mg/l	0.02
Ballyfruit, Headford	01/11/2012	Treated	Ammonium	0.3	mg/l	0.017
Coolarne	01/11/2012	Treated	Ammonium	0.3	mg/l	0.014
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Ammonium	0.3	mg/l	0.024
Ardrahan, GWS	05/11/2012	Treated	Ammonium	0.3	mg/l	0.021
Ballyglass/Fiddane	05/11/2012	Treated	Ammonium	0.3	mg/l	0.012
Lisheenavalla	05/11/2012	Treated	Ammonium	0.3	mg/l	0.089
Brackloon, Dunmore	06/11/2012	Treated	Ammonium	0.3	mg/l	0.027
Garrafrauns	06/11/2012	Treated	Ammonium	0.3	mg/l	0.026
Killasmuggaun	06/11/2012	Treated	Ammonium	0.3	mg/l	0.105
Knockauns	06/11/2012	Treated	Ammonium	0.3	mg/l	0.044
Newbridge Group Water Scheme	06/11/2012	Treated	Ammonium	0.3	mg/l	0.048
Abbert No 2	07/11/2012	Treated	Ammonium	0.3	mg/l	0.034
Abbert Public Group Water Scheme	07/11/2012	Treated	Ammonium	0.3	mg/l	0.094
Milltown Co-Op	07/11/2012	Treated	Ammonium	0.3	mg/l	0.174
Corohan Group Water Scheme	07/11/2012	Treated	Ammonium	0.3	mg/l	0.109
Lisananey/Liskeavy	07/11/2012	Treated	Ammonium	0.3	mg/l	0.18
Lettermullen No.2	12/11/2012	Treated	Ammonium	0.3	mg/l	0.033

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Ammonium	0.3	mg/l	0.032
Criminagh/Lettermore	12/11/2012	Treated	Ammonium	0.3	mg/l	0.029
Carranurlaur	14/11/2012	Treated	Ammonium	0.3	mg/l	0.016
Curry, Pollinmore GWS	14/11/2012	Treated	Ammonium	0.3	mg/l	0.018
Looscaun	15/11/2012	Treated	Ammonium	0.3	mg/l	0.076
Lowville No.1	19/11/2012	Treated	Ammonium	0.3	mg/l	0.072
Cloonluane (Renvyle)	20/11/2012	Treated	Ammonium	0.3	mg/l	0.018
New Inn GWS	21/11/2012	Treated	Ammonium	0.3	mg/l	0.014
Emlough	21/11/2012	Treated	Ammonium	0.3	mg/l	0.053
Hazel House B & B, Rusheens	21/11/2012	Treated	Ammonium	0.3	mg/l	0.03
Cloon	21/11/2012	Treated	Ammonium	0.3	mg/l	0.015
Cluide, Cahermorris.	22/11/2012	Treated	Ammonium	0.3	mg/l	0.03
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Ammonium	0.3	mg/l	0.05
Kilconly	03/12/2012	Treated	Ammonium	0.3	mg/l	0.049
Kilbannon	11/12/2012	Treated	Ammonium	0.3	mg/l	0.019
Caherfinisker	11/12/2012	Treated	Ammonium	0.3	mg/l	0.019
Caherdine/Caherdevan	11/12/2012	Treated	Ammonium	0.3	mg/l	0.018
Carhereenlea, Athenry.	11/12/2012	Treated	Ammonium	0.3	mg/l	0.022
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Ammonium	0.3	mg/l	0.013
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Ammonium	0.3	mg/l	0.03
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Ammonium	0.3	mg/l	0.02
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Ammonium	0.3	mg/l	0.1
Kilconierin	24/07/2017	Raw	Ammonium NH4	0.3	mg/l	0.17
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Antimony	5	µg/l	0.1
Ballymanagh, Craughwell	14/05/2012	Treated	Antimony	5	µg/l	0.4
Carrigan, Craughwell.	14/05/2012	Treated	Antimony	5	µg/l	0.1
Inismeain	30/07/2012	Treated	Antimony	5	µg/l	0.3
Gurteen/Cloonmore	09/08/2012	Treated	Antimony	5	µg/l	0.1
Esker/ Eyrecourt	10/09/2012	Treated	Antimony	5	µg/l	0.2
Clontuskert	10/09/2012	Treated	Antimony	5	µg/l	0.2
Cloonatleva	10/09/2012	Treated	Antimony	5	µg/l	0.2

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lowville No.1	10/09/2012	Treated	Antimony	5	µg/l	0.2
Menlough	10/09/2012	Treated	Antimony	5	µg/l	0.2
Killasmuggaun	10/09/2012	Treated	Antimony	5	µg/l	0.2
Brierfield No1, Ballinasloe	10/09/2012	Treated	Antimony	5	µg/l	0.2
New Inn GWS	21/11/2012	Treated	Antimony	5	µg/l	0.2
Seehan, Gort	21/11/2012	Treated	Antimony	5	µg/l	0.1
Tubber	21/11/2012	Treated	Antimony	5	µg/l	0.8
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Antimony	5	µg/l	1
Cloonkeen/Toomard	16/01/2012	Treated	Arsenic	10	µg/l	1
Newbridge Group Water Scheme	17/01/2012	Treated	Arsenic	10	µg/l	0.2
Cloonigney	17/01/2012	Treated	Arsenic	10	µg/l	0.2
Ardrahan, GWS	23/01/2012	Treated	Arsenic	10	µg/l	0.3
Lisananey/Liskeavy	12/03/2012	Treated	Arsenic	10	µg/l	0.5
Milltown Co-Op	12/03/2012	Treated	Arsenic	10	µg/l	0.4
Corohan Group Water Scheme	12/03/2012	Treated	Arsenic	10	µg/l	1
Belmont (Kilconly)	12/03/2012	Treated	Arsenic	10	µg/l	0.5
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Arsenic	10	µg/l	0.3
Kylemore Abbey	13/03/2012	Treated	Arsenic	10	µg/l	0.3
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Arsenic	10	µg/l	0.4
Kilchreest	13/03/2012	Treated	Arsenic	10	µg/l	0.5
Moyglass, Loughrea.	13/03/2012	Treated	Arsenic	10	µg/l	0.3
Bullaun, Loughrea	13/03/2012	Treated	Arsenic	10	µg/l	0.3
Anbally & District GWS	14/03/2012	Treated	Arsenic	10	µg/l	0.6
Clough/Cummer	14/03/2012	Treated	Arsenic	10	µg/l	0.5
Curry, Pollinmore GWS	14/03/2012	Treated	Arsenic	10	µg/l	0.4
Rusheens	14/03/2012	Treated	Arsenic	10	µg/l	0.6
Kilconly	14/03/2012	Treated	Arsenic	10	µg/l	0.2
Kilcooley (Gurtymadden)	14/05/2012	Treated	Arsenic	10	µg/l	0.5
Ballymanagh, Craughwell	14/05/2012	Treated	Arsenic	10	µg/l	0.3
Carrigan, Craughwell.	14/05/2012	Treated	Arsenic	10	µg/l	2
Ballyglass/Fiddane	14/05/2012	Treated	Arsenic	10	µg/l	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Arsenic	10	µg/l	0.4
Lisheenavalla	14/05/2012	Treated	Arsenic	10	µg/l	0.3
Carramore-Knock.	11/06/2012	Treated	Arsenic	10	µg/l	0.3
Annaghdown	09/07/2012	Treated	Arsenic	10	µg/l	0.3
Balroebuckbeg	09/07/2012	Treated	Arsenic	10	µg/l	0.4
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Arsenic	10	µg/l	0.4
Claren/knocklehard	09/07/2012	Treated	Arsenic	10	µg/l	0.3
Gortnaglassa	16/07/2012	Treated	Arsenic	10	µg/l	0.2
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Arsenic	10	µg/l	0.2
Inismeain	30/07/2012	Treated	Arsenic	10	µg/l	1.3
Cloonluane (Renvyle)	31/07/2012	Treated	Arsenic	10	µg/l	0.8
Knockauns	09/08/2012	Treated	Arsenic	10	µg/l	0.7
Gurteen/Cloonmore	09/08/2012	Treated	Arsenic	10	µg/l	0.6
Corofin/Ballintubber	09/08/2012	Treated	Arsenic	10	µg/l	0.3
Bullaun, Tuam	09/08/2012	Treated	Arsenic	10	µg/l	0.2
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Arsenic	10	µg/l	0.3
Clontuskert	10/09/2012	Treated	Arsenic	10	µg/l	0.5
Cloonatleva	10/09/2012	Treated	Arsenic	10	µg/l	0.5
Lowville No.1	10/09/2012	Treated	Arsenic	10	µg/l	0.4
Menlough	10/09/2012	Treated	Arsenic	10	µg/l	0.9
Killasmuggaun	10/09/2012	Treated	Arsenic	10	µg/l	0.4
Brierfield No1, Ballinasloe	10/09/2012	Treated	Arsenic	10	µg/l	0.5
Cluide, Cahermorris.	31/10/2012	Treated	Arsenic	10	µg/l	1
Cahermorris, Corrandulla.	31/10/2012	Treated	Arsenic	10	µg/l	0.6
New Inn GWS	21/11/2012	Treated	Arsenic	10	µg/l	0.4
Seehan, Gort	21/11/2012	Treated	Arsenic	10	µg/l	0.4
Tubber	21/11/2012	Treated	Arsenic	10	µg/l	0.4
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Arsenic	10	µg/l	0.2
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Arsenic	10	µg/l	0.4
Kilconierin	24/07/2017	Raw	Arsenic	10	µg/l	0
Kilconierin	24/07/2017	Raw	Barium	500	µg/l	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Benzo(a)pyrene	0.01	µg/l	0
Cloon	21/11/2012	Treated	Benzo(a)pyrene	0.01	µg/l	0.007
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Benzo(a)pyrene	0.01	µg/l	0.005
Kilconierin	24/07/2017	Raw	BOD	-	-	0
Gallagh/Brownsgrove	16/01/2012	Treated	Boron	1	mg/l	0.02
Cloonkeen/Toomard	16/01/2012	Treated	Boron	1	mg/l	0.02
Coole GWS	23/01/2012	Treated	Boron	1	mg/l	0.02
Ardrahan, GWS	23/01/2012	Treated	Boron	1	mg/l	0.02
Looscaun	13/03/2012	Treated	Boron	1	mg/l	0.11
Moyglass, Loughrea.	13/03/2012	Treated	Boron	1	mg/l	0.02
Tynagh GWS	14/05/2012	Treated	Boron	1	mg/l	0.19
Inismeain	30/07/2012	Treated	Boron	1	mg/l	0.03
Knockauns	09/08/2012	Treated	Boron	1	mg/l	0.02
Esker/ Eyrecourt	10/09/2012	Treated	Boron	1	mg/l	0.04
Cloonatleva	10/09/2012	Treated	Boron	1	mg/l	0.02
New Inn GWS	21/11/2012	Treated	Boron	1	mg/l	0.04
Newcastle (Aughrim)	21/11/2012	Treated	Boron	1	mg/l	0.03
Seehan, Gort	21/11/2012	Treated	Boron	1	mg/l	0.03
Tubber	21/11/2012	Treated	Boron	1	mg/l	0.04
Cloon	21/11/2012	Treated	Boron	1	mg/l	0.02
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Boron	1	mg/l	0.17
Cloonluane (Renvyle)	31/07/2012	Treated	Bromate	10	µg/l	10.5
Milltown Co-Op	12/03/2012	Treated	Bromate	10	µg/l	3.7
Corohan Group Water Scheme	12/03/2012	Treated	Bromate	10	µg/l	1.7
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Bromate	10	µg/l	1.2
Curry, Pollinmore GWS	14/03/2012	Treated	Bromate	10	µg/l	1.7
Kilconly	14/03/2012	Treated	Bromate	10	µg/l	4
Ballyglass/Fiddane	14/05/2012	Treated	Bromate	10	µg/l	1.5
Claren/knocklehard	09/07/2012	Treated	Bromate	10	µg/l	3
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Bromate	10	µg/l	1.8
Inismeain	30/07/2012	Treated	Bromate	10	µg/l	1.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lettergesh/Mullaghgloss	31/07/2012	Treated	Bromate	10	µg/l	3
Corofin/Ballintubber	09/08/2012	Treated	Bromate	10	µg/l	1.3
Bullaun, Tuam	09/08/2012	Treated	Bromate	10	µg/l	1.2
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Bromate	10	µg/l	1.2
Clontuskert	10/09/2012	Treated	Bromate	10	µg/l	1.5
Gallagh/Brownsgrove	16/01/2012	Treated	Cadmium	5	µg/l	0.3
Kiltevna	16/01/2012	Treated	Cadmium	5	µg/l	0.2
Toberowen	16/01/2012	Treated	Cadmium	5	µg/l	0.2
Glinsk/Creggs	16/01/2012	Treated	Cadmium	5	µg/l	0.1
Keelogue	16/01/2012	Treated	Cadmium	5	µg/l	0.2
Cloonkeen/Toomard	16/01/2012	Treated	Cadmium	5	µg/l	0.2
Newbridge Group Water Scheme	17/01/2012	Treated	Cadmium	5	µg/l	0.2
Cloonigney	17/01/2012	Treated	Cadmium	5	µg/l	0.2
Rhynn/Killeeneen	23/01/2012	Treated	Cadmium	5	µg/l	0.1
Coole GWS	23/01/2012	Treated	Cadmium	5	µg/l	0.1
Tierneevin	23/01/2012	Treated	Cadmium	5	µg/l	0.1
Roo	23/01/2012	Treated	Cadmium	5	µg/l	0.2
Ardrahan, GWS	23/01/2012	Treated	Cadmium	5	µg/l	0.2
Ballymanagh, Craughwell	14/05/2012	Treated	Cadmium	5	µg/l	0.1
Carrigan, Craughwell.	14/05/2012	Treated	Cadmium	5	µg/l	0.1
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Cadmium	5	µg/l	0.1
Lisheenavalla	14/05/2012	Treated	Cadmium	5	µg/l	0.1
Inismeain	30/07/2012	Treated	Cadmium	5	µg/l	0.1
Lettergesh/Mullaghgloss	31/07/2012	Treated	Cadmium	5	µg/l	0.1
Cloonluane (Renvyle)	31/07/2012	Treated	Cadmium	5	µg/l	0.1
Knockauns	09/08/2012	Treated	Cadmium	5	µg/l	0.2
Gurteen/Cloonmore	09/08/2012	Treated	Cadmium	5	µg/l	0.3
Corofin/Ballintubber	09/08/2012	Treated	Cadmium	5	µg/l	0.2
Bullaun, Tuam	09/08/2012	Treated	Cadmium	5	µg/l	0.2
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Cadmium	5	µg/l	0.2
Esker/ Eyrecourt	10/09/2012	Treated	Cadmium	5	µg/l	0.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloonatleva	10/09/2012	Treated	Cadmium	5	µg/l	0.2
Lowville No.1	10/09/2012	Treated	Cadmium	5	µg/l	0.2
Menlough	10/09/2012	Treated	Cadmium	5	µg/l	0.2
Killasmuggaun	10/09/2012	Treated	Cadmium	5	µg/l	0.4
Brierfield No1, Ballinasloe	10/09/2012	Treated	Cadmium	5	µg/l	0.2
Feigh East & West	10/09/2012	Treated	Cadmium	5	µg/l	0.2
Cluide, Cahermorris.	31/10/2012	Treated	Cadmium	5	µg/l	0.1
Cahermorris, Corrandulla.	31/10/2012	Treated	Cadmium	5	µg/l	0.2
Corrandulla	31/10/2012	Treated	Cadmium	5	µg/l	0.1
Kilbannon	11/12/2012	Treated	Cadmium	5	µg/l	0.2
Caherfinisker	11/12/2012	Treated	Cadmium	5	µg/l	0.2
Caherdine/Caherdevan	11/12/2012	Treated	Cadmium	5	µg/l	0.3
Carhereenlea, Athenry.	11/12/2012	Treated	Cadmium	5	µg/l	0.3
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Cadmium	5	µg/l	0.4
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Cadmium	5	µg/l	3
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Cadmium	5	µg/l	0.3
Kilconierin	24/07/2017	Raw	Cadmium	5	µg/l	0
Kilconierin	24/07/2017	Raw	Calcium	200	mg/l	136.1
Kilconierin	24/07/2017	Raw	Chloride	250	mg/l	11.02
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Chloride	250	mg/l	20.2
Gallagh/Brownsgrove	16/01/2012	Treated	Chloride	250	mg/l	13.8
Kiltevna	16/01/2012	Treated	Chloride	250	mg/l	11.6
Toberowen	16/01/2012	Treated	Chloride	250	mg/l	12
Glinsk/Creggs	16/01/2012	Treated	Chloride	250	mg/l	16.2
Keelogue	16/01/2012	Treated	Chloride	250	mg/l	11
Cloonkeen/Toomard	16/01/2012	Treated	Chloride	250	mg/l	14.2
Newbridge Group Water Scheme	17/01/2012	Treated	Chloride	250	mg/l	15.6
Cloonigney	17/01/2012	Treated	Chloride	250	mg/l	14.4
Rhynn/Killeeneen	23/01/2012	Treated	Chloride	250	mg/l	18.2
Coole GWS	23/01/2012	Treated	Chloride	250	mg/l	15.4
Tierneevin	23/01/2012	Treated	Chloride	250	mg/l	15.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Roo	23/01/2012	Treated	Chloride	250	mg/l	22
Ardrahan, GWS	23/01/2012	Treated	Chloride	250	mg/l	22.9
Lisananey/Liskeavy	12/03/2012	Treated	Chloride	250	mg/l	16.1
Milltown Co-Op	12/03/2012	Treated	Chloride	250	mg/l	29.3
Corohan Group Water Scheme	12/03/2012	Treated	Chloride	250	mg/l	27.7
Belmont (Kilconly)	12/03/2012	Treated	Chloride	250	mg/l	20.2
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Chloride	250	mg/l	15.2
Looscaun	13/03/2012	Treated	Chloride	250	mg/l	21
Killeen / Poulatoon	13/03/2012	Treated	Chloride	250	mg/l	15.8
Kylemore Abbey	13/03/2012	Treated	Chloride	250	mg/l	16.4
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Chloride	250	mg/l	14.9
Kilchreest	13/03/2012	Treated	Chloride	250	mg/l	14.3
Moyglass, Loughrea.	13/03/2012	Treated	Chloride	250	mg/l	14.9
Bullaun, Loughrea	13/03/2012	Treated	Chloride	250	mg/l	25.5
Anbally & District GWS	14/03/2012	Treated	Chloride	250	mg/l	17.6
Clough/Cummer	14/03/2012	Treated	Chloride	250	mg/l	18.4
Curry, Pollinmore GWS	14/03/2012	Treated	Chloride	250	mg/l	15.5
Rusheens	14/03/2012	Treated	Chloride	250	mg/l	19.9
Caherlea / Gurrane	14/03/2012	Treated	Chloride	250	mg/l	18.5
Kilconly	14/03/2012	Treated	Chloride	250	mg/l	15.4
Tynagh GWS	14/05/2012	Treated	Chloride	250	mg/l	13.7
Kilcooley (Gurtymadden)	14/05/2012	Treated	Chloride	250	mg/l	13.6
Ballymanagh, Craughwell	14/05/2012	Treated	Chloride	250	mg/l	14.7
Carrigan, Craughwell.	14/05/2012	Treated	Chloride	250	mg/l	25.4
Ballyglass/Fiddane	14/05/2012	Treated	Chloride	250	mg/l	17.8
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Chloride	250	mg/l	20.2
Lisheenavalla	14/05/2012	Treated	Chloride	250	mg/l	15.1
Carramore-Knock.	11/06/2012	Treated	Chloride	250	mg/l	11.8
Ballinakill, Moyard GWS	11/06/2012	Treated	Chloride	250	mg/l	39.7
Annaghdown	09/07/2012	Treated	Chloride	250	mg/l	16.1
Balroebuckbeg	09/07/2012	Treated	Chloride	250	mg/l	17.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Chloride	250	mg/l	18.6
Belclare	09/07/2012	Treated	Chloride	250	mg/l	18.1
Claren/knocklehard	09/07/2012	Treated	Chloride	250	mg/l	17.3
Emlough	10/07/2012	Treated	Chloride	250	mg/l	44.7
Gortnaglassa	16/07/2012	Treated	Chloride	250	mg/l	7.8
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Chloride	250	mg/l	32.6
Inismeain	30/07/2012	Treated	Chloride	250	mg/l	48.8
Lettergesh/Mullaghgloss	31/07/2012	Treated	Chloride	250	mg/l	13.3
Cloonluane (Renvyle)	31/07/2012	Treated	Chloride	250	mg/l	33
Knockauns	09/08/2012	Treated	Chloride	250	mg/l	24.4
Gurteen/Cloonmore	09/08/2012	Treated	Chloride	250	mg/l	12.8
Corofin/Ballintubber	09/08/2012	Treated	Chloride	250	mg/l	15.5
Bullaun, Tuam	09/08/2012	Treated	Chloride	250	mg/l	16
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Chloride	250	mg/l	16.1
Lady Gregory Hotel - private supply	27/08/2012	Treated	Chloride	250	mg/l	181
Esker/ Eyrecourt	10/09/2012	Treated	Chloride	250	mg/l	40.4
Clontuskert	10/09/2012	Treated	Chloride	250	mg/l	15.4
Cloonatleva	10/09/2012	Treated	Chloride	250	mg/l	12.9
Lowville No.1	10/09/2012	Treated	Chloride	250	mg/l	15.5
Menlough	10/09/2012	Treated	Chloride	250	mg/l	15.4
Killasmuggaun	10/09/2012	Treated	Chloride	250	mg/l	14.8
Brierfield No1, Ballinasloe	10/09/2012	Treated	Chloride	250	mg/l	15.8
Feigh East & West	10/09/2012	Treated	Chloride	250	mg/l	17.4
Cluide, Cahermorris.	31/10/2012	Treated	Chloride	250	mg/l	13.5
Cahermorris, Corrandulla.	31/10/2012	Treated	Chloride	250	mg/l	16.1
Corrandulla	31/10/2012	Treated	Chloride	250	mg/l	14
New Inn GWS	21/11/2012	Treated	Chloride	250	mg/l	22.5
Newcastle (Aughrim)	21/11/2012	Treated	Chloride	250	mg/l	12.9
Seehan, Gort	21/11/2012	Treated	Chloride	250	mg/l	18.7
Tubber	21/11/2012	Treated	Chloride	250	mg/l	7.1
Cloon	21/11/2012	Treated	Chloride	250	mg/l	13.5

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilbannon	11/12/2012	Treated	Chloride	250	mg/l	13.7
Caherfinisker	11/12/2012	Treated	Chloride	250	mg/l	13.9
Caherdine/Caherdevan	11/12/2012	Treated	Chloride	250	mg/l	16.7
Carhereenlea, Athenry.	11/12/2012	Treated	Chloride	250	mg/l	13.6
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Chloride	250	mg/l	13.1
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Chloride	250	mg/l	9.2
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Chloride	250	mg/l	16.1
Kilconierin	24/07/2017	Raw	Chromium	50	µg/l	0
Bullaun, Tuam	09/08/2012	Treated	Chromium	50	µg/l	1.6
Brierfield No1, Ballinasloe	10/09/2012	Treated	Chromium	50	µg/l	2.6
Feigh East & West	10/09/2012	Treated	Chromium	50	µg/l	1
Seehan, Gort	21/11/2012	Treated	Chromium	50	µg/l	1.4
Tubber	21/11/2012	Treated	Chromium	50	µg/l	1.4
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Clostridium Perfringens	0	number/100	1
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Clostridium Perfringens	0	number/100	1
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	Clostridium Perfringens	0	number/100	2
Clough/Cummer	14/05/2012	Treated	Clostridium Perfringens	0	number/100	1
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Clostridium Perfringens	0	number/100	1
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Clostridium Perfringens	0	number/100	1
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Clostridium Perfringens	0	number/100	1
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Clostridium Perfringens	0	number/100	2
Kylemore Abbey Restaurant	10/10/2012	Treated	Clostridium Perfringens	0	number/100	1
Seehan, Gort	21/11/2012	Treated	Clostridium Perfringens	0	number/100	3
Tubber	21/11/2012	Treated	Clostridium Perfringens	0	number/100	6
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Clostridium Perfringens	0	number/100	5
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Clostridium Perfringens	0	number/100	2
Kilconierin	24/07/2017	Raw	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Clostridium Perfringens	0	number/100	0
Gallagh/Brownsgrove	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiltevna	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Toberowen	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Glinsk/Creggs	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Keelogue	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonkeen/Toomard	16/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Newbridge Group Water Scheme	17/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonigney	17/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Rhynn/Killeeneen	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Corofin/Ballintubber	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrandulla	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloon	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Coole GWS	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Tierneevin	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Roo	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Ardrahan, GWS	23/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Clontuskert	24/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Cuillagh	26/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Doughiska No. 2	30/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherfinisker	30/01/2012	Treated	Clostridium Perfringens	0	number/100	0
Tubber	02/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Seehan, Gort	02/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Tierneevin	02/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Roo	02/02/2012	Treated	Clostridium Perfringens	0	number/100	0
BushyPark	06/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenavalla	06/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Killasolan	07/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Newbridge Group Water Scheme	07/02/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Ballyfruit, Headford	08/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Coolarne	08/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Gurteen/Cloonmore	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Brackloon, Dunmore	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Dartfield Museum - Well	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Mary Stoddarts Home Bakery - Well	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Garrafrauns	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Carranurlaur	09/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Annaghdown	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Balroebuckbeg	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Cluide, Cahermorris.	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Belclare	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Rusheens	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Anbally & District GWS	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Tuam	10/02/2012	Treated	Clostridium Perfringens	0	number/100	0
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Esker/ Eyrecourt	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Tynagh GWS	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Newcastle (Aughrim)	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Moyglass, Loughrea.	13/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Feigh East & West	14/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Abbert No 2	14/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Abbert Public Group Water Scheme	14/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballintleva GWS Spiddal	14/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Keelogue	14/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballymanagh, Craughwell	16/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Gortnaglassa	16/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Inismeain	23/02/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Connemara Golf Club, Ballyconneely - Lake	29/02/2012	Treated	Clostridium Perfringens	0	number/100	0
Ardrahan, GWS	01/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherdine/Caherdevan	01/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyglass/Fiddane	01/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Toberowen	02/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Glinsk/Creggs	02/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballinakill, Moyard GWS	06/03/2012	Treated	Clostridium Perfringens	0	number/100	0
New Inn GWS	07/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Menlough	07/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Brierfield No1, Ballinasloe	07/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Killough GWS	08/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Glann, Oughterard	08/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Glengowla (Gibbons)	08/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisananey/Liskeavy	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Loughrea	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Milltown Co-Op	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcooley (Gurtymadden)	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Corohan Group Water Scheme	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Newtowndaly	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Belmont (Kilconly)	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Rhynn/Killeeneen	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Corohan Group Water Scheme	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Belmont (Kilconly)	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Looscaun	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Milltown Co-Op	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisananey/Liskeavy	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeen / Poulatoon	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Abbey	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballynahinch Hotel	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Gallagh/Brownsgrove	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilchreest	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Moyglass, Loughrea.	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Loughrea	13/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Anbally & District GWS	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeen / Poulatoon	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Clough/Cummer	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Curry, Pollinmore GWS	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Rusheens	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherlea / Gurrane	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconly	14/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Claren/knocklehard	20/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Cahermorris, Corrandulla.	20/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconly	20/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilbannon	20/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	Clostridium Perfringens	0	number/100	0
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Moy	02/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Currenrue, Kinvara.	02/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Toureen/Tarrea	02/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Mulrock	02/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Carraghbrown	03/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Derrydonnell	03/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Doughiska No. 1.	03/04/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Loughwell (Leamhcoill)	03/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Corofin/Ballintubber	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrandulla	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Carraghy (Claregalway)	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiniska, Claregalway.	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Claregalway No 2	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloon	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonacauneen	04/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Carhereenlea, Athenry.	05/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiltevna	05/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Knockauns	05/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Killasmuggaun	05/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonkeen/Toomard	05/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Tully, Thornfield	10/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Clooncun, Glenamaddy	10/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Knockmascahill	10/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettergesh/Mullaghgloss	11/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Masonbrook, Loughrea	12/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Lowville No.2	12/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Castlegar/Lissyegan	12/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cornamucklagh	12/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Emlough	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Claregalway No.1.	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeen/Bruckey	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cashla No. 1	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Castlelambert, Knocknacreva.	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Moanbaun	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherfinisker	16/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Lowville No.1	19/04/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloonigney	19/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Carramore-Knock.	19/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenkyle	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cregannamore/Moneymore GWS	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Lavally No. 3 (Higgins)	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Tarramuid No 2, Oranmore	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeely/Kilcolgan	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Tyrone	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Tonroe	23/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Clontuskert	25/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Moher	25/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiltomer No. 3	25/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Perssepark (Ballinasloe)	25/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonatleva	25/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Gortanumera	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Looscaun	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Abbey	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilchreest	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonluane (Renvyle)	30/04/2012	Treated	Clostridium Perfringens	0	number/100	0
Coole GWS	01/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Carrigan, Craughwell.	01/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenavalla	01/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Dunloughan, Ballyconneely.	03/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Aillebrack GWS	03/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Murvey/Dolan	03/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen No.2	10/05/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Criminagh/Lettermore	10/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Tynagh GWS	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Curry, Pollinmore GWS	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcooley (Gurtymadden)	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherlea / Gurrane	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballymanagh, Craughwell	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Carrigan, Craughwell.	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyglass/Fiddane	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenavalla	14/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Actons Campsite & Caravan Pk, Grallagh, Claddagduff	15/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Renvyle House Hotel - Lake	16/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Menlough	31/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Glinsk/Creggs	31/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Toberowen	31/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Gallagh/Brownsgrove	31/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Clostridium Perfringens	0	number/100	0
Ardrahan, GWS	05/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyglass/Fiddane	05/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Rhynn/Killeeneen	05/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Annaghdown	07/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Claren/knocklehard	07/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Newbridge Group Water Scheme	07/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Carramore-Knock.	11/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballinakill, Moyard GWS	11/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Loughrea	12/06/2012	Treated	Clostridium Perfringens	0	number/100	0
New Inn GWS	12/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Abbey	14/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballinakill, Moyard GWS	14/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Milltown Co-Op	18/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Sliabh Aughty Riding Centre - Well	21/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilbannon	03/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconly	03/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Menlough	04/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Glinsk/Creggs	04/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Toberowen	04/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Gallagh/Brownsgrove	04/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcoona Caherlistrane GWS	04/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Clontuskert	05/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Annaghdown	09/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Balroebuckbeg	09/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Belclare	09/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Claren/knocklehard	09/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Emlough	10/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Connemara Lady - Stream water	11/07/2012	Treated	Clostridium Perfringens	0	number/100	0
K2, Leenane	11/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Pass Hotel	11/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Sleepzone Connemara, Leenane	11/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrandulla	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gortnaglassa	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Corofin/Ballintubber	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloon	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherfinisker	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Lough Inagh Lodge Hotel	18/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Joyce's Food Store, Recess	18/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Inismeain	30/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettergesh/Mullaghgloss	31/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonluane (Renvyle)	31/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Clostridium Perfringens	0	number/100	0
Knockauns	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Gurteen/Cloonmore	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Gurteen/Cloonmore	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Newbridge Group Water Scheme	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Keelogue	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Corofin/Ballintubber	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Tuam	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Esker/ Eyrecourt	13/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Gordans Bar, Tynagh - Well	19/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Pallas Karting - Well	19/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Connemara Lady - Stream water	21/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Dunloughan, Ballyconneely.	22/08/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Aillebrack GWS	22/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Murvey/Dolan	22/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Gortnaglassa	23/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Feigh East & West	30/08/2012	Treated	Clostridium Perfringens	0	number/100	0
New Inn GWS	30/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Rhynn/Killeeneen	30/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenavalla	30/08/2012	Treated	Clostridium Perfringens	0	number/100	0
Carraghy (Claregalway)	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Claregalway No 2	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Claregalway No.1.	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonacauneen	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Cashla No. 1	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Castlelambert, Knocknacreva.	03/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Tubber	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Ardrahan, GWS	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyglass/Fiddane	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Derrydonnell	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Doughiska No. 1.	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Carraghbrown	04/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Killough GWS	05/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Glengowla (Gibbons)	05/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballinakill, Moyard GWS	05/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Annaghdown	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Esker/ Eyrecourt	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Cahermorris, Corrandulla.	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Clontuskert	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Belclare	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonatleva	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Rusheens	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Lowville No.1	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Belmont (Kilconly)	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Menlough	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Tuam	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Killasmuggaun	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Brierfield No1, Ballinasloe	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Feigh East & West	10/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Brierfield No1, Ballinasloe	11/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Masonbrook, Loughrea	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Newtowndaly	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Tynagh GWS	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Abbey	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilchreest	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Loughrea	12/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcooley (Gurtymadden)	13/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Newcastle (Aughrim)	13/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherdine/Caherdevan	13/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Balroebuckbeg	17/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Claren/knocklehard	17/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Milltown Co-Op	17/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Anbally & District GWS	17/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballymanagh, Craughwell	17/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Claresse Webb - Well	19/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Red Oak Restaurant, Ballyshrule , Portumna - Well	19/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Inismeain	24/09/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gordans Bar, Tynagh - Well	26/09/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonigney	03/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonatleva	03/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrandulla	04/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconly	04/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilbannon	04/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Corofin/Ballintubber	04/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Moanbaun	04/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Seehan, Gort	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Roo	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
The Village Nursing Home, Craughwell - Well	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Currenrue, Kinvara.	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Moy	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Toureen/Tarrea	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Mulrock	08/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Moher	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Clontuskert	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiltomer No. 3	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Perssepark (Ballinasloe)	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Lowville No.2	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Castlegar/Lissyegan	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cornamucklagh	09/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Connemara National Park, Tea Rooms	10/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Filling Station	10/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiniska, Claregalway.	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloon	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeen/Bruckey	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenkyle	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cregannamore/Moneymore GWS	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Tarramuid No 2, Oranmore	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Lavally No. 3 (Higgins)	11/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeen / Poulatoon	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Gortanumera	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kylemore Abbey	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Moyglass, Loughrea.	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughwell (Leamhcoill)	15/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cuillagh	16/10/2012	Treated	Clostridium Perfringens	0	number/100	0
New Inn GWS	16/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Rhynn/Killeeneen	16/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Menlough	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonkeen/Toomard	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Glinsk/Creggs	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Toberowen	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Gallagh/Brownsgrove	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
St Colombas Nursing Home - Well	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Clough/Cummer	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherlea / Gurrane	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Carramore-Knock.	18/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherfinisker	22/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Killeely/Kilcolgan	22/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Tyrone	22/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Tonroe	22/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Doughiska No. 2	22/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Knockmascahill	23/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Clooncun, Glenamaddy	23/10/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Tully, Thornfield	23/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Killasolan	23/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Carhereenlea, Athenry.	25/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Carrigan, Craughwell.	25/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Glann, Oughterard	30/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cluide, Cahermorris.	31/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Cahermorris, Corrandulla.	31/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Corrandulla	31/10/2012	Treated	Clostridium Perfringens	0	number/100	0
Annaghdown	01/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyfruit, Headford	01/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Coolarne	01/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Ardrahan, GWS	05/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballyglass/Fiddane	05/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisheenavalla	05/11/2012	Treated	Clostridium Perfringens	0	number/100	0
BushyPark	05/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Brackloon, Dunmore	06/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Garrafrauns	06/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Killasmuggaun	06/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Knockauns	06/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Newbridge Group Water Scheme	06/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Abbert No 2	07/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Abbert Public Group Water Scheme	07/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Milltown Co-Op	07/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Corohan Group Water Scheme	07/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lisananey/Liskeavy	07/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettermullen No.2	12/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Criminagh/Lettermore	12/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Claren/knocklehard	14/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Carranurlaur	14/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Curry, Pollinmore GWS	14/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Looscaun	15/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Bullaun, Loughrea	15/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballintleva GWS Spiddal	15/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lowville No.1	19/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Ballinakill, Moyard GWS	20/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloonluane (Renvyle)	20/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Lettergesh/Mullaghgloss	20/11/2012	Treated	Clostridium Perfringens	0	number/100	0
New Inn GWS	21/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Newcastle (Aughrim)	21/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Emlough	21/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Hazel House B & B, Rusheens	21/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Cloon	21/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Kiltevna	22/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Cluide, Cahermorris.	22/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Coole GWS	26/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Clostridium Perfringens	0	number/100	0
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Clostridium Perfringens	0	number/100	0
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilbannon	03/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconly	03/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Clostridium Perfringens	0	number/100	0
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilcolgan Nursing Home - Well	06/12/2012	Treated	Clostridium Perfringens	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilbannon	11/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherfinisker	11/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Caherdine/Caherdevan	11/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Carhereenlea, Athenry.	11/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Clostridium Perfringens	0	number/100	0
Tierneevin	23/01/2012	Treated	Coliform Bacteria	0	number/100	1
Roo	23/01/2012	Treated	Coliform Bacteria	0	number/100	1
Seehan, Gort	02/02/2012	Treated	Coliform Bacteria	0	number/100	1
Roo	02/02/2012	Treated	Coliform Bacteria	0	number/100	1
Moyglass, Loughrea.	13/02/2012	Treated	Coliform Bacteria	0	number/100	1
Corohan Group Water Scheme	12/03/2012	Treated	Coliform Bacteria	0	number/100	1
Caherlea / Gurrane	14/05/2012	Treated	Coliform Bacteria	0	number/100	1
Gurteen/Cloonmore	09/08/2012	Treated	Coliform Bacteria	0	number/100	1
Anbally & District GWS	17/09/2012	Treated	Coliform Bacteria	0	number/100	1
St Colombas Nursing Home - Well	18/10/2012	Treated	Coliform Bacteria	0	number/100	1
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Coliform Bacteria	0	number/100	1
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Coliform Bacteria	0	number/100	1
Clough/Cummer	14/05/2012	Treated	Coliform Bacteria	0	number/100	2
Belclare	09/07/2012	Treated	Coliform Bacteria	0	number/100	3
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Coliform Bacteria	0	number/100	3
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Coliform Bacteria	0	number/100	3
Connemara Lady - Stream water	11/07/2012	Treated	Coliform Bacteria	0	number/100	4
Knockauns	09/08/2012	Treated	Coliform Bacteria	0	number/100	4
Belclare	10/02/2012	Treated	Coliform Bacteria	0	number/100	6
Kilcooley (Gurtymadden)	14/05/2012	Treated	Coliform Bacteria	0	number/100	6
Ballymore Cottage Creche, Craughwell - Well	02/11/2012	Treated	Coliform Bacteria	0	number/100	6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcooley (Gurtymadden)	12/03/2012	Treated	Coliform Bacteria	0	number/100	8
Carrigan, Craughwell.	14/05/2012	Treated	Coliform Bacteria	0	number/100	9
Gurteen/Cloonmore	09/08/2012	Treated	Coliform Bacteria	0	number/100	10
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Coliform Bacteria	0	number/100	11
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Coliform Bacteria	0	number/100	11
Beehive Restaurant, Portumna	15/06/2012	Treated	Coliform Bacteria	0	number/100	11
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Coliform Bacteria	0	number/100	11
Carramore-Knock.	18/10/2012	Treated	Coliform Bacteria	0	number/100	11
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Coliform Bacteria	0	number/100	16
Tynagh GWS	12/09/2012	Treated	Coliform Bacteria	0	number/100	16
Carrigan, Craughwell.	01/05/2012	Treated	Coliform Bacteria	0	number/100	25
Caherlea / Gurrane	14/03/2012	Treated	Coliform Bacteria	0	number/100	26
Caherlea / Gurrane	18/10/2012	Treated	Coliform Bacteria	0	number/100	32
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Coliform Bacteria	0	number/100	38
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Coliform Bacteria	0	number/100	66
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Coliform Bacteria	0	number/100	74
Gordans Bar, Tynagh - Well	19/08/2012	Treated	Coliform Bacteria	0	number/100	76
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Coliform Bacteria	0	number/100	76
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	15/10/2012	Treated	Coliform Bacteria	0	number/100	93
Hazel House B & B, Rusheens	21/11/2012	Treated	Coliform Bacteria	0	number/100	96
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Coliform Bacteria	0	number/100	96
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Coliform Bacteria	0	number/100	143
Kings Shop, Lettergesh	20/06/2012	Treated	Coliform Bacteria	0	number/100	187
Gordans Bar, Tynagh - Well	26/09/2012	Treated	Coliform Bacteria	0	number/100	201
Seehan, Gort	21/11/2012	Treated	Coliform Bacteria	0	number/100	202
Tubber	21/11/2012	Treated	Coliform Bacteria	0	number/100	202
Sleepzone Connemara, Leenane	11/07/2012	Treated	Coliform Bacteria	0	number/100	579
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Coliform Bacteria	0	number/100	0
Gallagh/Brownsgrove	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
Kiltevna	16/01/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Toberowen	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
Glinsk/Creggs	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
Keelogue	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonkeen/Toomard	16/01/2012	Treated	Coliform Bacteria	0	number/100	0
Newbridge Group Water Scheme	17/01/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonigney	17/01/2012	Treated	Coliform Bacteria	0	number/100	0
Rhynn/Killeeneen	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Corofin/Ballintubber	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Corrandulla	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Cloon	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Coole GWS	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Ardrahan, GWS	23/01/2012	Treated	Coliform Bacteria	0	number/100	0
Clontuskert	24/01/2012	Treated	Coliform Bacteria	0	number/100	0
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Coliform Bacteria	0	number/100	0
Cuillagh	26/01/2012	Treated	Coliform Bacteria	0	number/100	0
Doughiska No. 2	30/01/2012	Treated	Coliform Bacteria	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	Coliform Bacteria	0	number/100	0
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	Coliform Bacteria	0	number/100	0
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	Coliform Bacteria	0	number/100	0
Caherfinisker	30/01/2012	Treated	Coliform Bacteria	0	number/100	0
Tubber	02/02/2012	Treated	Coliform Bacteria	0	number/100	0
Tierneevin	02/02/2012	Treated	Coliform Bacteria	0	number/100	0
BushyPark	06/02/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenavalla	06/02/2012	Treated	Coliform Bacteria	0	number/100	0
Killasolan	07/02/2012	Treated	Coliform Bacteria	0	number/100	0
Newbridge Group Water Scheme	07/02/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyfruit, Headford	08/02/2012	Treated	Coliform Bacteria	0	number/100	0
Coolarne	08/02/2012	Treated	Coliform Bacteria	0	number/100	0
Gurteen/Cloonmore	09/02/2012	Treated	Coliform Bacteria	0	number/100	0
Brackloon, Dunmore	09/02/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Dartfield Museum - Well	09/02/2012	Treated	Coliform Bacteria	0	number/100	0
Mary Stoddarts Home Bakery - Well	09/02/2012	Treated	Coliform Bacteria	0	number/100	0
Garrafrauns	09/02/2012	Treated	Coliform Bacteria	0	number/100	0
Carranurlaur	09/02/2012	Treated	Coliform Bacteria	0	number/100	0
Annaghdown	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
Balroebuckbeg	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
Cluide, Cahermorris.	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
Rusheens	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
Anbally & District GWS	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Tuam	10/02/2012	Treated	Coliform Bacteria	0	number/100	0
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	Coliform Bacteria	0	number/100	0
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Coliform Bacteria	0	number/100	0
Esker/ Eyrecourt	13/02/2012	Treated	Coliform Bacteria	0	number/100	0
Tynagh GWS	13/02/2012	Treated	Coliform Bacteria	0	number/100	0
Newcastle (Aughrim)	13/02/2012	Treated	Coliform Bacteria	0	number/100	0
Feigh East & West	14/02/2012	Treated	Coliform Bacteria	0	number/100	0
Abbert No 2	14/02/2012	Treated	Coliform Bacteria	0	number/100	0
Abbert Public Group Water Scheme	14/02/2012	Treated	Coliform Bacteria	0	number/100	0
Ballintleva GWS Spiddal	14/02/2012	Treated	Coliform Bacteria	0	number/100	0
Keelogue	14/02/2012	Treated	Coliform Bacteria	0	number/100	0
Ballymanagh, Craughwell	16/02/2012	Treated	Coliform Bacteria	0	number/100	0
Gortnaglassa	16/02/2012	Treated	Coliform Bacteria	0	number/100	0
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Coliform Bacteria	0	number/100	0
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Coliform Bacteria	0	number/100	0
Inismeain	23/02/2012	Treated	Coliform Bacteria	0	number/100	0
Connemara Golf Club, Ballyconneely - Lake	29/02/2012	Treated	Coliform Bacteria	0	number/100	0
Ardrahan, GWS	01/03/2012	Treated	Coliform Bacteria	0	number/100	0
Caherdine/Caherdevan	01/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyglass/Fiddane	01/03/2012	Treated	Coliform Bacteria	0	number/100	0
Toberowen	02/03/2012	Treated	Coliform Bacteria	0	number/100	0
Glinsk/Creggs	02/03/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ballinakill, Moyard GWS	06/03/2012	Treated	Coliform Bacteria	0	number/100	0
New Inn GWS	07/03/2012	Treated	Coliform Bacteria	0	number/100	0
Menlough	07/03/2012	Treated	Coliform Bacteria	0	number/100	0
Brierfield No1, Ballinasloe	07/03/2012	Treated	Coliform Bacteria	0	number/100	0
Killough GWS	08/03/2012	Treated	Coliform Bacteria	0	number/100	0
Glann, Oughterard	08/03/2012	Treated	Coliform Bacteria	0	number/100	0
Glengowla (Gibbons)	08/03/2012	Treated	Coliform Bacteria	0	number/100	0
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Coliform Bacteria	0	number/100	0
Lisananey/Liskeavy	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Loughrea	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Milltown Co-Op	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Newtowndaly	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Belmont (Kilconly)	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Rhynn/Killeeneen	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Coliform Bacteria	0	number/100	0
Corohan Group Water Scheme	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Belmont (Kilconly)	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Looscaun	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Milltown Co-Op	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Lisananey/Liskeavy	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Killeen / Poulatoon	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Ballynahinch Hotel	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Gallagh/Brownsgrove	13/03/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilchreest	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Moyglass, Loughrea.	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Loughrea	13/03/2012	Treated	Coliform Bacteria	0	number/100	0
Anbally & District GWS	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Killeen / Poulatoon	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Clough/Cummer	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Curry, Pollinmore GWS	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Rusheens	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconly	14/03/2012	Treated	Coliform Bacteria	0	number/100	0
Claren/knocklehard	20/03/2012	Treated	Coliform Bacteria	0	number/100	0
Cahermorris, Corrandulla.	20/03/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconly	20/03/2012	Treated	Coliform Bacteria	0	number/100	0
Kilbannon	20/03/2012	Treated	Coliform Bacteria	0	number/100	0
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Coliform Bacteria	0	number/100	0
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	Coliform Bacteria	0	number/100	0
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	Coliform Bacteria	0	number/100	0
Moy	02/04/2012	Treated	Coliform Bacteria	0	number/100	0
Currenrue, Kinvara.	02/04/2012	Treated	Coliform Bacteria	0	number/100	0
Toureen/Tarrea	02/04/2012	Treated	Coliform Bacteria	0	number/100	0
Mulrock	02/04/2012	Treated	Coliform Bacteria	0	number/100	0
Carraghbrown	03/04/2012	Treated	Coliform Bacteria	0	number/100	0
Derrydonnell	03/04/2012	Treated	Coliform Bacteria	0	number/100	0
Doughiska No. 1.	03/04/2012	Treated	Coliform Bacteria	0	number/100	0
Loughwell (Leamhcoill)	03/04/2012	Treated	Coliform Bacteria	0	number/100	0
Corofin/Ballintubber	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Corrandulla	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Carraghy (Claregalway)	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kiniska, Claregalway.	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Claregalway No 2	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloon	04/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonacauneen	04/04/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Carhereenlea, Athenry.	05/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kiltevna	05/04/2012	Treated	Coliform Bacteria	0	number/100	0
Knockauns	05/04/2012	Treated	Coliform Bacteria	0	number/100	0
Killasmuggaun	05/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonkeen/Toomard	05/04/2012	Treated	Coliform Bacteria	0	number/100	0
Tully, Thornfield	10/04/2012	Treated	Coliform Bacteria	0	number/100	0
Clooncun, Glenamaddy	10/04/2012	Treated	Coliform Bacteria	0	number/100	0
Knockmascahill	10/04/2012	Treated	Coliform Bacteria	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	Coliform Bacteria	0	number/100	0
Lettergesh/Mullaghgloss	11/04/2012	Treated	Coliform Bacteria	0	number/100	0
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Coliform Bacteria	0	number/100	0
Masonbrook, Loughrea	12/04/2012	Treated	Coliform Bacteria	0	number/100	0
Lowville No.2	12/04/2012	Treated	Coliform Bacteria	0	number/100	0
Castlegar/Lissyegan	12/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cornamucklagh	12/04/2012	Treated	Coliform Bacteria	0	number/100	0
Emlough	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Claregalway No.1.	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Killeen/Bruckey	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cashla No. 1	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Castlelambert, Knocknacreva.	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Moanbaun	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Caherfinisker	16/04/2012	Treated	Coliform Bacteria	0	number/100	0
Lowville No.1	19/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonigney	19/04/2012	Treated	Coliform Bacteria	0	number/100	0
Carramore-Knock.	19/04/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenkyle	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cregannamore/Moneymore GWS	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Lavally No. 3 (Higgins)	23/04/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Tarramuid No 2, Oranmore	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Killeely/Kilcolgan	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Tyrone	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Tonroe	23/04/2012	Treated	Coliform Bacteria	0	number/100	0
Clontuskert	25/04/2012	Treated	Coliform Bacteria	0	number/100	0
Moher	25/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kiltomer No. 3	25/04/2012	Treated	Coliform Bacteria	0	number/100	0
Perssepark (Ballinasloe)	25/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonatleva	25/04/2012	Treated	Coliform Bacteria	0	number/100	0
Gortanumera	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Looscaun	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kilchreest	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Coliform Bacteria	0	number/100	0
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonluane (Renvyle)	30/04/2012	Treated	Coliform Bacteria	0	number/100	0
Coole GWS	01/05/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenavalla	01/05/2012	Treated	Coliform Bacteria	0	number/100	0
Dunloughan, Ballyconneely.	03/05/2012	Treated	Coliform Bacteria	0	number/100	0
Aillebrack GWS	03/05/2012	Treated	Coliform Bacteria	0	number/100	0
Murvey/Dolan	03/05/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen No.2	10/05/2012	Treated	Coliform Bacteria	0	number/100	0
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Coliform Bacteria	0	number/100	0
Criminagh/Lettermore	10/05/2012	Treated	Coliform Bacteria	0	number/100	0
Tynagh GWS	14/05/2012	Treated	Coliform Bacteria	0	number/100	0
Curry, Pollinmore GWS	14/05/2012	Treated	Coliform Bacteria	0	number/100	0
Ballymanagh, Craughwell	14/05/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyglass/Fiddane	14/05/2012	Treated	Coliform Bacteria	0	number/100	0
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenavalla	14/05/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Actons Campsite & Caravan Pk, Grallagh, Claddagduff	15/05/2012	Treated	Coliform Bacteria	0	number/100	0
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Coliform Bacteria	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	Coliform Bacteria	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	Coliform Bacteria	0	number/100	0
Renvyle House Hotel - Lake	16/05/2012	Treated	Coliform Bacteria	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Coliform Bacteria	0	number/100	0
Mother's Bar, Kiltormer - Well	28/05/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	Coliform Bacteria	0	number/100	0
Menlough	31/05/2012	Treated	Coliform Bacteria	0	number/100	0
Glinsk/Creggs	31/05/2012	Treated	Coliform Bacteria	0	number/100	0
Toberowen	31/05/2012	Treated	Coliform Bacteria	0	number/100	0
Gallagh/Brownsgrove	31/05/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Coliform Bacteria	0	number/100	0
Ardrahan, GWS	05/06/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyglass/Fiddane	05/06/2012	Treated	Coliform Bacteria	0	number/100	0
Rhynn/Killeeneen	05/06/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Coliform Bacteria	0	number/100	0
Annaghdown	07/06/2012	Treated	Coliform Bacteria	0	number/100	0
Claren/knocklehard	07/06/2012	Treated	Coliform Bacteria	0	number/100	0
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Coliform Bacteria	0	number/100	0
Newbridge Group Water Scheme	07/06/2012	Treated	Coliform Bacteria	0	number/100	0
Carramore-Knock.	11/06/2012	Treated	Coliform Bacteria	0	number/100	0
Ballinakill, Moyard GWS	11/06/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Loughrea	12/06/2012	Treated	Coliform Bacteria	0	number/100	0
New Inn GWS	12/06/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey	14/06/2012	Treated	Coliform Bacteria	0	number/100	0
Dessie O'Brians Bar - Well	14/06/2012	Treated	Coliform Bacteria	0	number/100	0
Ballinakill, Moyard GWS	14/06/2012	Treated	Coliform Bacteria	0	number/100	0
Milltown Co-Op	18/06/2012	Treated	Coliform Bacteria	0	number/100	0
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Coliform Bacteria	0	number/100	0
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Sliabh Aughty Riding Centre - Well	21/06/2012	Treated	Coliform Bacteria	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	Coliform Bacteria	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	Coliform Bacteria	0	number/100	0
St Annes CNU, Clifden - Lake	29/06/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	Coliform Bacteria	0	number/100	0
Kilbannon	03/07/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconly	03/07/2012	Treated	Coliform Bacteria	0	number/100	0
Menlough	04/07/2012	Treated	Coliform Bacteria	0	number/100	0
Glinsk/Creggs	04/07/2012	Treated	Coliform Bacteria	0	number/100	0
Toberowen	04/07/2012	Treated	Coliform Bacteria	0	number/100	0
Gallagh/Brownsgrove	04/07/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcoona Caherlistrane GWS	04/07/2012	Treated	Coliform Bacteria	0	number/100	0
Clontuskert	05/07/2012	Treated	Coliform Bacteria	0	number/100	0
Annaghdown	09/07/2012	Treated	Coliform Bacteria	0	number/100	0
Balroebuckbeg	09/07/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Coliform Bacteria	0	number/100	0
Claren/knocklehard	09/07/2012	Treated	Coliform Bacteria	0	number/100	0
Emlough	10/07/2012	Treated	Coliform Bacteria	0	number/100	0
K2, Leenane	11/07/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Pass Hotel	11/07/2012	Treated	Coliform Bacteria	0	number/100	0
Corrandulla	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Gortnaglassa	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Corofin/Ballintubber	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Cloon	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Caherfinisker	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Coliform Bacteria	0	number/100	0
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Coliform Bacteria	0	number/100	0
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Coliform Bacteria	0	number/100	0
Lough Inagh Lodge Hotel	18/07/2012	Treated	Coliform Bacteria	0	number/100	0
Joyce's Food Store, Recess	18/07/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Peacocks Hotel	18/07/2012	Treated	Coliform Bacteria	0	number/100	0
Carrig Bar, Leenane - Stream water	24/07/2012	Treated	Coliform Bacteria	0	number/100	0
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Coliform Bacteria	0	number/100	0
Inismeain	30/07/2012	Treated	Coliform Bacteria	0	number/100	0
Lettergesh/Mullaghgloss	31/07/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonluane (Renvyle)	31/07/2012	Treated	Coliform Bacteria	0	number/100	0
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Coliform Bacteria	0	number/100	0
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Coliform Bacteria	0	number/100	0
Newbridge Group Water Scheme	09/08/2012	Treated	Coliform Bacteria	0	number/100	0
Keelogue	09/08/2012	Treated	Coliform Bacteria	0	number/100	0
Corofin/Ballintubber	09/08/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Tuam	09/08/2012	Treated	Coliform Bacteria	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Coliform Bacteria	0	number/100	0
Esker/ Eyrecourt	13/08/2012	Treated	Coliform Bacteria	0	number/100	0
Pallas Karting - Well	19/08/2012	Treated	Coliform Bacteria	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Coliform Bacteria	0	number/100	0
Connemara Lady - Stream water	21/08/2012	Treated	Coliform Bacteria	0	number/100	0
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Coliform Bacteria	0	number/100	0
Dunloughan, Ballyconneely.	22/08/2012	Treated	Coliform Bacteria	0	number/100	0
Aillebrack GWS	22/08/2012	Treated	Coliform Bacteria	0	number/100	0
Murvey/Dolan	22/08/2012	Treated	Coliform Bacteria	0	number/100	0
Gortnaglassa	23/08/2012	Treated	Coliform Bacteria	0	number/100	0
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	Coliform Bacteria	0	number/100	0
Gort Mart Canteen - Well	27/08/2012	Treated	Coliform Bacteria	0	number/100	0
Lady Gregory Hotel - private supply	27/08/2012	Treated	Coliform Bacteria	0	number/100	0
Gort Golf Club - Well	27/08/2012	Treated	Coliform Bacteria	0	number/100	0
Feigh East & West	30/08/2012	Treated	Coliform Bacteria	0	number/100	0
New Inn GWS	30/08/2012	Treated	Coliform Bacteria	0	number/100	0
Rhynn/Killeeneen	30/08/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenavalla	30/08/2012	Treated	Coliform Bacteria	0	number/100	0
Carraghy (Claregalway)	03/09/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Claregalway No 2	03/09/2012	Treated	Coliform Bacteria	0	number/100	0
Claregalway No.1.	03/09/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonacauneen	03/09/2012	Treated	Coliform Bacteria	0	number/100	0
Cashla No. 1	03/09/2012	Treated	Coliform Bacteria	0	number/100	0
Castlelambert, Knocknacreva.	03/09/2012	Treated	Coliform Bacteria	0	number/100	0
Tubber	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Ardrahan, GWS	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyglass/Fiddane	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Derrydonnell	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Doughiska No. 1.	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Carraghbrown	04/09/2012	Treated	Coliform Bacteria	0	number/100	0
Killough GWS	05/09/2012	Treated	Coliform Bacteria	0	number/100	0
Glengowla (Gibbons)	05/09/2012	Treated	Coliform Bacteria	0	number/100	0
Ballinakill, Moyard GWS	05/09/2012	Treated	Coliform Bacteria	0	number/100	0
Annaghdown	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Esker/ Eyrecourt	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Cahermorris, Corrandulla.	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Clontuskert	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Belclare	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonatleva	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Rusheens	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Lowville No.1	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Belmont (Kilconly)	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Menlough	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Tuam	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Killasmuggaun	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Brierfield No1, Ballinasloe	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Feigh East & West	10/09/2012	Treated	Coliform Bacteria	0	number/100	0
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Fahy's Shop, Turloughmore - Well	11/09/2012	Treated	Coliform Bacteria	0	number/100	0
Brierfield No1, Ballinasloe	11/09/2012	Treated	Coliform Bacteria	0	number/100	0
Masonbrook, Loughrea	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Newtowndaly	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Coole Park Restaurant - Well	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Kilchreest	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Loughrea	12/09/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcooley (Gurtymadden)	13/09/2012	Treated	Coliform Bacteria	0	number/100	0
Newcastle (Aughrim)	13/09/2012	Treated	Coliform Bacteria	0	number/100	0
Caherdine/Caherdevan	13/09/2012	Treated	Coliform Bacteria	0	number/100	0
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Coliform Bacteria	0	number/100	0
Balroebuckbeg	17/09/2012	Treated	Coliform Bacteria	0	number/100	0
Claren/knocklehard	17/09/2012	Treated	Coliform Bacteria	0	number/100	0
Milltown Co-Op	17/09/2012	Treated	Coliform Bacteria	0	number/100	0
Ballymanagh, Craughwell	17/09/2012	Treated	Coliform Bacteria	0	number/100	0
Claresse Webb - Well	19/09/2012	Treated	Coliform Bacteria	0	number/100	0
Red Oak Restaurant, Ballyshrule , Portumna - Well	19/09/2012	Treated	Coliform Bacteria	0	number/100	0
Inismeain	24/09/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonigney	03/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonatleva	03/10/2012	Treated	Coliform Bacteria	0	number/100	0
Corrandulla	04/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconly	04/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kilbannon	04/10/2012	Treated	Coliform Bacteria	0	number/100	0
Corofin/Ballintubber	04/10/2012	Treated	Coliform Bacteria	0	number/100	0
Moanbaun	04/10/2012	Treated	Coliform Bacteria	0	number/100	0
Seehan, Gort	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
Roo	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
The Village Nursing Home, Craughwell - Well	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
Currenrue, Kinvara.	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
Moy	08/10/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Toureen/Tarrea	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
Mulrock	08/10/2012	Treated	Coliform Bacteria	0	number/100	0
Moher	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Clontuskert	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kiltomer No. 3	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Perssepark (Ballinasloe)	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Lowville No.2	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Castlegar/Lissyegan	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cornamucklagh	09/10/2012	Treated	Coliform Bacteria	0	number/100	0
Connemara National Park, Tea Rooms	10/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey Restaurant	10/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Filling Station	10/10/2012	Treated	Coliform Bacteria	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kiniska, Claregalway.	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cloon	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Killeen/Bruckey	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Lisheenkyle	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cregannamore/Moneymore GWS	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Tarramuid No 2, Oranmore	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Lavally No. 3 (Higgins)	11/10/2012	Treated	Coliform Bacteria	0	number/100	0
Killeen / Poulatoon	15/10/2012	Treated	Coliform Bacteria	0	number/100	0
Gortanumera	15/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kylemore Abbey	15/10/2012	Treated	Coliform Bacteria	0	number/100	0
Moyglass, Loughrea.	15/10/2012	Treated	Coliform Bacteria	0	number/100	0
Loughwell (Leamhcoill)	15/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cuillagh	16/10/2012	Treated	Coliform Bacteria	0	number/100	0
New Inn GWS	16/10/2012	Treated	Coliform Bacteria	0	number/100	0
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Coliform Bacteria	0	number/100	0
Rhynn/Killeeneen	16/10/2012	Treated	Coliform Bacteria	0	number/100	0
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Menlough	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonkeen/Toomard	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Glinsk/Creggs	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Toberowen	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Gallagh/Brownsgrove	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Clough/Cummer	18/10/2012	Treated	Coliform Bacteria	0	number/100	0
Caherfinisker	22/10/2012	Treated	Coliform Bacteria	0	number/100	0
Killeely/Kilcolgan	22/10/2012	Treated	Coliform Bacteria	0	number/100	0
Tyrone	22/10/2012	Treated	Coliform Bacteria	0	number/100	0
Tonroe	22/10/2012	Treated	Coliform Bacteria	0	number/100	0
Doughiska No. 2	22/10/2012	Treated	Coliform Bacteria	0	number/100	0
Knockmascahill	23/10/2012	Treated	Coliform Bacteria	0	number/100	0
Clooncun, Glenamaddy	23/10/2012	Treated	Coliform Bacteria	0	number/100	0
Tully, Thornfield	23/10/2012	Treated	Coliform Bacteria	0	number/100	0
Killasolan	23/10/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	Coliform Bacteria	0	number/100	0
Carhereenlea, Athenry.	25/10/2012	Treated	Coliform Bacteria	0	number/100	0
Carrigan, Craughwell.	25/10/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	Coliform Bacteria	0	number/100	0
Glann, Oughterard	30/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cluide, Cahermorris.	31/10/2012	Treated	Coliform Bacteria	0	number/100	0
Cahermorris, Corrandulla.	31/10/2012	Treated	Coliform Bacteria	0	number/100	0
Corrandulla	31/10/2012	Treated	Coliform Bacteria	0	number/100	0
Annaghdown	01/11/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyfruit, Headford	01/11/2012	Treated	Coliform Bacteria	0	number/100	0
Coolarne	01/11/2012	Treated	Coliform Bacteria	0	number/100	0
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Coliform Bacteria	0	number/100	0
Ardrahan, GWS	05/11/2012	Treated	Coliform Bacteria	0	number/100	0
Ballyglass/Fiddane	05/11/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisheenavalla	05/11/2012	Treated	Coliform Bacteria	0	number/100	0
BushyPark	05/11/2012	Treated	Coliform Bacteria	0	number/100	0
Brackloon, Dunmore	06/11/2012	Treated	Coliform Bacteria	0	number/100	0
Garrafrauns	06/11/2012	Treated	Coliform Bacteria	0	number/100	0
Killasmuggaun	06/11/2012	Treated	Coliform Bacteria	0	number/100	0
Knockauns	06/11/2012	Treated	Coliform Bacteria	0	number/100	0
Newbridge Group Water Scheme	06/11/2012	Treated	Coliform Bacteria	0	number/100	0
Abbert No 2	07/11/2012	Treated	Coliform Bacteria	0	number/100	0
Abbert Public Group Water Scheme	07/11/2012	Treated	Coliform Bacteria	0	number/100	0
Milltown Co-Op	07/11/2012	Treated	Coliform Bacteria	0	number/100	0
Corohan Group Water Scheme	07/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lisananey/Liskeavy	07/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lettermullen No.2	12/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Coliform Bacteria	0	number/100	0
Criminagh/Lettermore	12/11/2012	Treated	Coliform Bacteria	0	number/100	0
Claren/knocklehard	14/11/2012	Treated	Coliform Bacteria	0	number/100	0
Carranurlaur	14/11/2012	Treated	Coliform Bacteria	0	number/100	0
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Coliform Bacteria	0	number/100	0
Curry, Pollinmore GWS	14/11/2012	Treated	Coliform Bacteria	0	number/100	0
Looscaun	15/11/2012	Treated	Coliform Bacteria	0	number/100	0
Bullaun, Loughrea	15/11/2012	Treated	Coliform Bacteria	0	number/100	0
Ballintleva GWS Spiddal	15/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lowville No.1	19/11/2012	Treated	Coliform Bacteria	0	number/100	0
Ballinakill, Moyard GWS	20/11/2012	Treated	Coliform Bacteria	0	number/100	0
Cloonluane (Renvyle)	20/11/2012	Treated	Coliform Bacteria	0	number/100	0
Lettergesh/Mullaghgloss	20/11/2012	Treated	Coliform Bacteria	0	number/100	0
New Inn GWS	21/11/2012	Treated	Coliform Bacteria	0	number/100	0
Newcastle (Aughrim)	21/11/2012	Treated	Coliform Bacteria	0	number/100	0
Emlough	21/11/2012	Treated	Coliform Bacteria	0	number/100	0
Cloon	21/11/2012	Treated	Coliform Bacteria	0	number/100	0
Kiltevna	22/11/2012	Treated	Coliform Bacteria	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cluide, Cahermorris.	22/11/2012	Treated	Coliform Bacteria	0	number/100	0
Coole GWS	26/11/2012	Treated	Coliform Bacteria	0	number/100	0
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Coliform Bacteria	0	number/100	0
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Coliform Bacteria	0	number/100	0
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Coliform Bacteria	0	number/100	0
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Coliform Bacteria	0	number/100	0
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Coliform Bacteria	0	number/100	0
Kilbannon	03/12/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconly	03/12/2012	Treated	Coliform Bacteria	0	number/100	0
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Coliform Bacteria	0	number/100	0
Kilcolgan Nursing Home - Well	06/12/2012	Treated	Coliform Bacteria	0	number/100	0
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Coliform Bacteria	0	number/100	0
Kilbannon	11/12/2012	Treated	Coliform Bacteria	0	number/100	0
Caherfinisker	11/12/2012	Treated	Coliform Bacteria	0	number/100	0
Caherdine/Caherdevan	11/12/2012	Treated	Coliform Bacteria	0	number/100	0
Carhereenlea, Athenry.	11/12/2012	Treated	Coliform Bacteria	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Coliform Bacteria	0	number/100	0
Beehive Restaurant, Portumna	12/12/2012	Treated	Coliform Bacteria	0	number/100	0
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Coliform Bacteria	0	number/100	0
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Coliform Bacteria	0	number/100	0
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Coliform Bacteria	0	number/100	0
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Coliform Bacteria	0	number/100	0
Kilconierin	24/07/2017	Raw	Colour	Acceptable to co	-	2.1
Gallagh/Brownsgrove	16/01/2012	Treated	Colour	Acceptable to co	-	5.7
Glinsk/Creggs	16/01/2012	Treated	Colour	Acceptable to co	-	3.3
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Colour	Acceptable to co	-	3.2
Rhynn/Killeeneen	23/01/2012	Treated	Colour	Acceptable to co	-	5.2
Coole GWS	23/01/2012	Treated	Colour	Acceptable to co	-	4.9
Tubber	02/02/2012	Treated	Colour	Acceptable to co	-	14.2
Gurteen/Cloonmore	09/02/2012	Treated	Colour	Acceptable to co	-	18.8

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Carranurlaur	09/02/2012	Treated	Colour	Acceptable to co	-	8.1
Rusheens	10/02/2012	Treated	Colour	Acceptable to co	-	7.8
Anbally & District GWS	10/02/2012	Treated	Colour	Acceptable to co	-	10.1
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Colour	Acceptable to co	-	3.1
Inismeain	23/02/2012	Treated	Colour	Acceptable to co	-	13.8
Glinsk/Creggs	02/03/2012	Treated	Colour	Acceptable to co	-	14.7
Killough GWS	08/03/2012	Treated	Colour	Acceptable to co	-	27.4
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Colour	Acceptable to co	-	4.7
Milltown Co-Op	12/03/2012	Treated	Colour	Acceptable to co	-	3.4
Corohan Group Water Scheme	12/03/2012	Treated	Colour	Acceptable to co	-	3.7
Kilcooley (Gurtymadden)	12/03/2012	Treated	Colour	Acceptable to co	-	17.4
Belmont (Kilconly)	12/03/2012	Treated	Colour	Acceptable to co	-	5
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Colour	Acceptable to co	-	13.9
Corohan Group Water Scheme	13/03/2012	Treated	Colour	Acceptable to co	-	4.5
Milltown Co-Op	13/03/2012	Treated	Colour	Acceptable to co	-	11.8
Ballynahinch Hotel	13/03/2012	Treated	Colour	Acceptable to co	-	3.6
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Colour	Acceptable to co	-	42.4
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Colour	Acceptable to co	-	3.7
Gallagh/Brownsgrove	13/03/2012	Treated	Colour	Acceptable to co	-	7.9
Anbally & District GWS	14/03/2012	Treated	Colour	Acceptable to co	-	10.4
Clough/Cummer	14/03/2012	Treated	Colour	Acceptable to co	-	4
Rusheens	14/03/2012	Treated	Colour	Acceptable to co	-	3.4
Claren/knocklehard	20/03/2012	Treated	Colour	Acceptable to co	-	12.1
Moy	02/04/2012	Treated	Colour	Acceptable to co	-	19.2
Currenrue, Kinvara.	02/04/2012	Treated	Colour	Acceptable to co	-	15.8
Toureen/Tarrea	02/04/2012	Treated	Colour	Acceptable to co	-	13.1
Mulrock	02/04/2012	Treated	Colour	Acceptable to co	-	12.4
Tully, Thornfield	10/04/2012	Treated	Colour	Acceptable to co	-	6
Lettergesh/Mullaghgloss	11/04/2012	Treated	Colour	Acceptable to co	-	11.5
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Colour	Acceptable to co	-	9.5
Masonbrook, Loughrea	12/04/2012	Treated	Colour	Acceptable to co	-	5.4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Emlough	16/04/2012	Treated	Colour	Acceptable to co	-	4.7
Carramore-Knock.	19/04/2012	Treated	Colour	Acceptable to co	-	16
Clontuskert	25/04/2012	Treated	Colour	Acceptable to co	-	5.1
Gortanumera	26/04/2012	Treated	Colour	Acceptable to co	-	5.6
Looscaun	26/04/2012	Treated	Colour	Acceptable to co	-	4
Kilchreest	26/04/2012	Treated	Colour	Acceptable to co	-	4.5
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Colour	Acceptable to co	-	7.6
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Colour	Acceptable to co	-	20.9
Cloonluane (Renvyle)	30/04/2012	Treated	Colour	Acceptable to co	-	6.6
Coole GWS	01/05/2012	Treated	Colour	Acceptable to co	-	4.7
Carrigan, Craughwell.	01/05/2012	Treated	Colour	Acceptable to co	-	4.8
Dunloughan, Ballyconneely.	03/05/2012	Treated	Colour	Acceptable to co	-	29.1
Aillebrack GWS	03/05/2012	Treated	Colour	Acceptable to co	-	31.3
Murvey/Dolan	03/05/2012	Treated	Colour	Acceptable to co	-	27.7
Clough/Cummer	14/05/2012	Treated	Colour	Acceptable to co	-	7.2
Kilcooley (Gurtymadden)	14/05/2012	Treated	Colour	Acceptable to co	-	8.5
Caherlea / Gurrane	14/05/2012	Treated	Colour	Acceptable to co	-	6.2
Carrigan, Craughwell.	14/05/2012	Treated	Colour	Acceptable to co	-	8
Gallagh/Brownsgrove	31/05/2012	Treated	Colour	Acceptable to co	-	4.4
Claren/knocklehard	07/06/2012	Treated	Colour	Acceptable to co	-	27.6
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Colour	Acceptable to co	-	11.3
Carramore-Knock.	11/06/2012	Treated	Colour	Acceptable to co	-	16
New Inn GWS	12/06/2012	Treated	Colour	Acceptable to co	-	5.6
Kings Shop, Lettergesh	20/06/2012	Treated	Colour	Acceptable to co	-	6.3
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Colour	Acceptable to co	-	5.6
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Colour	Acceptable to co	-	18.2
Glinsk/Creggs	04/07/2012	Treated	Colour	Acceptable to co	-	8.1
Gallagh/Brownsgrove	04/07/2012	Treated	Colour	Acceptable to co	-	10.6
Balroebuckbeg	09/07/2012	Treated	Colour	Acceptable to co	-	3.8
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Colour	Acceptable to co	-	2.8
Claren/knocklehard	09/07/2012	Treated	Colour	Acceptable to co	-	20.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
K2, Leenane	11/07/2012	Treated	Colour	Acceptable to co	-	17.2
Kylemore Pass Hotel	11/07/2012	Treated	Colour	Acceptable to co	-	2.8
Sleepzone Connemara, Leenane	11/07/2012	Treated	Colour	Acceptable to co	-	33.5
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Colour	Acceptable to co	-	16.7
Lough Inagh Lodge Hotel	18/07/2012	Treated	Colour	Acceptable to co	-	27
Joyce's Food Store, Recess	18/07/2012	Treated	Colour	Acceptable to co	-	22.7
Peacocks Hotel	18/07/2012	Treated	Colour	Acceptable to co	-	65
Inismeain	30/07/2012	Treated	Colour	Acceptable to co	-	16.9
Lettergesh/Mullaghgloss	31/07/2012	Treated	Colour	Acceptable to co	-	10.9
Cloonluane (Renvyle)	31/07/2012	Treated	Colour	Acceptable to co	-	6.9
Knockauns	09/08/2012	Treated	Colour	Acceptable to co	-	2.9
Gurteen/Cloonmore	09/08/2012	Treated	Colour	Acceptable to co	-	28
Gurteen/Cloonmore	09/08/2012	Treated	Colour	Acceptable to co	-	22.9
Newbridge Group Water Scheme	09/08/2012	Treated	Colour	Acceptable to co	-	4.1
Connemara Lady - Stream water	21/08/2012	Treated	Colour	Acceptable to co	-	28
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Colour	Acceptable to co	-	10.8
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Colour	Acceptable to co	-	38
Dunloughan, Ballyconneely.	22/08/2012	Treated	Colour	Acceptable to co	-	11.9
Aillebrack GWS	22/08/2012	Treated	Colour	Acceptable to co	-	11.3
Murvey/Dolan	22/08/2012	Treated	Colour	Acceptable to co	-	12
Lady Gregory Hotel - private supply	27/08/2012	Treated	Colour	Acceptable to co	-	2.2
New Inn GWS	30/08/2012	Treated	Colour	Acceptable to co	-	5
Rhynn/Killeeneen	30/08/2012	Treated	Colour	Acceptable to co	-	9.3
Tubber	04/09/2012	Treated	Colour	Acceptable to co	-	18.3
Carraghbrown	04/09/2012	Treated	Colour	Acceptable to co	-	4.3
Esker/ Eyrecourt	10/09/2012	Treated	Colour	Acceptable to co	-	3
Clontuskert	10/09/2012	Treated	Colour	Acceptable to co	-	4.3
Cloonatleva	10/09/2012	Treated	Colour	Acceptable to co	-	2.5
Lowville No.1	10/09/2012	Treated	Colour	Acceptable to co	-	6.7
Belmont (Kilconly)	10/09/2012	Treated	Colour	Acceptable to co	-	6.9
Menlough	10/09/2012	Treated	Colour	Acceptable to co	-	9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Brierfield No1, Ballinasloe	10/09/2012	Treated	Colour	Acceptable to co	-	4.9
Brierfield No1, Ballinasloe	11/09/2012	Treated	Colour	Acceptable to co	-	4.8
Masonbrook, Loughrea	12/09/2012	Treated	Colour	Acceptable to co	-	7.5
Kilcooley (Gurtymadden)	13/09/2012	Treated	Colour	Acceptable to co	-	18.3
Claren/knocklehard	17/09/2012	Treated	Colour	Acceptable to co	-	10.7
Anbally & District GWS	17/09/2012	Treated	Colour	Acceptable to co	-	17.4
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Colour	Acceptable to co	-	2.2
Inismeain	24/09/2012	Treated	Colour	Acceptable to co	-	12.1
Moanbaun	04/10/2012	Treated	Colour	Acceptable to co	-	80.3
Connemara National Park, Tea Rooms	10/10/2012	Treated	Colour	Acceptable to co	-	3.7
Kylemore Filling Station	10/10/2012	Treated	Colour	Acceptable to co	-	10.5
Cloon	11/10/2012	Treated	Colour	Acceptable to co	-	11.4
Gortanumera	15/10/2012	Treated	Colour	Acceptable to co	-	9.5
Cuillagh	16/10/2012	Treated	Colour	Acceptable to co	-	9.3
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Colour	Acceptable to co	-	5.2
Rhynn/Killeeneen	16/10/2012	Treated	Colour	Acceptable to co	-	6.3
Glinsk/Creggs	18/10/2012	Treated	Colour	Acceptable to co	-	13
Gallagh/Brownsgrove	18/10/2012	Treated	Colour	Acceptable to co	-	7.5
Clough/Cummer	18/10/2012	Treated	Colour	Acceptable to co	-	33.7
Caherlea / Gurrane	18/10/2012	Treated	Colour	Acceptable to co	-	6.2
Carramore-Knock.	18/10/2012	Treated	Colour	Acceptable to co	-	19.1
Killasolan	23/10/2012	Treated	Colour	Acceptable to co	-	9.8
Cluide, Cahermorris.	31/10/2012	Treated	Colour	Acceptable to co	-	4.8
Cahermorris, Corrandulla.	31/10/2012	Treated	Colour	Acceptable to co	-	2.7
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Colour	Acceptable to co	-	17.7
Newbridge Group Water Scheme	06/11/2012	Treated	Colour	Acceptable to co	-	21.7
Abbert No 2	07/11/2012	Treated	Colour	Acceptable to co	-	7
Abbert Public Group Water Scheme	07/11/2012	Treated	Colour	Acceptable to co	-	6.7
Criminagh/Lettermore	12/11/2012	Treated	Colour	Acceptable to co	-	5.2
Claren/knocklehard	14/11/2012	Treated	Colour	Acceptable to co	-	9.7
Carranurlaur	14/11/2012	Treated	Colour	Acceptable to co	-	12.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Bullaun, Loughrea	15/11/2012	Treated	Colour	Acceptable to co	-	11.9
Cloonluane (Renvyle)	20/11/2012	Treated	Colour	Acceptable to co	-	9.1
Lettergesh/Mullaghgloss	20/11/2012	Treated	Colour	Acceptable to co	-	34.7
New Inn GWS	21/11/2012	Treated	Colour	Acceptable to co	-	4.3
Hazel House B & B, Rusheens	21/11/2012	Treated	Colour	Acceptable to co	-	4.4
Seehan, Gort	21/11/2012	Treated	Colour	Acceptable to co	-	15.3
Tubber	21/11/2012	Treated	Colour	Acceptable to co	-	6.4
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Colour	Acceptable to co	-	25.5
Cluide, Cahermorris.	22/11/2012	Treated	Colour	Acceptable to co	-	10.8
Coole GWS	26/11/2012	Treated	Colour	Acceptable to co	-	5.9
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Colour	Acceptable to co	-	5.6
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Colour	Acceptable to co	-	2.9
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Colour	Acceptable to co	-	3.6
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Colour	Acceptable to co	-	7.4
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Colour	Acceptable to co	-	4.6
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Colour	Acceptable to co	-	9.6
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Colour	Acceptable to co	-	3.5
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Colour	Acceptable to co	-	160
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Colour	Acceptable to co	-	5.2
Kilbannon	11/12/2012	Treated	Colour	Acceptable to co	-	3.4
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Colour	Acceptable to co	-	4.1
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Colour	Acceptable to co	-	4.7
Kilconierin	24/07/2017	Raw	Conductivity	2500	µS/cm	533
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Conductivity	2500	µS/cm	609
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Conductivity	2500	µS/cm	684
Gallagh/Brownsgrove	16/01/2012	Treated	Conductivity	2500	µS/cm	577
Kiltevna	16/01/2012	Treated	Conductivity	2500	µS/cm	639
Toberowen	16/01/2012	Treated	Conductivity	2500	µS/cm	639
Glinsk/Creggs	16/01/2012	Treated	Conductivity	2500	µS/cm	637
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Conductivity	2500	µS/cm	679
Keelogue	16/01/2012	Treated	Conductivity	2500	µS/cm	597

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloonkeen/Toomard	16/01/2012	Treated	Conductivity	2500	µS/cm	618
Newbridge Group Water Scheme	17/01/2012	Treated	Conductivity	2500	µS/cm	653
Cloonigney	17/01/2012	Treated	Conductivity	2500	µS/cm	642
Rhynn/Killeeneen	23/01/2012	Treated	Conductivity	2500	µS/cm	533
Corofin/Ballintubber	23/01/2012	Treated	Conductivity	2500	µS/cm	386
Corrandulla	23/01/2012	Treated	Conductivity	2500	µS/cm	366
Cloon	23/01/2012	Treated	Conductivity	2500	µS/cm	369
Coole GWS	23/01/2012	Treated	Conductivity	2500	µS/cm	648
Tierneevin	23/01/2012	Treated	Conductivity	2500	µS/cm	522
Roo	23/01/2012	Treated	Conductivity	2500	µS/cm	621
Ardrahan, GWS	23/01/2012	Treated	Conductivity	2500	µS/cm	656
Clontuskert	24/01/2012	Treated	Conductivity	2500	µS/cm	503
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Conductivity	2500	µS/cm	243
Cuillagh	26/01/2012	Treated	Conductivity	2500	µS/cm	609
Doughiska No. 2	30/01/2012	Treated	Conductivity	2500	µS/cm	396
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	Conductivity	2500	µS/cm	421
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	Conductivity	2500	µS/cm	408
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	Conductivity	2500	µS/cm	412
Caherfinisker	30/01/2012	Treated	Conductivity	2500	µS/cm	376
Tubber	02/02/2012	Treated	Conductivity	2500	µS/cm	532
Seehan, Gort	02/02/2012	Treated	Conductivity	2500	µS/cm	556
Tierneevin	02/02/2012	Treated	Conductivity	2500	µS/cm	548
Roo	02/02/2012	Treated	Conductivity	2500	µS/cm	592
BushyPark	06/02/2012	Treated	Conductivity	2500	µS/cm	243
Lisheenavalla	06/02/2012	Treated	Conductivity	2500	µS/cm	428
Killasolan	07/02/2012	Treated	Conductivity	2500	µS/cm	606
Newbridge Group Water Scheme	07/02/2012	Treated	Conductivity	2500	µS/cm	603
Ballyfruit, Headford	08/02/2012	Treated	Conductivity	2500	µS/cm	420
Coolarne	08/02/2012	Treated	Conductivity	2500	µS/cm	462
Gurteen/Cloonmore	09/02/2012	Treated	Conductivity	2500	µS/cm	494
Brackloon, Dunmore	09/02/2012	Treated	Conductivity	2500	µS/cm	579

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Garrafrauns	09/02/2012	Treated	Conductivity	2500	µS/cm	585
Carranurlaur	09/02/2012	Treated	Conductivity	2500	µS/cm	243
Annaghdown	10/02/2012	Treated	Conductivity	2500	µS/cm	430
Balroebuckbeg	10/02/2012	Treated	Conductivity	2500	µS/cm	581
Cluide, Cahermorris.	10/02/2012	Treated	Conductivity	2500	µS/cm	625
Belclare	10/02/2012	Treated	Conductivity	2500	µS/cm	640
Rusheens	10/02/2012	Treated	Conductivity	2500	µS/cm	605
Anbally & District GWS	10/02/2012	Treated	Conductivity	2500	µS/cm	593
Bullaun, Tuam	10/02/2012	Treated	Conductivity	2500	µS/cm	419
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	Conductivity	2500	µS/cm	415
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Conductivity	2500	µS/cm	486
Esker/ Eyrecourt	13/02/2012	Treated	Conductivity	2500	µS/cm	735
Tynagh GWS	13/02/2012	Treated	Conductivity	2500	µS/cm	596
Newcastle (Aughrim)	13/02/2012	Treated	Conductivity	2500	µS/cm	616
Moyglass, Loughrea.	13/02/2012	Treated	Conductivity	2500	µS/cm	433
Feigh East & West	14/02/2012	Treated	Conductivity	2500	µS/cm	620
Abbert No 2	14/02/2012	Treated	Conductivity	2500	µS/cm	614
Abbert Public Group Water Scheme	14/02/2012	Treated	Conductivity	2500	µS/cm	618
Ballintleva GWS Spiddal	14/02/2012	Treated	Conductivity	2500	µS/cm	181
Keelogue	14/02/2012	Treated	Conductivity	2500	µS/cm	573
Ballymanagh, Craughwell	16/02/2012	Treated	Conductivity	2500	µS/cm	634
Gortnaglassa	16/02/2012	Treated	Conductivity	2500	µS/cm	84.9
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Conductivity	2500	µS/cm	431
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Conductivity	2500	µS/cm	34
Inismeain	23/02/2012	Treated	Conductivity	2500	µS/cm	590
Ardrahan, GWS	01/03/2012	Treated	Conductivity	2500	µS/cm	631
Caherdine/Caherdevan	01/03/2012	Treated	Conductivity	2500	µS/cm	632
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Conductivity	2500	µS/cm	626
Ballyglass/Fiddane	01/03/2012	Treated	Conductivity	2500	µS/cm	639
Toberowen	02/03/2012	Treated	Conductivity	2500	µS/cm	624
Glinsk/Creggs	02/03/2012	Treated	Conductivity	2500	µS/cm	638

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Conductivity	2500	µS/cm	458
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	Conductivity	2500	µS/cm	210
Ballinakill, Moyard GWS	06/03/2012	Treated	Conductivity	2500	µS/cm	165
New Inn GWS	07/03/2012	Treated	Conductivity	2500	µS/cm	603
Menlough	07/03/2012	Treated	Conductivity	2500	µS/cm	642
Brierfield No1, Ballinasloe	07/03/2012	Treated	Conductivity	2500	µS/cm	635
Killough GWS	08/03/2012	Treated	Conductivity	2500	µS/cm	173
Glann, Oughterard	08/03/2012	Treated	Conductivity	2500	µS/cm	153
Glengowla (Gibbons)	08/03/2012	Treated	Conductivity	2500	µS/cm	151
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Conductivity	2500	µS/cm	761
Lisananey/Liskeavy	12/03/2012	Treated	Conductivity	2500	µS/cm	704
Bullaun, Loughrea	12/03/2012	Treated	Conductivity	2500	µS/cm	699
Milltown Co-Op	12/03/2012	Treated	Conductivity	2500	µS/cm	646
Kilcooley (Gurtymadden)	12/03/2012	Treated	Conductivity	2500	µS/cm	592
Corohan Group Water Scheme	12/03/2012	Treated	Conductivity	2500	µS/cm	698
Newtowndaly	12/03/2012	Treated	Conductivity	2500	µS/cm	311
Belmont (Kilconly)	12/03/2012	Treated	Conductivity	2500	µS/cm	660
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Conductivity	2500	µS/cm	319
Rhynn/Killeeneen	12/03/2012	Treated	Conductivity	2500	µS/cm	564
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Conductivity	2500	µS/cm	647
Corohan Group Water Scheme	13/03/2012	Treated	Conductivity	2500	µS/cm	697
Belmont (Kilconly)	13/03/2012	Treated	Conductivity	2500	µS/cm	662
Looscaun	13/03/2012	Treated	Conductivity	2500	µS/cm	499
Milltown Co-Op	13/03/2012	Treated	Conductivity	2500	µS/cm	650
Lisananey/Liskeavy	13/03/2012	Treated	Conductivity	2500	µS/cm	699
Killeen / Poulatoon	13/03/2012	Treated	Conductivity	2500	µS/cm	600
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	Conductivity	2500	µS/cm	340
Kylemore Abbey	13/03/2012	Treated	Conductivity	2500	µS/cm	378
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Conductivity	2500	µS/cm	169
Ballynahinch Hotel	13/03/2012	Treated	Conductivity	2500	µS/cm	1587
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Conductivity	2500	µS/cm	296

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gallagh/Brownsgrove	13/03/2012	Treated	Conductivity	2500	µS/cm	524
Kilchreest	13/03/2012	Treated	Conductivity	2500	µS/cm	588
Moyglass, Loughrea.	13/03/2012	Treated	Conductivity	2500	µS/cm	438
Bullaun, Loughrea	13/03/2012	Treated	Conductivity	2500	µS/cm	700
Anbally & District GWS	14/03/2012	Treated	Conductivity	2500	µS/cm	505
Killeen / Poulatoon	14/03/2012	Treated	Conductivity	2500	µS/cm	599
Clough/Cummer	14/03/2012	Treated	Conductivity	2500	µS/cm	455
Curry, Pollinmore GWS	14/03/2012	Treated	Conductivity	2500	µS/cm	364
Rusheens	14/03/2012	Treated	Conductivity	2500	µS/cm	487
Caherlea / Gurrane	14/03/2012	Treated	Conductivity	2500	µS/cm	412
Kilconly	14/03/2012	Treated	Conductivity	2500	µS/cm	340
Claren/knocklehard	20/03/2012	Treated	Conductivity	2500	µS/cm	225
Cahermorris, Corrandulla.	20/03/2012	Treated	Conductivity	2500	µS/cm	655
Kilconly	20/03/2012	Treated	Conductivity	2500	µS/cm	327
Kilbannon	20/03/2012	Treated	Conductivity	2500	µS/cm	355
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Conductivity	2500	µS/cm	474
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	Conductivity	2500	µS/cm	128
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	Conductivity	2500	µS/cm	424
Moy	02/04/2012	Treated	Conductivity	2500	µS/cm	456
Currenrue, Kinvara.	02/04/2012	Treated	Conductivity	2500	µS/cm	464
Toureen/Tarrea	02/04/2012	Treated	Conductivity	2500	µS/cm	457
Mulrock	02/04/2012	Treated	Conductivity	2500	µS/cm	461
Carraghbrown	03/04/2012	Treated	Conductivity	2500	µS/cm	410
Derrydonnell	03/04/2012	Treated	Conductivity	2500	µS/cm	437
Doughiska No. 1.	03/04/2012	Treated	Conductivity	2500	µS/cm	353
Loughwell (Leamhcoill)	03/04/2012	Treated	Conductivity	2500	µS/cm	331
Corofin/Ballintubber	04/04/2012	Treated	Conductivity	2500	µS/cm	415
Corrandulla	04/04/2012	Treated	Conductivity	2500	µS/cm	421
Carraghy (Claregalway)	04/04/2012	Treated	Conductivity	2500	µS/cm	404
Kiniska, Claregalway.	04/04/2012	Treated	Conductivity	2500	µS/cm	417
Claregalway No 2	04/04/2012	Treated	Conductivity	2500	µS/cm	417

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloon	04/04/2012	Treated	Conductivity	2500	µS/cm	409
Cloonacauneen	04/04/2012	Treated	Conductivity	2500	µS/cm	403
Carhereenlea, Athenry.	05/04/2012	Treated	Conductivity	2500	µS/cm	623
Kiltevna	05/04/2012	Treated	Conductivity	2500	µS/cm	597
Knockauns	05/04/2012	Treated	Conductivity	2500	µS/cm	794
Killasmuggaun	05/04/2012	Treated	Conductivity	2500	µS/cm	677
Cloonkeen/Toomard	05/04/2012	Treated	Conductivity	2500	µS/cm	605
Tully, Thornfield	10/04/2012	Treated	Conductivity	2500	µS/cm	663
Clooncun, Glenamaddy	10/04/2012	Treated	Conductivity	2500	µS/cm	641
Knockmascahill	10/04/2012	Treated	Conductivity	2500	µS/cm	575
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	Conductivity	2500	µS/cm	921
Lettergesh/Mullaghgloss	11/04/2012	Treated	Conductivity	2500	µS/cm	127
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Conductivity	2500	µS/cm	319
Masonbrook, Loughrea	12/04/2012	Treated	Conductivity	2500	µS/cm	320
Lowville No.2	12/04/2012	Treated	Conductivity	2500	µS/cm	744
Castlegar/Lissyegan	12/04/2012	Treated	Conductivity	2500	µS/cm	748
Cornamucklagh	12/04/2012	Treated	Conductivity	2500	µS/cm	747
Emlough	16/04/2012	Treated	Conductivity	2500	µS/cm	316
Claregalway No.1.	16/04/2012	Treated	Conductivity	2500	µS/cm	432
Killeen/Bruckey	16/04/2012	Treated	Conductivity	2500	µS/cm	410
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	Conductivity	2500	µS/cm	420
Cashla No. 1	16/04/2012	Treated	Conductivity	2500	µS/cm	427
Castlelambert, Knocknacreva.	16/04/2012	Treated	Conductivity	2500	µS/cm	428
Moanbaun	16/04/2012	Treated	Conductivity	2500	µS/cm	463
Caherfinisker	16/04/2012	Treated	Conductivity	2500	µS/cm	468
Lowville No.1	19/04/2012	Treated	Conductivity	2500	µS/cm	694
Cloonigney	19/04/2012	Treated	Conductivity	2500	µS/cm	629
Carramore-Knock.	19/04/2012	Treated	Conductivity	2500	µS/cm	251
Lisheenkyle	23/04/2012	Treated	Conductivity	2500	µS/cm	393
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	Conductivity	2500	µS/cm	408
Cregannamore/Moneymore GWS	23/04/2012	Treated	Conductivity	2500	µS/cm	405

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Conductivity	2500	µS/cm	667
Lavally No. 3 (Higgins)	23/04/2012	Treated	Conductivity	2500	µS/cm	398
Tarramuid No 2, Oranmore	23/04/2012	Treated	Conductivity	2500	µS/cm	399
Killeely/Kilcolgan	23/04/2012	Treated	Conductivity	2500	µS/cm	417
Tyrone	23/04/2012	Treated	Conductivity	2500	µS/cm	409
Tonroe	23/04/2012	Treated	Conductivity	2500	µS/cm	414
Clontuskert	25/04/2012	Treated	Conductivity	2500	µS/cm	529
Moher	25/04/2012	Treated	Conductivity	2500	µS/cm	527
Kiltomer No. 3	25/04/2012	Treated	Conductivity	2500	µS/cm	551
Perssepark (Ballinasloe)	25/04/2012	Treated	Conductivity	2500	µS/cm	533
Cloonatleva	25/04/2012	Treated	Conductivity	2500	µS/cm	691
Gortanumera	26/04/2012	Treated	Conductivity	2500	µS/cm	509
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Conductivity	2500	µS/cm	889
Looscaun	26/04/2012	Treated	Conductivity	2500	µS/cm	522
Kylemore Abbey	26/04/2012	Treated	Conductivity	2500	µS/cm	400
Kilchreest	26/04/2012	Treated	Conductivity	2500	µS/cm	616
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Conductivity	2500	µS/cm	655
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Conductivity	2500	µS/cm	676
Cloonluane (Renvyle)	30/04/2012	Treated	Conductivity	2500	µS/cm	175
Coole GWS	01/05/2012	Treated	Conductivity	2500	µS/cm	639
Carrigan, Craughwell.	01/05/2012	Treated	Conductivity	2500	µS/cm	717
Lisheenavalla	01/05/2012	Treated	Conductivity	2500	µS/cm	327
Dunloughan, Ballyconneely.	03/05/2012	Treated	Conductivity	2500	µS/cm	203
Aillebrack GWS	03/05/2012	Treated	Conductivity	2500	µS/cm	202
Murvey/Dolan	03/05/2012	Treated	Conductivity	2500	µS/cm	205
Lettermullen No.2	10/05/2012	Treated	Conductivity	2500	µS/cm	220
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Conductivity	2500	µS/cm	220
Criminagh/Lettermore	10/05/2012	Treated	Conductivity	2500	µS/cm	220
Tynagh GWS	14/05/2012	Treated	Conductivity	2500	µS/cm	613
Clough/Cummer	14/05/2012	Treated	Conductivity	2500	µS/cm	631
Curry, Pollinmore GWS	14/05/2012	Treated	Conductivity	2500	µS/cm	339

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcooley (Gurtymadden)	14/05/2012	Treated	Conductivity	2500	µS/cm	552
Caherlea / Gurrane	14/05/2012	Treated	Conductivity	2500	µS/cm	600
Ballymanagh, Craughwell	14/05/2012	Treated	Conductivity	2500	µS/cm	662
Carrigan, Craughwell.	14/05/2012	Treated	Conductivity	2500	µS/cm	709
Ballyglass/Fiddane	14/05/2012	Treated	Conductivity	2500	µS/cm	656
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Conductivity	2500	µS/cm	654
Lisheenavalla	14/05/2012	Treated	Conductivity	2500	µS/cm	349
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	Conductivity	2500	µS/cm	241
Menlough	31/05/2012	Treated	Conductivity	2500	µS/cm	665
Glinsk/Creggs	31/05/2012	Treated	Conductivity	2500	µS/cm	675
Toberowen	31/05/2012	Treated	Conductivity	2500	µS/cm	577
Gallagh/Brownsgrove	31/05/2012	Treated	Conductivity	2500	µS/cm	461
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Conductivity	2500	µS/cm	422
Ardrahan, GWS	05/06/2012	Treated	Conductivity	2500	µS/cm	633
Ballyglass/Fiddane	05/06/2012	Treated	Conductivity	2500	µS/cm	648
Rhynn/Killeeneen	05/06/2012	Treated	Conductivity	2500	µS/cm	596
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Conductivity	2500	µS/cm	650
Annaghdown	07/06/2012	Treated	Conductivity	2500	µS/cm	304
Claren/knocklehard	07/06/2012	Treated	Conductivity	2500	µS/cm	222
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Conductivity	2500	µS/cm	204
Newbridge Group Water Scheme	07/06/2012	Treated	Conductivity	2500	µS/cm	674
Carramore-Knock.	11/06/2012	Treated	Conductivity	2500	µS/cm	215
Ballinakill, Moyard GWS	11/06/2012	Treated	Conductivity	2500	µS/cm	176
Bullaun, Loughrea	12/06/2012	Treated	Conductivity	2500	µS/cm	721
New Inn GWS	12/06/2012	Treated	Conductivity	2500	µS/cm	624
Kylemore Abbey	14/06/2012	Treated	Conductivity	2500	µS/cm	393
Ballinakill, Moyard GWS	14/06/2012	Treated	Conductivity	2500	µS/cm	178
Milltown Co-Op	18/06/2012	Treated	Conductivity	2500	µS/cm	555
Kings Shop, Lettergesh	20/06/2012	Treated	Conductivity	2500	µS/cm	97
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Conductivity	2500	µS/cm	965
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Conductivity	2500	µS/cm	89

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	Conductivity	2500	µS/cm	209
Kilbannon	03/07/2012	Treated	Conductivity	2500	µS/cm	415
Kilconly	03/07/2012	Treated	Conductivity	2500	µS/cm	371
Menlough	04/07/2012	Treated	Conductivity	2500	µS/cm	663
Glinsk/Creggs	04/07/2012	Treated	Conductivity	2500	µS/cm	574
Toberowen	04/07/2012	Treated	Conductivity	2500	µS/cm	616
Gallagh/Brownsgrove	04/07/2012	Treated	Conductivity	2500	µS/cm	534
Kilcoona Caherlistrane GWS	04/07/2012	Treated	Conductivity	2500	µS/cm	492
Clontuskert	05/07/2012	Treated	Conductivity	2500	µS/cm	437
Annaghdown	09/07/2012	Treated	Conductivity	2500	µS/cm	483
Balroebuckbeg	09/07/2012	Treated	Conductivity	2500	µS/cm	650
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Conductivity	2500	µS/cm	533
Belclare	09/07/2012	Treated	Conductivity	2500	µS/cm	663
Claren/knocklehard	09/07/2012	Treated	Conductivity	2500	µS/cm	248
Emlough	10/07/2012	Treated	Conductivity	2500	µS/cm	281
K2, Leenane	11/07/2012	Treated	Conductivity	2500	µS/cm	110
Kylemore Pass Hotel	11/07/2012	Treated	Conductivity	2500	µS/cm	207
Sleepzone Connemara, Leenane	11/07/2012	Treated	Conductivity	2500	µS/cm	77
Corrandulla	16/07/2012	Treated	Conductivity	2500	µS/cm	479
Gortnaglassa	16/07/2012	Treated	Conductivity	2500	µS/cm	90
Corofin/Ballintubber	16/07/2012	Treated	Conductivity	2500	µS/cm	465
Cloon	16/07/2012	Treated	Conductivity	2500	µS/cm	466
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Conductivity	2500	µS/cm	467
Caherfinisker	16/07/2012	Treated	Conductivity	2500	µS/cm	497
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Conductivity	2500	µS/cm	206
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Conductivity	2500	µS/cm	235
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Conductivity	2500	µS/cm	59
Lough Inagh Lodge Hotel	18/07/2012	Treated	Conductivity	2500	µS/cm	94
Joyce's Food Store, Recess	18/07/2012	Treated	Conductivity	2500	µS/cm	314
Peacocks Hotel	18/07/2012	Treated	Conductivity	2500	µS/cm	101
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Conductivity	2500	µS/cm	432

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Inismeain	30/07/2012	Treated	Conductivity	2500	µS/cm	553
Lettergesh/Mullaghgloss	31/07/2012	Treated	Conductivity	2500	µS/cm	93
Cloonluane (Renvyle)	31/07/2012	Treated	Conductivity	2500	µS/cm	162
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Conductivity	2500	µS/cm	220
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Conductivity	2500	µS/cm	698
Knockauns	09/08/2012	Treated	Conductivity	2500	µS/cm	815
Gurteen/Cloonmore	09/08/2012	Treated	Conductivity	2500	µS/cm	667
Gurteen/Cloonmore	09/08/2012	Treated	Conductivity	2500	µS/cm	674
Newbridge Group Water Scheme	09/08/2012	Treated	Conductivity	2500	µS/cm	686
Keelogue	09/08/2012	Treated	Conductivity	2500	µS/cm	617
Corofin/Ballintubber	09/08/2012	Treated	Conductivity	2500	µS/cm	399
Bullaun, Tuam	09/08/2012	Treated	Conductivity	2500	µS/cm	394
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Conductivity	2500	µS/cm	394
Esker/ Eyrecourt	13/08/2012	Treated	Conductivity	2500	µS/cm	785
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Conductivity	2500	µS/cm	620
Gordans Bar, Tynagh - Well	18/08/2012	Treated	Conductivity	2500	µS/cm	718
Pallas Karting - Well	19/08/2012	Treated	Conductivity	2500	µS/cm	566
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Conductivity	2500	µS/cm	400
Connemara Lady - Stream water	21/08/2012	Treated	Conductivity	2500	µS/cm	87
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Conductivity	2500	µS/cm	114
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Conductivity	2500	µS/cm	38
Dunloughan, Ballyconneely.	22/08/2012	Treated	Conductivity	2500	µS/cm	181
Aillebrack GWS	22/08/2012	Treated	Conductivity	2500	µS/cm	180
Murvey/Dolan	22/08/2012	Treated	Conductivity	2500	µS/cm	181
Gortnaglassa	23/08/2012	Treated	Conductivity	2500	µS/cm	88
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	Conductivity	2500	µS/cm	28
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Conductivity	2500	µS/cm	572
Gort Golf Club - Well	27/08/2012	Treated	Conductivity	2500	µS/cm	632
Lady Gregory Hotel - private supply	27/08/2012	Treated	Conductivity	2500	µS/cm	1110
McGrath's B&B	28/08/2012	Treated	Conductivity	2500	µS/cm	814
Feigh East & West	30/08/2012	Treated	Conductivity	2500	µS/cm	678

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
New Inn GWS	30/08/2012	Treated	Conductivity	2500	µS/cm	702
Rhynn/Killeeneen	30/08/2012	Treated	Conductivity	2500	µS/cm	553
Lisheenavalla	30/08/2012	Treated	Conductivity	2500	µS/cm	408
Carraghy (Claregalway)	03/09/2012	Treated	Conductivity	2500	µS/cm	440
Claregalway No 2	03/09/2012	Treated	Conductivity	2500	µS/cm	425
Claregalway No.1.	03/09/2012	Treated	Conductivity	2500	µS/cm	425
Cloonacauneen	03/09/2012	Treated	Conductivity	2500	µS/cm	440
Cashla No. 1	03/09/2012	Treated	Conductivity	2500	µS/cm	438
Castlelambert, Knocknacreva.	03/09/2012	Treated	Conductivity	2500	µS/cm	445
Tubber	04/09/2012	Treated	Conductivity	2500	µS/cm	630
Ardrahan, GWS	04/09/2012	Treated	Conductivity	2500	µS/cm	706
Ballyglass/Fiddane	04/09/2012	Treated	Conductivity	2500	µS/cm	747
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	Conductivity	2500	µS/cm	742
Derrydonnell	04/09/2012	Treated	Conductivity	2500	µS/cm	448
Doughiska No. 1.	04/09/2012	Treated	Conductivity	2500	µS/cm	415
Carraghbrown	04/09/2012	Treated	Conductivity	2500	µS/cm	428
Killough GWS	05/09/2012	Treated	Conductivity	2500	µS/cm	229
Glengowla (Gibbons)	05/09/2012	Treated	Conductivity	2500	µS/cm	166
Ballinakill, Moyard GWS	05/09/2012	Treated	Conductivity	2500	µS/cm	186
Annaghdown	10/09/2012	Treated	Conductivity	2500	µS/cm	400
Esker/ Eyrecourt	10/09/2012	Treated	Conductivity	2500	µS/cm	794
Cahermorris, Corrandulla.	10/09/2012	Treated	Conductivity	2500	µS/cm	744
Clontuskert	10/09/2012	Treated	Conductivity	2500	µS/cm	490
Belclare	10/09/2012	Treated	Conductivity	2500	µS/cm	703
Cloonatleva	10/09/2012	Treated	Conductivity	2500	µS/cm	709
Rusheens	10/09/2012	Treated	Conductivity	2500	µS/cm	732
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Conductivity	2500	µS/cm	387
Lowville No.1	10/09/2012	Treated	Conductivity	2500	µS/cm	723
Belmont (Kilconly)	10/09/2012	Treated	Conductivity	2500	µS/cm	758
Menlough	10/09/2012	Treated	Conductivity	2500	µS/cm	686
Bullaun, Tuam	10/09/2012	Treated	Conductivity	2500	µS/cm	416

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killasmuggaun	10/09/2012	Treated	Conductivity	2500	µS/cm	721
Brierfield No1, Ballinasloe	10/09/2012	Treated	Conductivity	2500	µS/cm	723
Feigh East & West	10/09/2012	Treated	Conductivity	2500	µS/cm	649
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Conductivity	2500	µS/cm	623
Brierfield No1, Ballinasloe	11/09/2012	Treated	Conductivity	2500	µS/cm	743
Masonbrook, Loughrea	12/09/2012	Treated	Conductivity	2500	µS/cm	243
Newtowndaly	12/09/2012	Treated	Conductivity	2500	µS/cm	246
Tynagh GWS	12/09/2012	Treated	Conductivity	2500	µS/cm	660
Kylemore Abbey	12/09/2012	Treated	Conductivity	2500	µS/cm	394
Kilchreest	12/09/2012	Treated	Conductivity	2500	µS/cm	616
Bullaun, Loughrea	12/09/2012	Treated	Conductivity	2500	µS/cm	768
Kilcooley (Gurtymadden)	13/09/2012	Treated	Conductivity	2500	µS/cm	253
Newcastle (Aughrim)	13/09/2012	Treated	Conductivity	2500	µS/cm	252
Caherdine/Caherdevan	13/09/2012	Treated	Conductivity	2500	µS/cm	248
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Conductivity	2500	µS/cm	247
Balroebuckbeg	17/09/2012	Treated	Conductivity	2500	µS/cm	780
Claren/knocklehard	17/09/2012	Treated	Conductivity	2500	µS/cm	261
Milltown Co-Op	17/09/2012	Treated	Conductivity	2500	µS/cm	826
Anbally & District GWS	17/09/2012	Treated	Conductivity	2500	µS/cm	762
Ballymanagh, Craughwell	17/09/2012	Treated	Conductivity	2500	µS/cm	817
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Conductivity	2500	µS/cm	600
Inismeain	24/09/2012	Treated	Conductivity	2500	µS/cm	582
Cloonigney	03/10/2012	Treated	Conductivity	2500	µS/cm	744
Cloonatleva	03/10/2012	Treated	Conductivity	2500	µS/cm	764
Corrandulla	04/10/2012	Treated	Conductivity	2500	µS/cm	466
Kilconly	04/10/2012	Treated	Conductivity	2500	µS/cm	253
Kilbannon	04/10/2012	Treated	Conductivity	2500	µS/cm	249
Corofin/Ballintubber	04/10/2012	Treated	Conductivity	2500	µS/cm	249
Moanbaun	04/10/2012	Treated	Conductivity	2500	µS/cm	253
Seehan, Gort	08/10/2012	Treated	Conductivity	2500	µS/cm	665
Roo	08/10/2012	Treated	Conductivity	2500	µS/cm	649

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Currenrue, Kinvara.	08/10/2012	Treated	Conductivity	2500	µS/cm	607
Moy	08/10/2012	Treated	Conductivity	2500	µS/cm	615
Toureen/Tarrea	08/10/2012	Treated	Conductivity	2500	µS/cm	609
Mulrock	08/10/2012	Treated	Conductivity	2500	µS/cm	606
Moher	09/10/2012	Treated	Conductivity	2500	µS/cm	434
Clontuskert	09/10/2012	Treated	Conductivity	2500	µS/cm	425
Kiltomer No. 3	09/10/2012	Treated	Conductivity	2500	µS/cm	512
Perssepark (Ballinasloe)	09/10/2012	Treated	Conductivity	2500	µS/cm	425
Lowville No.2	09/10/2012	Treated	Conductivity	2500	µS/cm	780
Castlegar/Lissyegan	09/10/2012	Treated	Conductivity	2500	µS/cm	780
Cornamucklagh	09/10/2012	Treated	Conductivity	2500	µS/cm	780
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Conductivity	2500	µS/cm	625
Connemara National Park, Tea Rooms	10/10/2012	Treated	Conductivity	2500	µS/cm	261
Kylemore Abbey Restaurant	10/10/2012	Treated	Conductivity	2500	µS/cm	238
Kylemore Filling Station	10/10/2012	Treated	Conductivity	2500	µS/cm	72
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Conductivity	2500	µS/cm	497
Kiniska, Claregalway.	11/10/2012	Treated	Conductivity	2500	µS/cm	489
Cloon	11/10/2012	Treated	Conductivity	2500	µS/cm	482
Killeen/Bruckey	11/10/2012	Treated	Conductivity	2500	µS/cm	428
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Conductivity	2500	µS/cm	493
Lisheenkyle	11/10/2012	Treated	Conductivity	2500	µS/cm	458
Cregannamore/Moneymore GWS	11/10/2012	Treated	Conductivity	2500	µS/cm	472
Tarramuid No 2, Oranmore	11/10/2012	Treated	Conductivity	2500	µS/cm	466
Lavally No. 3 (Higgins)	11/10/2012	Treated	Conductivity	2500	µS/cm	457
Killeen / Poulatoon	15/10/2012	Treated	Conductivity	2500	µS/cm	667
Gortanumera	15/10/2012	Treated	Conductivity	2500	µS/cm	500
Kylemore Abbey	15/10/2012	Treated	Conductivity	2500	µS/cm	392
Moyglass, Loughrea.	15/10/2012	Treated	Conductivity	2500	µS/cm	460
Loughwell (Leamhcoill)	15/10/2012	Treated	Conductivity	2500	µS/cm	395
Cuillagh	16/10/2012	Treated	Conductivity	2500	µS/cm	707
New Inn GWS	16/10/2012	Treated	Conductivity	2500	µS/cm	265

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Conductivity	2500	µS/cm	265
Rhynn/Killeeneen	16/10/2012	Treated	Conductivity	2500	µS/cm	561
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Conductivity	2500	µS/cm	501
Menlough	18/10/2012	Treated	Conductivity	2500	µS/cm	721
Cloonkeen/Toomard	18/10/2012	Treated	Conductivity	2500	µS/cm	639
Glinsk/Creggs	18/10/2012	Treated	Conductivity	2500	µS/cm	640
Toberowen	18/10/2012	Treated	Conductivity	2500	µS/cm	670
Gallagh/Brownsgrove	18/10/2012	Treated	Conductivity	2500	µS/cm	561
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Conductivity	2500	µS/cm	615
Clough/Cummer	18/10/2012	Treated	Conductivity	2500	µS/cm	714
Caherlea / Gurrane	18/10/2012	Treated	Conductivity	2500	µS/cm	719
Carramore-Knock.	18/10/2012	Treated	Conductivity	2500	µS/cm	255
Caherfinisker	22/10/2012	Treated	Conductivity	2500	µS/cm	540
Killeely/Kilcolgan	22/10/2012	Treated	Conductivity	2500	µS/cm	559
Tyrone	22/10/2012	Treated	Conductivity	2500	µS/cm	548
Tonroe	22/10/2012	Treated	Conductivity	2500	µS/cm	553
Doughiska No. 2	22/10/2012	Treated	Conductivity	2500	µS/cm	536
Knockmascahill	23/10/2012	Treated	Conductivity	2500	µS/cm	711
Clooncun, Glenamaddy	23/10/2012	Treated	Conductivity	2500	µS/cm	759
Tully, Thornfield	23/10/2012	Treated	Conductivity	2500	µS/cm	700
Killasolan	23/10/2012	Treated	Conductivity	2500	µS/cm	636
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	Conductivity	2500	µS/cm	191
Carhereenlea, Athenry.	25/10/2012	Treated	Conductivity	2500	µS/cm	676
Carrigan, Craughwell.	25/10/2012	Treated	Conductivity	2500	µS/cm	826
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	Conductivity	2500	µS/cm	745
Glann, Oughterard	30/10/2012	Treated	Conductivity	2500	µS/cm	164
Cluide, Cahermorris.	31/10/2012	Treated	Conductivity	2500	µS/cm	672
Cahermorris, Corrandulla.	31/10/2012	Treated	Conductivity	2500	µS/cm	733
Corrandulla	31/10/2012	Treated	Conductivity	2500	µS/cm	448
Annaghdown	01/11/2012	Treated	Conductivity	2500	µS/cm	484
Ballyfruit, Headford	01/11/2012	Treated	Conductivity	2500	µS/cm	493

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Coolarne	01/11/2012	Treated	Conductivity	2500	µS/cm	497
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	Conductivity	2500	µS/cm	473
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Conductivity	2500	µS/cm	675
Ardrahan, GWS	05/11/2012	Treated	Conductivity	2500	µS/cm	772
Ballyglass/Fiddane	05/11/2012	Treated	Conductivity	2500	µS/cm	447
Lisheenavalla	05/11/2012	Treated	Conductivity	2500	µS/cm	530
BushyPark	05/11/2012	Treated	Conductivity	2500	µS/cm	451
Brackloon, Dunmore	06/11/2012	Treated	Conductivity	2500	µS/cm	683
Garrafrauns	06/11/2012	Treated	Conductivity	2500	µS/cm	690
Killasmuggaun	06/11/2012	Treated	Conductivity	2500	µS/cm	813
Knockauns	06/11/2012	Treated	Conductivity	2500	µS/cm	943
Newbridge Group Water Scheme	06/11/2012	Treated	Conductivity	2500	µS/cm	727
Abbert No 2	07/11/2012	Treated	Conductivity	2500	µS/cm	757
Abbert Public Group Water Scheme	07/11/2012	Treated	Conductivity	2500	µS/cm	758
Milltown Co-Op	07/11/2012	Treated	Conductivity	2500	µS/cm	735
Corohan Group Water Scheme	07/11/2012	Treated	Conductivity	2500	µS/cm	864
Lisananey/Liskeavy	07/11/2012	Treated	Conductivity	2500	µS/cm	836
Lettermullen No.2	12/11/2012	Treated	Conductivity	2500	µS/cm	212
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Conductivity	2500	µS/cm	201
Criminagh/Lettermore	12/11/2012	Treated	Conductivity	2500	µS/cm	214
Claren/knocklehard	14/11/2012	Treated	Conductivity	2500	µS/cm	251
Carranurlaur	14/11/2012	Treated	Conductivity	2500	µS/cm	268
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Conductivity	2500	µS/cm	464
Curry, Pollinmore GWS	14/11/2012	Treated	Conductivity	2500	µS/cm	463
Looscaun	15/11/2012	Treated	Conductivity	2500	µS/cm	511
Bullaun, Loughrea	15/11/2012	Treated	Conductivity	2500	µS/cm	799
Ballintleva GWS Spiddal	15/11/2012	Treated	Conductivity	2500	µS/cm	220
Lowville No.1	19/11/2012	Treated	Conductivity	2500	µS/cm	762
Ballinakill, Moyard GWS	20/11/2012	Treated	Conductivity	2500	µS/cm	164
Cloonluane (Renvyle)	20/11/2012	Treated	Conductivity	2500	µS/cm	151
Lettergesh/Mullaghgloss	20/11/2012	Treated	Conductivity	2500	µS/cm	53.5

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
New Inn GWS	21/11/2012	Treated	Conductivity	2500	µS/cm	676
Newcastle (Aughrim)	21/11/2012	Treated	Conductivity	2500	µS/cm	636
Emlough	21/11/2012	Treated	Conductivity	2500	µS/cm	272
Hazel House B & B, Rusheens	21/11/2012	Treated	Conductivity	2500	µS/cm	621
Seehan, Gort	21/11/2012	Treated	Conductivity	2500	µS/cm	609
Tubber	21/11/2012	Treated	Conductivity	2500	µS/cm	481
Cloon	21/11/2012	Treated	Conductivity	2500	µS/cm	400
Kiltevna	22/11/2012	Treated	Conductivity	2500	µS/cm	695
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Conductivity	2500	µS/cm	628
Cluide, Cahermorris.	22/11/2012	Treated	Conductivity	2500	µS/cm	714
Coole GWS	26/11/2012	Treated	Conductivity	2500	µS/cm	730
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Conductivity	2500	µS/cm	640
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Conductivity	2500	µS/cm	666
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Conductivity	2500	µS/cm	767
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Conductivity	2500	µS/cm	733
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Conductivity	2500	µS/cm	641
Kilbannon	03/12/2012	Treated	Conductivity	2500	µS/cm	635
Kilconly	03/12/2012	Treated	Conductivity	2500	µS/cm	640
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Conductivity	2500	µS/cm	664
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Conductivity	2500	µS/cm	1028
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Conductivity	2500	µS/cm	760
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Conductivity	2500	µS/cm	95
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Conductivity	2500	µS/cm	357
Kilbannon	11/12/2012	Treated	Conductivity	2500	µS/cm	564
Caherfinisker	11/12/2012	Treated	Conductivity	2500	µS/cm	605
Caherdine/Caherdevan	11/12/2012	Treated	Conductivity	2500	µS/cm	711
Carhereenlea, Athenry.	11/12/2012	Treated	Conductivity	2500	µS/cm	565
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Conductivity	2500	µS/cm	664
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Conductivity	2500	µS/cm	635
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Conductivity	2500	µS/cm	545
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Conductivity	2500	µS/cm	583

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Conductivity	2500	µS/cm	715
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Conductivity	2500	µS/cm	455
Kilconierin	24/07/2017	Raw	Copper	2000	µg/l	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Copper	2	mg/l	0.1
Gallagh/Brownsgrove	16/01/2012	Treated	Copper	2	mg/l	0.055
Kiltevna	16/01/2012	Treated	Copper	2	mg/l	0.097
Toberowen	16/01/2012	Treated	Copper	2	mg/l	0.022
Glinsk/Creggs	16/01/2012	Treated	Copper	2	mg/l	0.021
Keelogue	16/01/2012	Treated	Copper	2	mg/l	0.02
Cloonkeen/Toomard	16/01/2012	Treated	Copper	2	mg/l	0.006
Newbridge Group Water Scheme	17/01/2012	Treated	Copper	2	mg/l	0.022
Cloonigney	17/01/2012	Treated	Copper	2	mg/l	0.019
Rhynn/Killeeneen	23/01/2012	Treated	Copper	2	mg/l	0.009
Coole GWS	23/01/2012	Treated	Copper	2	mg/l	0.008
Tierneevin	23/01/2012	Treated	Copper	2	mg/l	0.007
Ardrahan, GWS	23/01/2012	Treated	Copper	2	mg/l	0.124
Lisananey/Liskeavy	12/03/2012	Treated	Copper	2	mg/l	0.008
Milltown Co-Op	12/03/2012	Treated	Copper	2	mg/l	0.021
Corohan Group Water Scheme	12/03/2012	Treated	Copper	2	mg/l	0.056
Belmont (Kilconly)	12/03/2012	Treated	Copper	2	mg/l	0.048
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Copper	2	mg/l	0.007
Looscaun	13/03/2012	Treated	Copper	2	mg/l	0.005
Killeen / Poulatoon	13/03/2012	Treated	Copper	2	mg/l	0.006
Kylemore Abbey	13/03/2012	Treated	Copper	2	mg/l	0.003
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Copper	2	mg/l	0.038
Kilchreest	13/03/2012	Treated	Copper	2	mg/l	0.042
Moyglass, Loughrea.	13/03/2012	Treated	Copper	2	mg/l	0.003
Bullaun, Loughrea	13/03/2012	Treated	Copper	2	mg/l	0.015
Anbally & District GWS	14/03/2012	Treated	Copper	2	mg/l	0.041
Clough/Cummer	14/03/2012	Treated	Copper	2	mg/l	0.062
Curry, Pollinmore GWS	14/03/2012	Treated	Copper	2	mg/l	0.406

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Rusheens	14/03/2012	Treated	Copper	2	mg/l	0.043
Caherlea / Gurrane	14/03/2012	Treated	Copper	2	mg/l	0.011
Kilconly	14/03/2012	Treated	Copper	2	mg/l	0.116
Tynagh GWS	14/05/2012	Treated	Copper	2	mg/l	0.008
Kilcooley (Gurtymadden)	14/05/2012	Treated	Copper	2	mg/l	0.01
Ballymanagh, Craughwell	14/05/2012	Treated	Copper	2	mg/l	0.097
Carrigan, Craughwell.	14/05/2012	Treated	Copper	2	mg/l	0.046
Ballyglass/Fiddane	14/05/2012	Treated	Copper	2	mg/l	0.008
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Copper	2	mg/l	0.009
Lisheenavalla	14/05/2012	Treated	Copper	2	mg/l	0.004
Carramore-Knock.	11/06/2012	Treated	Copper	2	mg/l	0.005
Ballinakill, Moyard GWS	11/06/2012	Treated	Copper	2	mg/l	0.011
Annaghdown	09/07/2012	Treated	Copper	2	mg/l	0.004
Balroebuckbeg	09/07/2012	Treated	Copper	2	mg/l	0.01
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Copper	2	mg/l	0.016
Belclare	09/07/2012	Treated	Copper	2	mg/l	0.006
Claren/knocklehard	09/07/2012	Treated	Copper	2	mg/l	0.007
Gortnaglassa	16/07/2012	Treated	Copper	2	mg/l	0.003
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Copper	2	mg/l	0.005
Inismeain	30/07/2012	Treated	Copper	2	mg/l	0.007
Lettergesh/Mullaghgloss	31/07/2012	Treated	Copper	2	mg/l	0.033
Cloonluane (Renvyle)	31/07/2012	Treated	Copper	2	mg/l	0.037
Knockauns	09/08/2012	Treated	Copper	2	mg/l	0.013
Gurteen/Cloonmore	09/08/2012	Treated	Copper	2	mg/l	0.039
Corofin/Ballintubber	09/08/2012	Treated	Copper	2	mg/l	0.019
Bullaun, Tuam	09/08/2012	Treated	Copper	2	mg/l	0.004
Esker/ Eyrecourt	10/09/2012	Treated	Copper	2	mg/l	0.009
Clontuskert	10/09/2012	Treated	Copper	2	mg/l	0.01
Cloonatleva	10/09/2012	Treated	Copper	2	mg/l	0.036
Lowville No.1	10/09/2012	Treated	Copper	2	mg/l	0.013
Menlough	10/09/2012	Treated	Copper	2	mg/l	0.014

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killasmuggaun	10/09/2012	Treated	Copper	2	mg/l	0.01
Brierfield No1, Ballinasloe	10/09/2012	Treated	Copper	2	mg/l	0.119
Feigh East & West	10/09/2012	Treated	Copper	2	mg/l	0.009
Cluide, Cahermorris.	31/10/2012	Treated	Copper	2	mg/l	0.01
Cahermorris, Corrandulla.	31/10/2012	Treated	Copper	2	mg/l	0.173
Corrandulla	31/10/2012	Treated	Copper	2	mg/l	0.013
New Inn GWS	21/11/2012	Treated	Copper	2	mg/l	0.077
Newcastle (Aughrim)	21/11/2012	Treated	Copper	2	mg/l	0.015
Seehan, Gort	21/11/2012	Treated	Copper	2	mg/l	0.018
Tubber	21/11/2012	Treated	Copper	2	mg/l	0.024
Cloon	21/11/2012	Treated	Copper	2	mg/l	0.016
Kilbannon	11/12/2012	Treated	Copper	2	mg/l	0.017
Caherfinisker	11/12/2012	Treated	Copper	2	mg/l	0.007
Caherdine/Caherdevan	11/12/2012	Treated	Copper	2	mg/l	0.013
Carhereenlea, Athenry.	11/12/2012	Treated	Copper	2	mg/l	0.016
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Copper	2	mg/l	0.095
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Copper	2	mg/l	0.01
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Copper	2	mg/l	0.015
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Cyanide	50	µg/l	14.7
Kilconierin	24/07/2017	Raw	Dissolved Oxygen O2	No abnormal changes	-	6.54
Kilconierin	24/07/2017	Raw	E. coli	0	number/100	162
Clough/Cummer	14/05/2012	Treated	E. coli	0	number/100	1
Connemara Lady - Stream water	11/07/2012	Treated	E. coli	0	number/100	1
Gurteen/Cloonmore	09/08/2012	Treated	E. coli	0	number/100	1
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	E. coli	0	number/100	1
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	E. coli	0	number/100	1
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	E. coli	0	number/100	1
Shanaheever Caravan Park - Lake	15/05/2012	Treated	E. coli	0	number/100	2
Beehive Restaurant, Portumna	15/06/2012	Treated	E. coli	0	number/100	2
Ballymore Cottage Creche, Craughwell - Well	02/11/2012	Treated	E. coli	0	number/100	2

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Shanaheever Caravan Park - Lake	23/05/2012	Treated	E. coli	0	number/100	3
Seehan, Gort	21/11/2012	Treated	E. coli	0	number/100	3
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	E. coli	0	number/100	4
Carrigan, Craughwell.	14/05/2012	Treated	E. coli	0	number/100	4
Shanaheever Caravan Park - Lake	23/05/2012	Treated	E. coli	0	number/100	4
Gurteen/Cloonmore	09/08/2012	Treated	E. coli	0	number/100	4
Carrigan, Craughwell.	01/05/2012	Treated	E. coli	0	number/100	6
Tynagh GWS	12/09/2012	Treated	E. coli	0	number/100	8
Lydons Public House, Knockdo - Well	03/12/2012	Treated	E. coli	0	number/100	15
Caherlea / Gurrane	18/10/2012	Treated	E. coli	0	number/100	18
Kings Shop, Lettergesh	20/06/2012	Treated	E. coli	0	number/100	20
Gordans Bar, Tynagh - Well	19/08/2012	Treated	E. coli	0	number/100	33
Hazel House B & B, Rusheens	21/11/2012	Treated	E. coli	0	number/100	47
Gordans Bar, Tynagh - Well	26/09/2012	Treated	E. coli	0	number/100	130
Tubber	21/11/2012	Treated	E. coli	0	number/100	145
Sleepzone Connemara, Leenane	11/07/2012	Treated	E. coli	0	number/100	326
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	E. coli	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	E. coli	0	number/100	0
Gallagh/Brownsgrove	16/01/2012	Treated	E. coli	0	number/100	0
Kiltevna	16/01/2012	Treated	E. coli	0	number/100	0
Toberowen	16/01/2012	Treated	E. coli	0	number/100	0
Glinsk/Creggs	16/01/2012	Treated	E. coli	0	number/100	0
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	E. coli	0	number/100	0
Keelogue	16/01/2012	Treated	E. coli	0	number/100	0
Cloonkeen/Toomard	16/01/2012	Treated	E. coli	0	number/100	0
Newbridge Group Water Scheme	17/01/2012	Treated	E. coli	0	number/100	0
Cloonigney	17/01/2012	Treated	E. coli	0	number/100	0
Rhynn/Killeeneen	23/01/2012	Treated	E. coli	0	number/100	0
Corofin/Ballintubber	23/01/2012	Treated	E. coli	0	number/100	0
Corrandulla	23/01/2012	Treated	E. coli	0	number/100	0
Cloon	23/01/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Coole GWS	23/01/2012	Treated	E. coli	0	number/100	0
Tierneevin	23/01/2012	Treated	E. coli	0	number/100	0
Roo	23/01/2012	Treated	E. coli	0	number/100	0
Ardrahan, GWS	23/01/2012	Treated	E. coli	0	number/100	0
Clontuskert	24/01/2012	Treated	E. coli	0	number/100	0
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	E. coli	0	number/100	0
Cuillagh	26/01/2012	Treated	E. coli	0	number/100	0
Doughiska No. 2	30/01/2012	Treated	E. coli	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	E. coli	0	number/100	0
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	E. coli	0	number/100	0
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	E. coli	0	number/100	0
Caherfinisker	30/01/2012	Treated	E. coli	0	number/100	0
Tubber	02/02/2012	Treated	E. coli	0	number/100	0
Seehan, Gort	02/02/2012	Treated	E. coli	0	number/100	0
Tierneevin	02/02/2012	Treated	E. coli	0	number/100	0
Roo	02/02/2012	Treated	E. coli	0	number/100	0
BushyPark	06/02/2012	Treated	E. coli	0	number/100	0
Lisheenavalla	06/02/2012	Treated	E. coli	0	number/100	0
Killasolan	07/02/2012	Treated	E. coli	0	number/100	0
Newbridge Group Water Scheme	07/02/2012	Treated	E. coli	0	number/100	0
Ballyfruit, Headford	08/02/2012	Treated	E. coli	0	number/100	0
Coolarne	08/02/2012	Treated	E. coli	0	number/100	0
Gurteen/Cloonmore	09/02/2012	Treated	E. coli	0	number/100	0
Brackloon, Dunmore	09/02/2012	Treated	E. coli	0	number/100	0
Dartfield Museum - Well	09/02/2012	Treated	E. coli	0	number/100	0
Mary Stoddarts Home Bakery - Well	09/02/2012	Treated	E. coli	0	number/100	0
Garrafrauns	09/02/2012	Treated	E. coli	0	number/100	0
Carranurlaur	09/02/2012	Treated	E. coli	0	number/100	0
Annaghdown	10/02/2012	Treated	E. coli	0	number/100	0
Balroebuckbeg	10/02/2012	Treated	E. coli	0	number/100	0
Cluide, Cahermorris.	10/02/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Belclare	10/02/2012	Treated	E. coli	0	number/100	0
Rusheens	10/02/2012	Treated	E. coli	0	number/100	0
Anbally & District GWS	10/02/2012	Treated	E. coli	0	number/100	0
Bullaun, Tuam	10/02/2012	Treated	E. coli	0	number/100	0
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	E. coli	0	number/100	0
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	E. coli	0	number/100	0
Esker/ Eyrecourt	13/02/2012	Treated	E. coli	0	number/100	0
Tynagh GWS	13/02/2012	Treated	E. coli	0	number/100	0
Newcastle (Aughrim)	13/02/2012	Treated	E. coli	0	number/100	0
Moyglass, Loughrea.	13/02/2012	Treated	E. coli	0	number/100	0
Feigh East & West	14/02/2012	Treated	E. coli	0	number/100	0
Abbert No 2	14/02/2012	Treated	E. coli	0	number/100	0
Abbert Public Group Water Scheme	14/02/2012	Treated	E. coli	0	number/100	0
Ballintleva GWS Spiddal	14/02/2012	Treated	E. coli	0	number/100	0
Keelogue	14/02/2012	Treated	E. coli	0	number/100	0
Ballymanagh, Craughwell	16/02/2012	Treated	E. coli	0	number/100	0
Gortnaglassa	16/02/2012	Treated	E. coli	0	number/100	0
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	E. coli	0	number/100	0
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	E. coli	0	number/100	0
Inismeain	23/02/2012	Treated	E. coli	0	number/100	0
Connemara Golf Club, Ballyconneely - Lake	29/02/2012	Treated	E. coli	0	number/100	0
Ardrahan, GWS	01/03/2012	Treated	E. coli	0	number/100	0
Caherdine/Caherdevan	01/03/2012	Treated	E. coli	0	number/100	0
Ballyglass/Fiddane	01/03/2012	Treated	E. coli	0	number/100	0
Toberowen	02/03/2012	Treated	E. coli	0	number/100	0
Glinsk/Creggs	02/03/2012	Treated	E. coli	0	number/100	0
Kilcoona Caherlistrane GWS	05/03/2012	Treated	E. coli	0	number/100	0
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	E. coli	0	number/100	0
Ballinakill, Moyard GWS	06/03/2012	Treated	E. coli	0	number/100	0
New Inn GWS	07/03/2012	Treated	E. coli	0	number/100	0
Menlough	07/03/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Brierfield No1, Ballinasloe	07/03/2012	Treated	E. coli	0	number/100	0
Killough GWS	08/03/2012	Treated	E. coli	0	number/100	0
Glann, Oughterard	08/03/2012	Treated	E. coli	0	number/100	0
Glengowla (Gibbons)	08/03/2012	Treated	E. coli	0	number/100	0
Whytes Shop, Mullagh - Well	08/03/2012	Treated	E. coli	0	number/100	0
Lisananey/Liskeavy	12/03/2012	Treated	E. coli	0	number/100	0
Bullaun, Loughrea	12/03/2012	Treated	E. coli	0	number/100	0
Milltown Co-Op	12/03/2012	Treated	E. coli	0	number/100	0
Kilcooley (Gurtymadden)	12/03/2012	Treated	E. coli	0	number/100	0
Corohan Group Water Scheme	12/03/2012	Treated	E. coli	0	number/100	0
Newtowndaly	12/03/2012	Treated	E. coli	0	number/100	0
Belmont (Kilconly)	12/03/2012	Treated	E. coli	0	number/100	0
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	E. coli	0	number/100	0
Rhynn/Killeeneen	12/03/2012	Treated	E. coli	0	number/100	0
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	E. coli	0	number/100	0
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	E. coli	0	number/100	0
Corohan Group Water Scheme	13/03/2012	Treated	E. coli	0	number/100	0
Belmont (Kilconly)	13/03/2012	Treated	E. coli	0	number/100	0
Looscaun	13/03/2012	Treated	E. coli	0	number/100	0
Milltown Co-Op	13/03/2012	Treated	E. coli	0	number/100	0
Lisananey/Liskeavy	13/03/2012	Treated	E. coli	0	number/100	0
Killeen / Poulatoon	13/03/2012	Treated	E. coli	0	number/100	0
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey	13/03/2012	Treated	E. coli	0	number/100	0
Ballynahinch Hotel	13/03/2012	Treated	E. coli	0	number/100	0
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	E. coli	0	number/100	0
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	E. coli	0	number/100	0
Gallagh/Brownsgrove	13/03/2012	Treated	E. coli	0	number/100	0
Kilchreest	13/03/2012	Treated	E. coli	0	number/100	0
Moyglass, Loughrea.	13/03/2012	Treated	E. coli	0	number/100	0
Bullaun, Loughrea	13/03/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Anbally & District GWS	14/03/2012	Treated	E. coli	0	number/100	0
Killeen / Poulatoon	14/03/2012	Treated	E. coli	0	number/100	0
Clough/Cummer	14/03/2012	Treated	E. coli	0	number/100	0
Curry, Pollinmore GWS	14/03/2012	Treated	E. coli	0	number/100	0
Rusheens	14/03/2012	Treated	E. coli	0	number/100	0
Caherlea / Gurrane	14/03/2012	Treated	E. coli	0	number/100	0
Kilconly	14/03/2012	Treated	E. coli	0	number/100	0
Claren/knocklehard	20/03/2012	Treated	E. coli	0	number/100	0
Cahermorris, Corrandulla.	20/03/2012	Treated	E. coli	0	number/100	0
Kilconly	20/03/2012	Treated	E. coli	0	number/100	0
Kilbannon	20/03/2012	Treated	E. coli	0	number/100	0
Zetland Hotel, Connemara - Well	28/03/2012	Treated	E. coli	0	number/100	0
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	E. coli	0	number/100	0
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	E. coli	0	number/100	0
Moy	02/04/2012	Treated	E. coli	0	number/100	0
Currenrue, Kinvara.	02/04/2012	Treated	E. coli	0	number/100	0
Toureen/Tarrea	02/04/2012	Treated	E. coli	0	number/100	0
Mulrock	02/04/2012	Treated	E. coli	0	number/100	0
Carraghbrown	03/04/2012	Treated	E. coli	0	number/100	0
Derrydonnell	03/04/2012	Treated	E. coli	0	number/100	0
Doughiska No. 1.	03/04/2012	Treated	E. coli	0	number/100	0
Loughwell (Leamhcoill)	03/04/2012	Treated	E. coli	0	number/100	0
Corofin/Ballintubber	04/04/2012	Treated	E. coli	0	number/100	0
Corrandulla	04/04/2012	Treated	E. coli	0	number/100	0
Carraghy (Claregalway)	04/04/2012	Treated	E. coli	0	number/100	0
Kiniska, Claregalway.	04/04/2012	Treated	E. coli	0	number/100	0
Claregalway No 2	04/04/2012	Treated	E. coli	0	number/100	0
Cloon	04/04/2012	Treated	E. coli	0	number/100	0
Cloonacauneen	04/04/2012	Treated	E. coli	0	number/100	0
Carhereenlea, Athenry.	05/04/2012	Treated	E. coli	0	number/100	0
Kiltevna	05/04/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Knockauns	05/04/2012	Treated	E. coli	0	number/100	0
Killasmuggaun	05/04/2012	Treated	E. coli	0	number/100	0
Cloonkeen/Toomard	05/04/2012	Treated	E. coli	0	number/100	0
Tully, Thornfield	10/04/2012	Treated	E. coli	0	number/100	0
Clooncun, Glenamaddy	10/04/2012	Treated	E. coli	0	number/100	0
Knockmascahill	10/04/2012	Treated	E. coli	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	E. coli	0	number/100	0
Lettergesh/Mullaghgloss	11/04/2012	Treated	E. coli	0	number/100	0
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	E. coli	0	number/100	0
Masonbrook, Loughrea	12/04/2012	Treated	E. coli	0	number/100	0
Lowville No.2	12/04/2012	Treated	E. coli	0	number/100	0
Castlegar/Lissyegan	12/04/2012	Treated	E. coli	0	number/100	0
Cornamucklagh	12/04/2012	Treated	E. coli	0	number/100	0
Emlough	16/04/2012	Treated	E. coli	0	number/100	0
Claregalway No.1.	16/04/2012	Treated	E. coli	0	number/100	0
Killeen/Bruckey	16/04/2012	Treated	E. coli	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	E. coli	0	number/100	0
Cashla No. 1	16/04/2012	Treated	E. coli	0	number/100	0
Castlelambert, Knocknacreva.	16/04/2012	Treated	E. coli	0	number/100	0
Moanbaun	16/04/2012	Treated	E. coli	0	number/100	0
Caherfinisker	16/04/2012	Treated	E. coli	0	number/100	0
Lowville No.1	19/04/2012	Treated	E. coli	0	number/100	0
Cloonigney	19/04/2012	Treated	E. coli	0	number/100	0
Carramore-Knock.	19/04/2012	Treated	E. coli	0	number/100	0
Lisheenkyle	23/04/2012	Treated	E. coli	0	number/100	0
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	E. coli	0	number/100	0
Cregannamore/Moneymore GWS	23/04/2012	Treated	E. coli	0	number/100	0
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	E. coli	0	number/100	0
Lavally No. 3 (Higgins)	23/04/2012	Treated	E. coli	0	number/100	0
Tarramuid No 2, Oranmore	23/04/2012	Treated	E. coli	0	number/100	0
Killeely/Kilcolgan	23/04/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Tyrone	23/04/2012	Treated	E. coli	0	number/100	0
Tonroe	23/04/2012	Treated	E. coli	0	number/100	0
Clontuskert	25/04/2012	Treated	E. coli	0	number/100	0
Moher	25/04/2012	Treated	E. coli	0	number/100	0
Kiltomer No. 3	25/04/2012	Treated	E. coli	0	number/100	0
Perssepark (Ballinasloe)	25/04/2012	Treated	E. coli	0	number/100	0
Cloonatleva	25/04/2012	Treated	E. coli	0	number/100	0
Gortanumera	26/04/2012	Treated	E. coli	0	number/100	0
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	E. coli	0	number/100	0
Looscaun	26/04/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey	26/04/2012	Treated	E. coli	0	number/100	0
Kilchreest	26/04/2012	Treated	E. coli	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	E. coli	0	number/100	0
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	E. coli	0	number/100	0
Cloonluane (Renvyle)	30/04/2012	Treated	E. coli	0	number/100	0
Coole GWS	01/05/2012	Treated	E. coli	0	number/100	0
Lisheenavalla	01/05/2012	Treated	E. coli	0	number/100	0
Dunloughan, Ballyconneely.	03/05/2012	Treated	E. coli	0	number/100	0
Aillebrack GWS	03/05/2012	Treated	E. coli	0	number/100	0
Murvey/Dolan	03/05/2012	Treated	E. coli	0	number/100	0
Lettermullen No.2	10/05/2012	Treated	E. coli	0	number/100	0
Lettercallow (Leitir Caladh)	10/05/2012	Treated	E. coli	0	number/100	0
Criminagh/Lettermore	10/05/2012	Treated	E. coli	0	number/100	0
Tynagh GWS	14/05/2012	Treated	E. coli	0	number/100	0
Curry, Pollinmore GWS	14/05/2012	Treated	E. coli	0	number/100	0
Kilcooley (Gurtymadden)	14/05/2012	Treated	E. coli	0	number/100	0
Caherlea / Gurrane	14/05/2012	Treated	E. coli	0	number/100	0
Ballymanagh, Craughwell	14/05/2012	Treated	E. coli	0	number/100	0
Ballyglass/Fiddane	14/05/2012	Treated	E. coli	0	number/100	0
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	E. coli	0	number/100	0
Lisheenavalla	14/05/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Actons Campsite & Caravan Pk, Grallagh, Claddagduff	15/05/2012	Treated	E. coli	0	number/100	0
Shanaheever Caravan Park - Lake	15/05/2012	Treated	E. coli	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	E. coli	0	number/100	0
Mortimers Caravan Park, Renvyle	16/05/2012	Treated	E. coli	0	number/100	0
Renvyle House Hotel - Lake	16/05/2012	Treated	E. coli	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	E. coli	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	E. coli	0	number/100	0
Mother's Bar, Kiltormer - Well	28/05/2012	Treated	E. coli	0	number/100	0
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	E. coli	0	number/100	0
Menlough	31/05/2012	Treated	E. coli	0	number/100	0
Glinsk/Creggs	31/05/2012	Treated	E. coli	0	number/100	0
Toberowen	31/05/2012	Treated	E. coli	0	number/100	0
Gallagh/Brownsgrove	31/05/2012	Treated	E. coli	0	number/100	0
Kilcoona Caherlistrane GWS	31/05/2012	Treated	E. coli	0	number/100	0
Ardrahan, GWS	05/06/2012	Treated	E. coli	0	number/100	0
Ballyglass/Fiddane	05/06/2012	Treated	E. coli	0	number/100	0
Rhynn/Killeeneen	05/06/2012	Treated	E. coli	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	E. coli	0	number/100	0
Annaghdown	07/06/2012	Treated	E. coli	0	number/100	0
Claren/knocklehard	07/06/2012	Treated	E. coli	0	number/100	0
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	E. coli	0	number/100	0
Newbridge Group Water Scheme	07/06/2012	Treated	E. coli	0	number/100	0
Carramore-Knock.	11/06/2012	Treated	E. coli	0	number/100	0
Ballinakill, Moyard GWS	11/06/2012	Treated	E. coli	0	number/100	0
Bullaun, Loughrea	12/06/2012	Treated	E. coli	0	number/100	0
New Inn GWS	12/06/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey	14/06/2012	Treated	E. coli	0	number/100	0
Dessie O'Brians Bar - Well	14/06/2012	Treated	E. coli	0	number/100	0
Ballinakill, Moyard GWS	14/06/2012	Treated	E. coli	0	number/100	0
Milltown Co-Op	18/06/2012	Treated	E. coli	0	number/100	0
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	E. coli	0	number/100	0
Sliabh Aughty Riding Centre - Well	21/06/2012	Treated	E. coli	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	E. coli	0	number/100	0
Shanaheever Caravan Park - Lake	26/06/2012	Treated	E. coli	0	number/100	0
St Annes CNU, Clifden - Lake	29/06/2012	Treated	E. coli	0	number/100	0
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	E. coli	0	number/100	0
Kilbannon	03/07/2012	Treated	E. coli	0	number/100	0
Kilconly	03/07/2012	Treated	E. coli	0	number/100	0
Menlough	04/07/2012	Treated	E. coli	0	number/100	0
Glinsk/Creggs	04/07/2012	Treated	E. coli	0	number/100	0
Toberowen	04/07/2012	Treated	E. coli	0	number/100	0
Gallagh/Brownsgrove	04/07/2012	Treated	E. coli	0	number/100	0
Kilcoona Caherlistrane GWS	04/07/2012	Treated	E. coli	0	number/100	0
Clontuskert	05/07/2012	Treated	E. coli	0	number/100	0
Annaghdown	09/07/2012	Treated	E. coli	0	number/100	0
Balroebuckbeg	09/07/2012	Treated	E. coli	0	number/100	0
Kilcoona Caherlistrane GWS	09/07/2012	Treated	E. coli	0	number/100	0
Belclare	09/07/2012	Treated	E. coli	0	number/100	0
Claren/knocklehard	09/07/2012	Treated	E. coli	0	number/100	0
Emlough	10/07/2012	Treated	E. coli	0	number/100	0
K2, Leenane	11/07/2012	Treated	E. coli	0	number/100	0
Kylemore Pass Hotel	11/07/2012	Treated	E. coli	0	number/100	0
Corrandulla	16/07/2012	Treated	E. coli	0	number/100	0
Gortnaglassa	16/07/2012	Treated	E. coli	0	number/100	0
Corofin/Ballintubber	16/07/2012	Treated	E. coli	0	number/100	0
Cloon	16/07/2012	Treated	E. coli	0	number/100	0
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	E. coli	0	number/100	0
Caherfinisker	16/07/2012	Treated	E. coli	0	number/100	0
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	E. coli	0	number/100	0
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	E. coli	0	number/100	0
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lough Inagh Lodge Hotel	18/07/2012	Treated	E. coli	0	number/100	0
Joyce's Food Store, Recess	18/07/2012	Treated	E. coli	0	number/100	0
Peacocks Hotel	18/07/2012	Treated	E. coli	0	number/100	0
Carrig Bar, Leenane - Stream water	24/07/2012	Treated	E. coli	0	number/100	0
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	E. coli	0	number/100	0
Inismeain	30/07/2012	Treated	E. coli	0	number/100	0
Lettergesh/Mullaghgloss	31/07/2012	Treated	E. coli	0	number/100	0
Cloonluane (Renvyle)	31/07/2012	Treated	E. coli	0	number/100	0
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	E. coli	0	number/100	0
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	E. coli	0	number/100	0
Knockauns	09/08/2012	Treated	E. coli	0	number/100	0
Newbridge Group Water Scheme	09/08/2012	Treated	E. coli	0	number/100	0
Keelogue	09/08/2012	Treated	E. coli	0	number/100	0
Corofin/Ballintubber	09/08/2012	Treated	E. coli	0	number/100	0
Bullaun, Tuam	09/08/2012	Treated	E. coli	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	E. coli	0	number/100	0
Esker/ Eyrecourt	13/08/2012	Treated	E. coli	0	number/100	0
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	E. coli	0	number/100	0
Pallas Karting - Well	19/08/2012	Treated	E. coli	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	E. coli	0	number/100	0
Connemara Lady - Stream water	21/08/2012	Treated	E. coli	0	number/100	0
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	E. coli	0	number/100	0
Dunloughan, Ballyconneely.	22/08/2012	Treated	E. coli	0	number/100	0
Aillebrack GWS	22/08/2012	Treated	E. coli	0	number/100	0
Murvey/Dolan	22/08/2012	Treated	E. coli	0	number/100	0
Gortnaglassa	23/08/2012	Treated	E. coli	0	number/100	0
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	E. coli	0	number/100	0
Gort Mart Canteen - Well	27/08/2012	Treated	E. coli	0	number/100	0
Lady Gregory Hotel - private supply	27/08/2012	Treated	E. coli	0	number/100	0
Gort Golf Club - Well	27/08/2012	Treated	E. coli	0	number/100	0
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Feigh East & West	30/08/2012	Treated	E. coli	0	number/100	0
New Inn GWS	30/08/2012	Treated	E. coli	0	number/100	0
Rhynn/Killeeneen	30/08/2012	Treated	E. coli	0	number/100	0
Lisheenavalla	30/08/2012	Treated	E. coli	0	number/100	0
Carraghy (Claregalway)	03/09/2012	Treated	E. coli	0	number/100	0
Claregalway No 2	03/09/2012	Treated	E. coli	0	number/100	0
Claregalway No.1.	03/09/2012	Treated	E. coli	0	number/100	0
Cloonacauneen	03/09/2012	Treated	E. coli	0	number/100	0
Cashla No. 1	03/09/2012	Treated	E. coli	0	number/100	0
Castlelambert, Knocknacreva.	03/09/2012	Treated	E. coli	0	number/100	0
Tubber	04/09/2012	Treated	E. coli	0	number/100	0
Ardrahan, GWS	04/09/2012	Treated	E. coli	0	number/100	0
Ballyglass/Fiddane	04/09/2012	Treated	E. coli	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	E. coli	0	number/100	0
Derrydonnell	04/09/2012	Treated	E. coli	0	number/100	0
Doughiska No. 1.	04/09/2012	Treated	E. coli	0	number/100	0
Carraghbrown	04/09/2012	Treated	E. coli	0	number/100	0
Killough GWS	05/09/2012	Treated	E. coli	0	number/100	0
Glengowla (Gibbons)	05/09/2012	Treated	E. coli	0	number/100	0
Ballinakill, Moyard GWS	05/09/2012	Treated	E. coli	0	number/100	0
Annaghdown	10/09/2012	Treated	E. coli	0	number/100	0
Esker/ Eyrecourt	10/09/2012	Treated	E. coli	0	number/100	0
Cahermorris, Corrandulla.	10/09/2012	Treated	E. coli	0	number/100	0
Clontuskert	10/09/2012	Treated	E. coli	0	number/100	0
Belclare	10/09/2012	Treated	E. coli	0	number/100	0
Cloonatleva	10/09/2012	Treated	E. coli	0	number/100	0
Rusheens	10/09/2012	Treated	E. coli	0	number/100	0
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	E. coli	0	number/100	0
Lowville No.1	10/09/2012	Treated	E. coli	0	number/100	0
Belmont (Kilconly)	10/09/2012	Treated	E. coli	0	number/100	0
Menlough	10/09/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Bullaun, Tuam	10/09/2012	Treated	E. coli	0	number/100	0
Killasmuggaun	10/09/2012	Treated	E. coli	0	number/100	0
Brierfield No1, Ballinasloe	10/09/2012	Treated	E. coli	0	number/100	0
Feigh East & West	10/09/2012	Treated	E. coli	0	number/100	0
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	E. coli	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/09/2012	Treated	E. coli	0	number/100	0
Brierfield No1, Ballinasloe	11/09/2012	Treated	E. coli	0	number/100	0
Masonbrook, Loughrea	12/09/2012	Treated	E. coli	0	number/100	0
Newtowndaly	12/09/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey	12/09/2012	Treated	E. coli	0	number/100	0
Coole Park Restaurant - Well	12/09/2012	Treated	E. coli	0	number/100	0
Kilchreest	12/09/2012	Treated	E. coli	0	number/100	0
Bullaun, Loughrea	12/09/2012	Treated	E. coli	0	number/100	0
Kilcooley (Gurtymadden)	13/09/2012	Treated	E. coli	0	number/100	0
Newcastle (Aughrim)	13/09/2012	Treated	E. coli	0	number/100	0
Caherdine/Caherdevan	13/09/2012	Treated	E. coli	0	number/100	0
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	E. coli	0	number/100	0
Balroebuckbeg	17/09/2012	Treated	E. coli	0	number/100	0
Claren/knocklehard	17/09/2012	Treated	E. coli	0	number/100	0
Milltown Co-Op	17/09/2012	Treated	E. coli	0	number/100	0
Anbally & District GWS	17/09/2012	Treated	E. coli	0	number/100	0
Ballymanagh, Craughwell	17/09/2012	Treated	E. coli	0	number/100	0
Claresse Webb - Well	19/09/2012	Treated	E. coli	0	number/100	0
Red Oak Restaurant, Ballyshrule , Portumna - Well	19/09/2012	Treated	E. coli	0	number/100	0
Inismeain	24/09/2012	Treated	E. coli	0	number/100	0
Cloonigney	03/10/2012	Treated	E. coli	0	number/100	0
Cloonatleva	03/10/2012	Treated	E. coli	0	number/100	0
Corrandulla	04/10/2012	Treated	E. coli	0	number/100	0
Kilconly	04/10/2012	Treated	E. coli	0	number/100	0
Kilbannon	04/10/2012	Treated	E. coli	0	number/100	0
Corofin/Ballintubber	04/10/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Moanbaun	04/10/2012	Treated	E. coli	0	number/100	0
Seehan, Gort	08/10/2012	Treated	E. coli	0	number/100	0
Roo	08/10/2012	Treated	E. coli	0	number/100	0
The Village Nursing Home, Craughwell - Well	08/10/2012	Treated	E. coli	0	number/100	0
Currenrue, Kinvara.	08/10/2012	Treated	E. coli	0	number/100	0
Moy	08/10/2012	Treated	E. coli	0	number/100	0
Toureen/Tarrea	08/10/2012	Treated	E. coli	0	number/100	0
Mulrock	08/10/2012	Treated	E. coli	0	number/100	0
Moher	09/10/2012	Treated	E. coli	0	number/100	0
Clontuskert	09/10/2012	Treated	E. coli	0	number/100	0
Kiltomer No. 3	09/10/2012	Treated	E. coli	0	number/100	0
Perssepark (Ballinasloe)	09/10/2012	Treated	E. coli	0	number/100	0
Lowville No.2	09/10/2012	Treated	E. coli	0	number/100	0
Castlegar/Lissyegan	09/10/2012	Treated	E. coli	0	number/100	0
Cornamucklagh	09/10/2012	Treated	E. coli	0	number/100	0
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	E. coli	0	number/100	0
Connemara National Park, Tea Rooms	10/10/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey Restaurant	10/10/2012	Treated	E. coli	0	number/100	0
Kylemore Filling Station	10/10/2012	Treated	E. coli	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	E. coli	0	number/100	0
Kiniska, Claregalway.	11/10/2012	Treated	E. coli	0	number/100	0
Cloon	11/10/2012	Treated	E. coli	0	number/100	0
Killeen/Bruckey	11/10/2012	Treated	E. coli	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	E. coli	0	number/100	0
Lisheenkyle	11/10/2012	Treated	E. coli	0	number/100	0
Cregannamore/Moneymore GWS	11/10/2012	Treated	E. coli	0	number/100	0
Tarramuid No 2, Oranmore	11/10/2012	Treated	E. coli	0	number/100	0
Lavally No. 3 (Higgins)	11/10/2012	Treated	E. coli	0	number/100	0
Killeen / Poulatoon	15/10/2012	Treated	E. coli	0	number/100	0
Gortanumera	15/10/2012	Treated	E. coli	0	number/100	0
Kylemore Abbey	15/10/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	15/10/2012	Treated	E. coli	0	number/100	0
Moyglass, Loughrea.	15/10/2012	Treated	E. coli	0	number/100	0
Loughwell (Leamhcoill)	15/10/2012	Treated	E. coli	0	number/100	0
Cuillagh	16/10/2012	Treated	E. coli	0	number/100	0
New Inn GWS	16/10/2012	Treated	E. coli	0	number/100	0
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	E. coli	0	number/100	0
Rhynn/Killeeneen	16/10/2012	Treated	E. coli	0	number/100	0
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	E. coli	0	number/100	0
Menlough	18/10/2012	Treated	E. coli	0	number/100	0
Cloonkeen/Toomard	18/10/2012	Treated	E. coli	0	number/100	0
Glinsk/Creggs	18/10/2012	Treated	E. coli	0	number/100	0
Toberowen	18/10/2012	Treated	E. coli	0	number/100	0
Gallagh/Brownsgrove	18/10/2012	Treated	E. coli	0	number/100	0
St Colombas Nursing Home - Well	18/10/2012	Treated	E. coli	0	number/100	0
Kilcoona Caherlistrane GWS	18/10/2012	Treated	E. coli	0	number/100	0
Clough/Cummer	18/10/2012	Treated	E. coli	0	number/100	0
Carramore-Knock.	18/10/2012	Treated	E. coli	0	number/100	0
Caherfinisker	22/10/2012	Treated	E. coli	0	number/100	0
Killeely/Kilcolgan	22/10/2012	Treated	E. coli	0	number/100	0
Tyrone	22/10/2012	Treated	E. coli	0	number/100	0
Tonroe	22/10/2012	Treated	E. coli	0	number/100	0
Doughiska No. 2	22/10/2012	Treated	E. coli	0	number/100	0
Knockmascahill	23/10/2012	Treated	E. coli	0	number/100	0
Clooncun, Glenamaddy	23/10/2012	Treated	E. coli	0	number/100	0
Tully, Thornfield	23/10/2012	Treated	E. coli	0	number/100	0
Killasolan	23/10/2012	Treated	E. coli	0	number/100	0
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	E. coli	0	number/100	0
Carhereenlea, Athenry.	25/10/2012	Treated	E. coli	0	number/100	0
Carrigan, Craughwell.	25/10/2012	Treated	E. coli	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	E. coli	0	number/100	0
Glann, Oughterard	30/10/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cluide, Cahermorris.	31/10/2012	Treated	E. coli	0	number/100	0
Cahermorris, Corrandulla.	31/10/2012	Treated	E. coli	0	number/100	0
Corrandulla	31/10/2012	Treated	E. coli	0	number/100	0
Annaghdown	01/11/2012	Treated	E. coli	0	number/100	0
Ballyfruit, Headford	01/11/2012	Treated	E. coli	0	number/100	0
Coolarne	01/11/2012	Treated	E. coli	0	number/100	0
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	E. coli	0	number/100	0
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	E. coli	0	number/100	0
Ardrahan, GWS	05/11/2012	Treated	E. coli	0	number/100	0
Ballyglass/Fiddane	05/11/2012	Treated	E. coli	0	number/100	0
Lisheenavalla	05/11/2012	Treated	E. coli	0	number/100	0
BushyPark	05/11/2012	Treated	E. coli	0	number/100	0
Brackloon, Dunmore	06/11/2012	Treated	E. coli	0	number/100	0
Garrafrauns	06/11/2012	Treated	E. coli	0	number/100	0
Killasmuggaun	06/11/2012	Treated	E. coli	0	number/100	0
Knockauns	06/11/2012	Treated	E. coli	0	number/100	0
Newbridge Group Water Scheme	06/11/2012	Treated	E. coli	0	number/100	0
Abbert No 2	07/11/2012	Treated	E. coli	0	number/100	0
Abbert Public Group Water Scheme	07/11/2012	Treated	E. coli	0	number/100	0
Milltown Co-Op	07/11/2012	Treated	E. coli	0	number/100	0
Corohan Group Water Scheme	07/11/2012	Treated	E. coli	0	number/100	0
Lisananey/Liskeavy	07/11/2012	Treated	E. coli	0	number/100	0
Lettermullen No.2	12/11/2012	Treated	E. coli	0	number/100	0
Lettercallow (Leitir Caladh)	12/11/2012	Treated	E. coli	0	number/100	0
Criminagh/Lettermore	12/11/2012	Treated	E. coli	0	number/100	0
Claren/knocklehard	14/11/2012	Treated	E. coli	0	number/100	0
Carranurlaur	14/11/2012	Treated	E. coli	0	number/100	0
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	E. coli	0	number/100	0
Curry, Pollinmore GWS	14/11/2012	Treated	E. coli	0	number/100	0
Looscaun	15/11/2012	Treated	E. coli	0	number/100	0
Bullaun, Loughrea	15/11/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Ballintleva GWS Spiddal	15/11/2012	Treated	E. coli	0	number/100	0
Lowville No.1	19/11/2012	Treated	E. coli	0	number/100	0
Ballinakill, Moyard GWS	20/11/2012	Treated	E. coli	0	number/100	0
Cloonluane (Renvyle)	20/11/2012	Treated	E. coli	0	number/100	0
Lettergesh/Mullaghgloss	20/11/2012	Treated	E. coli	0	number/100	0
New Inn GWS	21/11/2012	Treated	E. coli	0	number/100	0
Newcastle (Aughrim)	21/11/2012	Treated	E. coli	0	number/100	0
Emlough	21/11/2012	Treated	E. coli	0	number/100	0
Cloon	21/11/2012	Treated	E. coli	0	number/100	0
Kiltevna	22/11/2012	Treated	E. coli	0	number/100	0
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	E. coli	0	number/100	0
Cluide, Cahermorris.	22/11/2012	Treated	E. coli	0	number/100	0
Coole GWS	26/11/2012	Treated	E. coli	0	number/100	0
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	E. coli	0	number/100	0
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	E. coli	0	number/100	0
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	E. coli	0	number/100	0
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	E. coli	0	number/100	0
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	E. coli	0	number/100	0
Kilbannon	03/12/2012	Treated	E. coli	0	number/100	0
Kilconly	03/12/2012	Treated	E. coli	0	number/100	0
Copper Beech, Turloughmore - Well	03/12/2012	Treated	E. coli	0	number/100	0
Kilcolgan Nursing Home - Well	06/12/2012	Treated	E. coli	0	number/100	0
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	E. coli	0	number/100	0
Clifden Glen Holiday Village - Well	06/12/2012	Treated	E. coli	0	number/100	0
Kilbannon	11/12/2012	Treated	E. coli	0	number/100	0
Caherfinisker	11/12/2012	Treated	E. coli	0	number/100	0
Caherdine/Caherdevan	11/12/2012	Treated	E. coli	0	number/100	0
Carhereenlea, Athenry.	11/12/2012	Treated	E. coli	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	E. coli	0	number/100	0
Beehive Restaurant, Portumna	12/12/2012	Treated	E. coli	0	number/100	0
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	E. coli	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	E. coli	0	number/100	0
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	E. coli	0	number/100	0
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	E. coli	0	number/100	0
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	E. coli	0	number/100	0
Tierneevin	23/01/2012	Treated	Enterococci	0	number/100	2
Beehive Restaurant, Portumna	15/06/2012	Treated	Enterococci	0	number/100	3
Kings Shop, Lettergesh	20/06/2012	Treated	Enterococci	0	number/100	6
Gordans Bar, Tynagh - Well	19/08/2012	Treated	Enterococci	0	number/100	35
Gordans Bar, Tynagh - Well	26/09/2012	Treated	Enterococci	0	number/100	150
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	15/10/2012	Treated	Enterococci	0	number/100	4
Seehan, Gort	21/11/2012	Treated	Enterococci	0	number/100	24
Tubber	21/11/2012	Treated	Enterococci	0	number/100	44
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Enterococci	0	number/100	6
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Enterococci	0	number/100	1
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Enterococci	0	number/100	0
Gallagh/Brownsgrove	16/01/2012	Treated	Enterococci	0	number/100	0
Kiltevna	16/01/2012	Treated	Enterococci	0	number/100	0
Toberowen	16/01/2012	Treated	Enterococci	0	number/100	0
Glinsk/Creggs	16/01/2012	Treated	Enterococci	0	number/100	0
Keelogue	16/01/2012	Treated	Enterococci	0	number/100	0
Cloonkeen/Toomard	16/01/2012	Treated	Enterococci	0	number/100	0
Newbridge Group Water Scheme	17/01/2012	Treated	Enterococci	0	number/100	0
Cloonigney	17/01/2012	Treated	Enterococci	0	number/100	0
Rhynn/Killeeneen	23/01/2012	Treated	Enterococci	0	number/100	0
Coole GWS	23/01/2012	Treated	Enterococci	0	number/100	0
Roo	23/01/2012	Treated	Enterococci	0	number/100	0
Ardrahan, GWS	23/01/2012	Treated	Enterococci	0	number/100	0
Lisananey/Liskeavy	12/03/2012	Treated	Enterococci	0	number/100	0
Milltown Co-Op	12/03/2012	Treated	Enterococci	0	number/100	0
Corohan Group Water Scheme	12/03/2012	Treated	Enterococci	0	number/100	0
Belmont (Kilconly)	12/03/2012	Treated	Enterococci	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Enterococci	0	number/100	0
Looscaun	13/03/2012	Treated	Enterococci	0	number/100	0
Killeen / Poulatoon	13/03/2012	Treated	Enterococci	0	number/100	0
Kylemore Abbey	13/03/2012	Treated	Enterococci	0	number/100	0
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Enterococci	0	number/100	0
Kilchreest	13/03/2012	Treated	Enterococci	0	number/100	0
Moyglass, Loughrea.	13/03/2012	Treated	Enterococci	0	number/100	0
Bullaun, Loughrea	13/03/2012	Treated	Enterococci	0	number/100	0
Anbally & District GWS	14/03/2012	Treated	Enterococci	0	number/100	0
Clough/Cummer	14/03/2012	Treated	Enterococci	0	number/100	0
Curry, Pollinmore GWS	14/03/2012	Treated	Enterococci	0	number/100	0
Rusheens	14/03/2012	Treated	Enterococci	0	number/100	0
Caherlea / Gurrane	14/03/2012	Treated	Enterococci	0	number/100	0
Kilconly	14/03/2012	Treated	Enterococci	0	number/100	0
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Enterococci	0	number/100	0
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	Enterococci	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	Enterococci	0	number/100	0
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Enterococci	0	number/100	0
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Enterococci	0	number/100	0
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Enterococci	0	number/100	0
Tynagh GWS	14/05/2012	Treated	Enterococci	0	number/100	0
Kilcooley (Gurtymadden)	14/05/2012	Treated	Enterococci	0	number/100	0
Ballymanagh, Craughwell	14/05/2012	Treated	Enterococci	0	number/100	0
Carrigan, Craughwell.	14/05/2012	Treated	Enterococci	0	number/100	0
Ballyglass/Fiddane	14/05/2012	Treated	Enterococci	0	number/100	0
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Enterococci	0	number/100	0
Lisheenavalla	14/05/2012	Treated	Enterococci	0	number/100	0
Actons Campsite & Caravan Pk, Grallagh, Claddagduff	15/05/2012	Treated	Enterococci	0	number/100	0
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Enterococci	0	number/100	0
Shanaheever Caravan Park - Lake	15/05/2012	Treated	Enterococci	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Enterococci	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Enterococci	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Enterococci	0	number/100	0
Shanaheever Caravan Park - Lake	23/05/2012	Treated	Enterococci	0	number/100	0
Mother's Bar, Kiltormer - Well	28/05/2012	Treated	Enterococci	0	number/100	0
Carramore-Knock.	11/06/2012	Treated	Enterococci	0	number/100	0
Ballinakill, Moyard GWS	11/06/2012	Treated	Enterococci	0	number/100	0
Dessie O'Brians Bar - Well	14/06/2012	Treated	Enterococci	0	number/100	0
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Enterococci	0	number/100	0
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Enterococci	0	number/100	0
Sliabh Aughty Riding Centre - Well	21/06/2012	Treated	Enterococci	0	number/100	0
St Annes CNU, Clifden - Lake	29/06/2012	Treated	Enterococci	0	number/100	0
Annaghdown	09/07/2012	Treated	Enterococci	0	number/100	0
Balroebuckbeg	09/07/2012	Treated	Enterococci	0	number/100	0
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Enterococci	0	number/100	0
Belclare	09/07/2012	Treated	Enterococci	0	number/100	0
Claren/knocklehard	09/07/2012	Treated	Enterococci	0	number/100	0
Emlough	10/07/2012	Treated	Enterococci	0	number/100	0
K2, Leenane	11/07/2012	Treated	Enterococci	0	number/100	0
Gortnaglassa	16/07/2012	Treated	Enterococci	0	number/100	0
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Enterococci	0	number/100	0
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Enterococci	0	number/100	0
Inismeain	30/07/2012	Treated	Enterococci	0	number/100	0
Lettergesh/Mullaghgloss	31/07/2012	Treated	Enterococci	0	number/100	0
Cloonluane (Renvyle)	31/07/2012	Treated	Enterococci	0	number/100	0
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Enterococci	0	number/100	0
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Enterococci	0	number/100	0
Knockauns	09/08/2012	Treated	Enterococci	0	number/100	0
Gurteen/Cloonmore	09/08/2012	Treated	Enterococci	0	number/100	0
Corofin/Ballintubber	09/08/2012	Treated	Enterococci	0	number/100	0
Bullaun, Tuam	09/08/2012	Treated	Enterococci	0	number/100	0
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Enterococci	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Enterococci	0	number/100	0
Pallas Karting - Well	19/08/2012	Treated	Enterococci	0	number/100	0
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Enterococci	0	number/100	0
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	Enterococci	0	number/100	0
Gort Mart Canteen - Well	27/08/2012	Treated	Enterococci	0	number/100	0
Lady Gregory Hotel - private supply	27/08/2012	Treated	Enterococci	0	number/100	0
Gort Golf Club - Well	27/08/2012	Treated	Enterococci	0	number/100	0
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Enterococci	0	number/100	0
Esker/ Eyrecourt	10/09/2012	Treated	Enterococci	0	number/100	0
Clontuskert	10/09/2012	Treated	Enterococci	0	number/100	0
Cloonatleva	10/09/2012	Treated	Enterococci	0	number/100	0
Lowville No.1	10/09/2012	Treated	Enterococci	0	number/100	0
Menlough	10/09/2012	Treated	Enterococci	0	number/100	0
Killasmuggaun	10/09/2012	Treated	Enterococci	0	number/100	0
Brierfield No1, Ballinasloe	10/09/2012	Treated	Enterococci	0	number/100	0
Feigh East & West	10/09/2012	Treated	Enterococci	0	number/100	0
Fahy's Shop, Turloughmore - Well	11/09/2012	Treated	Enterococci	0	number/100	0
Coole Park Restaurant - Well	12/09/2012	Treated	Enterococci	0	number/100	0
Claresse Webb - Well	19/09/2012	Treated	Enterococci	0	number/100	0
Red Oak Restaurant, Ballyshrule , Portumna - Well	19/09/2012	Treated	Enterococci	0	number/100	0
The Village Nursing Home, Craughwell - Well	08/10/2012	Treated	Enterococci	0	number/100	0
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Enterococci	0	number/100	0
Connemara National Park, Tea Rooms	10/10/2012	Treated	Enterococci	0	number/100	0
Kylemore Abbey Restaurant	10/10/2012	Treated	Enterococci	0	number/100	0
Kylemore Filling Station	10/10/2012	Treated	Enterococci	0	number/100	0
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Enterococci	0	number/100	0
St Colombas Nursing Home - Well	18/10/2012	Treated	Enterococci	0	number/100	0
Cluide, Cahermorris.	31/10/2012	Treated	Enterococci	0	number/100	0
Cahermorris, Corrandulla.	31/10/2012	Treated	Enterococci	0	number/100	0
Corrandulla	31/10/2012	Treated	Enterococci	0	number/100	0
New Inn GWS	21/11/2012	Treated	Enterococci	0	number/100	0

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Newcastle (Aughrim)	21/11/2012	Treated	Enterococci	0	number/100	0
Cloon	21/11/2012	Treated	Enterococci	0	number/100	0
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Enterococci	0	number/100	0
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Enterococci	0	number/100	0
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Enterococci	0	number/100	0
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Enterococci	0	number/100	0
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Enterococci	0	number/100	0
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Enterococci	0	number/100	0
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Enterococci	0	number/100	0
Kilcolgan Nursing Home - Well	06/12/2012	Treated	Enterococci	0	number/100	0
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Enterococci	0	number/100	0
Kilbannon	11/12/2012	Treated	Enterococci	0	number/100	0
Caherfinisker	11/12/2012	Treated	Enterococci	0	number/100	0
Caherdine/Caherdevan	11/12/2012	Treated	Enterococci	0	number/100	0
Carhereenlea, Athenry.	11/12/2012	Treated	Enterococci	0	number/100	0
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Enterococci	0	number/100	0
Beehive Restaurant, Portumna	12/12/2012	Treated	Enterococci	0	number/100	0
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Enterococci	0	number/100	0
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Enterococci	0	number/100	0
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Enterococci	0	number/100	0
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Enterococci	0	number/100	0
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Enterococci	0	number/100	0
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Enterococci	0	number/100	0
Kilconierin	24/07/2017	Raw	Fluoride	0.8 (fluoridated)	mg/l	0.18
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.1
Gallagh/Brownsgrove	16/01/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.11
Keelogue	16/01/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.1
Newbridge Group Water Scheme	17/01/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.56
Coole GWS	23/01/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.13
Lisananey/Liskeavy	12/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.27
Belmont (Kilconly)	12/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.17

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.61
Anbally & District GWS	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.18
Clough/Cummer	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.16
Curry, Pollinmore GWS	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.63
Rusheens	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.23
Caherlea / Gurrane	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.16
Kilconly	14/03/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.63
Kilcooley (Gurtymadden)	14/05/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.18
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.12
Lisheenavalla	14/05/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.7
Annaghdown	09/07/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.61
Balroebuckbeg	09/07/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.13
Belclare	09/07/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.31
Knockauns	09/08/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.11
Gurteen/Cloonmore	09/08/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.18
Corofin/Ballintubber	09/08/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.7
Bullaun, Tuam	09/08/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.72
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.69
Esker/ Eyrecourt	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.23
Clontuskert	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.57
Cloonatleva	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.11
Lowville No.1	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.14
Menlough	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.29
Killasmuggaun	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.13
Brierfield No1, Ballinasloe	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.15
Feigh East & West	10/09/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.33
Cluide, Cahermorris.	31/10/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.1
Cahermorris, Corrandulla.	31/10/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.12
Corrandulla	31/10/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.59
New Inn GWS	21/11/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.12
Newcastle (Aughrim)	21/11/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloon	21/11/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.59
Kilbannon	11/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.56
Caherfinisker	11/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.51
Caherdine/Caherdevan	11/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.17
Carhereenlea, Athenry.	11/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.46
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.14
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.44
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Fluoride	0.8 (fluoridated)	mg/l	0.38
Kilconierin	24/07/2017	Raw	Hardness	200	mg/l	360.9
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Hardness (as CaCO3)	200	mg/l	282
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Hardness (as CaCO3)	200	mg/l	300
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Hardness (as CaCO3)	200	mg/l	355
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Hardness (as CaCO3)	200	mg/l	391
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Hardness (as CaCO3)	200	mg/l	208
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Hardness (as CaCO3)	200	mg/l	207
Gordans Bar, Tynagh - Well	18/08/2012	Treated	Hardness (as CaCO3)	200	mg/l	391
Pallas Karting - Well	19/08/2012	Treated	Hardness (as CaCO3)	200	mg/l	258
Lady Gregory Hotel - private supply	27/08/2012	Treated	Hardness (as CaCO3)	200	mg/l	429
McGrath's B&B	28/08/2012	Treated	Hardness (as CaCO3)	200	mg/l	420
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Hardness (as CaCO3)	200	mg/l	365
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Hardness (as CaCO3)	200	mg/l	381
Hazel House B & B, Rusheens	21/11/2012	Treated	Hardness (as CaCO3)	200	mg/l	381
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Hardness (as CaCO3)	200	mg/l	395
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Hardness (as CaCO3)	200	mg/l	409
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	395
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	465
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	231
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	370
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	223
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Hardness (as CaCO3)	200	mg/l	35
Kings Shop, Lettergesh	20/06/2012	Treated	Hardness (as CaCO3)	200	mg/l	24

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Hardness (as CaCO3)	200	mg/l	20
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Hardness (as CaCO3)	200	mg/l	87
Gort Golf Club - Well	27/08/2012	Treated	Hardness (as CaCO3)	200	mg/l	33
Kylemore Abbey Restaurant	10/10/2012	Treated	Hardness (as CaCO3)	200	mg/l	117
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Hardness (as CaCO3)	200	mg/l	16
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Hardness (as CaCO3)	200	mg/l	36
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	19
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Hardness (as CaCO3)	200	mg/l	150
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Iron	200	µg/l	319
Cloon	23/01/2012	Treated	Iron	200	µg/l	139
Cuillagh	26/01/2012	Treated	Iron	200	µg/l	15
Tubber	02/02/2012	Treated	Iron	200	µg/l	36
Gurteen/Cloonmore	09/02/2012	Treated	Iron	200	µg/l	28
Brackloon, Dunmore	09/02/2012	Treated	Iron	200	µg/l	20
Carranurlaur	09/02/2012	Treated	Iron	200	µg/l	81
Rusheens	10/02/2012	Treated	Iron	200	µg/l	13
Anbally & District GWS	10/02/2012	Treated	Iron	200	µg/l	35
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Iron	200	µg/l	39
Abbert No 2	14/02/2012	Treated	Iron	200	µg/l	22
Abbert Public Group Water Scheme	14/02/2012	Treated	Iron	200	µg/l	17
Ballintleva GWS Spiddal	14/02/2012	Treated	Iron	200	µg/l	17
Gortnaglassa	16/02/2012	Treated	Iron	200	µg/l	23
Inismeain	23/02/2012	Treated	Iron	200	µg/l	31
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Iron	200	µg/l	11
Ballyglass/Fiddane	01/03/2012	Treated	Iron	200	µg/l	10
Toberowen	02/03/2012	Treated	Iron	200	µg/l	13
Glinsk/Creggs	02/03/2012	Treated	Iron	200	µg/l	44
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Iron	200	µg/l	11
Menlough	07/03/2012	Treated	Iron	200	µg/l	11
Brierfield No1, Ballinasloe	07/03/2012	Treated	Iron	200	µg/l	30
Killough GWS	08/03/2012	Treated	Iron	200	µg/l	152

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Glann, Oughterard	08/03/2012	Treated	Iron	200	µg/l	15
Glengowla (Gibbons)	08/03/2012	Treated	Iron	200	µg/l	19
Kilcooley (Gurtymadden)	12/03/2012	Treated	Iron	200	µg/l	13
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Iron	200	µg/l	234
Belmont (Kilconly)	13/03/2012	Treated	Iron	200	µg/l	11
Milltown Co-Op	13/03/2012	Treated	Iron	200	µg/l	56
Gallagh/Brownsgrove	13/03/2012	Treated	Iron	200	µg/l	50
Anbally & District GWS	14/03/2012	Treated	Iron	200	µg/l	41.9
Claren/knocklehard	20/03/2012	Treated	Iron	200	µg/l	37
Cahermorris, Corrandulla.	20/03/2012	Treated	Iron	200	µg/l	18
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	Iron	200	µg/l	11
Moy	02/04/2012	Treated	Iron	200	µg/l	128
Currenrue, Kinvara.	02/04/2012	Treated	Iron	200	µg/l	102
Toureen/Tarrea	02/04/2012	Treated	Iron	200	µg/l	96
Mulrock	02/04/2012	Treated	Iron	200	µg/l	84
Carraghbrown	03/04/2012	Treated	Iron	200	µg/l	31
Derrydonnell	03/04/2012	Treated	Iron	200	µg/l	27
Doughiska No. 1.	03/04/2012	Treated	Iron	200	µg/l	34
Loughwell (Leamhcoill)	03/04/2012	Treated	Iron	200	µg/l	13
Corofin/Ballintubber	04/04/2012	Treated	Iron	200	µg/l	62
Corrandulla	04/04/2012	Treated	Iron	200	µg/l	11
Carraghy (Claregalway)	04/04/2012	Treated	Iron	200	µg/l	29
Kiniska, Claregalway.	04/04/2012	Treated	Iron	200	µg/l	14
Claregalway No 2	04/04/2012	Treated	Iron	200	µg/l	48
Cloon	04/04/2012	Treated	Iron	200	µg/l	141
Cloonacauneen	04/04/2012	Treated	Iron	200	µg/l	14
Carhereenlea, Athenry.	05/04/2012	Treated	Iron	200	µg/l	49
Kiltevna	05/04/2012	Treated	Iron	200	µg/l	24
Knockauns	05/04/2012	Treated	Iron	200	µg/l	27
Killasmuggaun	05/04/2012	Treated	Iron	200	µg/l	29
Cloonkeen/Toomard	05/04/2012	Treated	Iron	200	µg/l	43

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Tully, Thornfield	10/04/2012	Treated	Iron	200	µg/l	55
Clooncun, Glenamaddy	10/04/2012	Treated	Iron	200	µg/l	33
Knockmascahill	10/04/2012	Treated	Iron	200	µg/l	44
Lettergesh/Mullaghgloss	11/04/2012	Treated	Iron	200	µg/l	23
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Iron	200	µg/l	45
Masonbrook, Loughrea	12/04/2012	Treated	Iron	200	µg/l	13
Lowville No.2	12/04/2012	Treated	Iron	200	µg/l	20
Castlegar/Lissyegan	12/04/2012	Treated	Iron	200	µg/l	18
Cornamucklagh	12/04/2012	Treated	Iron	200	µg/l	18
Emlough	16/04/2012	Treated	Iron	200	µg/l	15
Claregalway No.1.	16/04/2012	Treated	Iron	200	µg/l	24
Killeen/Bruckey	16/04/2012	Treated	Iron	200	µg/l	33
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	Iron	200	µg/l	21
Cashla No. 1	16/04/2012	Treated	Iron	200	µg/l	39
Castlelambert, Knocknacreva.	16/04/2012	Treated	Iron	200	µg/l	58
Moanbaun	16/04/2012	Treated	Iron	200	µg/l	23
Caherfinisker	16/04/2012	Treated	Iron	200	µg/l	24
Lowville No.1	19/04/2012	Treated	Iron	200	µg/l	52
Cloonigney	19/04/2012	Treated	Iron	200	µg/l	52
Carramore-Knock.	19/04/2012	Treated	Iron	200	µg/l	27
Lisheenkyle	23/04/2012	Treated	Iron	200	µg/l	35
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	Iron	200	µg/l	35
Cregannamore/Moneymore GWS	23/04/2012	Treated	Iron	200	µg/l	35
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Iron	200	µg/l	22
Lavally No. 3 (Higgins)	23/04/2012	Treated	Iron	200	µg/l	34
Tarramuid No 2, Oranmore	23/04/2012	Treated	Iron	200	µg/l	34
Killeely/Kilcolgan	23/04/2012	Treated	Iron	200	µg/l	36
Tyrone	23/04/2012	Treated	Iron	200	µg/l	34
Tonroe	23/04/2012	Treated	Iron	200	µg/l	38
Clontuskert	25/04/2012	Treated	Iron	200	µg/l	89
Moher	25/04/2012	Treated	Iron	200	µg/l	94

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kiltomer No. 3	25/04/2012	Treated	Iron	200	µg/l	105
Perssepark (Ballinasloe)	25/04/2012	Treated	Iron	200	µg/l	91
Cloonatleva	25/04/2012	Treated	Iron	200	µg/l	125
Gortanumera	26/04/2012	Treated	Iron	200	µg/l	115
Looscaun	26/04/2012	Treated	Iron	200	µg/l	87
Kylemore Abbey	26/04/2012	Treated	Iron	200	µg/l	78
Kilchreest	26/04/2012	Treated	Iron	200	µg/l	121
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	Iron	200	µg/l	104
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Iron	200	µg/l	166
Cloonluane (Renvyle)	30/04/2012	Treated	Iron	200	µg/l	81
Coole GWS	01/05/2012	Treated	Iron	200	µg/l	12
Carrigan, Craughwell.	01/05/2012	Treated	Iron	200	µg/l	45
Lisheenavalla	01/05/2012	Treated	Iron	200	µg/l	10
Dunloughan, Ballyconneely.	03/05/2012	Treated	Iron	200	µg/l	40
Aillebrack GWS	03/05/2012	Treated	Iron	200	µg/l	39
Murvey/Dolan	03/05/2012	Treated	Iron	200	µg/l	45
Lettermullen No.2	10/05/2012	Treated	Iron	200	µg/l	10
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Iron	200	µg/l	10
Criminagh/Lettermore	10/05/2012	Treated	Iron	200	µg/l	13
Clough/Cummer	14/05/2012	Treated	Iron	200	µg/l	16
Caherlea / Gurrane	14/05/2012	Treated	Iron	200	µg/l	25
Carrigan, Craughwell.	14/05/2012	Treated	Iron	200	µg/l	183.5
Menlough	31/05/2012	Treated	Iron	200	µg/l	55
Glinsk/Creggs	31/05/2012	Treated	Iron	200	µg/l	15
Gallagh/Brownsgrove	31/05/2012	Treated	Iron	200	µg/l	91
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Iron	200	µg/l	12
Ballyglass/Fiddane	05/06/2012	Treated	Iron	200	µg/l	20
Rhynn/Killeeneen	05/06/2012	Treated	Iron	200	µg/l	32
Claren/knocklehard	07/06/2012	Treated	Iron	200	µg/l	65
Newbridge Group Water Scheme	07/06/2012	Treated	Iron	200	µg/l	11
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Iron	200	µg/l	32

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilbannon	03/07/2012	Treated	Iron	200	µg/l	13
Menlough	04/07/2012	Treated	Iron	200	µg/l	26
Glinsk/Creggs	04/07/2012	Treated	Iron	200	µg/l	11
Gallagh/Brownsgrove	04/07/2012	Treated	Iron	200	µg/l	41
Claren/knocklehard	09/07/2012	Treated	Iron	200	µg/l	106.5
K2, Leenane	11/07/2012	Treated	Iron	200	µg/l	355
Sleepzone Connemara, Leenane	11/07/2012	Treated	Iron	200	µg/l	203
Caherfinisker	16/07/2012	Treated	Iron	200	µg/l	11
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Iron	200	µg/l	20
Joyce's Food Store, Recess	18/07/2012	Treated	Iron	200	µg/l	77
Peacocks Hotel	18/07/2012	Treated	Iron	200	µg/l	192
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Iron	200	µg/l	68
Lettergesh/Mullaghgloss	31/07/2012	Treated	Iron	200	µg/l	29.9
Cloonluane (Renvyle)	31/07/2012	Treated	Iron	200	µg/l	55.5
Gurteen/Cloonmore	09/08/2012	Treated	Iron	200	µg/l	42
Gurteen/Cloonmore	09/08/2012	Treated	Iron	200	µg/l	30.7
Pallas Karting - Well	19/08/2012	Treated	Iron	200	µg/l	29
Connemara Lady - Stream water	21/08/2012	Treated	Iron	200	µg/l	430
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Iron	200	µg/l	23
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Iron	200	µg/l	200
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Iron	200	µg/l	160
Dunloughan, Ballyconneely.	22/08/2012	Treated	Iron	200	µg/l	31
Aillebrack GWS	22/08/2012	Treated	Iron	200	µg/l	24
Murvey/Dolan	22/08/2012	Treated	Iron	200	µg/l	38
Rhynn/Killeeneen	30/08/2012	Treated	Iron	200	µg/l	11
Carraghy (Claregalway)	03/09/2012	Treated	Iron	200	µg/l	27
Cashla No. 1	03/09/2012	Treated	Iron	200	µg/l	11
Tubber	04/09/2012	Treated	Iron	200	µg/l	26
Ballyglass/Fiddane	04/09/2012	Treated	Iron	200	µg/l	13
Doughiska No. 1.	04/09/2012	Treated	Iron	200	µg/l	10
Carraghbrown	04/09/2012	Treated	Iron	200	µg/l	12

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killough GWS	05/09/2012	Treated	Iron	200	µg/l	19
Glengowla (Gibbons)	05/09/2012	Treated	Iron	200	µg/l	15
Annaghdown	10/09/2012	Treated	Iron	200	µg/l	19
Cahermorris, Corrandulla.	10/09/2012	Treated	Iron	200	µg/l	19
Belclare	10/09/2012	Treated	Iron	200	µg/l	12
Rusheens	10/09/2012	Treated	Iron	200	µg/l	13
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Iron	200	µg/l	12
Belmont (Kilconly)	10/09/2012	Treated	Iron	200	µg/l	52
Menlough	10/09/2012	Treated	Iron	200	µg/l	95.4
Bullaun, Tuam	10/09/2012	Treated	Iron	200	µg/l	17
Killasmuggaun	10/09/2012	Treated	Iron	200	µg/l	58.3
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	Iron	200	µg/l	26
Brierfield No1, Ballinasloe	11/09/2012	Treated	Iron	200	µg/l	18
Masonbrook, Loughrea	12/09/2012	Treated	Iron	200	µg/l	13
Newtowndaly	12/09/2012	Treated	Iron	200	µg/l	18
Kilchreest	12/09/2012	Treated	Iron	200	µg/l	17
Bullaun, Loughrea	12/09/2012	Treated	Iron	200	µg/l	11
Kilcooley (Gurtymadden)	13/09/2012	Treated	Iron	200	µg/l	83
Newcastle (Aughrim)	13/09/2012	Treated	Iron	200	µg/l	24
Caherdine/Caherdevan	13/09/2012	Treated	Iron	200	µg/l	16
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Iron	200	µg/l	30
Balroebuckbeg	17/09/2012	Treated	Iron	200	µg/l	17
Claren/knocklehard	17/09/2012	Treated	Iron	200	µg/l	30
Milltown Co-Op	17/09/2012	Treated	Iron	200	µg/l	28
Anbally & District GWS	17/09/2012	Treated	Iron	200	µg/l	58
Ballymanagh, Craughwell	17/09/2012	Treated	Iron	200	µg/l	17
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Iron	200	µg/l	256
Inismeain	24/09/2012	Treated	Iron	200	µg/l	24
Cloonigney	03/10/2012	Treated	Iron	200	µg/l	21
Cloonatleva	03/10/2012	Treated	Iron	200	µg/l	22
Moanbaun	04/10/2012	Treated	Iron	200	µg/l	941

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Corrandulla	04/10/2012	Treated	Iron	200	µg/l	15
Kilconly	04/10/2012	Treated	Iron	200	µg/l	12
Kilbannon	04/10/2012	Treated	Iron	200	µg/l	20
Corofin/Ballintubber	04/10/2012	Treated	Iron	200	µg/l	13
Seehan, Gort	08/10/2012	Treated	Iron	200	µg/l	22
Roo	08/10/2012	Treated	Iron	200	µg/l	14
Currenrue, Kinvara.	08/10/2012	Treated	Iron	200	µg/l	16
Moy	08/10/2012	Treated	Iron	200	µg/l	15
Toureen/Tarrea	08/10/2012	Treated	Iron	200	µg/l	18
Mulrock	08/10/2012	Treated	Iron	200	µg/l	19
Moher	09/10/2012	Treated	Iron	200	µg/l	17
Clontuskert	09/10/2012	Treated	Iron	200	µg/l	28
Kiltomer No. 3	09/10/2012	Treated	Iron	200	µg/l	18
Perssepark (Ballinasloe)	09/10/2012	Treated	Iron	200	µg/l	26
Lowville No.2	09/10/2012	Treated	Iron	200	µg/l	30
Castlegar/Lissyegan	09/10/2012	Treated	Iron	200	µg/l	42
Cornamucklagh	09/10/2012	Treated	Iron	200	µg/l	46
Kylemore Abbey Restaurant	10/10/2012	Treated	Iron	200	µg/l	20
Kylemore Filling Station	10/10/2012	Treated	Iron	200	µg/l	79
Cloon	11/10/2012	Treated	Iron	200	µg/l	201
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Iron	200	µg/l	19
Kiniska, Claregalway.	11/10/2012	Treated	Iron	200	µg/l	19
Killeen/Bruckey	11/10/2012	Treated	Iron	200	µg/l	14
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Iron	200	µg/l	37
Lisheenkyle	11/10/2012	Treated	Iron	200	µg/l	19
Cregannamore/Moneymore GWS	11/10/2012	Treated	Iron	200	µg/l	19
Tarramuid No 2, Oranmore	11/10/2012	Treated	Iron	200	µg/l	19
Lavally No. 3 (Higgins)	11/10/2012	Treated	Iron	200	µg/l	18
Killeen / Poulatoon	15/10/2012	Treated	Iron	200	µg/l	24
Gortanumera	15/10/2012	Treated	Iron	200	µg/l	35
Kylemore Abbey	15/10/2012	Treated	Iron	200	µg/l	15

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Moyglass, Loughrea.	15/10/2012	Treated	Iron	200	µg/l	16
Loughwell (Leamhcoill)	15/10/2012	Treated	Iron	200	µg/l	19
Cuillagh	16/10/2012	Treated	Iron	200	µg/l	67
New Inn GWS	16/10/2012	Treated	Iron	200	µg/l	37
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Iron	200	µg/l	18
Rhynn/Killeeneen	16/10/2012	Treated	Iron	200	µg/l	33
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Iron	200	µg/l	26
Menlough	18/10/2012	Treated	Iron	200	µg/l	57
Cloonkeen/Toomard	18/10/2012	Treated	Iron	200	µg/l	16
Glinsk/Creggs	18/10/2012	Treated	Iron	200	µg/l	41
Toberowen	18/10/2012	Treated	Iron	200	µg/l	20
Gallagh/Brownsgrove	18/10/2012	Treated	Iron	200	µg/l	35
Kilcoona Caherlistrane GWS	18/10/2012	Treated	Iron	200	µg/l	21
Clough/Cummer	18/10/2012	Treated	Iron	200	µg/l	130
Caherlea / Gurrane	18/10/2012	Treated	Iron	200	µg/l	25
Carramore-Knock.	18/10/2012	Treated	Iron	200	µg/l	27
Caherfinisker	22/10/2012	Treated	Iron	200	µg/l	30
Killeely/Kilcolgan	22/10/2012	Treated	Iron	200	µg/l	18
Tyrone	22/10/2012	Treated	Iron	200	µg/l	19
Tonroe	22/10/2012	Treated	Iron	200	µg/l	22
Doughiska No. 2	22/10/2012	Treated	Iron	200	µg/l	23
Knockmascahill	23/10/2012	Treated	Iron	200	µg/l	43
Clooncun, Glenamaddy	23/10/2012	Treated	Iron	200	µg/l	37
Tully, Thornfield	23/10/2012	Treated	Iron	200	µg/l	42
Killasolan	23/10/2012	Treated	Iron	200	µg/l	51
Carhereenlea, Athenry.	25/10/2012	Treated	Iron	200	µg/l	24
Carrigan, Craughwell.	25/10/2012	Treated	Iron	200	µg/l	45
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	Iron	200	µg/l	38
Glann, Oughterard	30/10/2012	Treated	Iron	200	µg/l	26
Annaghdown	01/11/2012	Treated	Iron	200	µg/l	21
Ballyfruit, Headford	01/11/2012	Treated	Iron	200	µg/l	28

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Coolarne	01/11/2012	Treated	Iron	200	µg/l	23
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	Iron	200	µg/l	23
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Iron	200	µg/l	24
Ardrahan, GWS	05/11/2012	Treated	Iron	200	µg/l	22
Ballyglass/Fiddane	05/11/2012	Treated	Iron	200	µg/l	49
Lisheenavalla	05/11/2012	Treated	Iron	200	µg/l	21
BushyPark	05/11/2012	Treated	Iron	200	µg/l	18
Brackloon, Dunmore	06/11/2012	Treated	Iron	200	µg/l	51
Killasmuggaun	06/11/2012	Treated	Iron	200	µg/l	30
Knockauns	06/11/2012	Treated	Iron	200	µg/l	29
Newbridge Group Water Scheme	06/11/2012	Treated	Iron	200	µg/l	44
Abbert No 2	07/11/2012	Treated	Iron	200	µg/l	80
Abbert Public Group Water Scheme	07/11/2012	Treated	Iron	200	µg/l	59
Milltown Co-Op	07/11/2012	Treated	Iron	200	µg/l	41
Corohan Group Water Scheme	07/11/2012	Treated	Iron	200	µg/l	39
Lisananey/Liskeavy	07/11/2012	Treated	Iron	200	µg/l	40
Lettermullen No.2	12/11/2012	Treated	Iron	200	µg/l	12
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Iron	200	µg/l	11
Criminagh/Lettermore	12/11/2012	Treated	Iron	200	µg/l	22
Claren/knocklehard	14/11/2012	Treated	Iron	200	µg/l	44
Carranurlaur	14/11/2012	Treated	Iron	200	µg/l	73
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Iron	200	µg/l	20
Curry, Pollinmore GWS	14/11/2012	Treated	Iron	200	µg/l	22
Looscaun	15/11/2012	Treated	Iron	200	µg/l	27
Bullaun, Loughrea	15/11/2012	Treated	Iron	200	µg/l	34
Ballintleva GWS Spiddal	15/11/2012	Treated	Iron	200	µg/l	41
Lowville No.1	19/11/2012	Treated	Iron	200	µg/l	93
Cloonluane (Renvyle)	20/11/2012	Treated	Iron	200	µg/l	148
Lettergesh/Mullaghgloss	20/11/2012	Treated	Iron	200	µg/l	84
Hazel House B & B, Rusheens	21/11/2012	Treated	Iron	200	µg/l	876
Emlough	21/11/2012	Treated	Iron	200	µg/l	15

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Iron	200	µg/l	293
Cluide, Cahermorris.	22/11/2012	Treated	Iron	200	µg/l	12
Coole GWS	26/11/2012	Treated	Iron	200	µg/l	12
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Iron	200	µg/l	21
Kilbannon	03/12/2012	Treated	Iron	200	µg/l	21
Kilconly	03/12/2012	Treated	Iron	200	µg/l	10
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Iron	200	µg/l	83
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Iron	200	µg/l	29
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Iron	200	µg/l	432
Kilbannon	11/12/2012	Treated	Iron	200	µg/l	61.1
Caherfinisker	11/12/2012	Treated	Iron	200	µg/l	61.5
Caherdine/Caherdevan	11/12/2012	Treated	Iron	200	µg/l	63.2
Carhereenlea, Athenry.	11/12/2012	Treated	Iron	200	µg/l	61.8
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Iron	200	µg/l	59.6
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Iron	200	µg/l	34
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Iron	200	µg/l	21
Kilconierin	24/07/2017	Raw	Iron	200	µg/l	0
Kilconierin	24/07/2017	Raw	Lead	10	µg/l	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Lead	10	µg/l	2.3
Gallagh/Brownsgrove	16/01/2012	Treated	Lead	10	µg/l	0.6
Kiltevna	16/01/2012	Treated	Lead	10	µg/l	2.4
Toberowen	16/01/2012	Treated	Lead	10	µg/l	0.5
Keelogue	16/01/2012	Treated	Lead	10	µg/l	0.3
Newbridge Group Water Scheme	17/01/2012	Treated	Lead	10	µg/l	0.7
Cloonigney	17/01/2012	Treated	Lead	10	µg/l	0.3
Rhynn/Killeeneen	23/01/2012	Treated	Lead	10	µg/l	0.6
Lisananey/Liskeavy	12/03/2012	Treated	Lead	10	µg/l	0.3
Milltown Co-Op	12/03/2012	Treated	Lead	10	µg/l	0.6
Corohan Group Water Scheme	12/03/2012	Treated	Lead	10	µg/l	1
Belmont (Kilconly)	12/03/2012	Treated	Lead	10	µg/l	0.5
Looscaun	13/03/2012	Treated	Lead	10	µg/l	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killeen / Poulatoon	13/03/2012	Treated	Lead	10	µg/l	0.5
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Lead	10	µg/l	0.4
Kilchreest	13/03/2012	Treated	Lead	10	µg/l	2
Bullaun, Loughrea	13/03/2012	Treated	Lead	10	µg/l	0.5
Anbally & District GWS	14/03/2012	Treated	Lead	10	µg/l	0.9
Clough/Cummer	14/03/2012	Treated	Lead	10	µg/l	1
Curry, Pollinmore GWS	14/03/2012	Treated	Lead	10	µg/l	0.4
Rusheens	14/03/2012	Treated	Lead	10	µg/l	2.3
Caherlea / Gurrane	14/03/2012	Treated	Lead	10	µg/l	1.7
Kilconly	14/03/2012	Treated	Lead	10	µg/l	0.8
Ballymanagh, Craughwell	14/05/2012	Treated	Lead	10	µg/l	0.4
Carrigan, Craughwell.	14/05/2012	Treated	Lead	10	µg/l	4.4
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Lead	10	µg/l	0.4
Carramore-Knock.	11/06/2012	Treated	Lead	10	µg/l	0.3
Ballinakill, Moyard GWS	11/06/2012	Treated	Lead	10	µg/l	1
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Lead	10	µg/l	0.4
Belclare	09/07/2012	Treated	Lead	10	µg/l	0.5
Lettergesh/Mullaghgloss	31/07/2012	Treated	Lead	10	µg/l	0.6
Cloonluane (Renvyle)	31/07/2012	Treated	Lead	10	µg/l	0.6
Knockauns	09/08/2012	Treated	Lead	10	µg/l	0.5
Gurteen/Cloonmore	09/08/2012	Treated	Lead	10	µg/l	0.5
Esker/ Eyrecourt	10/09/2012	Treated	Lead	10	µg/l	0.5
Cloonatleva	10/09/2012	Treated	Lead	10	µg/l	0.8
Menlough	10/09/2012	Treated	Lead	10	µg/l	1.8
Killasmuggaun	10/09/2012	Treated	Lead	10	µg/l	0.9
Brierfield No1, Ballinasloe	10/09/2012	Treated	Lead	10	µg/l	1
Feigh East & West	10/09/2012	Treated	Lead	10	µg/l	0.5
Cluide, Cahermorris.	31/10/2012	Treated	Lead	10	µg/l	0.3
Cahermorris, Corrandulla.	31/10/2012	Treated	Lead	10	µg/l	0.5
New Inn GWS	21/11/2012	Treated	Lead	10	µg/l	0.4
Newcastle (Aughrim)	21/11/2012	Treated	Lead	10	µg/l	0.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilbannon	11/12/2012	Treated	Lead	10	µg/l	0.4
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Lead	10	µg/l	8.1
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Lead	10	µg/l	0.5
Kilconierin	24/07/2017	Raw	Magnesium	50	mg/l	5.11
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Manganese	50	µg/l	127
Glinsk/Creggs	16/01/2012	Treated	Manganese	50	µg/l	1
Coole GWS	23/01/2012	Treated	Manganese	50	µg/l	3.9
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Manganese	50	µg/l	31
Lisananey/Liskeavy	12/03/2012	Treated	Manganese	50	µg/l	18.5
Milltown Co-Op	12/03/2012	Treated	Manganese	50	µg/l	7.4
Corohan Group Water Scheme	12/03/2012	Treated	Manganese	50	µg/l	6.5
Looscaun	13/03/2012	Treated	Manganese	50	µg/l	1.1
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Manganese	50	µg/l	2.1
Bullaun, Loughrea	13/03/2012	Treated	Manganese	50	µg/l	5.9
Anbally & District GWS	14/03/2012	Treated	Manganese	50	µg/l	1.2
Clough/Cummer	14/03/2012	Treated	Manganese	50	µg/l	1.2
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Manganese	50	µg/l	277
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Manganese	50	µg/l	61
Carrigan, Craughwell.	14/05/2012	Treated	Manganese	50	µg/l	14.5
Ballyglass/Fiddane	14/05/2012	Treated	Manganese	50	µg/l	1
Carramore-Knock.	11/06/2012	Treated	Manganese	50	µg/l	19.4
Ballinakill, Moyard GWS	11/06/2012	Treated	Manganese	50	µg/l	5.2
Claren/knocklehard	09/07/2012	Treated	Manganese	50	µg/l	74.6
K2, Leenane	11/07/2012	Treated	Manganese	50	µg/l	30
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Manganese	50	µg/l	3.9
Joyce's Food Store, Recess	18/07/2012	Treated	Manganese	50	µg/l	32
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Manganese	50	µg/l	384
Cloonluane (Renvyle)	31/07/2012	Treated	Manganese	50	µg/l	3.8
Knockauns	09/08/2012	Treated	Manganese	50	µg/l	182.3
Gurteen/Cloonmore	09/08/2012	Treated	Manganese	50	µg/l	1.9
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Manganese	50	µg/l	78

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Clontuskert	10/09/2012	Treated	Manganese	50	µg/l	6.7
Lowville No.1	10/09/2012	Treated	Manganese	50	µg/l	1.2
Menlough	10/09/2012	Treated	Manganese	50	µg/l	11.3
Killasmuggaun	10/09/2012	Treated	Manganese	50	µg/l	14.5
Brierfield No1, Ballinasloe	10/09/2012	Treated	Manganese	50	µg/l	8.4
Seehan, Gort	21/11/2012	Treated	Manganese	50	µg/l	2.7
Tubber	21/11/2012	Treated	Manganese	50	µg/l	1
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Manganese	50	µg/l	42.4
Kilconierin	24/07/2017	Raw	Manganese	50	µg/l	0
Lisananey/Liskeavy	12/03/2012	Treated	Mercury	1	µg/l	0.02
Milltown Co-Op	12/03/2012	Treated	Mercury	1	µg/l	0.02
Corohan Group Water Scheme	12/03/2012	Treated	Mercury	1	µg/l	0.03
Killeen / Poulatoon	13/03/2012	Treated	Mercury	1	µg/l	0.02
Kilchreest	13/03/2012	Treated	Mercury	1	µg/l	0.02
Moyglass, Loughrea.	13/03/2012	Treated	Mercury	1	µg/l	0.02
Caherlea / Gurrane	14/03/2012	Treated	Mercury	1	µg/l	0.05
Kilconly	14/03/2012	Treated	Mercury	1	µg/l	0.02
Gortnaglassa	16/07/2012	Treated	Mercury	1	µg/l	0.02
Knockauns	09/08/2012	Treated	Mercury	1	µg/l	0.03
Gurteen/Cloonmore	09/08/2012	Treated	Mercury	1	µg/l	0.05
Corofin/Ballintubber	09/08/2012	Treated	Mercury	1	µg/l	0.04
Bullaun, Tuam	09/08/2012	Treated	Mercury	1	µg/l	0.03
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Mercury	1	µg/l	0.04
Caherdine/Caherdevan	11/12/2012	Treated	Mercury	1	µg/l	0.02
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Mercury	1	µg/l	0.37
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Mercury	1	µg/l	0.02
Kilconierin	24/07/2017	Raw	Nickel	20	µg/l	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Nickel	20	µg/l	2
Gallagh/Brownsgrove	16/01/2012	Treated	Nickel	20	µg/l	1.3
Kiltevna	16/01/2012	Treated	Nickel	20	µg/l	1.3
Toberowen	16/01/2012	Treated	Nickel	20	µg/l	0.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Glinsk/Creggs	16/01/2012	Treated	Nickel	20	µg/l	2
Keelogue	16/01/2012	Treated	Nickel	20	µg/l	0.9
Newbridge Group Water Scheme	17/01/2012	Treated	Nickel	20	µg/l	1.4
Cloonigney	17/01/2012	Treated	Nickel	20	µg/l	1.2
Rhynn/Killeeneen	23/01/2012	Treated	Nickel	20	µg/l	1.2
Coole GWS	23/01/2012	Treated	Nickel	20	µg/l	1.1
Tierneevin	23/01/2012	Treated	Nickel	20	µg/l	0.5
Ardrahan, GWS	23/01/2012	Treated	Nickel	20	µg/l	0.6
Lisananey/Liskeavy	12/03/2012	Treated	Nickel	20	µg/l	1.6
Milltown Co-Op	12/03/2012	Treated	Nickel	20	µg/l	2.1
Corohan Group Water Scheme	12/03/2012	Treated	Nickel	20	µg/l	3.5
Belmont (Kilconly)	12/03/2012	Treated	Nickel	20	µg/l	2.1
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Nickel	20	µg/l	0.9
Killeen / Poulatoon	13/03/2012	Treated	Nickel	20	µg/l	0.8
Kilchreest	13/03/2012	Treated	Nickel	20	µg/l	1.4
Bullaun, Loughrea	13/03/2012	Treated	Nickel	20	µg/l	7.5
Anbally & District GWS	14/03/2012	Treated	Nickel	20	µg/l	2.3
Clough/Cummer	14/03/2012	Treated	Nickel	20	µg/l	1.6
Curry, Pollinmore GWS	14/03/2012	Treated	Nickel	20	µg/l	0.8
Rusheens	14/03/2012	Treated	Nickel	20	µg/l	2.1
Caherlea / Gurrane	14/03/2012	Treated	Nickel	20	µg/l	1.4
Kilconly	14/03/2012	Treated	Nickel	20	µg/l	0.8
Tynagh GWS	14/05/2012	Treated	Nickel	20	µg/l	1.6
Kilcooley (Gurtymadden)	14/05/2012	Treated	Nickel	20	µg/l	2.6
Ballymanagh, Craughwell	14/05/2012	Treated	Nickel	20	µg/l	1.7
Carrigan, Craughwell.	14/05/2012	Treated	Nickel	20	µg/l	2.4
Ballyglass/Fiddane	14/05/2012	Treated	Nickel	20	µg/l	1.4
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Nickel	20	µg/l	1
Lisheenavalla	14/05/2012	Treated	Nickel	20	µg/l	0.6
Carramore-Knock.	11/06/2012	Treated	Nickel	20	µg/l	0.6
Annaghdown	09/07/2012	Treated	Nickel	20	µg/l	0.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Balroebuckbeg	09/07/2012	Treated	Nickel	20	µg/l	0.7
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Nickel	20	µg/l	0.7
Belclare	09/07/2012	Treated	Nickel	20	µg/l	0.7
Gortnaglassa	16/07/2012	Treated	Nickel	20	µg/l	0.8
Inismeain	30/07/2012	Treated	Nickel	20	µg/l	0.8
Cloonluane (Renvyle)	31/07/2012	Treated	Nickel	20	µg/l	1
Knockauns	09/08/2012	Treated	Nickel	20	µg/l	2.1
Gurteen/Cloonmore	09/08/2012	Treated	Nickel	20	µg/l	2.9
Corofin/Ballintubber	09/08/2012	Treated	Nickel	20	µg/l	1
Bullaun, Tuam	09/08/2012	Treated	Nickel	20	µg/l	1.1
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Nickel	20	µg/l	1
Esker/ Eyrecourt	10/09/2012	Treated	Nickel	20	µg/l	1.4
Clontuskert	10/09/2012	Treated	Nickel	20	µg/l	1.6
Cloonatleva	10/09/2012	Treated	Nickel	20	µg/l	2.5
Lowville No.1	10/09/2012	Treated	Nickel	20	µg/l	2.6
Menlough	10/09/2012	Treated	Nickel	20	µg/l	3
Killasmuggaun	10/09/2012	Treated	Nickel	20	µg/l	1.9
Brierfield No1, Ballinasloe	10/09/2012	Treated	Nickel	20	µg/l	2.5
Feigh East & West	10/09/2012	Treated	Nickel	20	µg/l	0.5
Cluide, Cahermorris.	31/10/2012	Treated	Nickel	20	µg/l	1.4
Cahermorris, Corrandulla.	31/10/2012	Treated	Nickel	20	µg/l	1.4
New Inn GWS	21/11/2012	Treated	Nickel	20	µg/l	1.8
Newcastle (Aughrim)	21/11/2012	Treated	Nickel	20	µg/l	1.3
Seehan, Gort	21/11/2012	Treated	Nickel	20	µg/l	1.3
Tubber	21/11/2012	Treated	Nickel	20	µg/l	1.1
Cloon	21/11/2012	Treated	Nickel	20	µg/l	1
Kilbannon	11/12/2012	Treated	Nickel	20	µg/l	1.2
Caherfinisker	11/12/2012	Treated	Nickel	20	µg/l	1.2
Caherdine/Caherdevan	11/12/2012	Treated	Nickel	20	µg/l	1.2
Carhereenlea, Athenry.	11/12/2012	Treated	Nickel	20	µg/l	1.3
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Nickel	20	µg/l	10.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Nickel	20	µg/l	1
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Nitrate	50	mg/l	4.12
Gallagh/Brownsgrove	16/01/2012	Treated	Nitrate	50	mg/l	4.83
Kiltevna	16/01/2012	Treated	Nitrate	50	mg/l	5.85
Toberowen	16/01/2012	Treated	Nitrate	50	mg/l	3.63
Glinsk/Creggs	16/01/2012	Treated	Nitrate	50	mg/l	2.08
Keelogue	16/01/2012	Treated	Nitrate	50	mg/l	2.59
Newbridge Group Water Scheme	17/01/2012	Treated	Nitrate	50	mg/l	4.76
Cloonigney	17/01/2012	Treated	Nitrate	50	mg/l	6.51
Rhynn/Killeeneen	23/01/2012	Treated	Nitrate	50	mg/l	2.23
Coole GWS	23/01/2012	Treated	Nitrate	50	mg/l	3.82
Tierneevin	23/01/2012	Treated	Nitrate	50	mg/l	3.18
Roo	23/01/2012	Treated	Nitrate	50	mg/l	6.49
Ardrahan, GWS	23/01/2012	Treated	Nitrate	50	mg/l	9.68
Lisananey/Liskeavy	12/03/2012	Treated	Nitrate	50	mg/l	2.72
Milltown Co-Op	12/03/2012	Treated	Nitrate	50	mg/l	4.94
Corohan Group Water Scheme	12/03/2012	Treated	Nitrate	50	mg/l	4.51
Belmont (Kilconly)	12/03/2012	Treated	Nitrate	50	mg/l	2.7
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Nitrate	50	mg/l	2.09
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Nitrate	50	mg/l	10
Killeen / Poulatoon	13/03/2012	Treated	Nitrate	50	mg/l	13.79
Kylemore Abbey	13/03/2012	Treated	Nitrate	50	mg/l	5.92
Ballynahinch Hotel	13/03/2012	Treated	Nitrate	50	mg/l	2.9
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Nitrate	50	mg/l	0.97
Kilchreest	13/03/2012	Treated	Nitrate	50	mg/l	2.29
Moyglass, Loughrea.	13/03/2012	Treated	Nitrate	50	mg/l	3.56
Bullaun, Loughrea	13/03/2012	Treated	Nitrate	50	mg/l	2.24
Anbally & District GWS	14/03/2012	Treated	Nitrate	50	mg/l	6.09
Clough/Cummer	14/03/2012	Treated	Nitrate	50	mg/l	9.05
Curry, Pollinmore GWS	14/03/2012	Treated	Nitrate	50	mg/l	2.48
Rusheens	14/03/2012	Treated	Nitrate	50	mg/l	8.04

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Caherlea / Gurrane	14/03/2012	Treated	Nitrate	50	mg/l	7.66
Kilconly	14/03/2012	Treated	Nitrate	50	mg/l	2.42
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Nitrate	50	mg/l	15.4
Tynagh GWS	14/05/2012	Treated	Nitrate	50	mg/l	4.56
Kilcooley (Gurtymadden)	14/05/2012	Treated	Nitrate	50	mg/l	0.98
Ballymanagh, Craughwell	14/05/2012	Treated	Nitrate	50	mg/l	4.3
Carrigan, Craughwell.	14/05/2012	Treated	Nitrate	50	mg/l	8.32
Ballyglass/Fiddane	14/05/2012	Treated	Nitrate	50	mg/l	9.44
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Nitrate	50	mg/l	9.99
Lisheenavalla	14/05/2012	Treated	Nitrate	50	mg/l	1.24
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Nitrate	50	mg/l	2.8
Carramore-Knock.	11/06/2012	Treated	Nitrate	50	mg/l	0.64
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Nitrate	50	mg/l	3.8
Annaghdown	09/07/2012	Treated	Nitrate	50	mg/l	2.59
Balroebuckbeg	09/07/2012	Treated	Nitrate	50	mg/l	10.7
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Nitrate	50	mg/l	6.41
Belclare	09/07/2012	Treated	Nitrate	50	mg/l	8.32
Claren/knocklehard	09/07/2012	Treated	Nitrate	50	mg/l	1.19
Inismeain	30/07/2012	Treated	Nitrate	50	mg/l	9.52
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Nitrate	50	mg/l	2.5
Knockauns	09/08/2012	Treated	Nitrate	50	mg/l	11.1
Gurteen/Cloonmore	09/08/2012	Treated	Nitrate	50	mg/l	9.07
Corofin/Ballintubber	09/08/2012	Treated	Nitrate	50	mg/l	1.13
Bullaun, Tuam	09/08/2012	Treated	Nitrate	50	mg/l	1.3
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Nitrate	50	mg/l	0.91
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Nitrate	50	mg/l	12.3
Gordans Bar, Tynagh - Well	18/08/2012	Treated	Nitrate	50	mg/l	13.7
Lady Gregory Hotel - private supply	27/08/2012	Treated	Nitrate	50	mg/l	6
Gort Golf Club - Well	27/08/2012	Treated	Nitrate	50	mg/l	6.1
McGrath's B&B	28/08/2012	Treated	Nitrate	50	mg/l	15.9
Esker/ Eyrecourt	10/09/2012	Treated	Nitrate	50	mg/l	20.75

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Clontuskert	10/09/2012	Treated	Nitrate	50	mg/l	2.67
Cloonatleva	10/09/2012	Treated	Nitrate	50	mg/l	8.68
Lowville No.1	10/09/2012	Treated	Nitrate	50	mg/l	7.24
Menlough	10/09/2012	Treated	Nitrate	50	mg/l	5.48
Killasmuggaun	10/09/2012	Treated	Nitrate	50	mg/l	3.96
Brierfield No1, Ballinasloe	10/09/2012	Treated	Nitrate	50	mg/l	11.13
Feigh East & West	10/09/2012	Treated	Nitrate	50	mg/l	13.05
Cluide, Cahermorris.	31/10/2012	Treated	Nitrate	50	mg/l	13.28
Cahermorris, Corrandulla.	31/10/2012	Treated	Nitrate	50	mg/l	11.36
Corrandulla	31/10/2012	Treated	Nitrate	50	mg/l	2.73
New Inn GWS	21/11/2012	Treated	Nitrate	50	mg/l	9.44
Newcastle (Aughrim)	21/11/2012	Treated	Nitrate	50	mg/l	4.25
Seehan, Gort	21/11/2012	Treated	Nitrate	50	mg/l	4.19
Tubber	21/11/2012	Treated	Nitrate	50	mg/l	8.19
Cloon	21/11/2012	Treated	Nitrate	50	mg/l	2.42
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Nitrate	50	mg/l	7.3
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Nitrate	50	mg/l	8.2
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Nitrate	50	mg/l	12.1
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	Nitrate	50	mg/l	23.1
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Nitrate	50	mg/l	10.1
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Nitrate	50	mg/l	7.1
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Nitrate	50	mg/l	18.6
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Nitrate	50	mg/l	19.9
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Nitrate	50	mg/l	3.7
Kilbannon	11/12/2012	Treated	Nitrate	50	mg/l	4.56
Caherfinisker	11/12/2012	Treated	Nitrate	50	mg/l	5.1
Caherdine/Caherdevan	11/12/2012	Treated	Nitrate	50	mg/l	8.95
Carhereenlea, Athenry.	11/12/2012	Treated	Nitrate	50	mg/l	4.65
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Nitrate	50	mg/l	7.26
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Nitrate	50	mg/l	4.09
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Nitrate	50	mg/l	3.8

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Nitrate	50	mg/l	3.53
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Nitrate	50	mg/l	13.3
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Nitrate	50	mg/l	2.4
Kilconierin	24/07/2017	Raw	Nitrate NO3	50	mg/l	5.54
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.57
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.02
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.04
Carramore-Knock.	11/06/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.053
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.02
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.02
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Nitrite (at tap)	0.5	mg/l	0.12
Kilconierin	24/07/2017	Raw	Nitrite NO2	0.5	mg/l	0.03
Kilconierin	24/07/2017	Raw	P Orthophosphate P	0.03	mg/l	0.01
Cloon	21/11/2012	Treated	PAH	0.1	µg/l	0.042
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	PAH	0.1	µg/l	0.022
Claren/knocklehard	09/07/2012	Treated	Pesticides - Total	0.5	µg/l	0.278
Kilconierin	24/07/2017	Raw	pH	≥6.5 and ≤9.5	pH units	6.9
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Gallagh/Brownsgrove	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kiltevna	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Toberowen	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Glinsk/Creggs	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Keelogue	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Cloonkeen/Toomard	16/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Newbridge Group Water Scheme	17/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Cloonigney	17/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Rhynn/Killeeneen	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Corofin/Ballintubber	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Corrandulla	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloon	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Coole GWS	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Tierneevin	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Roo	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ardrahan, GWS	23/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Clontuskert	24/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Cuillagh	26/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Doughiska No. 2	30/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Mid-Galway G.W.S.S. Phase 3.	30/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Cahernasilleany/Kiltrogue.	30/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Carnmore No. 2 (Kiltullagh)	30/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Caherfinisker	30/01/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Tubber	02/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Seehan, Gort	02/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Tierneevin	02/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Roo	02/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
BushyPark	06/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Lisheenavalla	06/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Killasolan	07/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Newbridge Group Water Scheme	07/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Ballyfruit, Headford	08/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Coolarne	08/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Gurteen/Cloonmore	09/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Brackloon, Dunmore	09/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Garrafrauns	09/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Carranurlaur	09/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Annaghdown	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Balroebuckbeg	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cluide, Cahermorris.	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Belclare	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Rusheens	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Anbally & District GWS	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Bullaun, Tuam	10/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Esker/ Eyrecourt	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Tynagh GWS	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Newcastle (Aughrim)	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Moyglass, Loughrea.	13/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Feigh East & West	14/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Abbert No 2	14/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Abbert Public Group Water Scheme	14/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Ballintleva GWS Spiddal	14/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Keelogue	14/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballymanagh, Craughwell	16/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Gortnaglassa	16/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Inismeain	23/02/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Ardrahan, GWS	01/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Caherdine/Caherdevan	01/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballyglass/Fiddane	01/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Toberowen	02/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Glinsk/Creggs	02/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kilcoona Caherlistrane GWS	05/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Lettermullen (Sceim na nOileain)	06/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Ballinakill, Moyard GWS	06/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
New Inn GWS	07/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Menlough	07/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Brierfield No1, Ballinasloe	07/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Killough GWS	08/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Glann, Oughterard	08/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Glengowla (Gibbons)	08/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Whytes Shop, Mullagh - Well	08/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Lisananey/Liskeavy	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Bullaun, Loughrea	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Milltown Co-Op	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Corohan Group Water Scheme	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kilcooley (Gurtymadden)	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Newtowndaly	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Belmont (Kilconly)	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Rhynn/Killeeneen	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Corohan Group Water Scheme	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Belmont (Kilconly)	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Looscaun	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Milltown Co-Op	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lisananey/Liskeavy	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Killeen / Poulatoon	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ratesh-Ardour (Kilconly)	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kylemore Abbey	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Ballynahinch Hotel	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.1
Gallagh/Brownsgrove	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kilchreest	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Moyglass, Loughrea.	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Bullaun, Loughrea	13/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Anbally & District GWS	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Killeen / Poulatoon	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Clough/Cummer	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Curry, Pollinmore GWS	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Rusheens	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Caherlea / Gurrane	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Kilconly	14/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Claren/knocklehard	20/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Cahermorris, Corrandulla.	20/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilconly	20/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilbannon	20/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Zetland Hotel, Connemara - Well	28/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Mays Coffee Dock @ McGaughs Garden Centre - Well	28/03/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lydacan GWS Co-op Society Ltd	02/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Moy	02/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Currenrue, Kinvara.	02/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Toureen/Tarrea	02/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Mulrock	02/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Carraghbrown	03/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Derrydonnell	03/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Doughiska No. 1.	03/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Loughwell (Leamhcoill)	03/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Corofin/Ballintubber	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Corrandulla	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Carraghy (Claregalway)	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Kiniska, Claregalway.	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Claregalway No 2	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Cloon	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cloonacauneen	04/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Carhereenlea, Athenry.	05/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Kiltevna	05/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Knockauns	05/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Killasmuggaun	05/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloonkeen/Toomard	05/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Tully, Thornfield	10/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Clooncun, Glenamaddy	10/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Knockmascahill	10/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lettergesh/Mullaghgloss	11/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.1
Masonbrook, Loughrea	12/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.2
Lowville No.2	12/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Castlegar/Lissyegan	12/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Cornamucklagh	12/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Emlough	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Claregalway No.1.	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Killeen/Bruckey	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Mid-Galway G.W.S.S. Phase 3.	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Cashla No. 1	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Castlelambert, Knocknacreva.	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Moanbaun	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Caherfinisker	16/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lowville No.1	19/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Cloonigney	19/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Carramore-Knock.	19/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Lisheenkyle	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Carnmore No. 2 (Kiltullagh)	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Cregannamore/Moneymore GWS	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Lavally No. 3 (Higgins)	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Tarramuid No 2, Oranmore	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Killeely/Kilcolgan	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Tyrone	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Tonroe	23/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Clontuskert	25/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Moher	25/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Kiltomer No. 3	25/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Perssepark (Ballinasloe)	25/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cloonatleva	25/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Gortanumera	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Looscaun	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Kylemore Abbey	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kilchreest	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Kilconieran GWS Co-Op Society Ltd	26/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Cloonluane (Renvyle)	30/04/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Coole GWS	01/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Carrigan, Craughwell.	01/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lisheenavalla	01/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Dunloughan, Ballyconneely.	03/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Aillebrack GWS	03/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Murvey/Dolan	03/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.2
Lettermullen No.2	10/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Lettercallow (Leitir Caladh)	10/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Criminagh/Lettermore	10/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Tynagh GWS	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Clough/Cummer	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Curry, Pollinmore GWS	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilcooley (Gurtymadden)	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Caherlea / Gurrane	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Ballymanagh, Craughwell	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Carrigan, Craughwell.	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballyglass/Fiddane	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisheenavalla	14/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Lettermullen (Sceim na nOileain)	28/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Menlough	31/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Glinsk/Creggs	31/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Toberowen	31/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Gallagh/Brownsgrove	31/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Kilcoona Caherlistrane GWS	31/05/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Ardrahan, GWS	05/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballyglass/Fiddane	05/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Rhynn/Killeeneen	05/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Annaghdown	07/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Claren/knocklehard	07/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Newbridge Group Water Scheme	07/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Carramore-Knock.	11/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8
Ballinakill, Moyard GWS	11/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Bullaun, Loughrea	12/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
New Inn GWS	12/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Kylemore Abbey	14/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Ballinakill, Moyard GWS	14/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Milltown Co-Op	18/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kings Shop, Lettergesh	20/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Lettermullen (Sceim na nOileain)	02/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Kilbannon	03/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Kilconly	03/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Menlough	04/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Glinsk/Creggs	04/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Toberowen	04/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gallagh/Brownsgrove	04/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Kilcoona Caherlistrane GWS	04/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Clontuskert	05/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Annaghdown	09/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Balroebuckbeg	09/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Kilcoona Caherlistrane GWS	09/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Belclare	09/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Claren/knocklehard	09/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.9
Emlough	10/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
K2, Leenane	11/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Kylemore Pass Hotel	11/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Sleepzone Connemara, Leenane	11/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Corrandulla	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Gortnaglassa	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Corofin/Ballintubber	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.5
Cloon	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Caherfinisker	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Lough Inagh Lodge Hotel	18/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Joyce's Food Store, Recess	18/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Peacocks Hotel	18/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Inismeain	30/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Lettergesh/Mullaghgloss	31/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Cloonluane (Renvyle)	31/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Knockauns	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gurteen/Cloonmore	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Gurteen/Cloonmore	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Newbridge Group Water Scheme	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Keelogue	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.8
Corofin/Ballintubber	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Bullaun, Tuam	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Esker/ Eyrecourt	13/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Gordans Bar, Tynagh - Well	18/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Pallas Karting - Well	19/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Connemara Lady - Stream water	21/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Dunloughan, Ballyconneely.	22/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Aillebrack GWS	22/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Murvey/Dolan	22/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Gortnaglassa	23/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Lady Gregory Hotel - private supply	27/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Gort Golf Club - Well	27/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
McGrath's B&B	28/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Feigh East & West	30/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
New Inn GWS	30/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Rhynn/Killeeneen	30/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Lisheenavalla	30/08/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Carraghy (Claregalway)	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Claregalway No 2	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Claregalway No.1.	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloonacauneen	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Cashla No. 1	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Castlelambert, Knocknacreva.	03/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Tubber	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Ardrahan, GWS	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Ballyglass/Fiddane	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Kilconieran GWS Co-Op Society Ltd	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Derrydonnell	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Doughiska No. 1.	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Carraghbrown	04/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Killough GWS	05/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Glengowla (Gibbons)	05/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Ballinakill, Moyard GWS	05/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Annaghdown	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Esker/ Eyrecourt	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Cahermorris, Corrandulla.	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Clontuskert	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Belclare	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Cloonatleva	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Rusheens	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lowville No.1	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Belmont (Kilconly)	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Menlough	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Bullaun, Tuam	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Killasmuggaun	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Brierfield No1, Ballinasloe	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Feigh East & West	10/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Boyounagh/Ballyedmond - Gortgarrow	11/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Brierfield No1, Ballinasloe	11/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Masonbrook, Loughrea	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Newtowndaly	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Tynagh GWS	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Kylemore Abbey	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Kilchreest	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Bullaun, Loughrea	12/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kilcooley (Gurtymadden)	13/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Newcastle (Aughrim)	13/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Caherdine/Caherdevan	13/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Balroebuckbeg	17/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Claren/knocklehard	17/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Milltown Co-Op	17/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Anbally & District GWS	17/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballymanagh, Craughwell	17/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Inismeain	24/09/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Cloonigney	03/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cloonatleva	03/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Corrandulla	04/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilconly	04/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilbannon	04/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Corofin/Ballintubber	04/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Moanbaun	04/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Seehan, Gort	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Roo	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Currenrue, Kinvara.	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Moy	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Toureen/Tarrea	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Mulrock	08/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Moher	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.6
Clontuskert	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kiltomer No. 3	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Perssepark (Ballinasloe)	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lowville No.2	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Castlegar/Lissyegan	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Cornamucklagh	09/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Connemara National Park, Tea Rooms	10/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kylemore Abbey Restaurant	10/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kylemore Filling Station	10/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kiniska, Claregalway.	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cloon	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Killeen/Bruckey	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lisheenkyle	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Cregannamore/Moneymore GWS	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Tarramuid No 2, Oranmore	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Lavally No. 3 (Higgins)	11/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Killeen / Poulatoon	15/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Gortanumera	15/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Kylemore Abbey	15/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Moyglass, Loughrea.	15/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Loughwell (Leamhcoill)	15/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Cuillagh	16/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
New Inn GWS	16/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Rhynn/Killeeneen	16/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Menlough	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Cloonkeen/Toomard	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Glinsk/Creggs	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Toberowen	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Gallagh/Brownsgrove	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Kilcoona Caherlistrane GWS	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Clough/Cummer	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Caherlea / Gurrane	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Carramore-Knock.	18/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Caherfinisker	22/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Killeely/Kilcolgan	22/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Tyrone	22/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Tonroe	22/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Doughiska No. 2	22/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Knockmascahill	23/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Clooncun, Glenamaddy	23/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Tully, Thornfield	23/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Killasolan	23/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lettermullen (Sceim na nOileain)	24/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Carhereenlea, Athenry.	25/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Carrigan, Craughwell.	25/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Kilconieran GWS Co-Op Society Ltd	25/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Glann, Oughterard	30/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Cluide, Cahermorris.	31/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Cahermorris, Corrandulla.	31/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Corrandulla	31/10/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Annaghdown	01/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Ballyfruit, Headford	01/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Coolarne	01/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Cahernasilleany/Kiltrogue.	01/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Ardrahan, GWS	05/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballyglass/Fiddane	05/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Lisheenavalla	05/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
BushyPark	05/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
Brackloon, Dunmore	06/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Garrafrauns	06/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Killasmuggaun	06/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Knockauns	06/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Newbridge Group Water Scheme	06/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Abbert No 2	07/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Abbert Public Group Water Scheme	07/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Milltown Co-Op	07/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Corohan Group Water Scheme	07/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lisananey/Liskeavy	07/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lettermullen No.2	12/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Lettercallow (Leitir Caladh)	12/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Criminagh/Lettermore	12/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Claren/knocklehard	14/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Carranurlaur	14/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.7
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Curry, Pollinmore GWS	14/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Looscaun	15/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Bullaun, Loughrea	15/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Ballintleva GWS Spiddal	15/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Lowville No.1	19/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Ballinakill, Moyard GWS	20/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Cloonluane (Renvyle)	20/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.7
Lettergesh/Mullaghgloss	20/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
New Inn GWS	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Newcastle (Aughrim)	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Emlough	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Hazel House B & B, Rusheens	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.5
Seehan, Gort	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Tubber	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cloon	21/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Kiltevna	22/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Cluide, Cahermorris.	22/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Coole GWS	26/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.8
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	8.2
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.3
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
The Palm Tree, Ballyglunin - Well	27/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.6
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kilbannon	03/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Kilconly	03/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Lydons Public House, Knockdo - Well	03/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Copper Beech, Turloughmore - Well	03/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Clifden Glen Holiday Village - Well	06/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Kilbannon	11/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	6.9
Caherfinisker	11/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Caherdine/Caherdevan	11/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Carhereenlea, Athenry.	11/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.8
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.4
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.2
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	pH	≥6.5 and ≤9.5	pH units	7.1
Kilconierin	24/07/2017	Raw	Potassium	12	mg/l	1.59
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Selenium	10	µg/l	0.9
Glinsk/Creggs	16/01/2012	Treated	Selenium	10	µg/l	0.2
Cloonigney	17/01/2012	Treated	Selenium	10	µg/l	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lisananey/Liskeavy	12/03/2012	Treated	Selenium	10	µg/l	3.5
Milltown Co-Op	12/03/2012	Treated	Selenium	10	µg/l	0.4
Corohan Group Water Scheme	12/03/2012	Treated	Selenium	10	µg/l	2.3
Belmont (Kilconly)	12/03/2012	Treated	Selenium	10	µg/l	1.3
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Selenium	10	µg/l	0.8
Looscaun	13/03/2012	Treated	Selenium	10	µg/l	0.8
Killeen / Poulatoon	13/03/2012	Treated	Selenium	10	µg/l	0.2
Kylemore Abbey	13/03/2012	Treated	Selenium	10	µg/l	1.3
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Selenium	10	µg/l	1.2
Kilchreest	13/03/2012	Treated	Selenium	10	µg/l	0.6
Moyglass, Loughrea.	13/03/2012	Treated	Selenium	10	µg/l	1
Bullaun, Loughrea	13/03/2012	Treated	Selenium	10	µg/l	1
Anbally & District GWS	14/03/2012	Treated	Selenium	10	µg/l	1.3
Clough/Cummer	14/03/2012	Treated	Selenium	10	µg/l	1.7
Curry, Pollinmore GWS	14/03/2012	Treated	Selenium	10	µg/l	0.9
Rusheens	14/03/2012	Treated	Selenium	10	µg/l	1.7
Kilcooley (Gurtymadden)	14/05/2012	Treated	Selenium	10	µg/l	1.2
Ballymanagh, Craughwell	14/05/2012	Treated	Selenium	10	µg/l	0.7
Carrigan, Craughwell.	14/05/2012	Treated	Selenium	10	µg/l	0.8
Ballyglass/Fiddane	14/05/2012	Treated	Selenium	10	µg/l	0.7
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Selenium	10	µg/l	0.8
Lisheenavalla	14/05/2012	Treated	Selenium	10	µg/l	0.4
Annaghdown	09/07/2012	Treated	Selenium	10	µg/l	0.4
Balroebuckbeg	09/07/2012	Treated	Selenium	10	µg/l	1.3
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Selenium	10	µg/l	1
Belclare	09/07/2012	Treated	Selenium	10	µg/l	1
Claren/knocklehard	09/07/2012	Treated	Selenium	10	µg/l	0.4
Gortnaglassa	16/07/2012	Treated	Selenium	10	µg/l	0.6
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Selenium	10	µg/l	0.4
Inismeain	30/07/2012	Treated	Selenium	10	µg/l	0.8
Knockauns	09/08/2012	Treated	Selenium	10	µg/l	0.5

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Gurteen/Cloonmore	09/08/2012	Treated	Selenium	10	µg/l	0.4
Corofin/Ballintubber	09/08/2012	Treated	Selenium	10	µg/l	0.5
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Selenium	10	µg/l	0.6
Esker/ Eyrecourt	10/09/2012	Treated	Selenium	10	µg/l	0.5
Cloonatleva	10/09/2012	Treated	Selenium	10	µg/l	0.8
Lowville No.1	10/09/2012	Treated	Selenium	10	µg/l	0.5
Menlough	10/09/2012	Treated	Selenium	10	µg/l	0.3
Killasmuggaun	10/09/2012	Treated	Selenium	10	µg/l	0.4
Brierfield No1, Ballinasloe	10/09/2012	Treated	Selenium	10	µg/l	0.5
Feigh East & West	10/09/2012	Treated	Selenium	10	µg/l	0.8
Cluide, Cahermorris.	31/10/2012	Treated	Selenium	10	µg/l	0.4
Cahermorris, Corrandulla.	31/10/2012	Treated	Selenium	10	µg/l	0.7
New Inn GWS	21/11/2012	Treated	Selenium	10	µg/l	1
Newcastle (Aughrim)	21/11/2012	Treated	Selenium	10	µg/l	0.7
Tubber	21/11/2012	Treated	Selenium	10	µg/l	1
Kilbannon	11/12/2012	Treated	Selenium	10	µg/l	0.6
Caherfinisker	11/12/2012	Treated	Selenium	10	µg/l	0.2
Caherdine/Caherdevan	11/12/2012	Treated	Selenium	10	µg/l	0.6
Carhereenlea, Athenry.	11/12/2012	Treated	Selenium	10	µg/l	0.4
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Selenium	10	µg/l	0.4
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Selenium	10	µg/l	1.7
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Selenium	10	µg/l	0.5
Kilconierin	24/07/2017	Raw	Silica	No abnormal change	-	3.34
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Sodium	200	mg/l	207
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Sodium	200	mg/l	240
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Sodium	200	mg/l	209.2
Kilconierin	24/07/2017	Raw	Sodium	200	mg/l	7.29
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Sodium	200	mg/l	11.6
Gallagh/Brownsgrove	16/01/2012	Treated	Sodium	200	mg/l	8.6
Kiltevna	16/01/2012	Treated	Sodium	200	mg/l	7.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Toberowen	16/01/2012	Treated	Sodium	200	mg/l	7.8
Glinsk/Creggs	16/01/2012	Treated	Sodium	200	mg/l	47.4
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Sodium	200	mg/l	69
Keelogue	16/01/2012	Treated	Sodium	200	mg/l	7.6
Cloonkeen/Toomard	16/01/2012	Treated	Sodium	200	mg/l	14.2
Newbridge Group Water Scheme	17/01/2012	Treated	Sodium	200	mg/l	9.6
Cloonigney	17/01/2012	Treated	Sodium	200	mg/l	8
Rhynn/Killeeneen	23/01/2012	Treated	Sodium	200	mg/l	11
Coole GWS	23/01/2012	Treated	Sodium	200	mg/l	9.8
Tierneevin	23/01/2012	Treated	Sodium	200	mg/l	8.7
Roo	23/01/2012	Treated	Sodium	200	mg/l	13
Ardrahan, GWS	23/01/2012	Treated	Sodium	200	mg/l	13.8
O'Donnells Shop, Kylebrack, Loughrea - Well	13/02/2012	Treated	Sodium	200	mg/l	84
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Sodium	200	mg/l	125
Lisananey/Liskeavy	12/03/2012	Treated	Sodium	200	mg/l	11
Milltown Co-Op	12/03/2012	Treated	Sodium	200	mg/l	40.8
Corohan Group Water Scheme	12/03/2012	Treated	Sodium	200	mg/l	16.5
Belmont (Kilconly)	12/03/2012	Treated	Sodium	200	mg/l	12.9
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Sodium	200	mg/l	9.9
Looscaun	13/03/2012	Treated	Sodium	200	mg/l	23.2
Killeen / Poulatoon	13/03/2012	Treated	Sodium	200	mg/l	13.2
Kylemore Abbey	13/03/2012	Treated	Sodium	200	mg/l	11.5
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Sodium	200	mg/l	9.1
Kilchreest	13/03/2012	Treated	Sodium	200	mg/l	10.5
Moyglass, Loughrea.	13/03/2012	Treated	Sodium	200	mg/l	11.7
Bullaun, Loughrea	13/03/2012	Treated	Sodium	200	mg/l	15.4
Anbally & District GWS	14/03/2012	Treated	Sodium	200	mg/l	10.8
Clough/Cummer	14/03/2012	Treated	Sodium	200	mg/l	9.8
Curry, Pollinmore GWS	14/03/2012	Treated	Sodium	200	mg/l	9.8
Rusheens	14/03/2012	Treated	Sodium	200	mg/l	12.6
Caherlea / Gurrane	14/03/2012	Treated	Sodium	200	mg/l	9.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilconly	14/03/2012	Treated	Sodium	200	mg/l	10.3
Corrib Foods Products, Kiltullagh, Athenry - Well	23/04/2012	Treated	Sodium	200	mg/l	21
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Sodium	200	mg/l	43
Tynagh GWS	14/05/2012	Treated	Sodium	200	mg/l	44.9
Kilcooley (Gurtymadden)	14/05/2012	Treated	Sodium	200	mg/l	10.8
Ballymanagh, Craughwell	14/05/2012	Treated	Sodium	200	mg/l	13.9
Carrigan, Craughwell.	14/05/2012	Treated	Sodium	200	mg/l	16.4
Ballyglass/Fiddane	14/05/2012	Treated	Sodium	200	mg/l	13.7
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Sodium	200	mg/l	18.4
Lisheenavalla	14/05/2012	Treated	Sodium	200	mg/l	12.2
Carramore-Knock.	11/06/2012	Treated	Sodium	200	mg/l	7.8
Ballinakill, Moyard GWS	11/06/2012	Treated	Sodium	200	mg/l	21
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Sodium	200	mg/l	10
Annaghdown	09/07/2012	Treated	Sodium	200	mg/l	10
Balroebuckbeg	09/07/2012	Treated	Sodium	200	mg/l	10.1
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Sodium	200	mg/l	12.2
Belclare	09/07/2012	Treated	Sodium	200	mg/l	10.7
Claren/knocklehard	09/07/2012	Treated	Sodium	200	mg/l	11.7
Emlough	10/07/2012	Treated	Sodium	200	mg/l	50.5
Gortnaglassa	16/07/2012	Treated	Sodium	200	mg/l	12.9
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Sodium	200	mg/l	29.5
Inismeain	30/07/2012	Treated	Sodium	200	mg/l	39.1
Lettergesh/Mullaghgloss	31/07/2012	Treated	Sodium	200	mg/l	11.1
Cloonluane (Renvyle)	31/07/2012	Treated	Sodium	200	mg/l	23.6
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Sodium	200	mg/l	183
Knockauns	09/08/2012	Treated	Sodium	200	mg/l	15.4
Gurteen/Cloonmore	09/08/2012	Treated	Sodium	200	mg/l	7.3
Corofin/Ballintubber	09/08/2012	Treated	Sodium	200	mg/l	10.3
Bullaun, Tuam	09/08/2012	Treated	Sodium	200	mg/l	10.8
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Sodium	200	mg/l	10.8
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Sodium	200	mg/l	195

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Lady Gregory Hotel - private supply	27/08/2012	Treated	Sodium	200	mg/l	64
Gort Golf Club - Well	27/08/2012	Treated	Sodium	200	mg/l	143
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Sodium	200	mg/l	155
Esker/ Eyrecourt	10/09/2012	Treated	Sodium	200	mg/l	24.4
Clontuskert	10/09/2012	Treated	Sodium	200	mg/l	9
Cloonatleva	10/09/2012	Treated	Sodium	200	mg/l	9.8
Lowville No.1	10/09/2012	Treated	Sodium	200	mg/l	10.6
Menlough	10/09/2012	Treated	Sodium	200	mg/l	11.7
Killasmuggaun	10/09/2012	Treated	Sodium	200	mg/l	11.3
Brierfield No1, Ballinasloe	10/09/2012	Treated	Sodium	200	mg/l	10.2
Feigh East & West	10/09/2012	Treated	Sodium	200	mg/l	113.4
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Sodium	200	mg/l	151
Cluide, Cahermorris.	31/10/2012	Treated	Sodium	200	mg/l	10
Cahermorris, Corrandulla.	31/10/2012	Treated	Sodium	200	mg/l	10.7
Corrandulla	31/10/2012	Treated	Sodium	200	mg/l	2.8
New Inn GWS	21/11/2012	Treated	Sodium	200	mg/l	16.5
Newcastle (Aughrim)	21/11/2012	Treated	Sodium	200	mg/l	8.9
Seehan, Gort	21/11/2012	Treated	Sodium	200	mg/l	12.3
Tubber	21/11/2012	Treated	Sodium	200	mg/l	7
Cloon	21/11/2012	Treated	Sodium	200	mg/l	9.5
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Sodium	200	mg/l	167
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Sodium	200	mg/l	171
Kilbannon	11/12/2012	Treated	Sodium	200	mg/l	11.2
Caherfinisker	11/12/2012	Treated	Sodium	200	mg/l	11
Caherdine/Caherdevan	11/12/2012	Treated	Sodium	200	mg/l	11.2
Carhereenlea, Athenry.	11/12/2012	Treated	Sodium	200	mg/l	11
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Sodium	200	mg/l	9
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Sodium	200	mg/l	10.5
Kilconierin	24/07/2017	Raw	Strontium	-	-	0
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Sulphate	250	mg/l	5.5
Gallagh/Brownsgrove	16/01/2012	Treated	Sulphate	250	mg/l	4.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kiltevna	16/01/2012	Treated	Sulphate	250	mg/l	2.5
Toberowen	16/01/2012	Treated	Sulphate	250	mg/l	2.5
Glinsk/Creggs	16/01/2012	Treated	Sulphate	250	mg/l	132.7
Keelogue	16/01/2012	Treated	Sulphate	250	mg/l	1.7
Cloonkeen/Toomard	16/01/2012	Treated	Sulphate	250	mg/l	8.6
Newbridge Group Water Scheme	17/01/2012	Treated	Sulphate	250	mg/l	2.8
Cloonigney	17/01/2012	Treated	Sulphate	250	mg/l	2.4
Rhynn/Killeeneen	23/01/2012	Treated	Sulphate	250	mg/l	4
Coole GWS	23/01/2012	Treated	Sulphate	250	mg/l	5.7
Tierneevin	23/01/2012	Treated	Sulphate	250	mg/l	3.6
Roo	23/01/2012	Treated	Sulphate	250	mg/l	4.7
Ardrahan, GWS	23/01/2012	Treated	Sulphate	250	mg/l	8.8
Lisananey/Liskeavy	12/03/2012	Treated	Sulphate	250	mg/l	8.9
Milltown Co-Op	12/03/2012	Treated	Sulphate	250	mg/l	170.3
Corohan Group Water Scheme	12/03/2012	Treated	Sulphate	250	mg/l	22.8
Belmont (Kilconly)	12/03/2012	Treated	Sulphate	250	mg/l	4.8
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Sulphate	250	mg/l	71.9
Looscaun	13/03/2012	Treated	Sulphate	250	mg/l	10.4
Killeen / Poulatoon	13/03/2012	Treated	Sulphate	250	mg/l	8.8
Kylemore Abbey	13/03/2012	Treated	Sulphate	250	mg/l	6
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Sulphate	250	mg/l	5.7
Kilchreest	13/03/2012	Treated	Sulphate	250	mg/l	4.4
Moyglass, Loughrea.	13/03/2012	Treated	Sulphate	250	mg/l	5.1
Bullaun, Loughrea	13/03/2012	Treated	Sulphate	250	mg/l	21.8
Anbally & District GWS	14/03/2012	Treated	Sulphate	250	mg/l	7.5
Clough/Cummer	14/03/2012	Treated	Sulphate	250	mg/l	6.2
Curry, Pollinmore GWS	14/03/2012	Treated	Sulphate	250	mg/l	68
Rusheens	14/03/2012	Treated	Sulphate	250	mg/l	8.4
Caherlea / Gurrane	14/03/2012	Treated	Sulphate	250	mg/l	4.2
Kilconly	14/03/2012	Treated	Sulphate	250	mg/l	68.6
Tynagh GWS	14/05/2012	Treated	Sulphate	250	mg/l	16.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Kilcooley (Gurtymadden)	14/05/2012	Treated	Sulphate	250	mg/l	10.6
Ballymanagh, Craughwell	14/05/2012	Treated	Sulphate	250	mg/l	10.4
Carrigan, Craughwell.	14/05/2012	Treated	Sulphate	250	mg/l	13
Ballyglass/Fiddane	14/05/2012	Treated	Sulphate	250	mg/l	8.3
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Sulphate	250	mg/l	10.6
Lisheenavalla	14/05/2012	Treated	Sulphate	250	mg/l	75
Carramore-Knock.	11/06/2012	Treated	Sulphate	250	mg/l	2.3
Ballinakill, Moyard GWS	11/06/2012	Treated	Sulphate	250	mg/l	2.1
Annaghdown	09/07/2012	Treated	Sulphate	250	mg/l	78.7
Balroebuckbeg	09/07/2012	Treated	Sulphate	250	mg/l	4.8
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Sulphate	250	mg/l	4.8
Belclare	09/07/2012	Treated	Sulphate	250	mg/l	11.1
Claren/knocklehard	09/07/2012	Treated	Sulphate	250	mg/l	1.5
Emlough	10/07/2012	Treated	Sulphate	250	mg/l	45.9
Gortnaglassa	16/07/2012	Treated	Sulphate	250	mg/l	16.6
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Sulphate	250	mg/l	36
Inismeain	30/07/2012	Treated	Sulphate	250	mg/l	8.5
Cloonluane (Renvyle)	31/07/2012	Treated	Sulphate	250	mg/l	1.2
Knockauns	09/08/2012	Treated	Sulphate	250	mg/l	18.4
Corofin/Ballintubber	09/08/2012	Treated	Sulphate	250	mg/l	86.8
Bullaun, Tuam	09/08/2012	Treated	Sulphate	250	mg/l	84.6
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Sulphate	250	mg/l	84.4
Esker/ Eyrecourt	10/09/2012	Treated	Sulphate	250	mg/l	47.7
Clontuskert	10/09/2012	Treated	Sulphate	250	mg/l	91.8
Cloonatleva	10/09/2012	Treated	Sulphate	250	mg/l	8.4
Lowville No.1	10/09/2012	Treated	Sulphate	250	mg/l	10.4
Menlough	10/09/2012	Treated	Sulphate	250	mg/l	10.9
Killasmuggaun	10/09/2012	Treated	Sulphate	250	mg/l	5.5
Brierfield No1, Ballinasloe	10/09/2012	Treated	Sulphate	250	mg/l	5.1
Feigh East & West	10/09/2012	Treated	Sulphate	250	mg/l	21.9
Cluide, Cahermorris.	31/10/2012	Treated	Sulphate	250	mg/l	4.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cahermorris, Corrandulla.	31/10/2012	Treated	Sulphate	250	mg/l	5.9
Corrandulla	31/10/2012	Treated	Sulphate	250	mg/l	78.2
New Inn GWS	21/11/2012	Treated	Sulphate	250	mg/l	8.9
Newcastle (Aughrim)	21/11/2012	Treated	Sulphate	250	mg/l	3.8
Seehan, Gort	21/11/2012	Treated	Sulphate	250	mg/l	1.1
Tubber	21/11/2012	Treated	Sulphate	250	mg/l	6.5
Cloon	21/11/2012	Treated	Sulphate	250	mg/l	82.6
Kilbannon	11/12/2012	Treated	Sulphate	250	mg/l	116.5
Caherfinisker	11/12/2012	Treated	Sulphate	250	mg/l	112.7
Caherdine/Caherdevan	11/12/2012	Treated	Sulphate	250	mg/l	3.7
Carhereenlea, Athenry.	11/12/2012	Treated	Sulphate	250	mg/l	113
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Sulphate	250	mg/l	5.2
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Sulphate	250	mg/l	10.5
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Sulphate	250	mg/l	10.3
Kilconierin	24/07/2017	Raw	Sulphate SO4	250	mg/l	3.48
Kilconierin	24/07/2017	Raw	Total Coliforms	0	number/100 ml	1203
Gallagh/Brownsgrove	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.08
Kiltevna	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.06
Toberowen	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.06
Glinsk/Creggs	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.57
Keelogue	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.66
Cloonkeen/Toomard	16/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.2
Newbridge Group Water Scheme	17/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.17
Cloonigney	17/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.27
Rhynn/Killeeneen	23/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.51
Coole GWS	23/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.33
Tierneevin	23/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.66
Roo	23/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.07
Ardrahan, GWS	23/01/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.48
Lisananey/Liskeavy	12/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.38

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Milltown Co-Op	12/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	4.12
Corohan Group Water Scheme	12/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.84
Belmont (Kilconly)	12/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	4.61
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.53
Looscaun	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.77
Killeen / Poulatoon	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.09
Kylemore Abbey	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.64
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.59
Kilchreest	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.02
Moyglass, Loughrea.	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.61
Bullaun, Loughrea	13/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.48
Anbally & District GWS	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.59
Clough/Cummer	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.43
Curry, Pollinmore GWS	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.09
Rusheens	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.65
Caherlea / Gurrane	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.89
Kilconly	14/03/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.08
Tynagh GWS	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.13
Kilcooley (Gurtymadden)	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	4.23
Ballymanagh, Craughwell	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.58
Carrigan, Craughwell.	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.73
Ballyglass/Fiddane	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.18
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.3
Lisheenavalla	14/05/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.25
Carramore-Knock.	11/06/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.87
Ballinakill, Moyard GWS	11/06/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.79
Annaghdown	09/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.56
Balroebuckbeg	09/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.1
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.8
Belclare	09/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.45
Claren/knocklehard	09/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	4.26

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Emlough	10/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.36
Gortnaglassa	16/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.93
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.88
Inismeain	30/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	6
Lettergesh/Mullaghgloss	31/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.8
Cloonluane (Renvyle)	31/07/2012	Treated	Total Organic Carbon	no abnormal cha	-	6.31
Knockauns	09/08/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.06
Gurteen/Cloonmore	09/08/2012	Treated	Total Organic Carbon	no abnormal cha	-	5.74
Corofin/Ballintubber	09/08/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.41
Bullaun, Tuam	09/08/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.38
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.34
Esker/ Eyrecourt	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	2
Clontuskert	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	4.93
Cloonatleva	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.37
Lowville No.1	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.19
Menlough	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.68
Killasmuggaun	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.85
Brierfield No1, Ballinasloe	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.45
Feigh East & West	10/09/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.55
Cluide, Cahermorris.	31/10/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.53
Cahermorris, Corrandulla.	31/10/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.34
Corrandulla	31/10/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.51
New Inn GWS	21/11/2012	Treated	Total Organic Carbon	no abnormal cha	-	3.23
Newcastle (Aughrim)	21/11/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.98
Seehan, Gort	21/11/2012	Treated	Total Organic Carbon	no abnormal cha	-	5.32
Tubber	21/11/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.04
Cloon	21/11/2012	Treated	Total Organic Carbon	no abnormal cha	-	2.32
Kilbannon	11/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.76
Caherfinisker	11/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.8
Caherdine/Caherdevan	11/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.2
Carhereenlea, Athenry.	11/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	0.34
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.3
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Total Organic Carbon	no abnormal cha	-	1.58
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Total Organic Carbon	no abnormal cha	-	1.68
Kilconierin	24/07/2017	Raw	Total Organic Carbon	no abnormal cha	-	1.1
Kilconieran GWS Co-Op Society Ltd	01/09/2015	Treated	Trihalomethanes(Total)	10	µg/l	21
Gallagh/Brownsgrove	16/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	40
Kiltevna	16/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	13.92
Toberowen	16/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	13.37
Glinsk/Creggs	16/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	64.33
Keelogue	16/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	16.71
Newbridge Group Water Scheme	17/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	24.45
Rhynn/Killeeneen	23/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	40.17
Ardrahan, GWS	23/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	12.5
Milltown Co-Op	12/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	67.18
Belmont (Kilconly)	12/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	46.56
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	27.96
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	58.66
Bullaun, Loughrea	13/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	14.15
Anbally & District GWS	14/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	19.85
Curry, Pollinmore GWS	14/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	29.23
Kilconly	14/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	29.71
Lisheenavalla	14/05/2012	Treated	Trihalomethanes(Total)	10	µg/l	46.2
Ballinakill, Moyard GWS	11/06/2012	Treated	Trihalomethanes(Total)	10	µg/l	73.25
Annaghdown	09/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	54.26
Balroebuckbeg	09/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	15.06
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	63.29
Claren/knocklehard	09/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	154.61
Emlough	10/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	79.11
Gortnaglassa	16/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	32.5
Lettermullen (Sceim na nOileain)	16/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	79.8

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Inismeain	30/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	69.33
Lettergesh/Mullaghgloss	31/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	93.85
Cloonluane (Renvyle)	31/07/2012	Treated	Trihalomethanes(Total)	10	µg/l	93.04
Corofin/Ballintubber	09/08/2012	Treated	Trihalomethanes(Total)	10	µg/l	38.96
Bullaun, Tuam	09/08/2012	Treated	Trihalomethanes(Total)	10	µg/l	43.51
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Trihalomethanes(Total)	10	µg/l	43.45
Clontuskert	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	172.72
Cloonatleva	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	29.96
Lowville No.1	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	24.49
Menlough	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	25.94
Killasmuggaun	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	24.57
Brierfield No1, Ballinasloe	10/09/2012	Treated	Trihalomethanes(Total)	10	µg/l	56.83
Cahermorris, Corrandulla.	31/10/2012	Treated	Trihalomethanes(Total)	10	µg/l	21.01
Corrandulla	31/10/2012	Treated	Trihalomethanes(Total)	10	µg/l	37.19
New Inn GWS	21/11/2012	Treated	Trihalomethanes(Total)	10	µg/l	26.34
Newcastle (Aughrim)	21/11/2012	Treated	Trihalomethanes(Total)	10	µg/l	15.09
Cloon	21/11/2012	Treated	Trihalomethanes(Total)	10	µg/l	40.92
Kilbannon	11/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	41.42
Caherfinisker	11/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	40.68
Caherdine/Caherdevan	11/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	10.27
Carhereenlea, Athenry.	11/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	33.25
Kilconieran GWS Co-Op Society Ltd	12/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	41.45
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Trihalomethanes(Total)	10	µg/l	50.69
Cloonigney	17/01/2012	Treated	Trihalomethanes(Total)	10	µg/l	9.6
Rusheens	14/03/2012	Treated	Trihalomethanes(Total)	10	µg/l	8.89
Ballymanagh, Craughwell	14/05/2012	Treated	Trihalomethanes(Total)	10	µg/l	5.47
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Trihalomethanes(Total)	10	µg/l	9.48
Kilconierin	24/07/2017	Raw	Turbidity	Acceptable to co	-	0.12
Gallagh/Brownsgrove	16/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.18
Glinsk/Creggs	16/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.11
McCarthy's Bar, Kilbeacanty, Gort - Well	16/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	2.6

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Newbridge Group Water Scheme	17/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.13
Cloon	23/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Coole GWS	23/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.38
Tierneevin	23/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.11
Roo	23/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.12
Ardrahan, GWS	23/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.17
Clontuskert	24/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Tubber	02/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
BushyPark	06/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Brackloon, Dunmore	09/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Annaghdown	10/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cluide, Cahermorris.	10/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Belclare	10/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Rusheens	10/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.9
Anbally & District GWS	10/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Skellys Shop, Dalystown, Loughrea - Well	13/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Gortnaglassa	16/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Griffins Bakery, Limehill, Tynagh - Well	21/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Inismeain	23/02/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Brockagh/Lisduff Craughwell.	01/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Glinsk/Creggs	02/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.5
Kilcoona Caherlistrane GWS	05/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Killough GWS	08/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.7
Whytes Shop, Mullagh - Well	08/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Milltown Co-Op	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.52
Corohan Group Water Scheme	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.28
Kilcooley (Gurtymadden)	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Newtowndaly	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Ratesh-Ardour (Kilconly)	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.61

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Rhynn/Killeeneen	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Ballymore Cottage Creche, Craughwell - Well	12/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Corohan Group Water Scheme	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Belmont (Kilconly)	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Looscaun	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.31
Milltown Co-Op	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.9
Ballynahinch Hotel	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Duanes Fine Foods, Helen Duane, Ballyconneely	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.6
Loughrea Rural, (Killeenadeema)	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Gallagh/Brownsgrove	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Bullaun, Loughrea	13/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.14
Anbally & District GWS	14/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.46
Clough/Cummer	14/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.18
Rusheens	14/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.27
Caherlea / Gurrane	14/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.29
Claren/knocklehard	20/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Cahermorris, Corrandulla.	20/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Kilbannon	20/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Zetland Hotel, Connemara - Well	28/03/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Moy	02/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Currenrue, Kinvara.	02/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Toureen/Tarrea	02/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Mulrock	02/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Carraghbrown	03/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Derrydonnell	03/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Corofin/Ballintubber	04/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Carraghy (Claregalway)	04/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Claregalway No 2	04/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Cloon	04/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Cloonacauneen	04/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Tully, Thornfield	10/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Fahy's Shop, Turloughmore - Well	11/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Lettergesh/Mullaghgloss	11/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.8
Masonbrook, Loughrea	12/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Lowville No.1	19/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Carramore-Knock.	19/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Clontuskert	25/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Moher	25/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Kiltomer No. 3	25/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Perssepark (Ballinasloe)	25/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Gortanumera	26/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Meadow Court Hotel, Loughrea - Well	26/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Looscaun	26/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kings Caravan Park, Ballyconneely - Well	30/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.5
Cloonluane (Renvyle)	30/04/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Coole GWS	01/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Carrigan, Craughwell.	01/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Dunloughan, Ballyconneely.	03/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1
Aillebrack GWS	03/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.1
Murvey/Dolan	03/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.8
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Criminagh/Lettermore	10/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Tynagh GWS	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.16
Kilcooley (Gurtymadden)	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Caherlea / Gurrane	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Carrigan, Craughwell.	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	8.38
Ballyglass/Fiddane	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.18
Brockagh/Lisduff Craughwell.	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.13
Lisheenavalla	14/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.15
Gallagh/Brownsgrove	31/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Kilcoona Caherlistrane GWS	31/05/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Ardrahan, GWS	05/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Rhynn/Killeeneen	05/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kilconieran GWS Co-Op Society Ltd	05/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Claren/knocklehard	07/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Curraveagh House, Oughterard - Spring	07/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Carramore-Knock.	11/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.45
Milltown Co-Op	18/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kings Shop, Lettergesh	20/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Rosleague Manor Hotel, Letterfrack - Well	20/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Laffeys Caravan Site, Lettergesh - Well	20/06/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Kilbannon	03/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Gallagh/Brownsgrove	04/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Kilcoona Caherlistrane GWS	04/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Clontuskert	05/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Annaghdown	09/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.17
Kilcoona Caherlistrane GWS	09/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.19
Belclare	09/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Claren/knocklehard	09/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.96
Emlough	10/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.11
K2, Leenane	11/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.2
Sleepzone Connemara, Leenane	11/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Corrandulla	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Gortnaglassa	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.26
Corofin/Ballintubber	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cloon	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Caherfinisker	16/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Leenane Hotel, Leenane - Stream water	18/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Lough Inagh Lodge Hotel	18/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Peacocks Hotel	18/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Dan O'Hara Homestead, Clifden - Stream water	25/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.9
Inismeain	30/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.18
Cloonluane (Renvyle)	31/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Cross Cut Bar, Duniry - Well	31/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Hill Bar, Kylebrack, Loughrea - Well	31/07/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Knockauns	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.24
Gurteen/Cloonmore	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Gurteen/Cloonmore	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Newbridge Group Water Scheme	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Corofin/Ballintubber	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.23
Bullaun, Tuam	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.16
Mid-Galway G.W.S.S. Phase 3.	09/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.16
McCarthy's Bar, Kilbeacanty, Gort - Well	18/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Pallas Karting - Well	19/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Connemara Lady - Stream water	21/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.8
Galway Outdoor Educ. Centre, Recess - Lake	21/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Carrig Bar, Leenane - Stream water	21/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Dunloughan, Ballyconneely.	22/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Aillebrack GWS	22/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Murvey/Dolan	22/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Caroline Wynnes House, Leitrim, Loughrea - Well	27/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Tuohys Shop, Coose (Deli Tap) - Well	27/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Lady Gregory Hotel - private supply	27/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Gort Golf Club - Well	27/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
McGrath's B&B	28/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Rhynn/Killeeneen	30/08/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Carraghy (Claregalway)	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Claregalway No 2	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Claregalway No.1.	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Cloonacauneen	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cashla No. 1	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Castlelambert, Knocknacreva.	03/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Tubber	04/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Derrydonnell	04/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Doughiska No. 1.	04/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Carraghbrown	04/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Killough GWS	05/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Glengowla (Gibbons)	05/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Annaghdown	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Esker/ Eyrecourt	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.13
Cahermorris, Corrandulla.	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Clontuskert	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.36
Cloonatleva	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Ratesh-Ardour (Kilconly)	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Lowville No.1	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.18
Belmont (Kilconly)	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Menlough	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.24
Bullaun, Tuam	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Killasmuggaun	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.28
Brierfield No1, Ballinasloe	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Feigh East & West	10/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.21
Brierfield No1, Ballinasloe	11/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Masonbrook, Loughrea	12/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Newtowndaly	12/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Kilcooley (Gurtymadden)	13/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Brockagh/Lisduff Craughwell.	13/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Balroebuckbeg	17/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Claren/knocklehard	17/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Milltown Co-Op	17/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Anbally & District GWS	17/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Ballymanagh, Craughwell	17/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Hazel House, Glenfoha, Tuam - Well	19/09/2012	Treated	Turbidity (at tap)	Acceptable to co	-	3.3
Cloonigney	03/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Corrandulla	04/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kilbannon	04/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Moanbaun	04/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	6.8
Seehan, Gort	08/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Roo	08/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Moy	08/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Mulrock	08/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Moher	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Clontuskert	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Kiltomer No. 3	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Lowville No.2	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Castlegar/Lissyegan	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Cornamucklagh	09/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Katie Kearney's Cafe, Knockdoe, Claregalway -Well	10/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Kylemore Filling Station	10/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Mid-Galway G.W.S.S. Phase 3.	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kiniska, Claregalway.	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cloon	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.9
Carnmore No. 2 (Kiltullagh)	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Cregannamore/Moneymore GWS	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Lavally No. 3 (Higgins)	11/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cuillagh	16/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Rose Curleys DH, Kylebrack Jams, Loughrea - Well	17/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Glinsk/Creggs	18/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.7
Gallagh/Brownsgrove	18/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Clough/Cummer	18/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	2.4
Caherlea / Gurrane	18/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Carramore-Knock.	18/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Tully, Thornfield	23/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Killasolan	23/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Carrigan, Craughwell.	25/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cluide, Cahermorris.	31/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.45
Cahermorris, Corrandulla.	31/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Corrandulla	31/10/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.78
Lydacan GWS Co-op Society Ltd	05/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Lisheenavalla	05/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
BushyPark	05/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Brackloon, Dunmore	06/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Garrafrauns	06/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Newbridge Group Water Scheme	06/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.5
Abbert No 2	07/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Abbert Public Group Water Scheme	07/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Criminagh/Lettermore	12/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Claren/knocklehard	14/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Carranurlaur	14/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Bullaun, Loughrea	15/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Lowville No.1	19/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Ballinakill, Moyard GWS	20/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cloonluane (Renvyle)	20/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Lettergesh/Mullaghgloss	20/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
New Inn GWS	21/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.12
Hazel House B & B, Rusheens	21/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	5.4
Seehan, Gort	21/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.6
Tubber	21/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.11
Cloon	21/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Boyounagh/Ballyedmond - Gortgarrow	22/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	3.1
Cluide, Cahermorris.	22/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Coole GWS	26/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Flannerys Nursing Home, Abbeyknockmoy - Well	26/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Cuan Mhuire, Coolarne - Well	27/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
Just Devine Foods, Terman, Gort - Well	27/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.3
McHughs Bar & Restaurant, Castlegar - Well	27/11/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.8
Copper Beech, Turloughmore - Well	03/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Lydons Public House, Knockdo - Well	03/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	2.2
New Leaf Farm, Dunmore - Well	04/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.5
Waterfront Rest B+B, Derreen, Clifden - Well	06/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	1.2
Clifden Glen Holiday Village - Well	06/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Kilbannon	11/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.47
Caherfinisker	11/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.14
Carhereenlea, Athenry.	11/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.13
Carnmore No. 2 (Kiltullagh)	11/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.11
Maldron Hotel, Oranmore - Well	12/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.9
Lydacan GWS Co-op Society Ltd	12/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.51
Oranmore Lodge Hotel, Oranmore - Well	14/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Sharamore House B & B, Clifden - Well	17/12/2012	Treated	Turbidity (at tap)	Acceptable to co	-	0.4
Kilconieran GWS Co-Op Society Ltd	13/07/2015	Treated	Turbidity (at tap)	Acceptable to co	-	0.2
Cloon	23/01/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Clontuskert	24/01/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.8
Loughrea Rural, (Killeenadeema)	26/01/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Cuillagh	26/01/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
BushyPark	06/02/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Lisheenavalla	06/02/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Ballintleva GWS Spiddal	14/02/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	7.5
Bunnahevally, Kilcurrivard.	20/02/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Killough GWS	08/03/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.7
Newtowndaly	12/03/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Moy	02/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.9
Currenrue, Kinvara.	02/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.9
Toureen/Tarrea	02/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.9
Mulrock	02/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.9

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Loughrea Rural, (Killeenadeema)	12/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Masonbrook, Loughrea	12/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Clontuskert	25/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Moher	25/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Kiltomer No. 3	25/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Perssepark (Ballinasloe)	25/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Gortanumera	26/04/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Dunloughan, Ballyconneely.	03/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1.5
Aillebrack GWS	03/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1.5
Murvey/Dolan	03/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1.5
Lettermullen No.2	10/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1
Lettercallow (Leitir Caladh)	10/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1
Criminagh/Lettermore	10/05/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	1
Newbridge Group Water Scheme	07/06/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.6
Clontuskert	05/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Corrandulla	16/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Corofin/Ballintubber	16/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Cloon	16/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Carnmore No. 2 (Kiltullagh)	16/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Caherfinisker	16/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Loughrea Rural, (Killeenadeema)	18/07/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.6
Newbridge Group Water Scheme	09/08/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.6
Mid-Galway G.W.S.S. Phase 3.	21/08/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Dunloughan, Ballyconneely.	22/08/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Aillebrack GWS	22/08/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Murvey/Dolan	22/08/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Carraghy (Claregalway)	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Claregalway No 2	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Claregalway No.1.	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Cloonacauneen	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Cashla No. 1	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3

Scheme Name/Water Supply	Sample Date	Sample Type	Parameter	Drinking Water Limit	Units	Result
Castlelambert, Knocknacreva.	03/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Derrydonnell	04/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Doughiska No. 1.	04/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Carraghbrown	04/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Killough GWS	05/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Masonbrook, Loughrea	12/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Newtowndaly	12/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Inismeain	24/09/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Corrandulla	04/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Kilconly	04/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Kilbannon	04/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Corofin/Ballintubber	04/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Moanbaun	04/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Lowville No.2	09/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Castlegar/Lissyegan	09/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Cornamucklagh	09/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Gortanumera	15/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Loughrea Rural, (Killeenadeema)	16/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Knockmascahill	23/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Clooncun, Glenamaddy	23/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.2
Tully, Thornfield	23/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.4
Killasolan	23/10/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Brackloon, Dunmore	06/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Garrafrauns	06/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Newbridge Group Water Scheme	06/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.9
Lettermullen No.2	12/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Lettercallow (Leitir Caladh)	12/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Criminagh/Lettermore	12/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.5
Bunnahevally, Kilcurrivard.	14/11/2012	Treated	Turbidity (at WTW)	Acceptable to co	-	0.3
Kilconierin	24/07/2017	Raw	Zinc	5000	µg/l	30

List of Contents

Section 1:	**Introduction**	
Section 2:	**Executive Summary**	
Section 3:	**Tabular presentation of Data**	
Section 4:	**Tabular Data Presentation**	
Section 5:	**Commentary on the Analytical Results**	
Section 6:	**Process Operational Changes Record**	
Section 7:	**Health & Safety Issues**	
Section 8:	**Outstanding Operational Maintenance Issues Report**	- Not Appicable
Section 9:	**Complaint Record**	- Not Appicable
Section 10:	**Site Alarm /Incident Record**	
Section 11:	**Site Visit Report**	
Section 12:	**Equipment Calibration Record**	
Section 13:	**Equipment Service Record**	- Not Appicable
Section 14:	**Plant Maintenance Schedule Report**	- Not Appicable
Section 15:	**Non-Sludge Waste Disposal Record**	- Not Appicable
Section 16:	**Analysis Results for Microbiological Analysis**	
Section 17:	**Facility Maintenance Record**	-
Section 18:	**Emergency Event Record**	- Not Appicable
Section 19:	**Random Analysis by Employer**	- Not Appicable

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 1: ***Operator: Stephen Costello***

Introduction

Operational Period Month &Year	Aug-17	**Short process description:** Kilconierin WTP provides for the removal of the bacteriological contaminates, the reduction of the turbidity, colour from water as characterised by Table 9.2c to achieve the Drinking Water Regulations S.I. 122 of 2014 and Employer's Requirements.
Report No.:	8-2017	
Number of Reports To Date Including This One	70	
Date of Commencement of Operations Contract	25 September 2011	

This Monthly Status Report (MSR) is prepared in accordance with the Performance Management System of WSNTG. All issues relevant to the site activities and plant performance during the period covered are included in the body of this report.

The operational period covered in this MSR No.8-2017 is for August 2017.
In general:
- Raw water quantity was sufficient to cater for the Scheme's demand

- Raw water quality was good and stable throughout the Operational Period

- Treatment water met the required standards at all times.

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 2: ***Operator: Stephen Costello***

Executive Summary

Category	Report On	Comments/Explanations/Results
General Weather Conditions	Typical conditions and anomallies	This month was an unsettled and changeable month. Rainfall was above the Monthly Long Term Average. Temperatures ranged between 12 - 23℃.
Source availability	limitation to treatment	Source yielded full design capacity throughout the duration of this O&M period.
Quantity of Water Treated and distributed to public	cubic meters	**2,479m^3**
Treated Water Flowmeter	24/07/2017	**197417m3**
Treated Water Flowmeter	30/08/2017	**199896m3**
Analytical Results	Results in or out of spec.	All on-line results within specified parameters Independent Lab Reports attached.
Process Efficiency	Recommendations to improve	Raw water quality is of good quality.
Complaints	what and solution	None recorded
Alarm Callouts	what they were	No. Callouts.
Heath & Safety Issues	what since last report or	None recorded
Equipment	taken off line and why or placed into service	None recorded
Treated Water Quality	Phis-Chem and Bio	Treated water quality is good. All chemical parameters are low and there is no microorganisms present in water.
Electricity Disruption		None recorded

Notes:

Monthly Status Report

Section 3:

Tabular Data Presentation

Daily averages of Colour and Turbidity in Final Water for August 2017.

Date	**Colour** (Pt Co)	**Turbidity** (NTU)	
	Treated	**Raw**	**Treated**
01/08/2017	3.42	0.28	0.07
02/08/2017	2.82	0.16	0.05
03/08/2017	3.28	0.15	0.08
04/08/2017	3.68	0.13	0.11
05/08/2017	4.03	0.14	0.13
06/08/2017	3.73	0.10	0.05
07/08/2017	3.43	0.09	0.09
08/08/2017	3.56	0.09	0.13
09/08/2017	4.24	0.09	0.19
10/08/2017	4.02	0.09	0.13
11/08/2017	3.85	0.09	0.13
12/08/2017	3.83	0.08	0.13
13/08/2017	3.57	0.08	0.04
14/08/2017	3.39	0.16	0.05
15/08/2017	3.32	0.08	0.05
16/08/2017	3.08	0.07	0.05
17/08/2017	2.68	0.08	0.05
18/08/2017	2.44	0.07	0.06
19/08/2017	3.11	0.15	0.11
20/08/2017	3.36	0.12	0.09
21/08/2017	3.55	0.10	0.08
22/08/2017	5.40	0.27	0.23
23/08/2017	4.52	0.12	0.10
24/08/2017	6.90	0.12	0.10
25/08/2017	7.18	0.10	0.09
26/08/2017	6.97	0.11	0.09
27/08/2017	6.72	0.08	0.08
28/08/2017	6.87	0.08	0.07
29/08/2017	6.71	0.07	0.07
30/08/2017	6.66	0.07	0.07
31/08/2017	6.48	0.09	0.07
Turbidity Limit (NTU):			1
Colour Limit (mg/l Pt Co) :			20

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS


Section 3: ***Operator: Stephen Costello***

Tabular Data Presentation


Daily averages of Free Chlorine in Final Water for August 2017.

Date	Chlorine (mg/l Cl_2)			
Day | Time	**06:00:00**	**12:00:00**	**18:00:00**	**23:59:59**
01/08/2017	0.27	0.35	0.29	0.25
02/08/2017	0.28	0.41	0.34	0.29
03/08/2017	0.33	0.43	0.36	0.31
04/08/2017	0.34	0.39	0.33	0.29
05/08/2017	0.30	0.36	0.29	0.25
06/08/2017	0.32	0.39	0.32	0.28
07/08/2017	0.34	0.41	0.35	0.31
08/08/2017	0.35	0.49	0.43	0.38
09/08/2017	0.41	0.48	0.41	0.38
10/08/2017	0.41	0.55	0.48	0.44
11/08/2017	0.49	0.58	0.51	0.47
12/08/2017	0.51	0.62	0.55	0.50
13/08/2017	0.50	0.54	0.48	0.45
14/08/2017	0.46	0.52	0.46	0.42
15/08/2017	0.43	0.48	0.43	0.39
16/08/2017	0.41	0.49	0.44	0.39
17/08/2017	0.41	0.46	0.41	0.37
18/08/2017	0.39	0.45	0.40	0.37
19/08/2017	0.38	0.37	0.33	0.30
20/08/2017	0.32	0.34	0.29	0.26
21/08/2017	0.29	0.32	0.27	0.26
22/08/2017	0.29	0.26	0.30	0.38
23/08/2017	0.31	0.26	0.28	0.31
24/08/2017	0.40	0.31	0.27	0.24
25/08/2017	0.34	0.35	0.30	0.26
26/08/2017	0.31	0.40	0.34	0.30
27/08/2017	0.34	0.48	0.41	0.36
28/08/2017	0.39	0.47	0.41	0.37
29/08/2017	0.41	0.48	0.43	0.39
30/08/2017	0.45	0.52	0.47	0.44
31/08/2017	0.34	0.40	0.36	0.32
Lower Limit:		**0.2**	mg/l Cl	
Upper Limit:		**0.7**	mg/l Cl	


Graph of Daily Treated Water

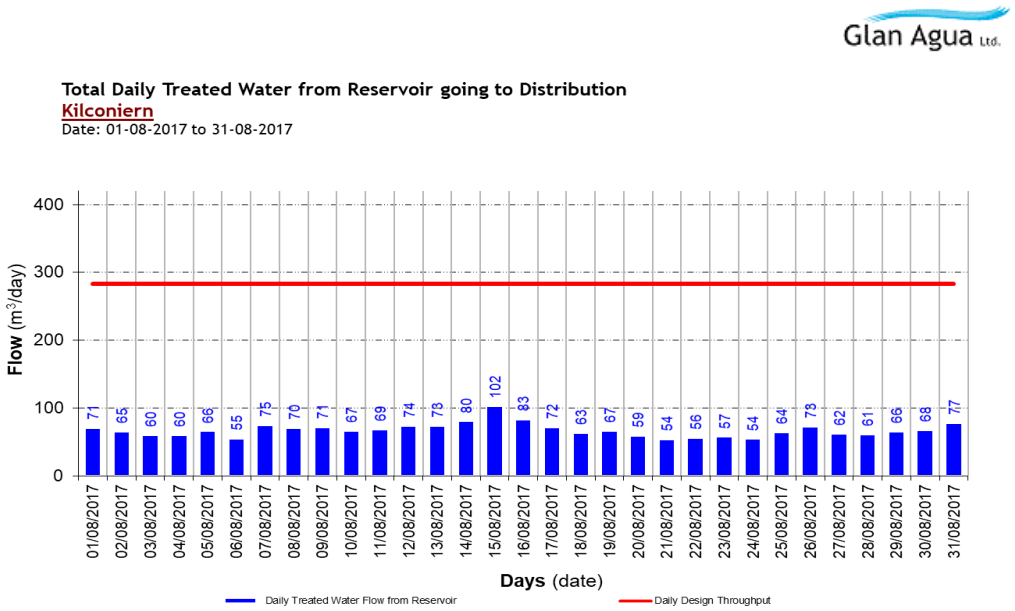

Graph of Reservoir Levels

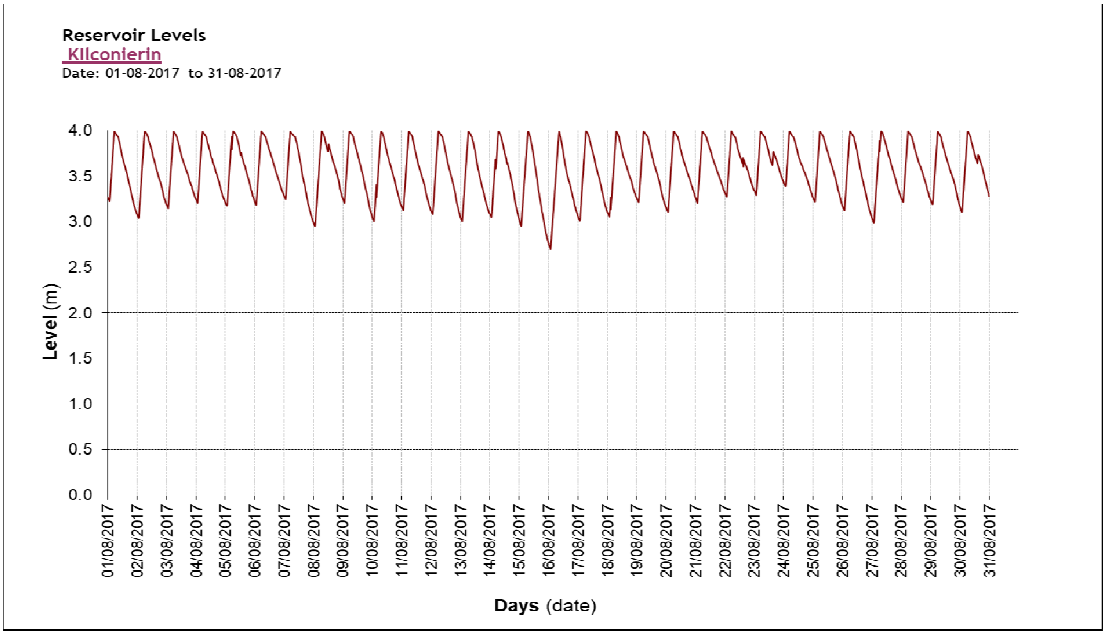

Graph of Daily Flows of Raw and Treated Water

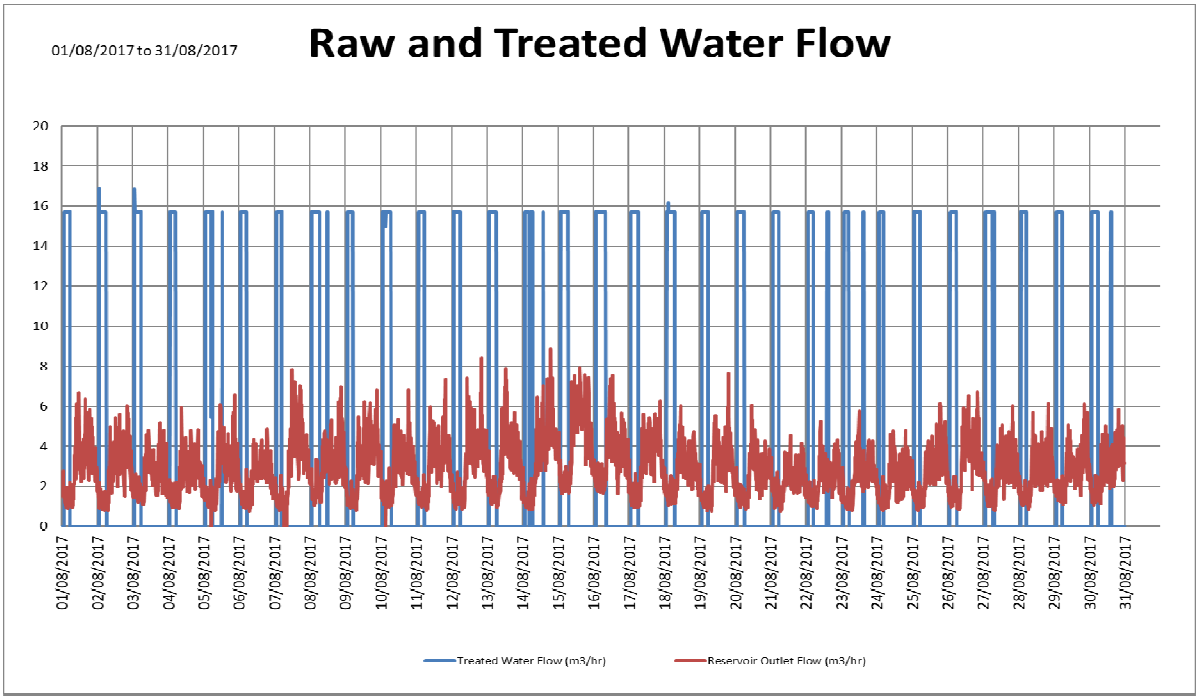


Monthly Status Report ***Contract: Galway GWS DBO***


Plant: Kilconierin GWS

Section 4: Graphical Presentation of Data ***Operator: Stephen Costello***


Average Daily Graph of Colour in Treated Water

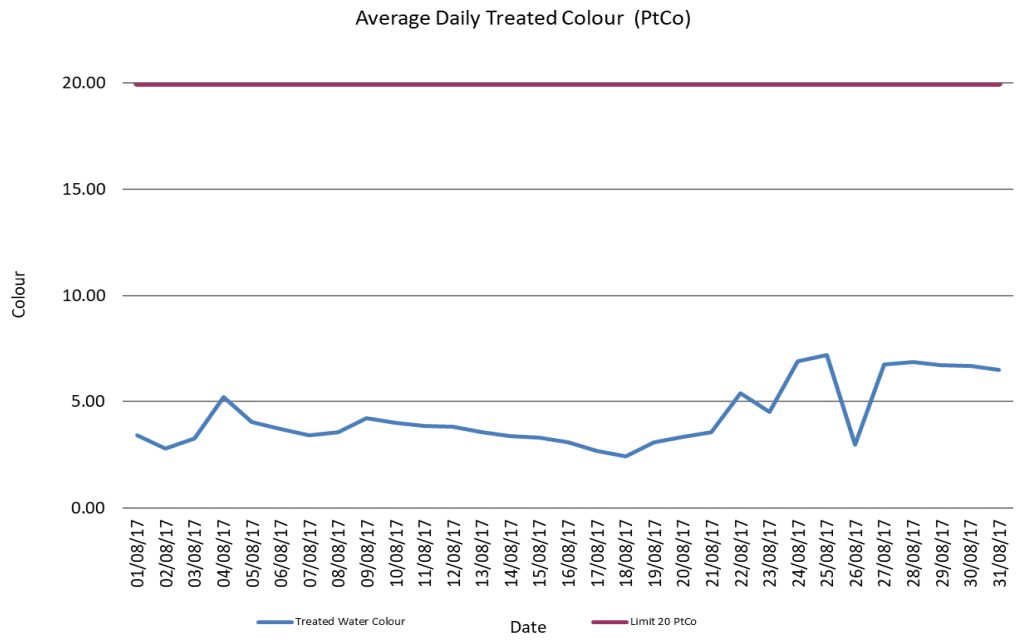


Average Daily Graph of Turbidity in Raw and Treated Water

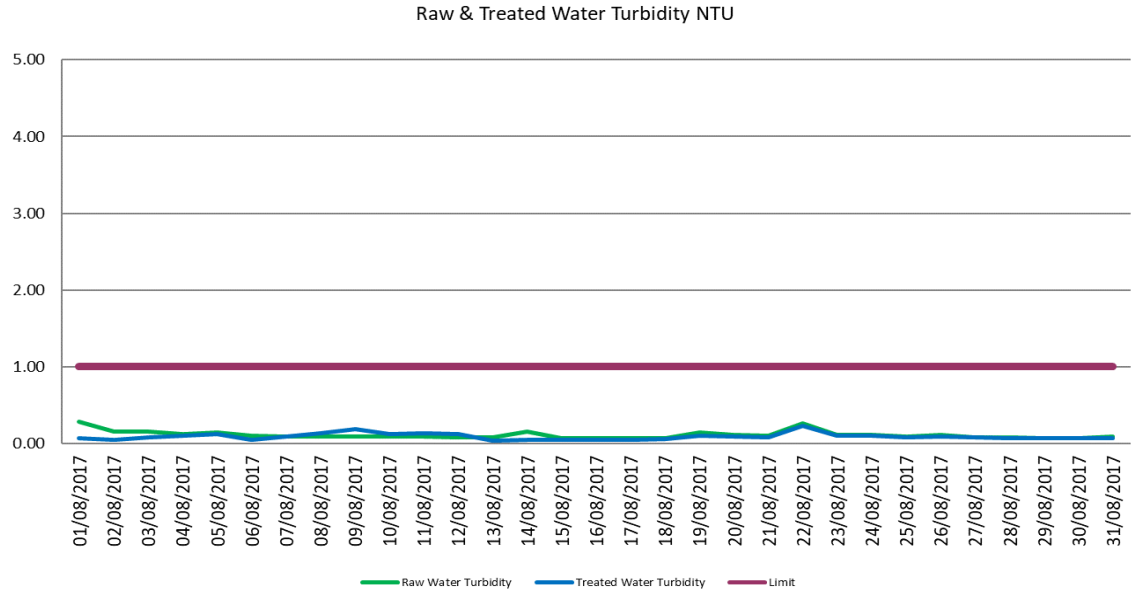

Six Hourly Graph of Free Chlorine in Treated Water going to Distribution

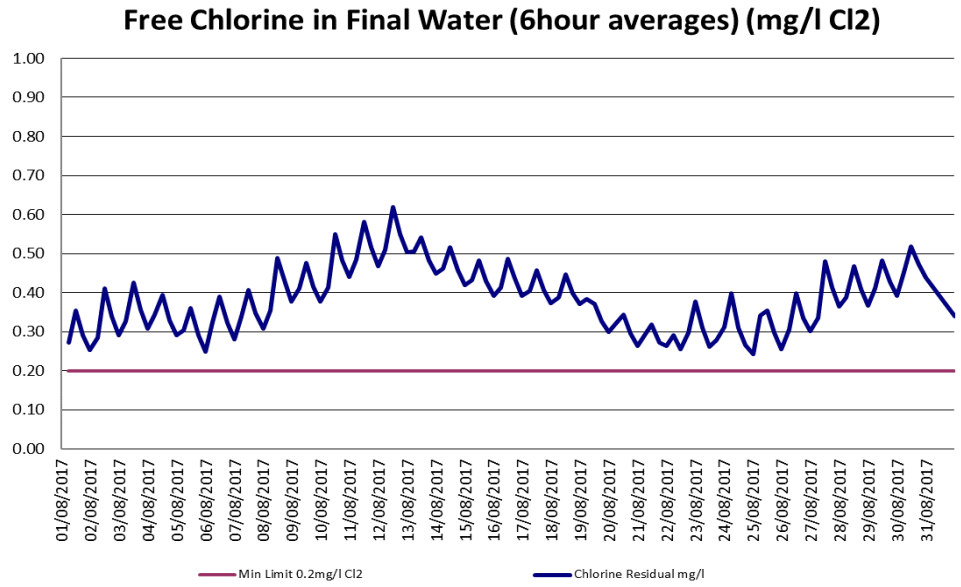

UV in Treated Water going to Distribution

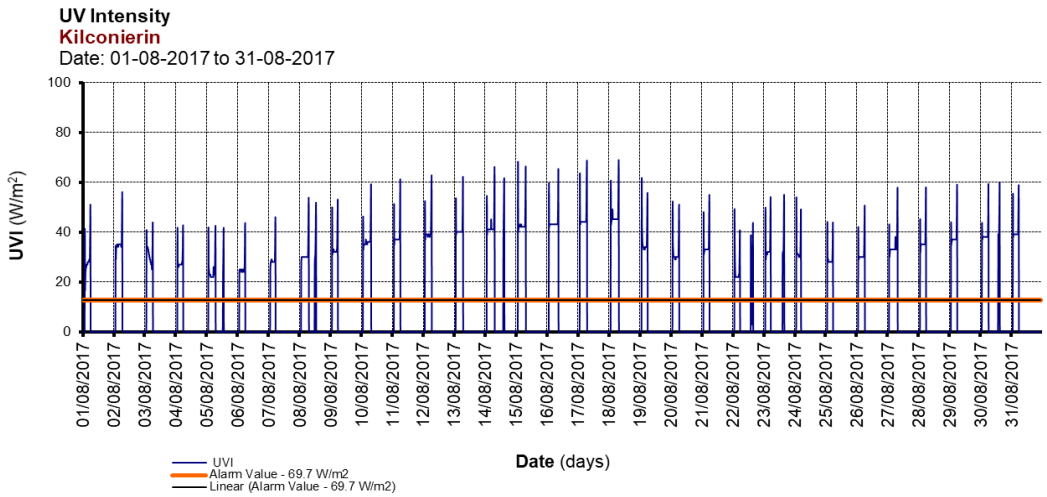

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 5: ***Operator: Stephen Costello***

Commentary on the Analytical Results

Category	Report On	Comments
	Quality comparison to contract requirements	Fully compliant with S.I. 122 and Contract Requirements.
Coliforms presence in the final water	What density	none. Fully complant with S.I 122
Other microorganisms presence in the final water	What and what density	*Clostridium Perfingens* - none
Raw water	Quality	Raw Water was good quality throughout the process proving.
Results	Major change since the previous reporting period	N/A
Other		Treated water of excellent quality
Other		
Other		
Other		

Lab Results Summary — 14/08/2017

Parameter	Unit	Value
Raw Water		
Turbidity	NTU	<0.10
TOC	mg/l	0.59
pH		6.94
Apparent Colour	mg/l PtCo	<5.00
Fe	ug/l	<10.0
Al	ug/l	<10.0
Mn	ug/l	<1.0
Treated Water		
Aluminium	ug/l	115
TOC	mg/l	0.6
Apparent Colour	mg/l PtCo	<5
E.coli	MPN/100ml	<1
pH	pH units	6.93
Fe	ug/l	<10.0
Mn	ug/l	<1.0
Coliform	MPN/100ml	<1
Clostridium Pefringens	cfu/100ml	<1
Turbidity	NTU	<0.10

Monthly Status Report | ***Contract: Galway GWS DBO*** | ***Plant: Kilconierin GWS*** | **Health & Safety Issues** | ***Operator: Stephen Costello***

Section 7.3 - HEALTH & SAFETY STATISTICS REPORT

	John Fox	**Date:**	05/09/2017
For Period:	01/08/2017-31/08/2017		
Site Involved:	Kilconierin GWS		

Category 1: Covers fatalities and major injuries.
Category 2: Cover lost time accidents resulting in more than 3 days absence
Category 3: Covers lost time accidents resulting in 3 days absence or less.
Major Incidents: Accident not covered by Categories 1 to 3

Direct Employees

Number of Emplyees	**3**	*Exposure Hrs*	**09:50**	

	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Sub Contractor

Sub Contractor	**2**	*Exposure Hrs*	**00:50**	
Visitor				

	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Visitor

Number of Vistors	**0**	*Exposure Hrs*	**00:00**	
Visitor				

	Category 1	**Category 2**	**Category 3**	**Major Incident**	**Near Miss**
Number of Accidents	0	0	0	0	0
Days Lost	0	0	0	0	0

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 11: ***Operator: Stephen Costello***

Site Visit Report

Date	Name	Company & Position	Arrival Time	Departure Time	Purpose of visit
01/08/2017	Steve Costello	Glan Agua	10:45	11:15	Download Data, Checks, Cal
04/08/2017	Steve Costello	Glan Agua	10:30	10:50	CTU
05/08/2017	Steve Costello	Glan Agua	11:25	12:00	Adjust Chlorine
08/08/2017	Steve Costello	Glan Agua	10:50	11:50	Checks, Cal
09/08/2017	Steve Costello	Glan Agua	10:35	10:45	Collect Lawn Mower
11/08/2017	Martin Egan	Glan Agua	15:55	16:30	Top-up chemicals
12/08/2017	Steve Costello	Glan Agua	10:50	11:20	Adjust Chlorine
14/08/2017	Steve Costello	Glan Agua	12:50	13:15	Sampling/Cal
15/08/2017	Steve Costello	Glan Agua	16:10	17:00	Checks, Cal
17/08/2017	Steve Costello	Glan Agua	12:10	13:40	Maint
21/08/2017	Martin Egan	Glan Agua	10:15	10:40	Operational Duties
22/08/2017	Shane O'Donnell	Glan Agua	12:45	14:15	Adjust Chlorine
23/08/2017	Shane O'Donnell	Glan Agua	13:20	14:20	Adjust Chlorine
28/08/2017	Martin Egan	Glan Agua	15:30	16:00	Operational Duties
30/08/2017	Shane O'Donnell	Glan Agua	12:40	13:40	Adjust Chlorine

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 12: ***Operator: Stephen Costello***

Equipment Calibration Record

Date	Equipment Description	Serial No.	Calibrated by (name &company)	Next Calib. Due	Calib. Cert Rec'd.	Comments
01/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Plant Chlorine		Steve Costello	Sep-17		Passed Verification
08/08/2017	Raw Ph		Steve Costello	Sep-17		Calibrated
08/08/2017	Plant Ph		Steve Costello	Sep-17		Passed Verification
08/08/2017	Res Ph		Steve Costello	Sep-17		Passed Verification
08/08/2017	Colour		Steve Costello	Sep-17		Passed Verification
14/08/2017	Raw Turbidity		Steve Costello	Sep-17		Passed Verification
14/08/2017	Treated Turbidity		Steve Costello	Sep-17		Passed Verification
15/08/2017	Res Chlorine		Steve Costello	Sep-17		Passed Verification
23/08/2017	Res Chlorine		Shane O'Donnell	Sep-17		Passed Verification

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 16: ***Operator: Stephen Costello***

Analysis Results for Microbiological Analysis

Samling Date:	14/08/2017	***Sample No:***	368901
	City Analysts		
FINAL WATER CHARACTERISTICS		**PRESENCE/ABSENCE**	
Total Coliform	<1	Absence	
Faecal Coliform	<1	Absence	
Clostridium	<1	Absence	

Analysis Results for Microbiological Analysis - by Client

Sampling Date:	N/A	***Repeat Sample No:***	
Analyst			
FINAL WATER CHARACTERISTICS		**Total Coliform Colonies/100ml**	
Total Coliform			
Faecal Coliform			

Monthly Status Report ***Contract: Galway GWS DBO***

Plant: Kilconierin GWS

Section 17: ***Operator: Stephen Costello***

Facility Maintenance Record

A = Excellent B = Acceptable C = Unacceptable

	A	B	C
1. LAWN MAINTENANCE			
a. Grass cut & collected		X	
b. Edging tidy		X	
2. SHRUB MAINTENACE			
a. Bushes prund		X	
b. Trees erect & staked where required		X	
c. Hedges cut		X	
3. HARD SURFACES			
a. All surfaces swept		X	
b. All surfaces free of algae, moss etc.		X	
c. Road surface clean & adequate		X	
d. All roofs free from algea, moss etc.		X	
4. EXTERIOR PAINTING			
a. All buildings painted/clean		X	
b. All gates & doors painted		X	
5. HOUSEKEEPING			
a. Litter removed from site		X	
b. Surface area around bins & skip clean		X	
c. Site free from spillages		X	
6. BUILDINGS			
a. Roof in waterproof conditions		X	
b. Glazing in good order		X	
7. INTERIOIR CONDITIONS			
a. All rooms clean		X	
8. WELFARE & SANITATION			
a. Toilet/washing facilities clean N/A			
b. Canteen clean N/A			

Checked by: **Steve Costello** Date: **17/08/2017**

External Lab Reports

Lab	Sample location	Date	Report No.
City Analysts	Kilconierin Raw Water	14/08/2017	17-32471
City Analysts	Kilconierin Treated Water	14/08/2017	17-32471

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Certificate Of Analysis

Job Number: 17-32468
Issue Number: 1
Report Date: 1 September 2017

Site: Kilconierin
PO Number: 5800036527
Date Samples Received: 14/08/2017

Please find attached the results for the samples received at our laboratory on 14/08/2017.

Should you have any queries regarding the report or require any further services, we would be happy to discuss your requirements. For additional information about the company please log-on to our website at the above address.

Thank you for choosing City Analysts Limited. We look forward to assisting you again.

Authorised By: Shane Reynolds
Laboratory Manager

Authorised Date: 1 September 2017

Notes:

Results relate only to the items tested.
Information on methods of analysis and performance characteristics is available on request.
Any opinions or interpretations indicated are outside the scope of our INAB accreditation.
This test report shall not be reproduced except in full or with written approval of City Analysts Limited.

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-32468

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Raw

Sample Type: Surface

Lab Reference Number: 368900

Date of Sampling: 14/08/2017

Date Sample Received: 14/08/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	15/08/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	28/08/2017	Iron	< 10.0	ug/l	-
S/S3244#	15/08/2017	Aluminium	< 10.0	ug/l	-
S/S3244#	28/08/2017	Manganese	< 1.0	ug/l	-
S/S1041#	14/08/2017	PH	6.94	pH Unit	-
S/S3224#	30/08/2017	Total Organic Carbon	0.590	mg/l	-
S/S3054#	14/08/2017	Turbidity	< 0.10	NTU	-

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited,
Pigeon House Road,
Ringsend,
Dublin 4.

Tel: (01) 613 6003
Fax: (01) 613 6008

Email:
reports@cityanalysts.ie

www.cityanalysts.ie

Certificate Of Analysis

Customer

John Fox

Glan Aqua Ltd
Railway House
Station Road
Loughrea
Co Galway
H62 VN56

Report Reference: 17-32468

Report Version: 1

Site: Kilconierin

Sample Description: Kilconierin Treated

Sample Type: Treated

Lab Reference Number: 368901

Date of Sampling: 14/08/2017

Date Sample Received: 14/08/2017

Site / Method Ref.	Analysis Start Date	Parameter	Result	Units	PV Value (Drinking Water Only)
S/S3010#	15/08/2017	Colour Apparent	< 5.00	Hazen	-
S/S3244#	28/08/2017	Iron	< 10.0	ug/l	<= 200.0
S/S3244#	15/08/2017	Aluminium	115	ug/l	<= 200.0
S/S3244#	28/08/2017	Manganese	< 1.0	ug/l	<= 50.0
S/S1041#	14/08/2017	PH	6.93	pH Unit	6.50 - 9.50
S/S3224#	30/08/2017	Total Organic Carbon	0.600	mg/l	NAC & ATC
S/S3054#	14/08/2017	Turbidity	< 0.10	NTU	NAC & ATC
S/S1214#	14/08/2017	Clostridium perfringens	< 1	cfu/100ml	<= 0
S/S1201#	14/08/2017	Coliforms	< 1.0	MPN/100ml	<= 0.0
S/S1201#	14/08/2017	E.coli	< 1.0	MPN/100ml	<= 0.0

= INAB Accredited, U = UKAS Accredited, * = Subcontracted

Note:
PV Value is the parametric value, taken from European Communities, (Drinking Water) Regulations, 2014. S.I. No. 122 of 2014 and relates only to drinking water samples.
For queries on results, please contact us within two weeks of the report date to ensure that we can accommodate your query as samples cannot be stored indefinitely.
NAC & ATC - No abnormal change and acceptable to customers.
TVC - Total viable count
Site D = Analysed at City Analysts Dublin. Site S = Analysed at City Analysts Shannon

City Analysts Limited
Environmental Laboratories

Report Reference: 17-32468

Report Version: 1

Raw Data

Raw data has been provided with this Certificate of Analysis as it has been specifically requested by you. Please note that raw data results are Not Accredited. Raw data can be provided only for analysis carried out in-house.

Lab Reference Number:	Parameter	Result	Units	Site / Method Ref.
368900	Colour Apparent	0	Hazen	S/S3010
368900	Iron	3.88782	ug/l	S/S3244
368900	Aluminium	7.8264	ug/l	S/S3244
368900	Manganese	0.810192	ug/l	S/S3244
368900	PH	6.94	pH Unit	S/S1041
368900	Total Organic Carbon	0.59	mg/l	S/S3224
368900	Turbidity	0.02	NTU	S/S3054
368901	Colour Apparent	0	Hazen	S/S3010
368901	Iron	7.54923	ug/l	S/S3244
368901	Aluminium	115.1017	ug/l	S/S3244
368901	Manganese	0.74565	ug/l	S/S3244
368901	PH	6.93	pH Unit	S/S1041
368901	Total Organic Carbon	0.6	mg/l	S/S3224
368901	Turbidity	0.07	NTU	S/S3054
368901	Clostridium perfringens	0	cfu/100ml	S/S1214
368901	Coliforms	0	MPN/100ml	S/S1201
368901	E.coli	0	MPN/100ml	S/S1201

Appendix 4

Acronyms and Glossary

Acronyms

EPA – Environmental Protection Agency
DEHLG – Department of Environment Heritage and Local Government
EU – European Union
GSI – Geological Survey of Ireland
GWB – Groundwater Body
GWD – Groundwater Directive (European Union)
GWS – Group Water Scheme
IGI – Institute of Geologists of Ireland
IG – Irish National Grid Reference
m aOD – metres above Ordnance Datum
m bgl – metres below ground level
TVs – Threshold Values
UV – Ultra-Violet
ZOC – Zone of Contribution
WFD – Water Framework Directive

Glossary of Terms

Aquifer
A subsurface layer or layers of rock, or other geological strata, of sufficient porosity and permeability to allow either a significant flow of groundwater or the abstraction of significant quantities of groundwater (Groundwater Regulations, 2010).

Attenuation
A decrease in pollutant concentrations, flux, or toxicity as a function of physical, chemical and/or biological processes, individually or in combination, in the subsurface environment.

Borehole
A particular type of well - a narrow hole in the ground constructed by a drilling machine in order to gain access to the groundwater system.

Boulder Clay
See 'Till'

Conceptual Hydrogeological Model
A simplified representation or working description of how a real hydrogeological system is believed to behave on the basis of qualitative analysis of desk study information, field observations and field data.

Diffuse Sources
Diffuse sources of pollution are spread over wider geographical areas rather than at individual point locations. Diffuse sources include general land use activities and landspreading of industrial, municipal wastes and agricultural organic and inorganic fertilisers.

Direct Input
An input to groundwater that bypasses the unsaturated zone (e.g. direct injection through a borehole) or is directly in contact with the groundwater table in an aquifer either year round or seasonally.

Doline
Dolines, or enclosed depressions, are relatively shallow bowl or funnel shaped depressions that form in karst landscapes, and serve to funnel or concentrate recharge underground. Their presence indicates that subterranean drainage is in operation.

Dolomitisation
Is a process, whereby the calcite crystals in limestone is replaced by magnesium. This results in an increase in the porosity and permeability of the rock. Dolomitised rocks are a highly weathered, yellow/orange/brown colour and are usually evident in boreholes as loose yellow-brown sand with significant void space and poor core recovery. Dolomitisation often occurs preferentially in both fault zones and purer limestones.

Down-gradient
The direction of decreasing groundwater levels, i.e. flow direction. The area of the groundwater system that has lower groundwater levels than other areas. Opposite of upgradient.

Enclosed Depression
See doline

Fissure
A natural crack in rock which allows rapid water movement.

Groundwater
All water which is below the surface of the ground in the saturation zone and in direct contact with the ground or subsoil (Groundwater Regulations, 2010).

Groundwater Body (GWB)
A volume of groundwater defined as a groundwater management unit for the purposes of reporting to the European Commission under the Water Framework Directive. Groundwater bodies are defined by aquifers capable of providing more than 10 m_3/d, on average, or serving more than 50 persons.

Groundwater Recharge
Two definitions: a) the process of rainwater or surface water infiltrating to the groundwater table; b) the volume (amount) of water added to a groundwater system.

Groundwater Resource
An aquifer capable of providing a groundwater supply of more than 10 m_3/d as an average or serving more than 50 persons.

Hydraulic Conductivity (also known as 'Permeability')
The rate at which water can move through a unit volume of geological medium under a potential unit hydraulic gradient. The hydraulic conductivity can be influenced by the properties of the fluid, including its density, viscosity and temperature, as well as by the properties of the soil or rock.

Hydraulic Gradient
The change in total head of water with distance; the slope of the groundwater table or the piezometric surface.

Igneous Rock
Igneous rock is formed through the cooling and solidification of magma or lava.

Indirect Input
An input to groundwater where the pollutants infiltrate through soil, subsoil and/or bedrock to the groundwater table.

Input
The direct or indirect introduction of pollutants into groundwater as a result of human activity.

Karst
A distinctive landform characterised by features such as surface collapses, sinking streams, swallow holes, caves, turloughs and dry valleys, and a distinctive groundwater flow regime where drainage is largely underground in solutionally enlarged fissures and conduits.

Karstification
Karstification is the process whereby limestones are slowly dissolved by acidic waters moving through them. This results in the development of an uneven distribution of permeability with the enlargement of certain fissures at the expense of others and the concentration of water flow into these high permeability zones. Karstification results in the progressive development of distinctive karst landforms such as caves, swallow holes, sinking streams, turloughs and dry valleys, and a distinctive groundwater flow regime. It is an important feature of Irish hydrogeology.

Metamorphic Rock
A rock made out of highly altered existing rock. Common types include marble, schist and quartzite.

Pathway
The route which a particle of water and/or chemical or biological substance takes through the environment from a source to a receptor location. Pathways are determined by natural hydrogeological characteristics and the nature of the contaminant, but can also be influenced by the presence of features resulting from human activities (e.g., abandoned ungrouted boreholes which can direct surface water and associated pollutants preferentially to groundwater).

Permeability
A measure of a soil or rock's ability or capacity to transmit water (synonymous with hydraulic conductivity).

Point Source
Any discernible, confined or discrete conveyance from which pollutants are or may be discharged. These may exist in the form of pipes, ditches, channels, tunnels, conduits, containers, and sheds, or may exist as distinct percolation areas, integrated constructed wetlands, or other surface application of pollutants at individual locations. Examples are discharges from waste water works and effluent discharges from industry.

Pollution
The direct or indirect introduction, as a result of human activity, of substances or heat into the air, water or land which may be harmful to human health or the quality of aquatic ecosystems or terrestrial ecosystems directly depending on aquatic ecosystems which result in damage to material property, or which impair or interfere with amenities and other legitimate uses of the environment (Groundwater Regulations, 2010).

Poorly Productive Aquifers (PPAs)
Low-yielding bedrock aquifers that are generally not regarded as important sources of water for public water supply but that nonetheless may be important in terms of providing domestic and small community water supplies and of delivering water and associated pollutants to rivers and lakes via shallow groundwater pathways.

Preferential Flow
A term used to describe water movement along favoured pathways through a geological medium, bypassing other parts of the medium. Examples include pores formed by soil fauna, plant root channels, weathering cracks, fissures and/or fractures.

Saturated Zone
The zone below the water table in an aquifer in which all pores and fissures and fractures are filled with water at a pressure that is greater than atmospheric.

Sedimentary Rock
A rock composed of sediments (sand, silt, clay, calcium carbonate fragments, shell fragments, etc.) that have been buried and lithified (cemented). Common types include sandstone, shale and limestone.

Soil (topsoil)
The uppermost layer of soil in which plants grow.

Spring
A spring is a natural feature where groundwater emerges at the surface. Springs usually occur where the rate of flow of groundwater is too great to remain underground. The position of a spring usually reflects a change in soil or rock type, or a change in slope.

Subsoil
Unlithified (uncemented) geological strata or materials beneath the topsoil and above bedrock. Common types include Till/Boulder Clay, sand/gravel and peat.

Surface Water
An element of water on the land's surface such as a lake, reservoir, stream, river or canal. Can also be part of transitional or coastal waters. (Surface Waters Regulations, 2009.).

Swallow Hole (also known as 'Sinkhole')
The point where concentrated inflows of water sink underground. They are found in karst environments.

Threshold Values (TVs)
Chemical concentration values for substances listed in Schedule 5 of the Groundwater Regulations (2010), which are used for the purpose of chemical status classification of groundwater bodies.

Till (also known as 'Boulder Clay')
Unsorted glacial Sediment deposited directly by the glacier. It is the most common Quaternary deposit in Ireland. Its components may vary from gravel, sands and clays.

Unsaturated Zone
The zone between the land surface and the water table, in which pores, fractures and fissures are only partially filled with water. Also known as the vadose zone.

Up-gradient
The direction of increasing groundwater levels, i.e. the direction from which groundwater is flowing. The area of the groundwater system that has higher groundwater levels than other areas. Opposite of down-gradient.

Vulnerability
The intrinsic geological and hydrogeological characteristics that determine the ease with which groundwater may be contaminated by human activities (Fitzsimmons et al, 2003).

Water Table
The uppermost level of saturation in an aquifer at which the pressure is atmospheric. This is the level to which water naturally settles in the cracks, cavities and pore spaces underground. Above the water table, the spaces in the rock or sediments are air-filled. Below the water table, the spaces are filled with water.

Weathering
The breakdown of rocks and minerals at the earth's surface by chemical and physical processes.

Well
A construction into the ground in order to access groundwater. Can be a dug well, which is generally shallow, with a diameter of a metre of more, or a borewell (see 'Borehole'), which is narrower in diameter and generally deeper.

Zone of Contribution (ZOC)
The area surrounding a pumped well or spring that encompasses all areas or features that supply groundwater to the well or spring. It is defined as the area required to support an abstraction and/or overflow (in the case of springs) from long-term groundwater recharge.

Appendix 5

ZOC Boundary Calculations

The area, downgradient boundary and zone of contribution width calculations are used to support the deliniated boundary extents and to confirm that the ZOC delineated is big enough to supply the quantity of water at the source.

The area of the zone of contribution is calculated using the following equation:

$$A = Q/R$$

Q = pumping rate (m^3/day)

R = recharge rate (mm/yr)

Q = 376.8 m^3/day x 150%= 565.2 m^3/day

R = 491 mm/yr = 0.0013 m/d.

A = Q / R

A = 565.2 / 0.0013 = 420,159 m^2 = 0.42 km^2

The downgradient boundary (Xl) and zone of contribution width boundary (Yl) are calculated using the following equations:

$$Xl = Q/(2\pi Ti) \qquad Yl = Q/(2Ti)$$

Q = pumping rate (m^3/day) = 376.8 m^3/day

T = Transmissitivity[7] (m^2/day) = 100 (m^2/day)

i = hydraulic gradient – estimated based on topographic contours and noted datum locations on OSI map = 0.016.

Xl = 376.8 / (2π x 100 x 0.016)

Xl = 37.69 m ≈ 0.04 km

Yl = 376.8 / (2 x 100 x 0.016)

Yl = 118.41 m ≈ 0.12 km

[7] value taken from Clarinbirdge Groundwater Body Description