


LEGEND


- Em Fitting LED Self-Test
- Bulkhead LED Self-Test
- EXT EM External Bulkhead IP68 Rated LED Self-Test
- Exit Sign LED Self-Test
- Twin Spot LED Self-Test

NOTES

- ATS Type PERC (All Self test fittings - Automatic testing & reporting, 24hr luminaire monitoring)
- ATS locations to be agreeded on site
- Installation to comply with IS3217:2023
- Fire-stopping of all opes is the responsibility of main contractor

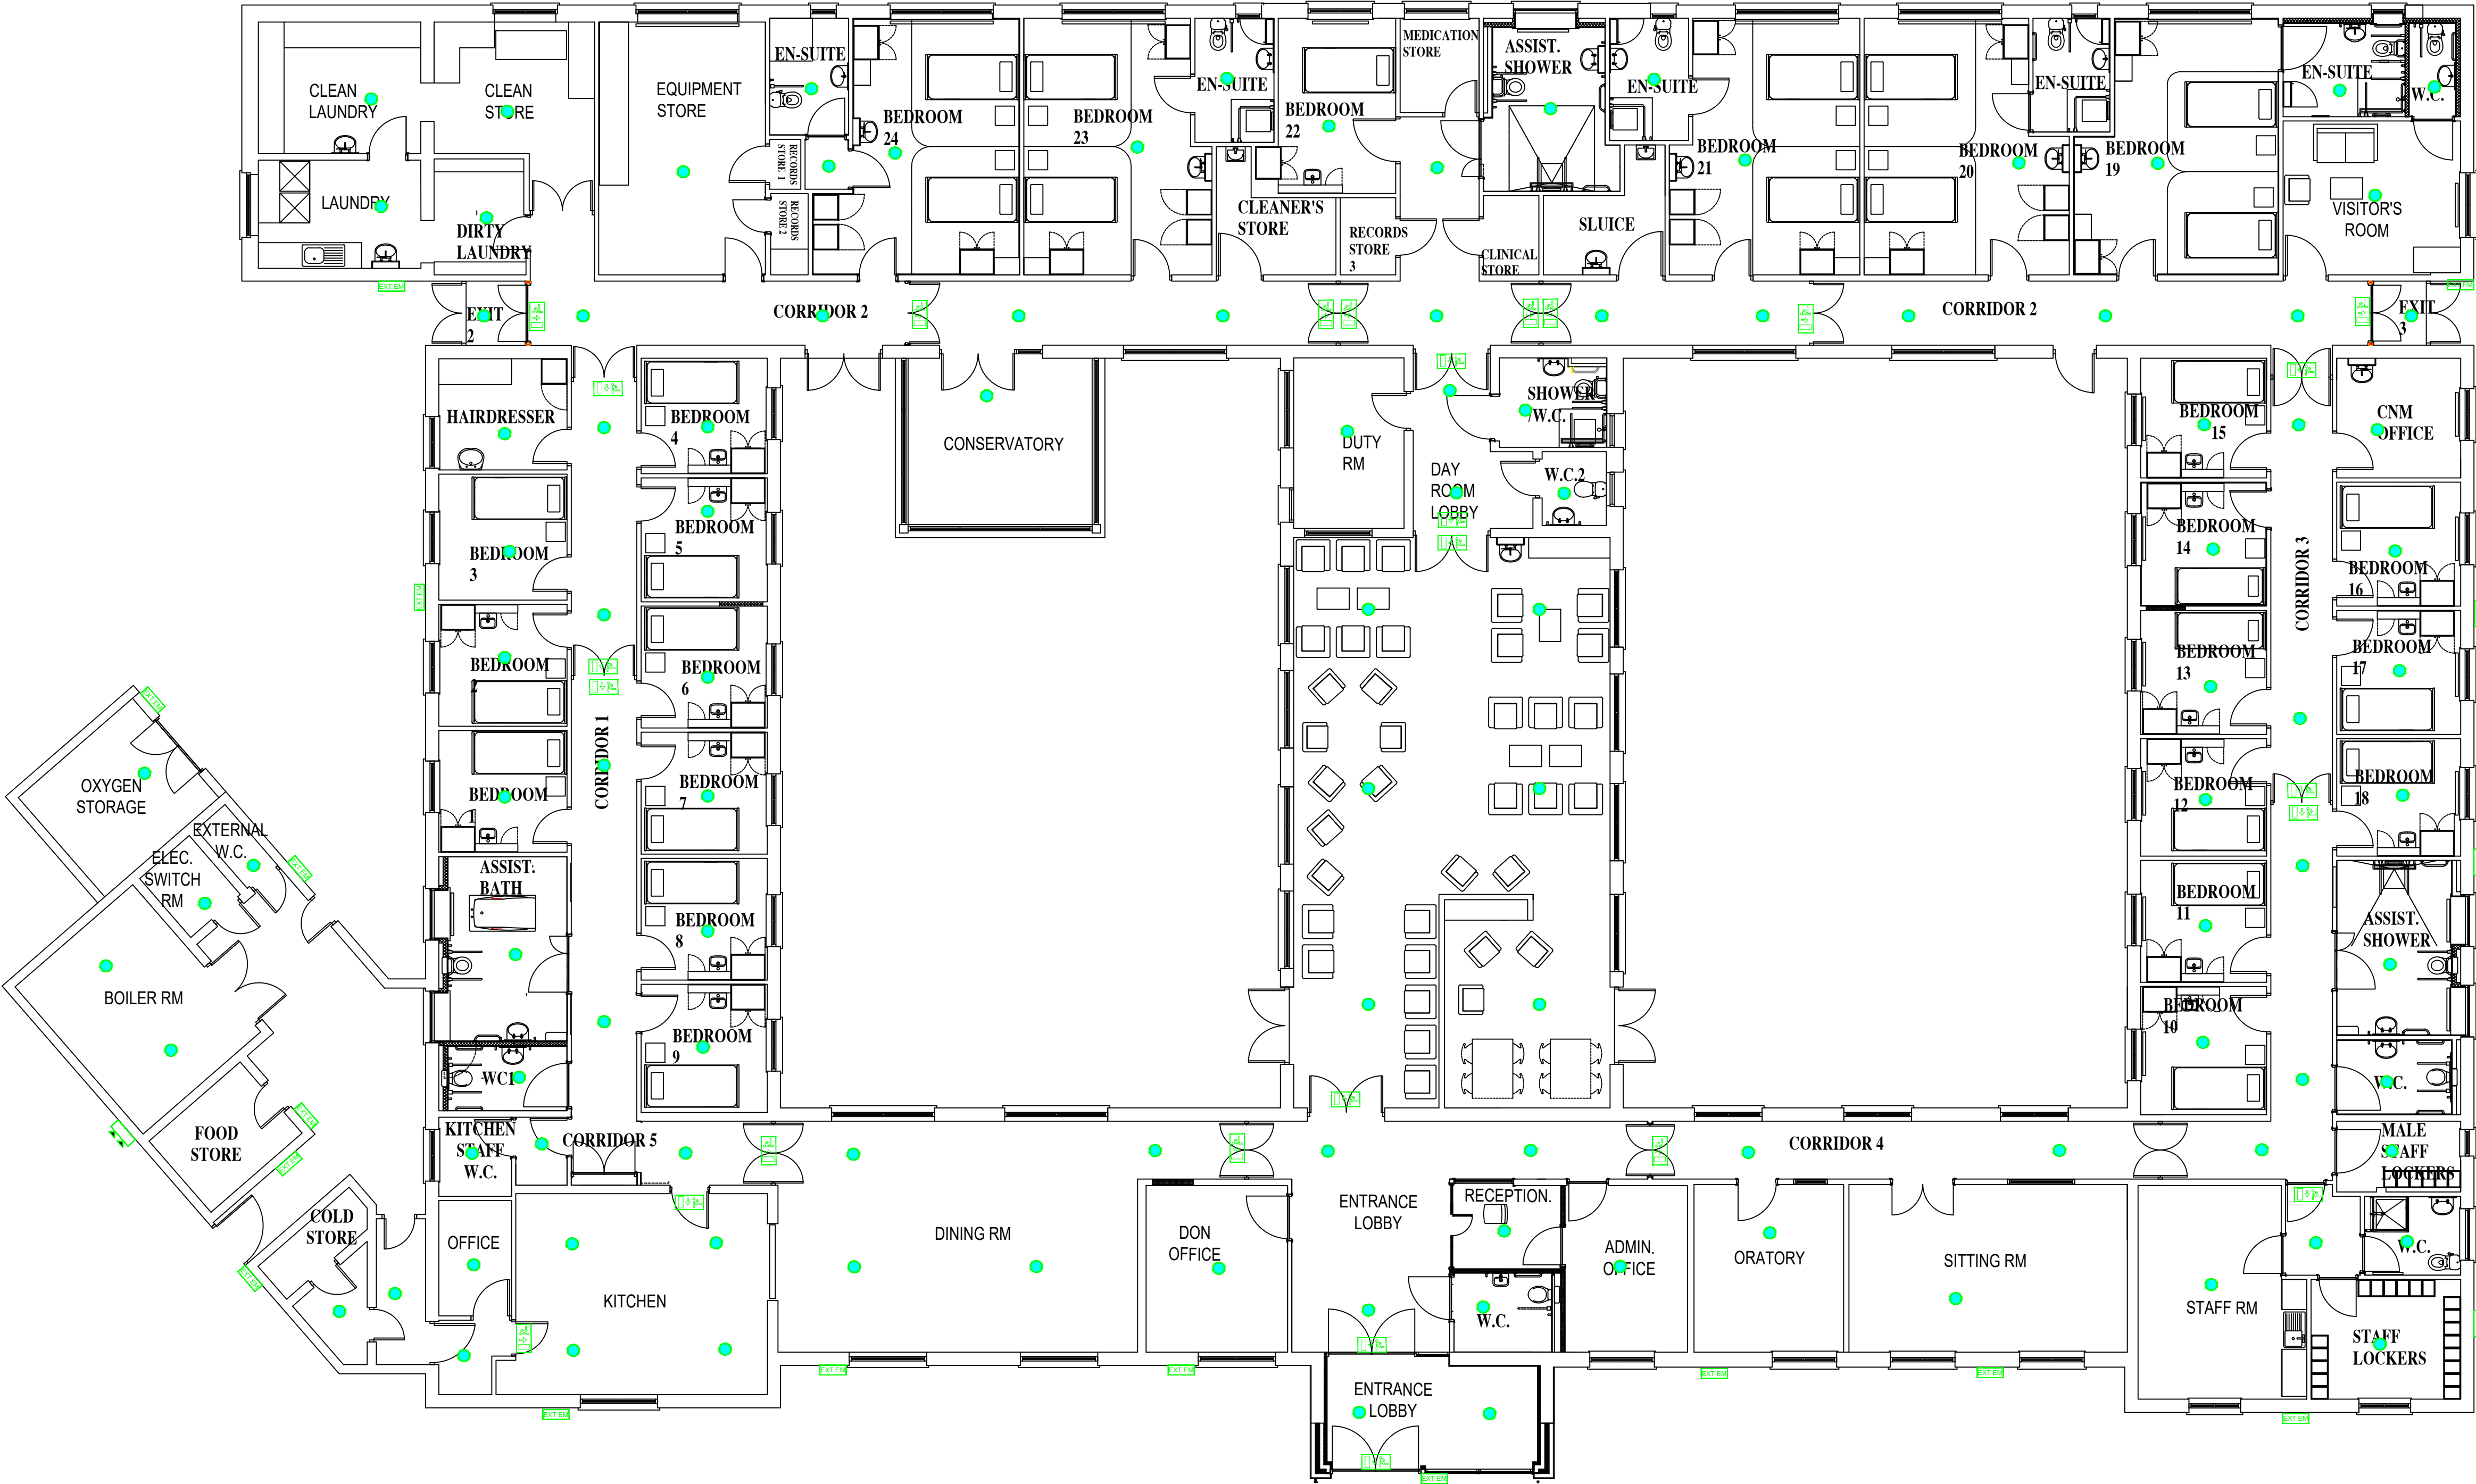

REV. NO.	DATE	COMMENT	TITLE
			McBride MHU Westport
			CLIENT: HSE
			PROJ. NO. TFS-HSE-MBMHU-001
			ROOM: GROUND
			DRAWN: R.D. SCALE: NTS
			CHECKED: G.D. DATE: 18/10/2026
			PROJECT: Emergency Escape Lighting



Titan Fire Safety Ltd. Dun Eimear, Drogheda, Co. Louth
Tel: 085 151 9509
Email: ray@titanfiresafety.ie

Titan Fire Safety Ltd.