



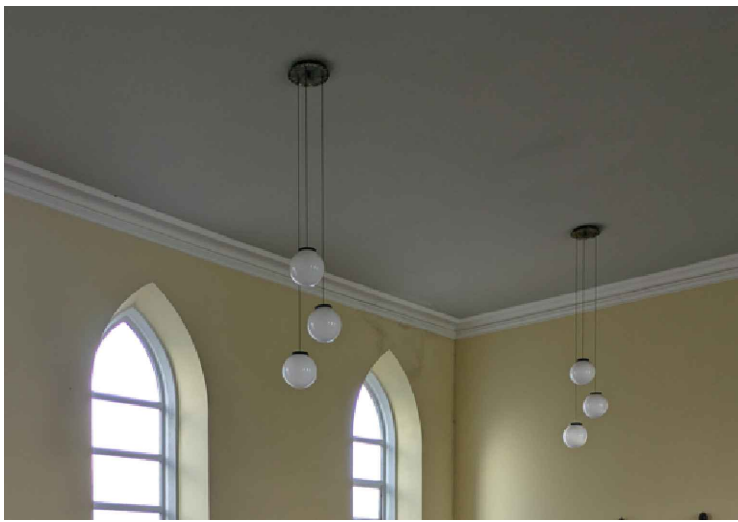


IMAGE OF CEILING SUSPENDED DECORATIVE LIGHTS REF 'EX1'



IMAGE OF CEILING SUSPENDED DECORATIVE LIGHTS REF 'EX2'

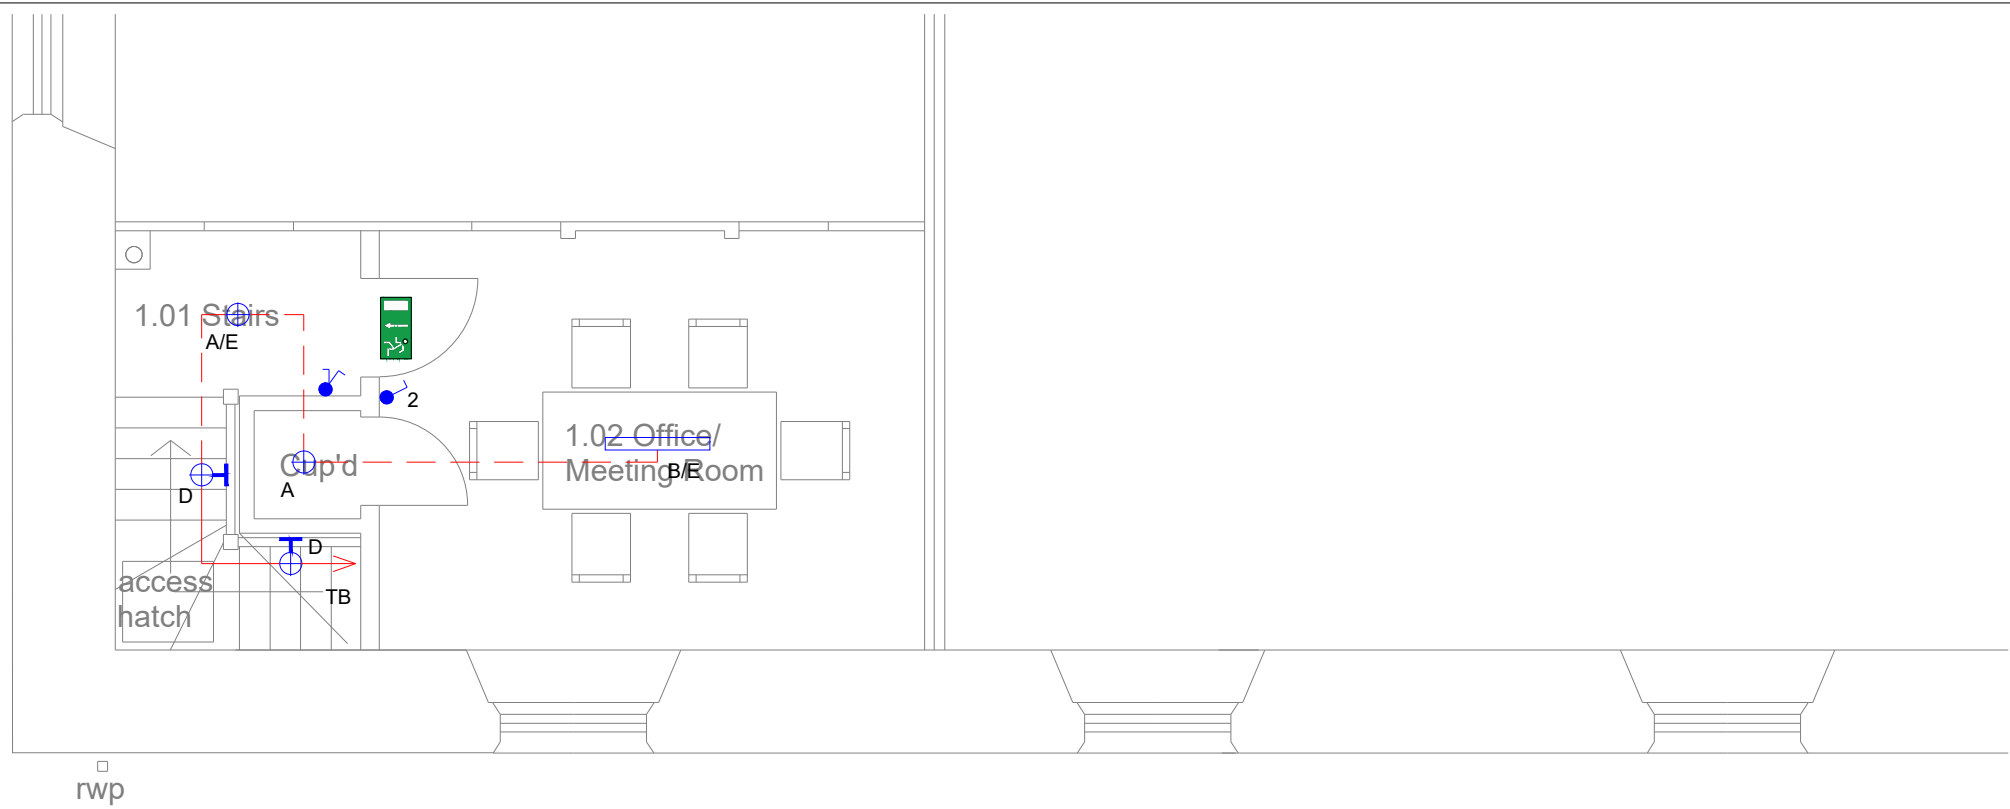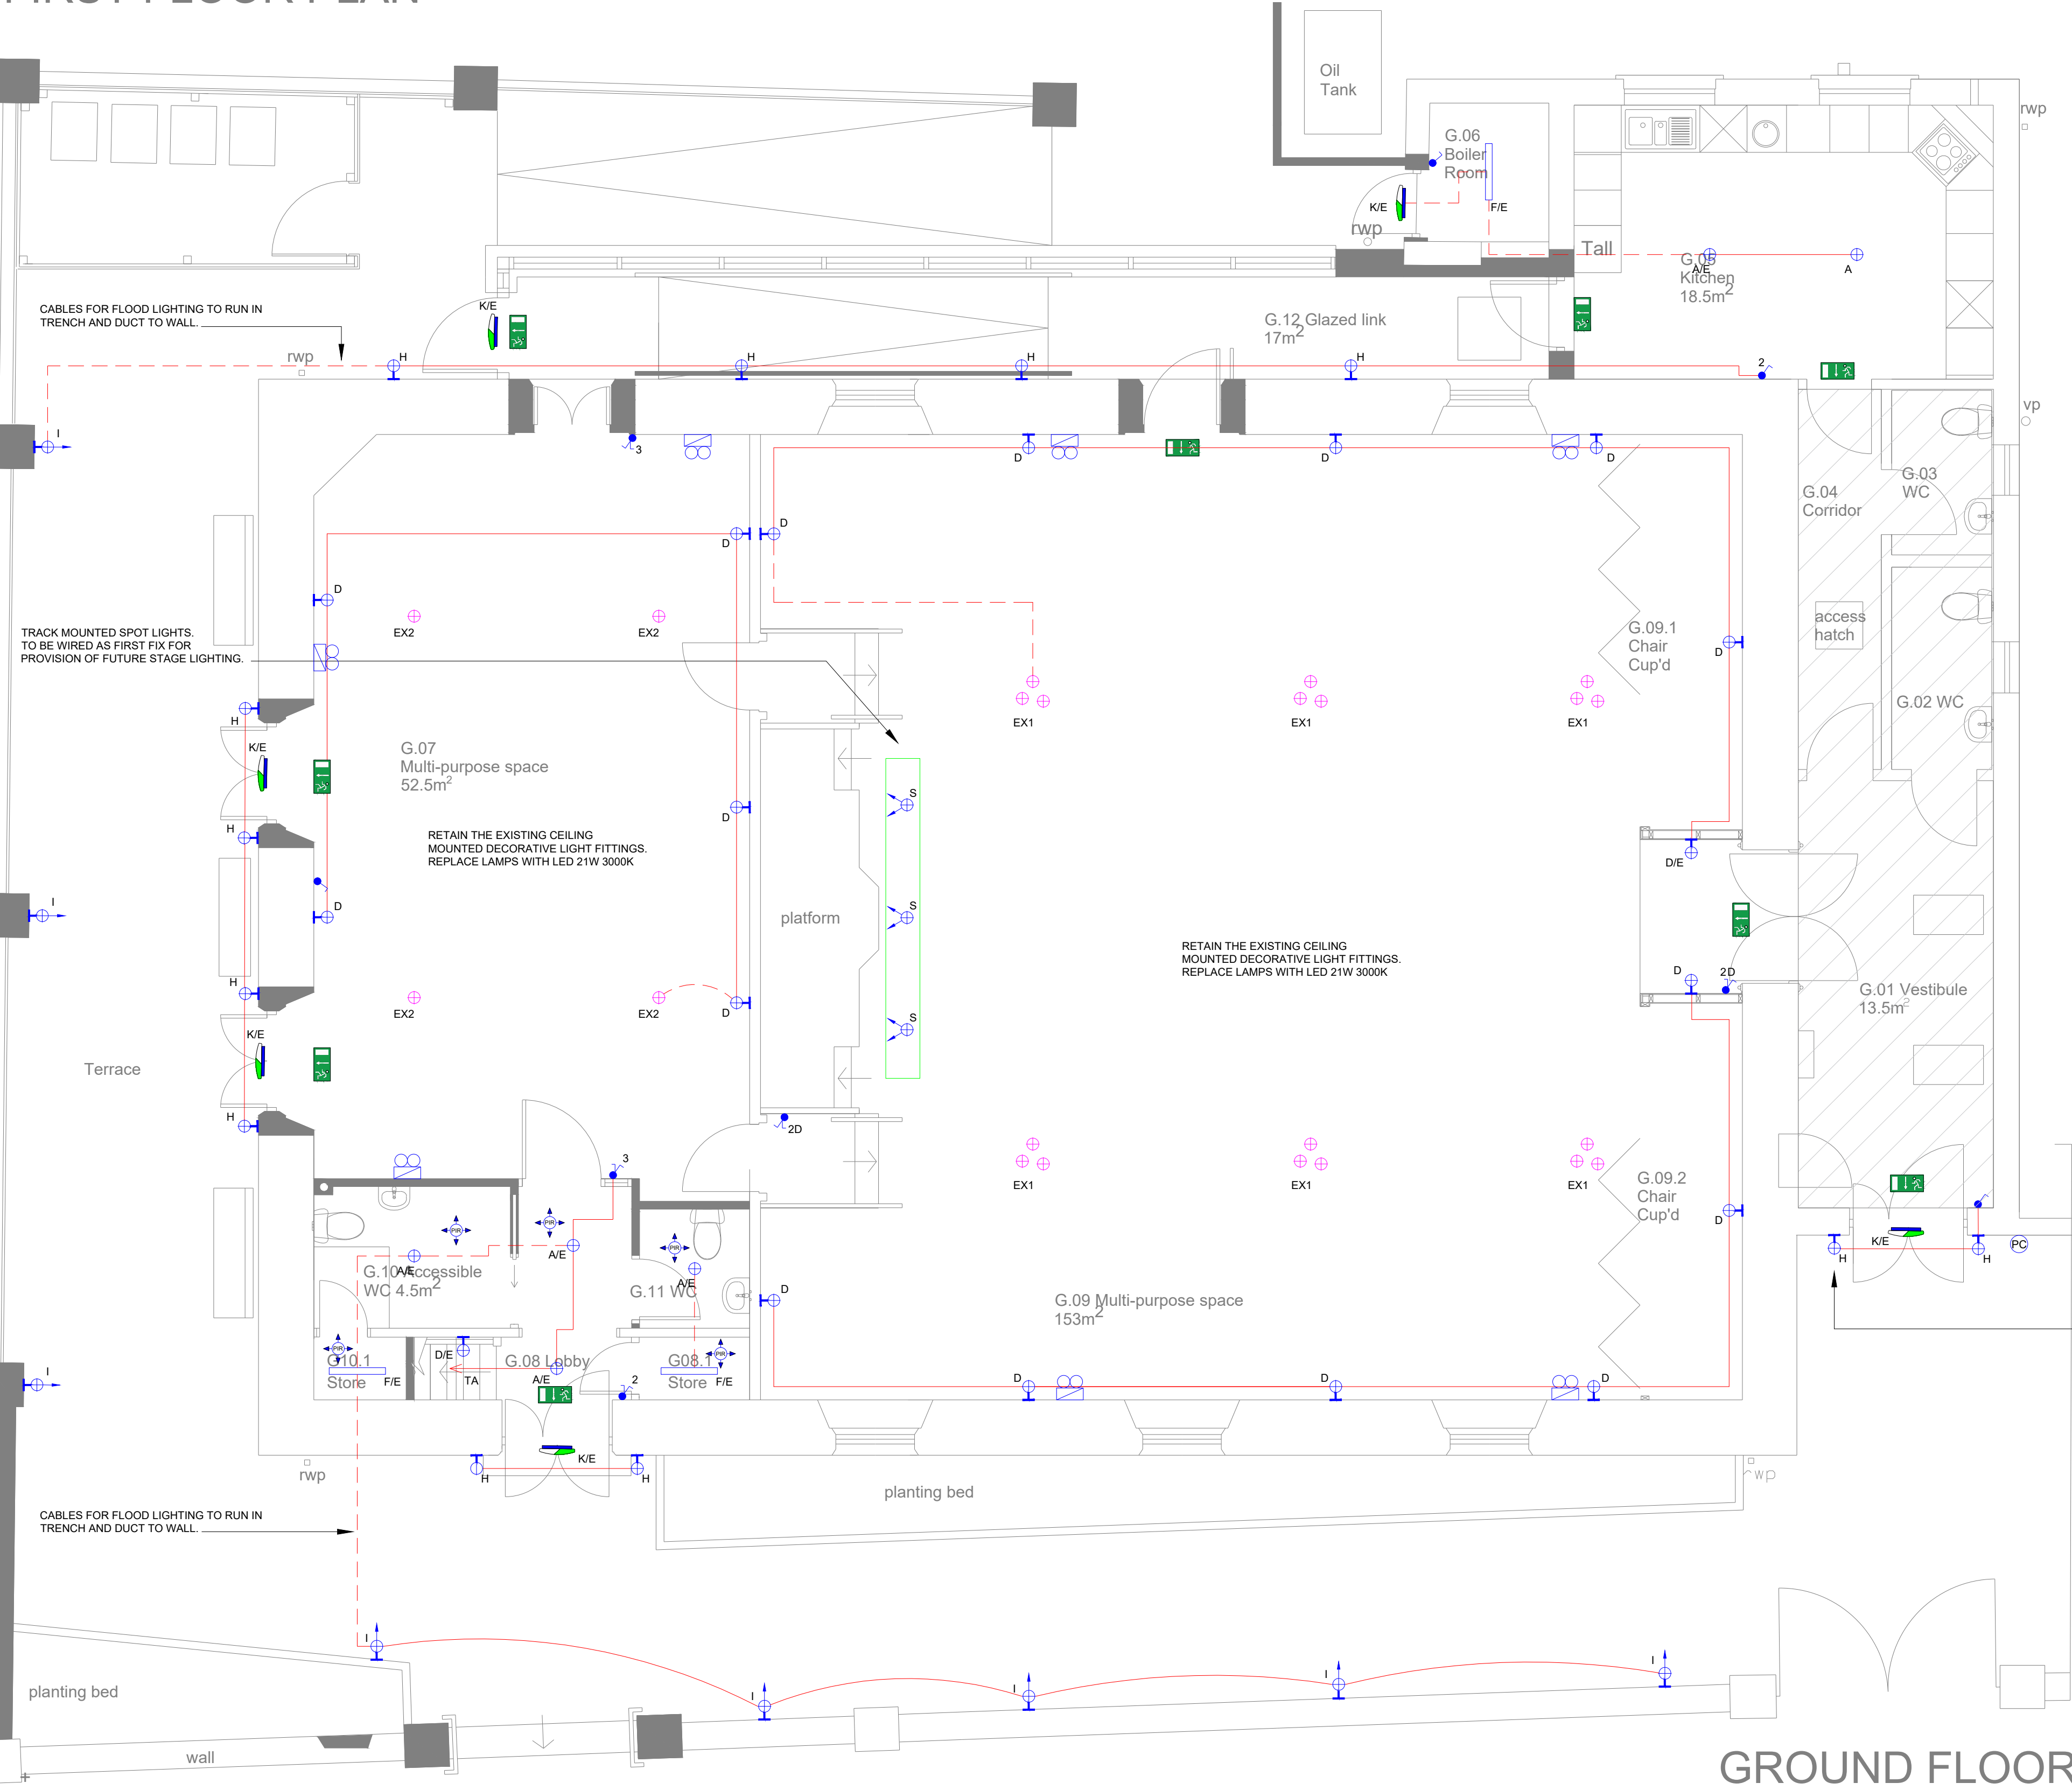

- LIGHTING LEGEND:
REFER TO LIGHTING SCHEDULE WITH ELECTRICAL SPECIFICATION FOR FULL DETAILS OF LIGHT FITTINGS
- CIRCULAR MOUNTED FITTING
 - FEATURE WALL LIGHT
 - TRACK MOUNTED SPOTLIGHT
 - CEILING MOUNTED LINEAR FITTING
 - CEILING MOUNT MOVEMENT & ACOUSTIC LIGHTING CONTROL 360° COVERAGE
 - SURFACE MOUNTED FLOOD LIGHT
 - LED STRIP LIGHTING C/W DRIVERS
 - 1 GANG 1 WAY LIGHT SWITCH
 - 2 GANG PLUS GRID SWITCH
 - 2 GANG 1 WAY LIGHT SWITCH
 - 1 GANG 2 WAY LIGHT SWITCH
 - 2 GANG 1 WAY DIMMER LIGHT SWITCH
 - CEILING MOUNTED 1 WAY PULL CORD SWITCH
 - DIMMER SWITCH
 - INDICATES WEATHER RESISTANT
 - INDICATES PHOTOCELL
 - FITTINGS ON SAME CIRCUIT AND SWITCH
 - FITTINGS ON SAME CIRCUIT SWITCHED SEPERATE

- EMERGENCY LIGHTING LEGEND:
- INDICATES MAINTAINED EXIT SIGN
 - E1 INDICATES MAINTAINED LED EMERGENCY LIGHT C/W OPEN AREA LENS
 - E2 INDICATES MAINTAINED LED EMERGENCY LIGHT C/W ESCAPE ROUTE LENS HIGH OUTPUT TYPE
 - INDICATES COMBINED GENERAL / EMERGENCY LIGHT FITTING WALL MOUNTED
 - X/E DENOTES LIGHT FITTING C/W EMERGENCY
 - IP65 RATED TWIN EMERGENCY SPOT LIGHT

ALL DIMENSIONS SCALED OR OTHERWISE ARE NOMINAL ONLY AND ALL SHOULD BE CHECKED ON SITE PRIOR TO ANY WORK.

GENERAL NOTES

THE COMPLETE ELECTRICAL SERVICES INSTALLATION SHALL BE PROVIDED & INSTALLED IN ACCORDANCE WITH THE CURRENT NATIONAL RULES FOR ELECTRICAL INSTALLATIONS AS PUBLISHED BY THE ELECTRO TECHNICAL COUNCIL OF IRELAND AND RELEVANT IRISH STANDARDS.

LIGHTING NOTES

- THE EXACT POSITIONING & SETTING OUT OF ALL LUMINAIRES SHALL BE CLARIFIED WITH THE CONSULTING ENGINEER PRIOR TO THE COMMENCEMENT OF ALL ASSOCIATED WORKS.
- MOUNTING HEIGHTS OF ALL ELECTRICAL ACCESSORIES SHALL COMPLY WITH THE REQUIREMENTS OF TECHNICAL GUIDANCE DOCUMENT M ACCESS TO AND USE OF BUILDINGS AS PUBLISHED BY THE DEPARTMENT RESPONSIBLE FOR BUILDING REGULATIONS IN IRELAND.
- ELECTRICAL CONTRACTOR TO ENSURE THAT ALL SWITCHES AND ELECTRICAL OUTLET POINTS ARE NOT POSITIONED BACK TO BACK IN PARTY WALLS TO MAINTAIN ACOUSTIC INTEGRITY.
- ELECTRICAL CONTRACTOR SHALL CO ORDINATE THE PROPOSED LOCATION OF LIGHT SWITCHES WITH OTHER TRADES TO AVOID CONFLICTS AND TO ENSURE ADEQUATE PROVISION FOR THE EQUIPMENT.
- ELECTRICAL CONTRACTOR SHALL ENSURE THAT LIGHT SWITCHES, SOCKETS AND ACCESSORIES ARE NOT POSITIONED BACK TO BACK IN PARTY WALLS TO ENSURE ACOUSTIC INTEGRITY.
- WHERE VISUAL CONTRAST IS REQUIRED, COMPLY WITH THE GUIDANCE IN TECHNICAL GUIDANCE DOCUMENT M FOR CONTRAST AND ACCESSIBILITY. A SUITABLE DIFFERENCE IN LIGHT REFLECTANCE VALUE SHALL BE PROVIDED TO ACHIEVE REASONABLE VISUAL CONTRAST. LIGHT SWITCHES SHOULD BE WIDE ROCKER TYPE UNITS SUITABLE FOR ACCESSIBLE USE.
- LIGHTING CIRCUITS TO BE WIRED BACK TO THE APPROPRIATE DISTRIBUTION BOARD AND PROTECTED BY 2.5MM SQ CABLES FROM 10AMP TYPE C RCBO WHERE INDICATED. EMERGENCY LIGHTING SHALL COMPLY WITH IRISH STANDARD IS 5217 (EMERGENCY LIGHTING) AND ANY RELEVANT NATIONAL GUIDANCE.
- EXACT POSITION OF ALL FITTINGS TO BE AGREED ON SITE WITH THE CONSULTING ENGINEER.

ADDITIONAL NOTE

ALL WORKS SHALL ALSO COMPLY WITH ANY LOCAL AUTHORITY REQUIREMENTS, HEALTH AND SAFETY LEGISLATION, AND THE LATEST EDITIONS OF REFERENCED IRISH STANDARDS AND NATIONAL RULES.

T2	16.06.26	TENDER ISSUE REVISED	TM	RC
T1	09.06.26	TENDER ISSUE	TM	RC
REV	DATE	DESCRIPTION	ENG	APP

Client:
MILFORD & DISTRICT RESOURCE CENTRE

Architect:
DEDALUS ARCHITECTURE

Project:
REFURBISHMENT OF THE GALLOWGLASS COMMUNITY CENTRE, MILFORD

Service:
ELECTRICAL

Drawing Status:
TENDER

DMAC
Consulting Engineers Ltd

Glenturas House
18 Beraghmore Road, Derry
BT48 8SE

t: (028) 7127 7846
e: info@dmac-ce.com
w: www.dmac-ce.com

Title:
PROPOSED GROUND & FIRST FLOOR
PHASE 2 & 3
GENERAL & EMERGENCY LIGHTING
INSTALLATION

Scale(s): 1:50@A1 Date: SEPT 2025

Eng / CAD: TM Checked: RC

Project Origin Zone Level Type Number Rev.
2361-DMAC-XX-00-PL-E101 T2