


FIRST FLOOR PLAN

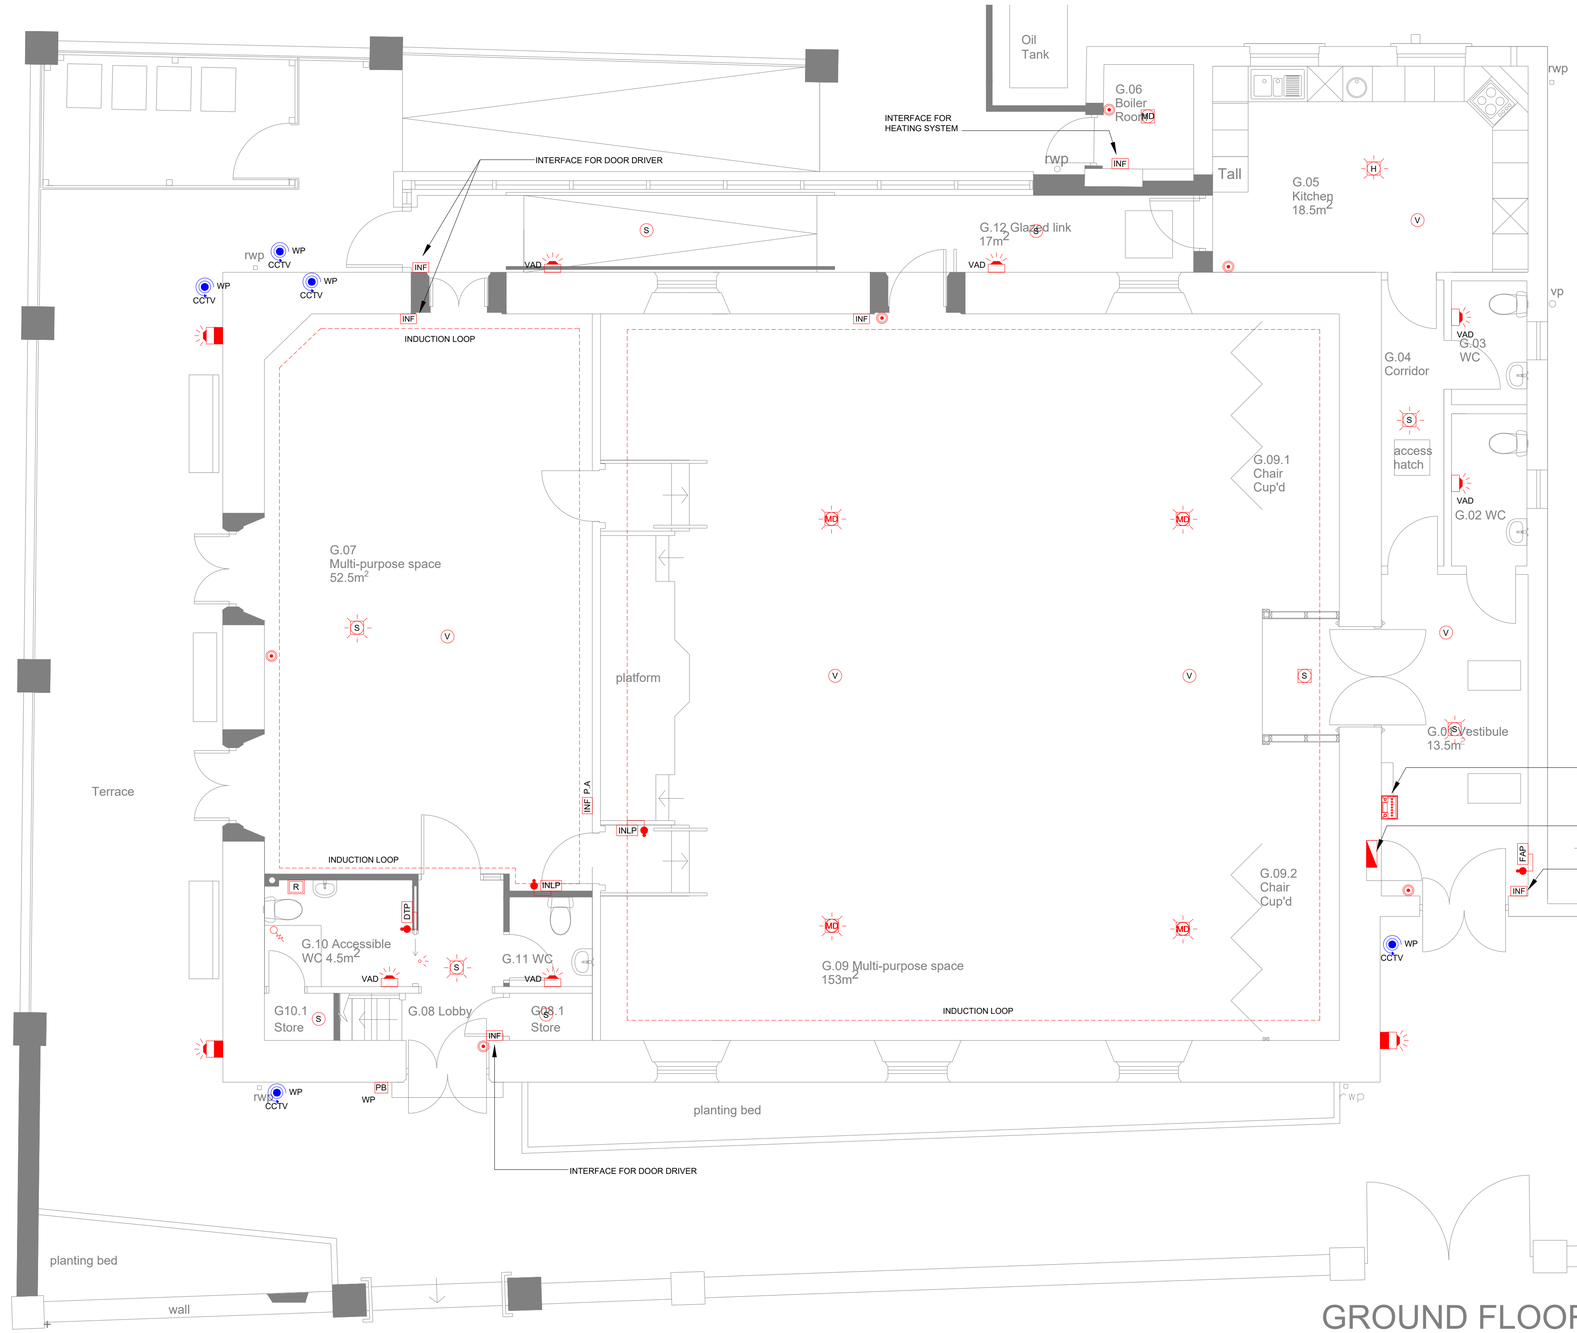

PATH:

FIRE ALARM LEGEND:

FAP	MAIN FIRE ALARM PANEL & ISOLATING SWITCH
S	SMOKE DETECTOR
V	VOID DETECTOR (VOID HEIGHT OVER 800MM)
S	SMOKE DETECTOR C/W SOUNDER BASE
S	SMOKE DETECTOR C/W SOUNDER BASE & FLASHING BEACON
H	HEAT DETECTOR C/W SOUNDER BASE & FLASHING BEACON
MD	MULTI-DETECTOR C/W SOUNDER BASE & FLASHING BEACON
MD	MULTI-DETECTOR C/W SOUNDER BASE
INF	INPUT/OUTPUT INTERFACE UNIT
	EXTERNAL FIRE SOUNDER/BEACON (IP65)
	INTERNAL FIRE SOUNDER/BEACON (SOUND LEVEL DECREASED)
	ADDRESSABLE BREAK GLASS C/W HINGED COVER.
INLP	INDUCTION LOOP PANEL AND POWER SUPPLY.

CCTV LEGEND:

MON	COLOUR CCTV MONITOR
WP	WEATHER PROOF
X CCTV	DOME CAMERA C/W WIRE GUARD (X INDICATES CAMERA NO.) DUAL DENOTES DUAL CAMERA

DISABLED REFUGE/ DISABLED TOILET LEGEND:

R	DISABLED TOILET ALARM RESET / REASSURANCE BUTTON
	DISABLED TOILET PULL CORD
	DISABLED TOILET ALARM OVER DOOR INDICATOR / SOUNDER
DTP	DISABLED TOILET ALARM PANEL
PB	PUSH TO OPEN BUTTON

ALL DIMENSIONS SCALED OR OTHERWISE ARE NOMINAL ONLY AND ALL SHOULD BE CHECKED ON SITE PRIOR TO ANY WORK.

GENERAL NOTES

1. ELECTRICAL INSTALLATION TO BE CARRIED OUT TO CURRENT EDITION IS10101
2. CCTV CAMERAS TO BE WIRED IN CAT6A CABLES IN HIGH IMPACT PVC CONDUIT CONDUIT.
3. FIRE ALARM TO BE DESIGNED, INSTALLED AND COMMISSIONED TO CURRENT EDITION OF IS 3218 AS PER NATIONAL STANDARDS AUTHORITY of IRELAND.
4. CCTV SYSTEM TO BE UPGRADED FOR NEW CCTV CAMERAS AS INDICATED.
5. INTRUDER ALARM DESIGN, TESTING AND COMMISSIONING CERTIFICATES TO BE HANDED OVER TO CLIENT AT COMPLETION OF WORKS.
6. INTRUDER ALARM TO BE IN COMPLIANCE WITH IS EN 50131.
7. INTRUDER ALARM TO BE WIRED IN PVC CONDUIT SURFACE MOUNTED.

REV	DATE	DESCRIPTION	ENG	APP
T1	09.06.26	TENDER ISSUE	TM	RC

Client.
MILFORD & DISTRICT RESOURCE CENTRE

Architect.
DEDALUS ARCHITECTURE

Project.
REFURBISHMENT OF THE GALLOWGLASS COMMUNITY CENTRE, MILFORD

Service.
ELECTRICAL

Drawing Status.
TENDER

DMAC
Consulting Engineers Ltd
Glenturas House
18 Beraghmore Road, Derry
BT48 8SE
t: (028) 7127 7846
e: info@dmac-ce.com
w: www.dmac-ce.com

Title:
PROPOSED GROUND & FIRST FLOOR FIRE ALARM INSTALLATION

Scale(s):	1:50@A1	Date:	SEPT 2025
Eng / CAD.	TM	Checked.	RC

Project	Origin	Zone	Level	Type	Number	Rev.
2361-DMAC-XX-00-PL-E301						T1