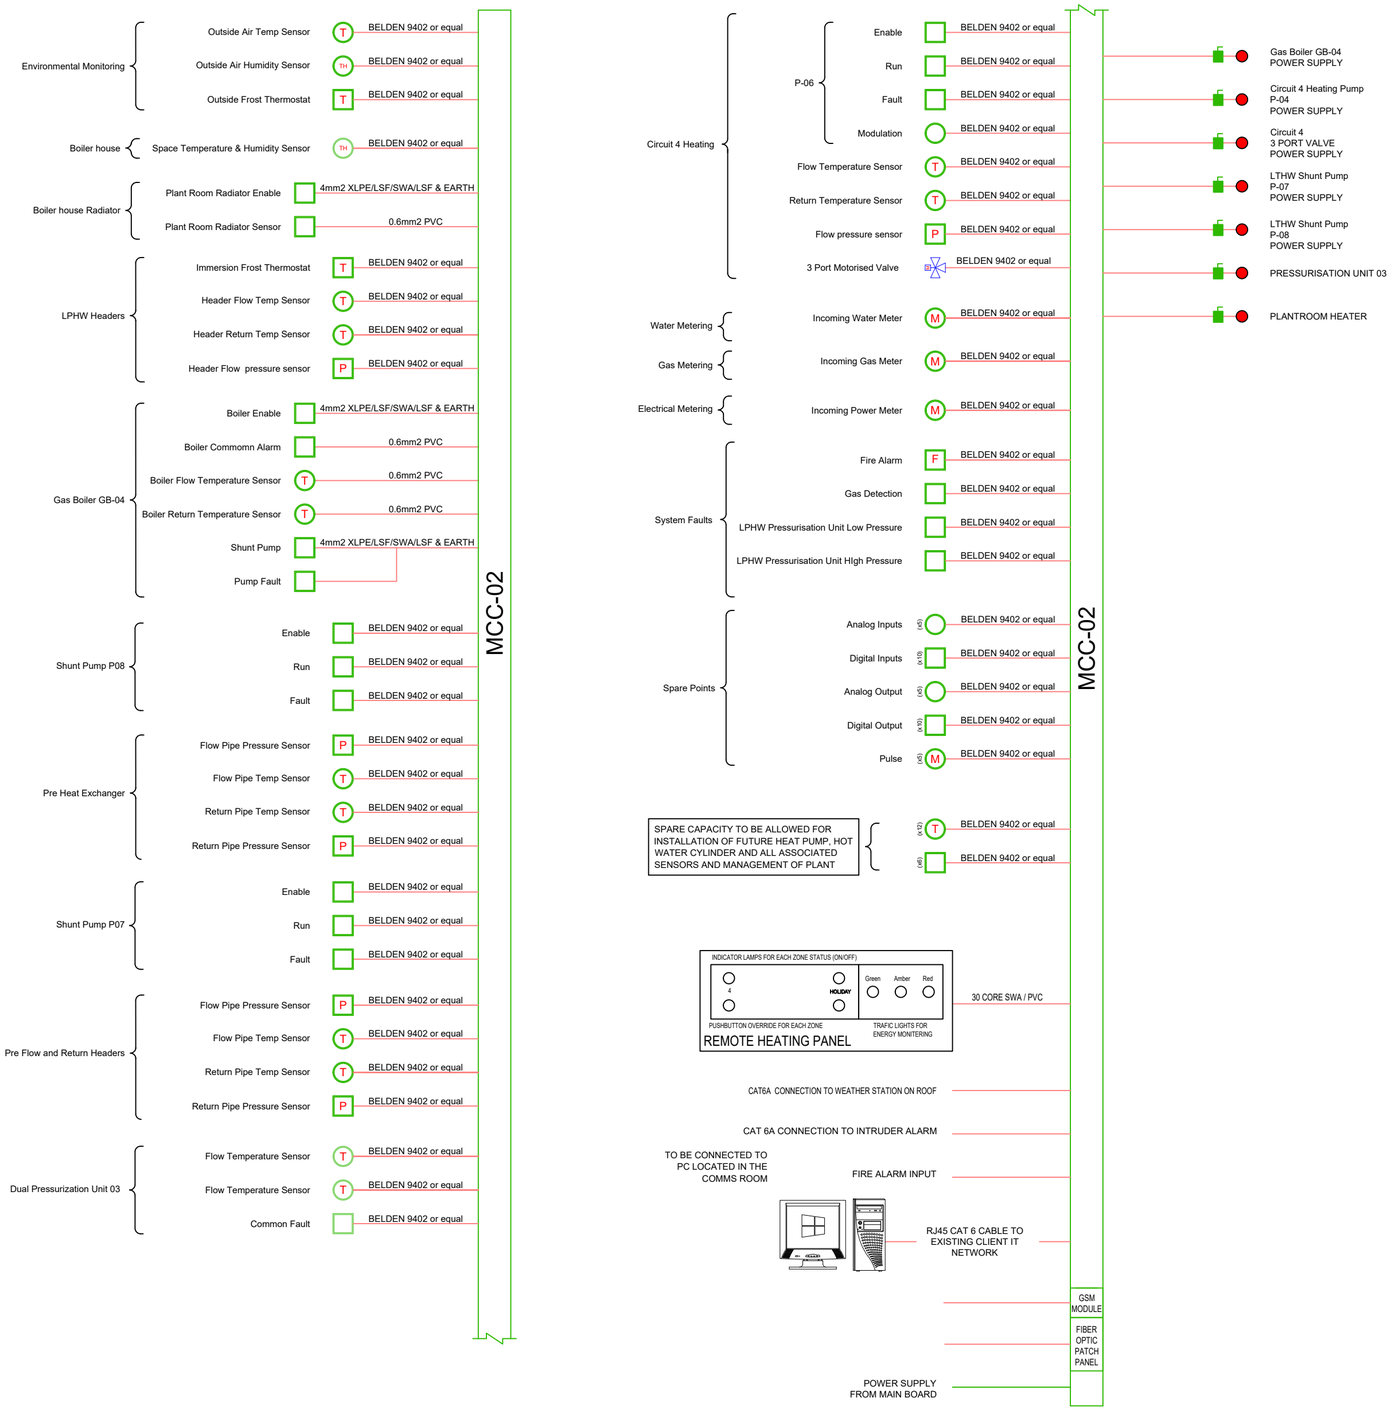


HEATING CENTRE 2

NOTES

1. UNDER NO CIRCUMSTANCES IS THE CONTRACTOR TO ORDER ANY MATERIALS FOR THE MECHANICAL SERVICES INSTALLATION BEFORE AGREEING QUANTITY AND MANUFACTURE WITH THE CONSULTING ENGINEER.
2. CONTRACTOR TO AGREE FINAL LOCATIONS OF ALL ITEMS IN THE MECHANICAL SERVICES INSTALLATION WITH THE CONSULTING ENGINEER BEFORE INSTALLING SAME.
3. DRAWING TO BE READ IN CONJUNCTION WITH OTHER SERVICE DRAWINGS AND MECHANICAL SPECIFICATION.
4. ALL CABLES TO BE LSF TYPE.
5. ALL POWER AND CONTROL CABLES TO BE SUPPLIED AND INSTALLED BY ELECTRICAL CONTRACTOR.

LEGEND

- DIGITAL SIGNAL
- ANALOG SIGNAL
- TEMPERATURE SENSOR
- THERMOSTAT
- HUMIDITY SENSOR
- METER
- FIRE ALARM
- FLOW PRESSURE SENSOR

CONTRACTOR TO COMPLY WITH AND INSTALL TO THE NEW NATIONAL RULES AND REGULATIONS FOR ELECTRICAL INSTALLATIONS I.S. 10101:2020+AC1:2020

Issue	REVISION	DATE	BY	CKD.
T1	ISSUED FOR TENDER	30.10.26	POB	JG

Figured dimensions only should be taken from this drawing. All contractors must visit the site and be responsible for taking and checking all dimensions that relate to this work

Matt O'Mahony & Associates
Engineering and Project Consultants.
8 Sidney Place, Wellington Rd., Cork
TEL: (021) 4506364 FAX: (021) 4509796
EMAIL: email@mattomahony.ie

Job: MIDLETON CBS BOYS NS, MIDLETON, CO. CORK

Client: BOARD OF MANAGEMENT

Drawing: MECHANICAL SERVICES CONTROLS SCHEMATIC 2

Job No.	Scale	Cad ref.
E26/2879	NTS@A2	2879_Midleton_CSB.dwg
Drg. No. M5		Date JUNE 2026
Drawn PAUL O'BRIEN		
Checked JOHN GEANEY		