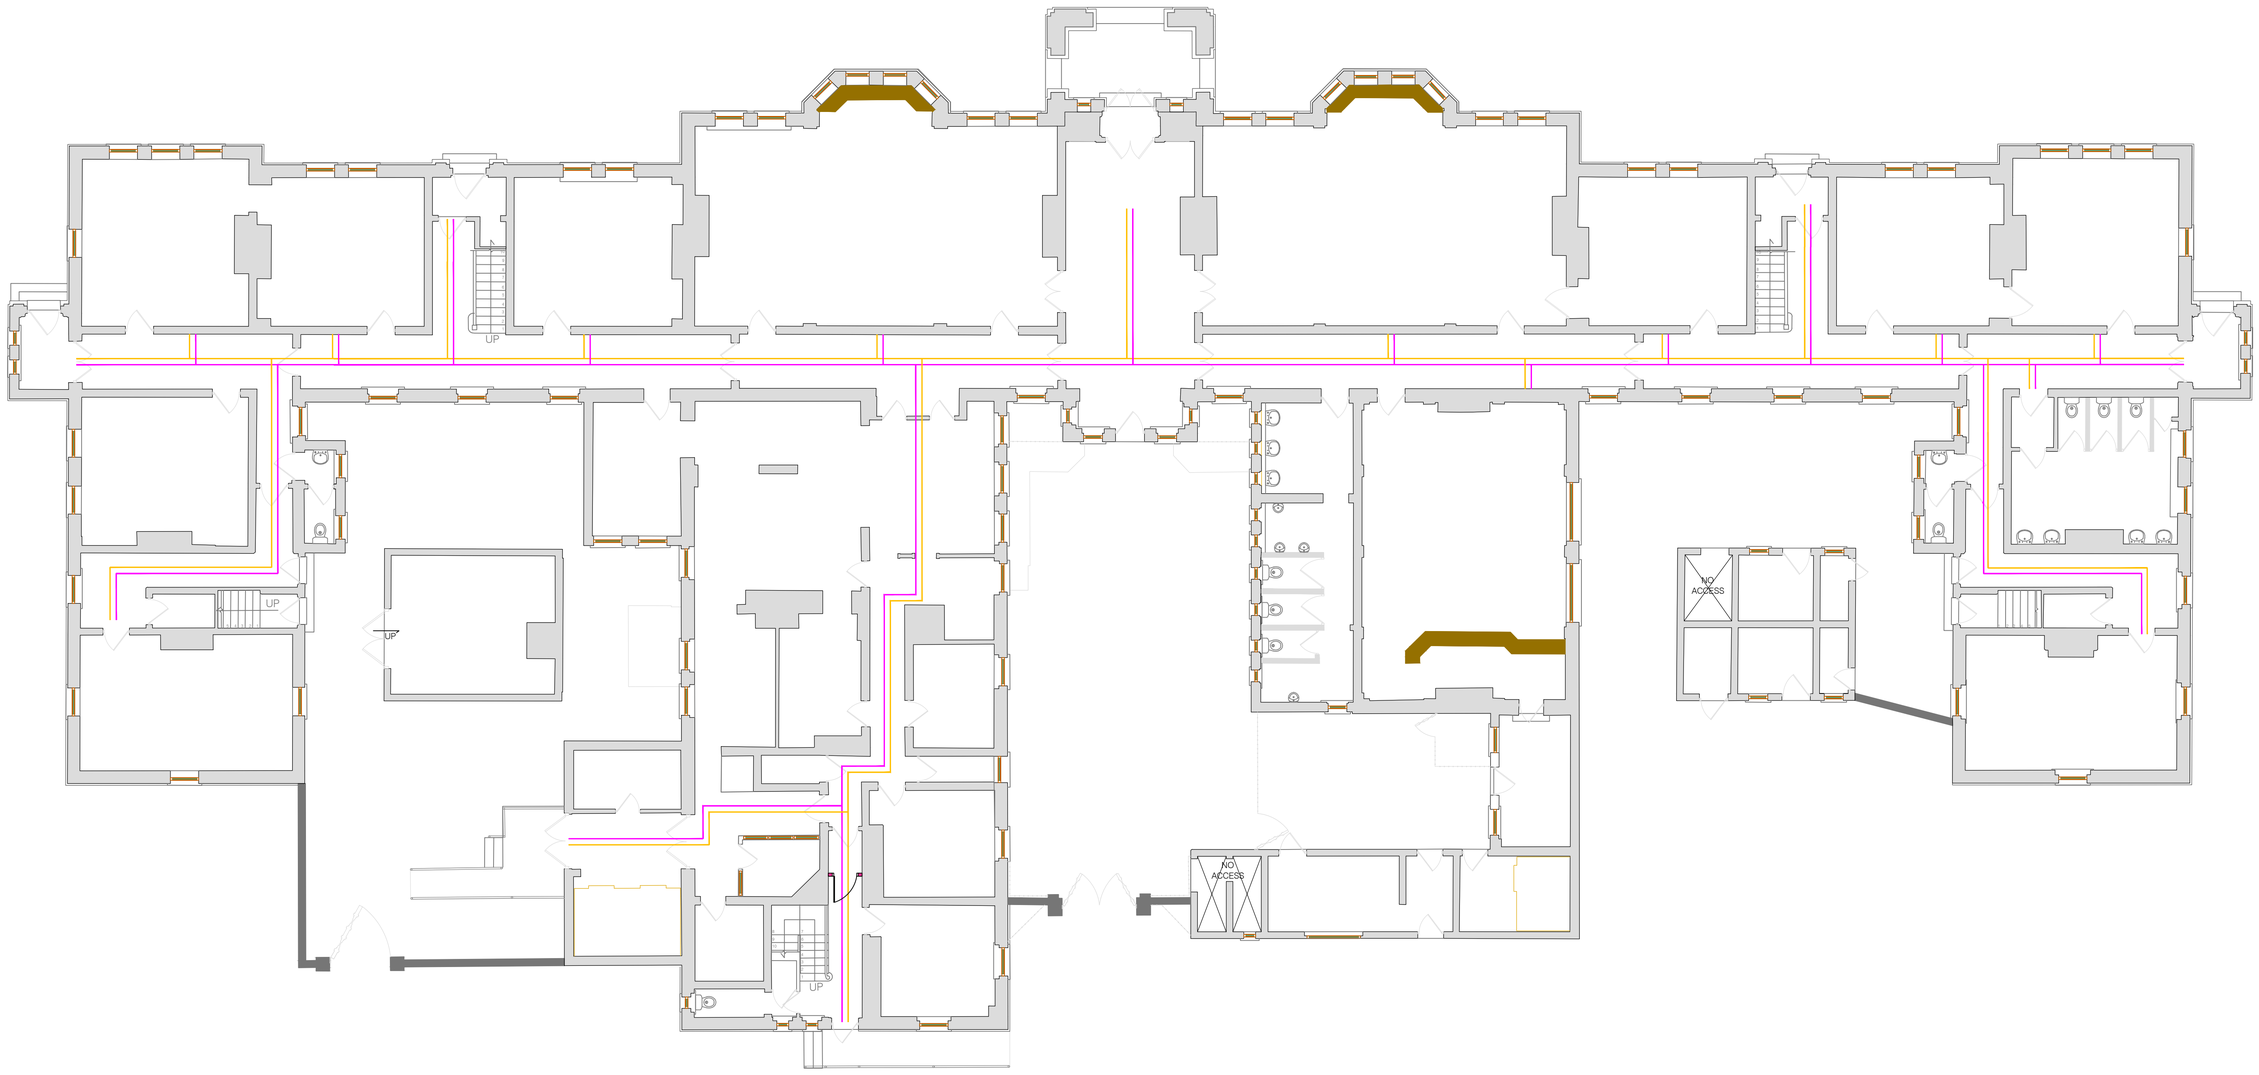


Ceiling mounted tray for EL

Ceiling mounted tray for FDAS

Note: New fittings to be installed omitted for clarity. See ground floor series drawings 1002, 6000, 6001 & 6002 for details and location of new fittings to be installed. Location of new fittings to be installed to suit installation of new tray. New tray to suit existing site conditions. All necessary grounds to be provide and all surfaces to be made good prior to installation of new cable tray. Clarity with ER is to be sought should any issues arise owing to a high volume of fittings etc in one area. A site visit shall be undertaken to determine the most suitable route and location for the cable tray. All final routes and locations shall be verified on site prior to installation to ensure coordination with existing services and site conditions.

Revisions

Date:	Description:	Drawn by:
September '26	Initial draft for review	ND

Project: Proposed fire safety upgrades to Pearse Officer's Mess

Location: Pearse Officer's Mess - DFTC East

Drawing: Proposed ground floor containment systems

Drawing Number:	Scale:
DFTC - 28 - 26A - 5000	1:100 A1
Surveyed By:	Drawn By: Niall Darby
Date: October '26	Checked By: Comdt Shane Phelan