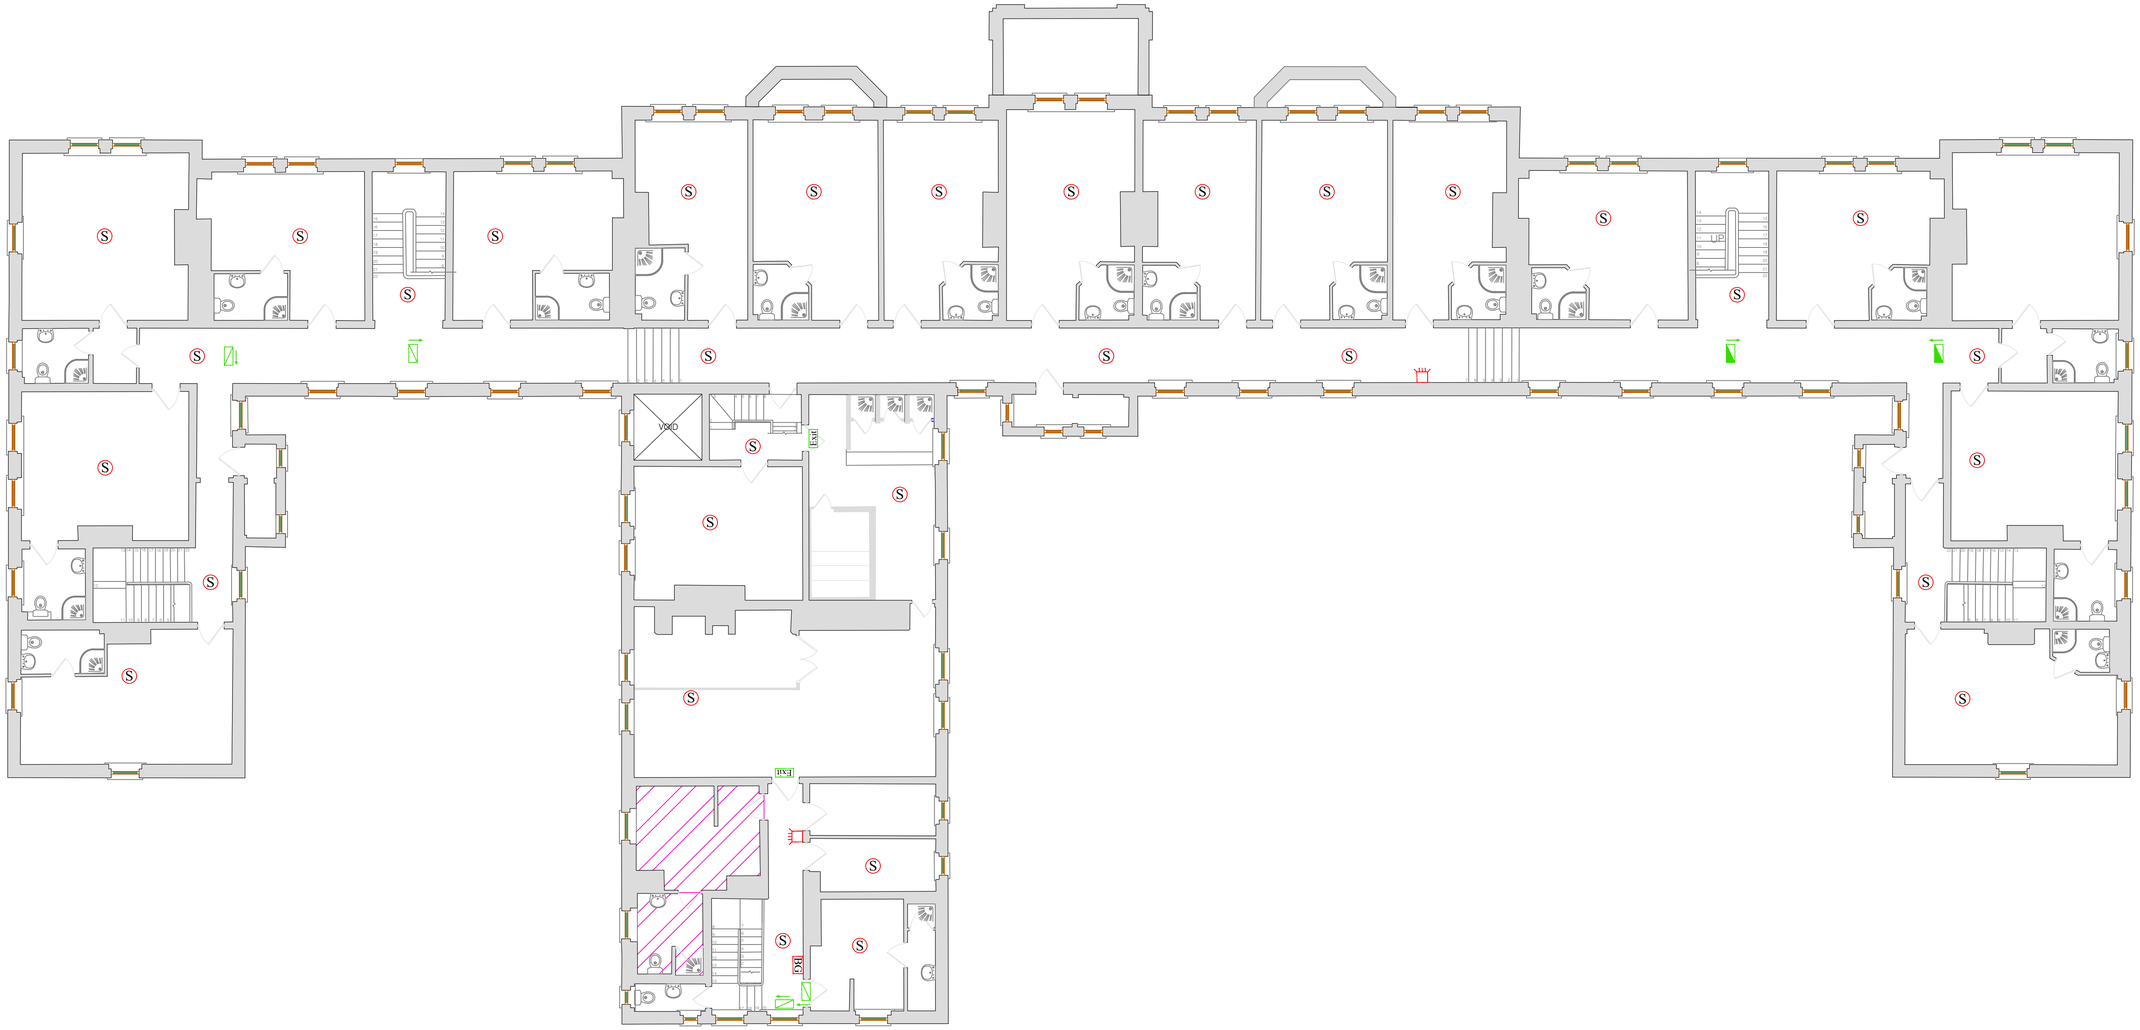


No access on day of survey. Contractor to assume 2nr smoke heads in each room and an emergency light at each door.

Emergency exit signage & direction of travel.

BG — Break glass unit.

Exit — Emergency exit sign.

FAP — Existing fire alarm panel.

Sounder (Internal).

S — Smoke detector.

DR — Emergency door release.

Note: Contractor to carefully remove and dispose of all existing FF FDAS and associated components. Any surfaces damaged due to removal of existing system are to be repaired prior to installation of new system. All new necessary grounds are to be installed where necessary to allow for installation of new system / fittings. Exact extent of existing FDAS on ground floor to be assessed on site by contractor. Please note some rooms were unaccessible on the day of the survey.

Revisions

Date	Description	Drawn by:
September '26	Initial draft for review	ND

Project: Proposed fire safety upgrades to Pearse Officer's Mess

Location: Pearse Officers Mess - DFTC East

Drawing: Existing FF FDAS - Pearse OM

Drawing Number:	Scale:
DFTC - 28 - 26A - 6004	1:100 A1
Surveyed By:	Drawn By: Niall Darby
Date: October '26	Checked By: Comdt Shane Phelan