No part of this document may be re-produced or transmitted in any form or stored in any retrieval system of any nature without the written permission from Douglas Carroll Consulting Engineers as copyright holder except as agreed for use on the project for which the document was originally issued. © Douglas Carroll Consulting Engineers Copyright.

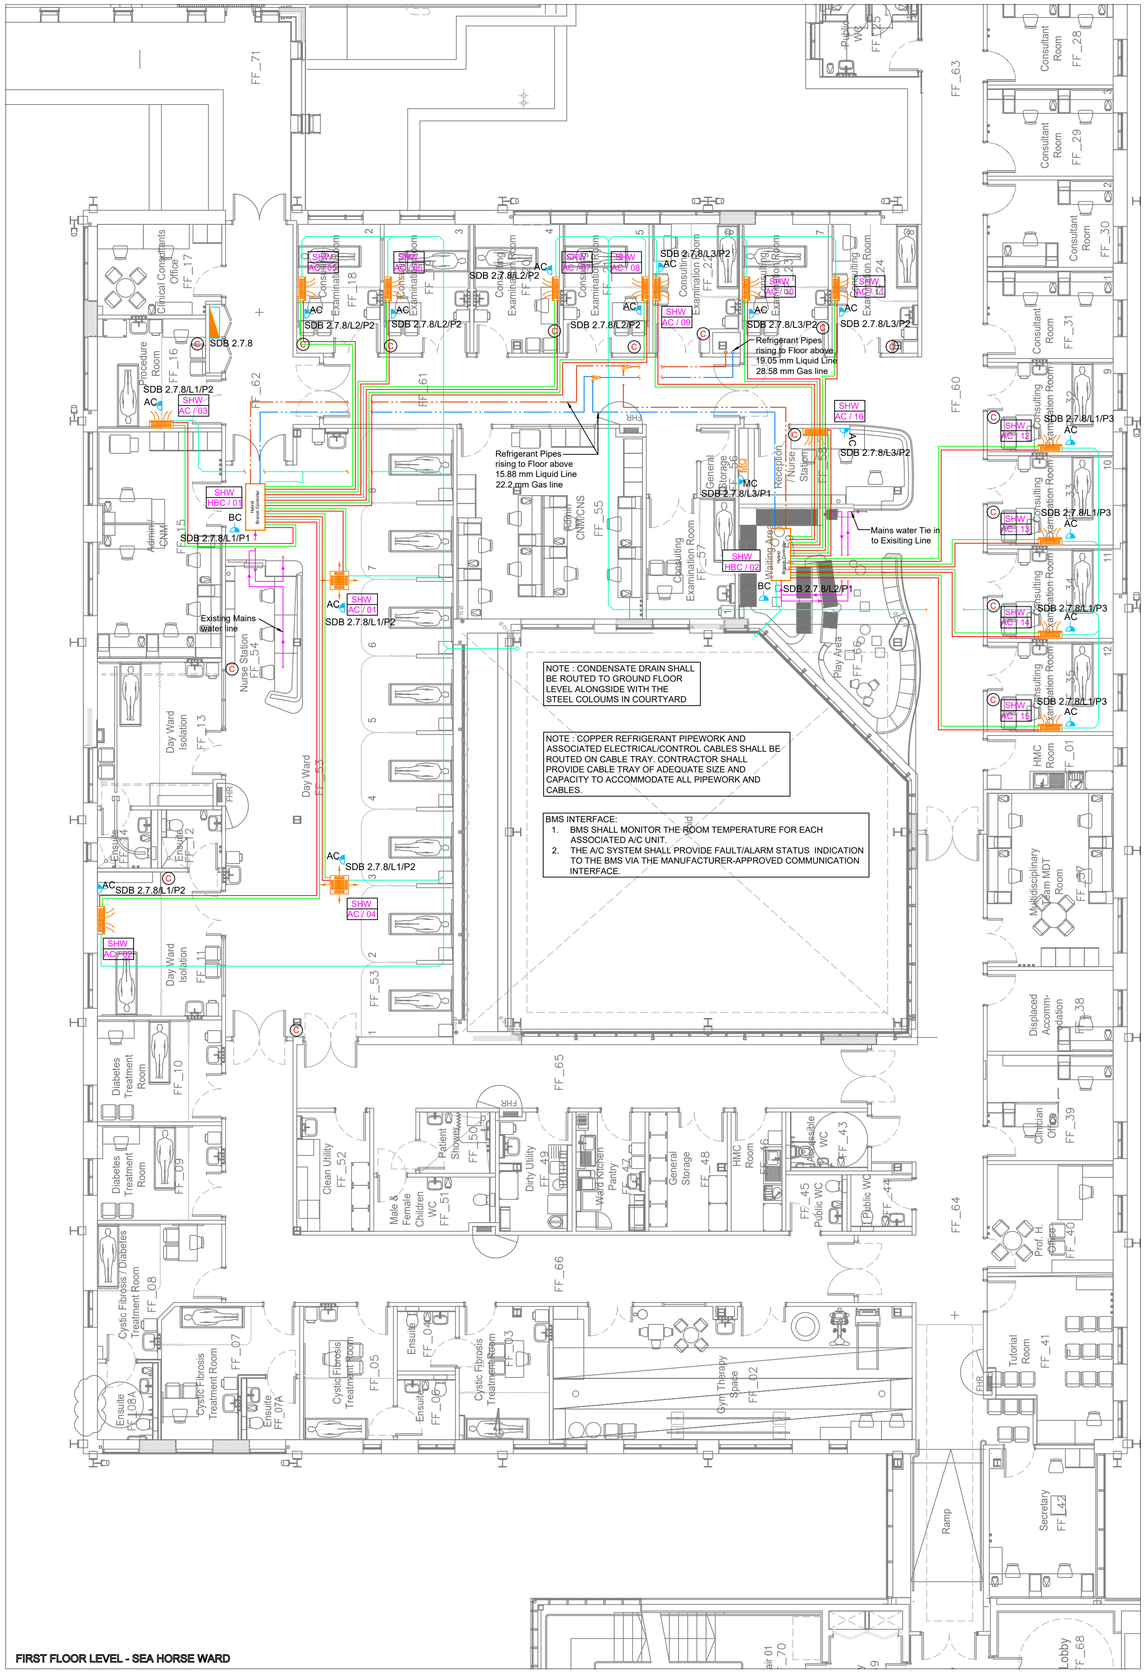

FIRST FLOOR LEVEL - SEA HORSE WARD

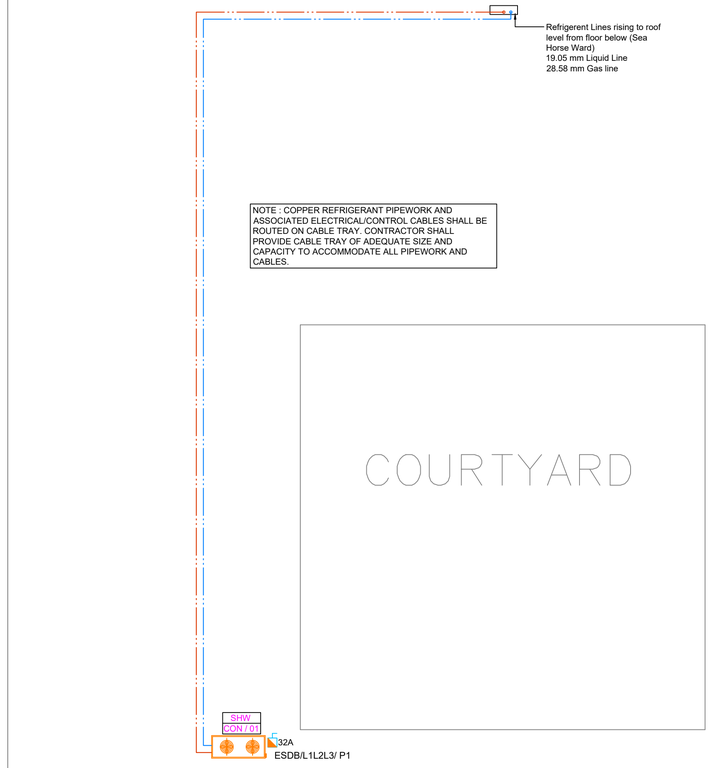

ROOF LEVEL - PEADS Building

LEGENDS

- Gas Refrigerant Line
- Liquid Refrigerant Line
- Chilled Water Supply (20mm Ø)
- Chilled Water Return (20mm Ø)
- Pipe Continuation
- Pipe Rise Drop
- Mains Water Supply (15mm Ø)
- Condensate Drain Line
- 4 Way Cassette Indoor Unit
- Hi Wall Type Indoor Unit
- (C) Wall Mounted Room Controller
- MC — Master Controller 306mm x 71.8mm x 211mm
- XX / AC / 12 — Indoor Unit Tag; Sea Horse Ward - SHW; Orchids Ward - OW
- XX / CON / 01 — Outdoor Unit Tag; Sea Horse Ward - SHW; Orchids Ward - OW
- XX / HBC / 01 — Hybrid Branch Controller Tag; Sea Horse Ward - SHW; Orchids Ward - OW
- Sub Distribution Board
- Switched Spur Outlet cabled in 3 core 4mm²
- 3 Phase Isolator cabled in 5 core XLPE/SWA 6mm²
- AC — Power supply to Indoor Air Conditioning Unit
- BC — Power supply to Branch Controller
- MC — Power supply to Master Controller

GENERAL NOTES

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS, DETAILS, SCHEMATICS DOCUMENTATION AND APPENDICES.
2. CONTRACTOR SHALL CONFIRM THAT THEY HAVE CHECKED AND COORDINATED ALL EQUIPMENT DIMENSIONS INTO THEIR INSTALLATION DRAWINGS PRIOR TO PLACING OF ORDER.
3. TEMPERATURE CONTROLLER SHALL BE INSTALLED TO CONTROL +/- 3 DEGREES AROUND SETPOINT DEFINED ON BMS.
4. ALL HVRF EQUIPMENT AND PIPEWORK SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS AND PROJECT SPECIFICATION.
5. REFRIGERANT PIPEWORK SHALL BE HARD DRAWN COPPER, SIZED IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS.
6. REFRIGERANT PIPE INSULATION SHALL BE PROVIDED WITH ALUMINIUM CLADDING/FOIL FINISH.
7. REFRIGERANT PIPEWORK SHALL BE ROUTED ON CABLE TRAYS. PROVIDE COVERED CABLE TRAYS WHERE PIPEWORK IS EXPOSED.
8. PROVIDE VALVE ARRANGEMENT AS SHOWN ON THE TYPICAL DETAIL.
9. PROVIDE AUTOMATIC AIR VENTS AT ALL HIGH POINTS OF WATER PIPEWORK.
10. ALL WATER-SIDE PIPEWORK SHALL BE FLUSHED, CLEANED, PRESSURE TESTED AND COMMISSIONED PRIOR TO HANDOVER
11. PROVIDE DRAIN PUMPS FOR ALL HI-WALL INDOOR UNITS. CASSETTE UNITS SHALL BE PROVIDED WITH INTEGRAL DRAIN PUMPS.
12. ALL CONDENSATE DRAIN PIPEWORK SHALL BE PROVIDED WITH DRY TRAPS.
13. CONDENSATE DRAIN PIPEWORK SHALL BE uPVC AND INSULATED WITH 9MM THICK TUBULAR INSULATION.
14. OUTDOOR UNITS SHALL BE INSTALLED ON SUITABLE STRUCTURAL SUPPORTS/BASES WITH ADEQUATE SERVICE AND AIRFLOW CLEARANCES.
15. FIRESTOP ALL PIPEWORK AND CABLE PENETRATIONS THROUGH FIRE-RATED WALLS AND FLOORS USING APPROVED FIRESTOPPING SYSTEMS.

10 9 8 7 6 5 4 3 2 1 0 5 10
Scale in metres

Revision	Date	No.	Checked
-	-	-	-

Douglas Carroll CONSULTING ENGINEERS
Office 7, 3rd Floor, Station House, Railway Square, Waterford, IE. X91 XKBY
Tel: 051-306670 Web:www.dceng.ie E-mail: info@dceng.ie
Douglas Carroll Consulting Engineers Ltd trading as Douglas Carroll Consulting Engineers

Project: Air Conditioning Installation Seahorse and Orchid Wards at CUH	Client: Health Services Executive South
Drawing Discipline: Mechanical Services Installation	
Drawing Title: Seahorse Wards Air Conditioning Layout	

Scale	Drawing Size	Drawing by	Checked by	Date
Refer to Scaleber (1:100 at A1)	A1	RK	DA	05-10-2026

Document Number	Suitability	Revision	DC REF	Stage
Project - Zone-System-Level - Type - Originator - Role - Number: 26048-XX-57-L01-DR-DCCE-EM-12001	-	-	W26-048	Tender