No part of this document may be re-produced or transmitted in any form or stored in any retrieval system of any nature without the written permission from Douglas Carroll Consulting Engineers as copyright holder except as agreed for use on the project for which the document was originally issued. © Douglas Carroll Consulting Engineers Copyright.

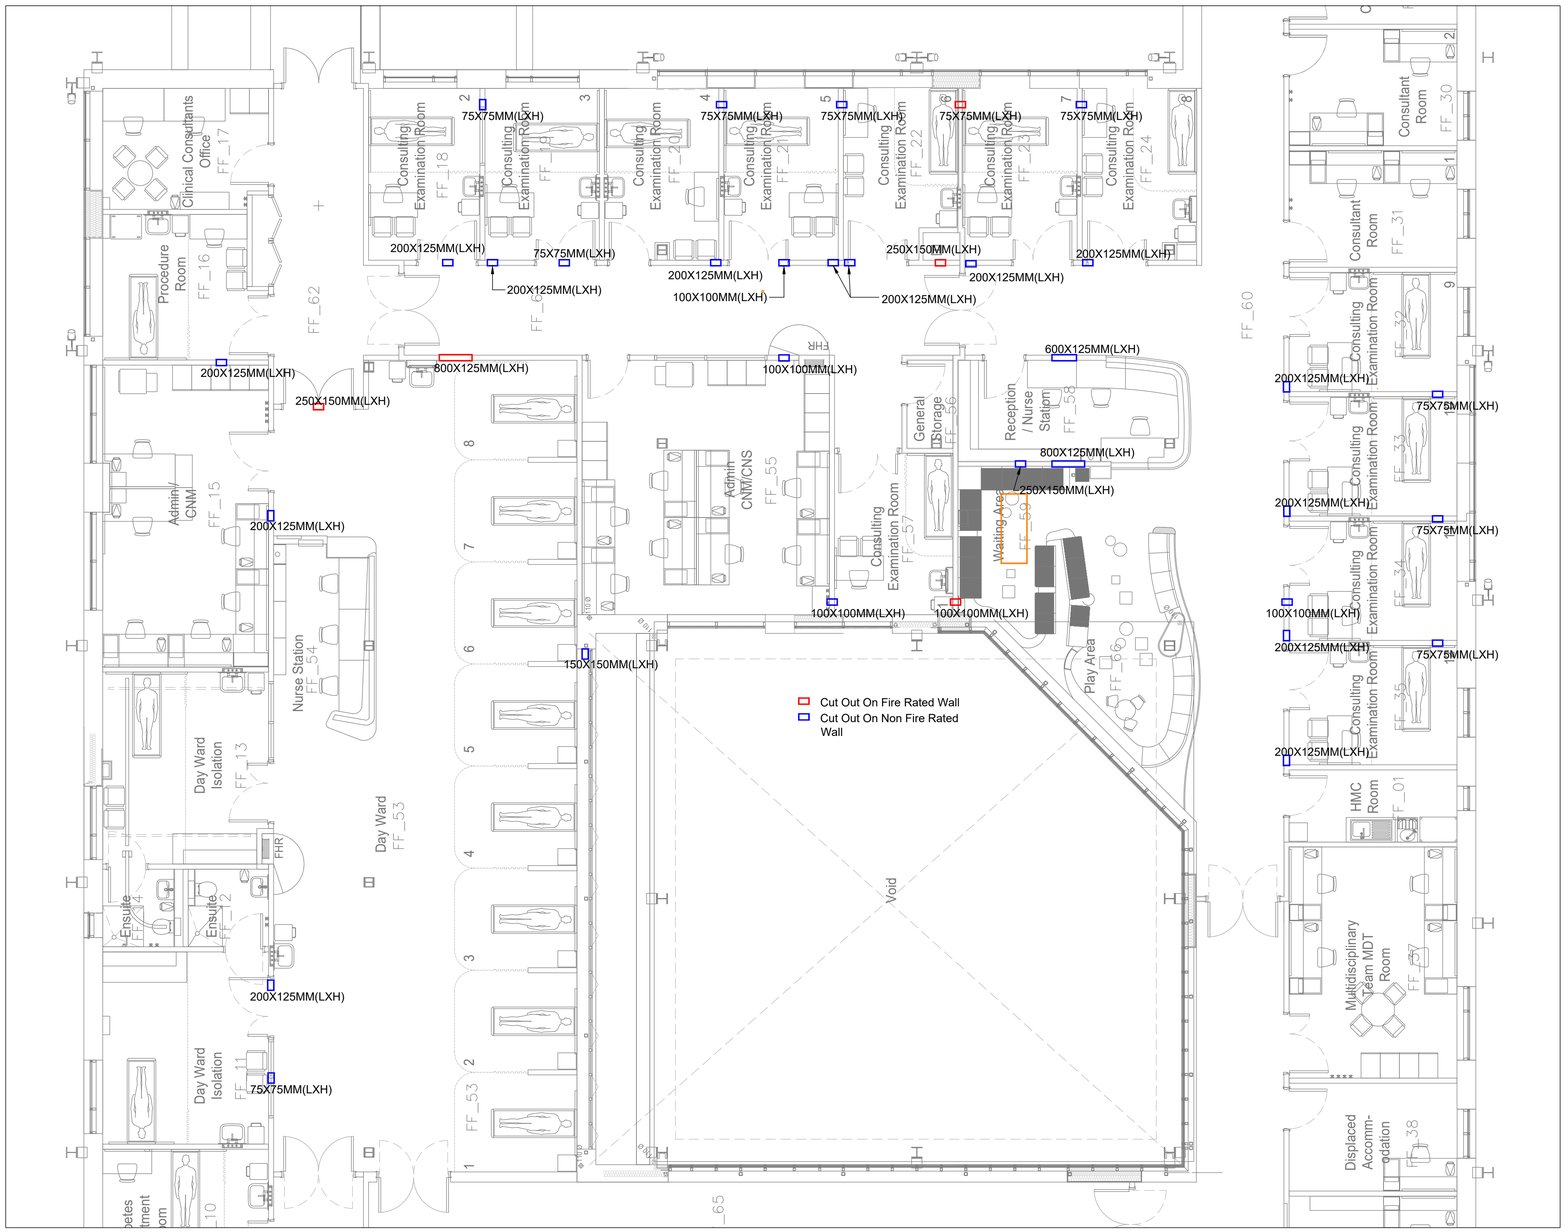

FIRST FLOOR LEVEL - SEA HORSE WARD

ALL PENETRATIONS THROUGH FIRE-RATED WALLS/FLOORS SHALL BE PROPERLY SEALED AND ENCLOSED USING AN APPROVED FIRE-RATED SYSTEM SUITABLE FOR THE WALL/FLOOR FIRE RATING. ALL FIRESTOPPING WORKS SHALL BE CARRIED OUT BY A COMPETENT SPECIALIST CONTRACTOR AND INSPECTED, CERTIFIED AND SIGNED OFF BY THE FIRESTOPPING SPECIALIST UPON COMPLETION.

Revision	Date	No.	Checked
-	-	-	-

Douglas Carroll
CONSULTING ENGINEERS
Office 7, 3rd Floor, Station House, Railway Square, Waterford, IE. X91 XK8Y
Tel: 051-306670 Web:www.dceng.ie E-mail: info@dceng.ie
Douglas Carroll Consulting Engineers Ltd trading as Douglas Carroll Consulting Engineers

Project: Air Conditioning Installation Seahorse and Orchid Wards at CUH	Client: Health Services Executive South
Drawing Discipline: Mechanical Services Installation	
Drawing Title: Seahorse Ward Builders Work Layout	

Scale	Drawing Size	Drawing by	Checked by	Date
Refer to Scaleber (1:100 at A1)	A1	RK	DA	15-09-2026

Document Number: Project - Zone-System-Level - Type - Originator - Role - Number	Suitability	Revision	DC REF	Stage
26048-XX-59-L01-DR-DCCE-EM-18001	-	-	W26-048	Tender