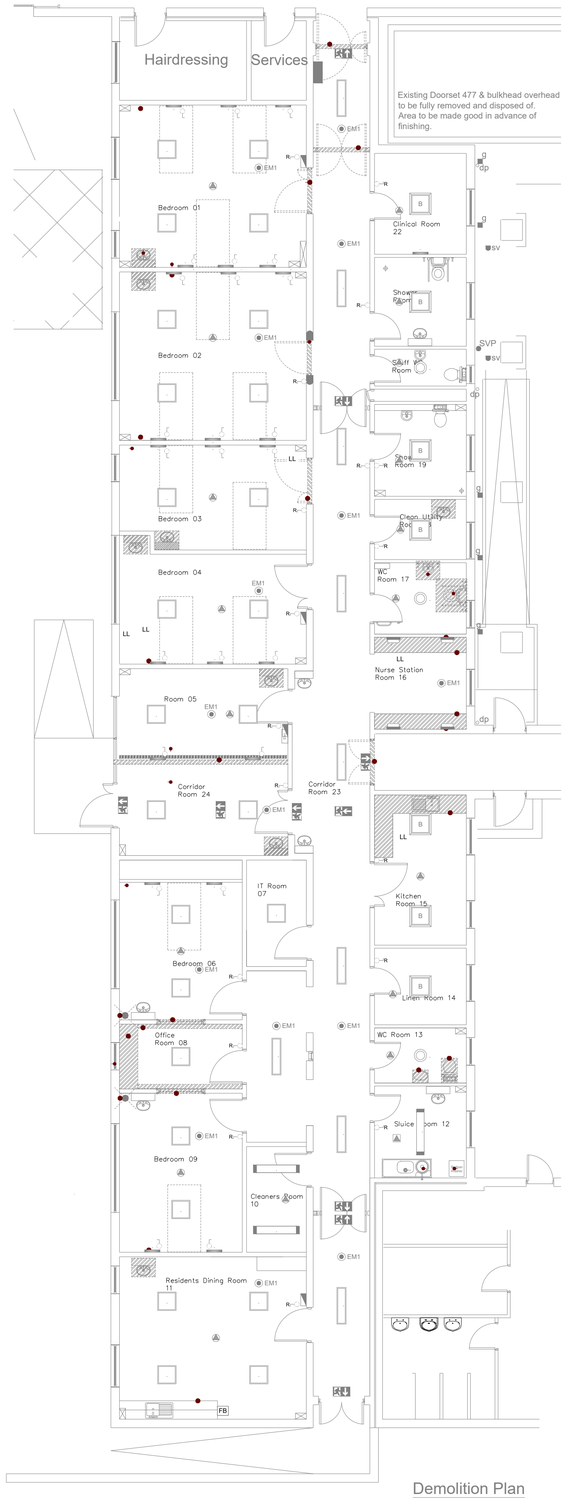

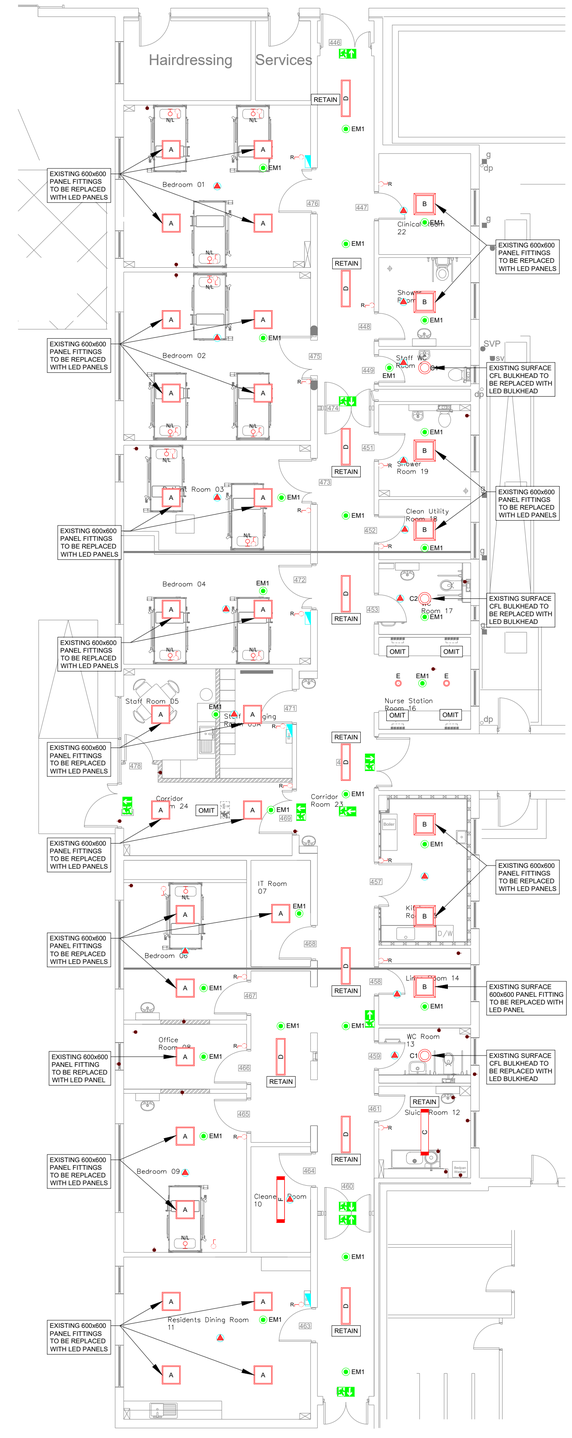

NOTES

1. DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS.
2. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MAIN CONTRACTOR TO CO-ORDINATE ALL SERVICES.
3. THE CONTRACTOR SHALL PROVIDE SAMPLES OF ALL LUMINAIRES TO THE ARCHITECT/ENGINEER FOR APPROVAL PRIOR TO ORDERING.
4. THE LIGHTING INSTALLATION IS NOT TO BE USED FOR WORKING ILLUMINANCE DURING THE CONSTRUCTION PERIOD.
5. PROTECTIVE COVERINGS TO REMAIN ON ALL LUMINAIRES UNTIL IMMEDIATELY PRIOR TO HAND OVER.
6. EXACT LOCATIONS OF ALL ITEMS TO BE AGREED ON SITE WITH THE ARCHITECT/ENGINEER PRIOR TO INSTALLATION OF CABLING.
7. THE INSTALLATION MUST COMPLY WITH ALL THE RELEVANT CODES BOTH GOVERNMENT & LOCAL.
8. LUMINAIRES SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS. ONLY DEDICATED FIXING POINTS INDICATED ON THE LUMINAIRES SHALL BE USED.
9. INDIVIDUAL SUB CIRCUIT MONITORING SHALL BE PROVIDED AT ALL DISTRIBUTION CENTERS (DC'S) TO ENSURE THE EMERGENCY LIGHTING SYSTEM IS ACTIVATED UPON GENERAL LIGHTING CIRCUIT FAILURE.
10. COORDINATE CONDUIT WITH CONSTRUCTION PROGRAM.
11. THE CONTRACTOR IS TO PRICE FOR ALL ACCESSORIES TO BE PROVIDED TO COMPLETE THE CONSTRUCTION OF ALL LIGHT FITTINGS.
12. ELECTRICAL INSTALLATION TO COMPLY WITH
    - IS 10101
    - EN 12464-1
    - SLL LIGHTING GUIDE, LIGHTING GUIDE 2
    - SLL LIGHTING GUIDE, LIGHTING GUIDE 5 WHERE APPLICABLE

LEGEND

- A — TEGRAL COM LITE HIGH EFFICIENCY 3cct LOW UGR 600x600 LED PANEL, 19W LED, 4000k, 3075lm, 162.8lm/W, IP44, UGR<19. CHL20LGMC
- B — TEGRAL COM LITE HIGH EFFICIENCY 3cct LOW UGR 600x600 LED PANEL, 19W LED, 4000k, 3075lm, 162.8lm/W, IP44, UGR<19. CHL20LGMC. COMPLETE WITH SURFACE MOUNT CEILING KIT.
- C1 — SURFACE MOUNTED ROUND BULKHEAD, 18W LED, 4000k, 1985lm, 110lm/W, IP54, UGR<19.
- C2 — SURFACE MOUNTED ROUND BULKHEAD, 29W LED, 4000k, 3250lm, 110lm/W, IP54, UGR<19.
- C — EXISTING SURFACE MOUNTED MOISTURE PROOF LUMINAIRE TO BE REFURBISHED AND RETAINED
- D — EXISTING RECESSED 1200 x 300 LUMINAIRE TO BE REFURBISHED AND RETAINED
- E — TEGRAL COM LITE DOWNLIGHT: CLC MODEL, 12.3W LED, 4000k, 1679lm, 136.1lm/W, IP54, UGR<19. CLC12MC
- F — SURFACE MOUNTED LINEAR LUMINAIRE, 23.5W LED, 4000k, 2900lm, 123lm/W, IP44
- N/L — DADO MOUNTED LED BEDHEAD LIGHT, 120LUMENS, 2700K.
- R — RETRACTABLE SWITCH
- LIGHT SWITCH
- PRESENCE SENSOR
- NEW EXIT SIGN
- EM1 — NEW EMERGENCY LIGHT
- EXISTING RECESSED 600x600 LIGHT PANEL TO BE REPLACED
- EXISTING SURFACE 600x600 LIGHT PANEL TO BE REPLACED
- EXISTING ROUND CFL BULKHEAD TO BE REPLACED
- EXISTING DECORATIVE WALL MOUNTED LUMINAIRE TO BE REMOVED
- EXISTING BEDHEAD LIGHT FITTING TO BE REPLACED
- NEW EXIT SIGN
- NEW EMERGENCY LIGHT

EXISTING LIGHTING & EM LIGHTING SERVICES - WILLOW UNIT
SCALE 1 : 100

PROPOSED LIGHTING & EM LIGHTING SERVICES - WILLOW UNIT
SCALE 1 : 100

Rev	Date	Description	Drawn	Ckd
T1	20-11-26	ISSUED FOR TENDER	MH	PC

Drawing Status: **TENDER ISSUE**

92 O'Connell Street, Limerick
Ireland
Tel : +353 (0)61318677
Email: services@domalley.com
Web: www.domalley.com

Approved:	Checked:	Drawn:	Date:
PC	PC	MH	2026/11/12

Architect: Hassett Leyden

Client: Feidhmeannacht na Seirbhíse Sláinte — Health Service Executive

Project: HSE Willow Unit, St. Josephs Ennis

Title: Electrical Installation — Willow Unit - Ground Floor — Lighting & EM Lighting Services

Scale:	Job Number:	Status:
1:100 @ A1	7366	

Drawing Number: **E200**

Client Drawing Number: -

COPYRIGHT ©
No part of this document may be re-produced or transmitted in any form or stored in any retrieval system of any nature without the written permission of the Consultant as copyright holder except as agreed for use on the project for which the document was originally written.